



Mechatronics

ELECTRONIC CONTROL SYSTEMS IN
MECHANICAL AND ELECTRICAL ENGINEERING

3rd EDITION

PEARSON
Prentice
Hall

W. BOLTON

Pearson Education Limited

Edinburgh Gate
Harlow
Essex CM20 2JE
England

and Associated Companies throughout the world

Visit us on the World Wide Web at:
www.pearsoned.co.uk

First published 1995
Second edition 1999
Third edition 2003

© Pearson Education Limited 1995, 2003

The right of William Bolton to be identified as author of this work has been asserted by him in accordance with the Copyright, Designs and Patents Act 1988.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording or otherwise, without either the prior written permission of the publisher or a licence permitting restricted copying in the United Kingdom issued by the Copyright Licensing Agency Ltd, 90 Tottenham Court Road, London W1T 4LP.

All trademarks used herein are the property of their respective owners. The use of any trademark in this text does not vest in the author or publisher any trademark ownership rights in such trademarks, nor does the use of such trademarks imply any affiliation with or endorsement of this book by such owners.

ISBN 0 131 21633 3

British Library Cataloguing-in-Publication Data

A catalogue record for this book is available from the British Library

Library of Congress Cataloging-in-Publication Data

A catalog record for this book is available from the Library of Congress

10 9 8 7 6 5 4 3

08 07 06 05 04

Printed by Ashford Colour Press Ltd, Gosport

Contents

	Preface	xi
1	Mechatronics	
	1.1 What is mechatronics?	1
	1.2 Systems	2
	1.3 Measurement systems	2
	1.4 Control systems	3
	1.5 Microprocessor-based controllers	11
	1.6 Response of systems	14
	1.7 The mechatronics approach	15
	Problems	16
2	Sensors and transducers	
	2.1 Sensors and transducers	17
	2.2 Performance terminology	17
	2.3 Displacement, position and proximity	22
	2.4 Velocity and motion	33
	2.5 Force	36
	2.6 Fluid pressure	37
	2.7 Liquid flow	40
	2.8 Liquid level	41
	2.9 Temperature	42
	2.10 Light sensors	47
	2.11 Selection of sensors	48
	2.12 Inputting data by switches	49
	Problems	51
3	Signal conditioning	
	3.1 Signal conditioning	54
	3.2 The operational amplifier	56
	3.3 Protection	65
	3.4 Filtering	66
	3.5 Wheatstone bridge	67
	3.6 Digital signals	72
	3.7 Multiplexers	83
	3.8 Data acquisition	85
	3.9 Digital signal processing	87
	3.10 Pulse modulation	88
	Problems	90

4	Data presentation systems	4.1	Displays	92
		4.2	Data presentation elements	94
		4.3	Magnetic recording	101
		4.4	Displays	104
		4.5	Data acquisition systems	109
		4.6	Measurement systems	112
		4.7	Testing and calibration	117
			Problems	119
5	Pneumatic and hydraulic actuation systems	5.1	Actuation systems	122
		5.2	Pneumatic and hydraulic systems	122
		5.3	Directional control valves	124
		5.4	Pressure control valves	127
		5.5	Cylinders	128
		5.6	Process control valves	132
		5.7	Rotary actuators	138
			Problems	139
6	Mechanical actuation systems	6.1	Mechanical systems	141
		6.2	Types of motion	142
		6.3	Kinematic chains	144
		6.4	Cams	147
		6.5	Gear trains	148
		6.6	Ratchet and pawl	151
		6.7	Belt and chain drives	151
		6.8	Bearings	153
		6.9	Mechanical aspects of motor selection	157
			Problems	159
7	Electrical actuation systems	7.1	Electrical systems	161
		7.2	Mechanical switches	161
		7.3	Solid-state switches	163
		7.4	Solenoids	168
		7.5	D.C. motors	168
		7.6	A.C. motors	176
		7.7	Stepper motors	178
			Problems	184
8	Basic system models	8.1	Mathematical models	185
		8.2	Mechanical system building blocks	186
		8.3	Electrical system building blocks	192
		8.4	Fluid system building blocks	197
		8.5	Thermal system building blocks	205
			Problems	208
9	System models	9.1	Engineering systems	210
		9.2	Rotational-translational systems	213
		9.3	Electromechanical systems	213

	9.4	Hydraulic-mechanical systems	217
		Problems	220
10		Dynamic responses of systems	
	10.1	Modelling dynamic systems	222
	10.2	First-order systems	224
	10.3	Second-order systems	230
	10.4	Performance measures for second-order systems	236
	10.5	System identification	240
		Problems	240
11		System transfer functions	
	11.1	The transfer function	242
	11.2	First-order systems	245
	11.3	Second-order systems	247
	11.4	Systems in series	250
	11.5	Systems with feedback loops	250
	11.6	Effect of pole location on transient response	252
	11.7	MATLAB and SIMULINK	254
		Problems	260
12		Frequency response	
	12.1	Sinusoidal input	262
	12.2	Phasors	262
	12.3	Frequency response	265
	12.4	Bode plots	268
	12.5	Performance specifications	277
	12.6	Stability	278
		Problems	279
13		Closed-loop controllers	
	13.1	Continuous and discrete processes	280
	13.2	Control modes	282
	13.3	Two-step mode	283
	13.4	Proportional mode	284
	13.5	Derivative control	288
	13.6	Integral control	290
	13.7	PID controller	293
	13.8	Digital controllers	295
	13.9	Control system performance	297
	13.10	Controller tuning	299
	13.11	Velocity control	301
	13.12	Adaptive control	301
		Problems	305
14		Digital logic	
	14.1	Digital logic	307
	14.2	Number systems	308
	14.3	Logic gates	314
	14.4	Boolean algebra	320
	14.5	Karnaugh maps	325
	14.6	Applications of logic gates	329
	14.7	Sequential logic	335
		Problems	339

15	Microprocessors	15.1	Control	342
		15.2	Microprocessor systems	343
		15.3	Microcontrollers	356
		15.4	Applications	373
		15.5	Programming	375
			Problems	377
16	Assembly language	16.1	Languages	378
		16.2	Instruction sets	379
		16.3	Assembly language programs	386
		16.4	Subroutines	392
		16.5	Look-up tables	396
			Problems	400
17	C language	17.1	Why C?	401
		17.2	Program structure	401
		17.3	Branches and loops	409
		17.4	Arrays	412
		17.5	Pointers	413
		17.6	Program development	415
		17.7	Examples of programs	416
			Problems	419
18	Input/output systems	18.1	Interfacing	421
		18.2	Input/output addressing	421
		18.3	Interface requirements	424
		18.4	Peripheral interface adapters	432
		18.5	Serial communications interface	437
		18.6	Examples of interfacing	440
			Problems	443
19	Programmable logic controllers	19.1	Programmable logic controllers	444
		19.2	Basic structure	445
		19.3	Input/output processing	448
		19.4	Programming	449
		19.5	Mnemonics	454
		19.6	Timers, internal relays and counters	455
		19.7	Shift registers	460
		19.8	Master and jump controls	461
		19.9	Data handling	462
		19.10	Analogue input/output	465
		19.11	Selection of a PLC	466
			Problems	466
20	Communication systems	20.1	Digital communications	468
		20.2	Centralised, hierarchical and distributed control	468
		20.3	Networks	471
		20.4	Protocols	473

	20.5	Open Systems Interconnection communication model	475
	20.6	Communication interfaces	478
		Problems	486
21	Fault finding		
	21.1	Fault-detection techniques	487
	21.2	Watchdog timer	488
	21.3	Parity and error coding checks	489
	21.4	Common hardware faults	491
	21.5	Microprocessor systems	492
	21.6	Emulation and simulation	497
	21.7	PLC systems	498
		Problems	500
22	Mechatronics systems		
	22.1	Traditional and mechatronics designs	502
	22.2	Possible mechatronics design solutions	508
	22.3	Case studies of mechatronic systems	518
		Problems and assignments	530
	Appendix A:		
	The Laplace transform		
	A.1	The Laplace transform	531
	A.2	Unit steps and impulses	532
	A.3	Standard Laplace transforms	534
	A.4	The inverse transform	538
	Appendix B:		
	Logic gates		
		AND gate	541
		OR gate	541
		NOT gate	541
		NAND gate	542
		NOR gate	542
		EXCLUSIVE-OR (XOR) gate	542
	Appendix C:		
	Instruction sets		
		M68HC11	543
		Intel 8051	545
		PIC16Cxx	546
	Appendix D:		
	C library functions		
		<ctype.h>	547
		<math.h>	547
		<stdio.h>	548
		<stdlib.h>	548
		<time.h>	548
		Further information	549
		Answers	553
		Index	567

Preface

Overview

The integration of electronic engineering, electrical engineering, computer technology and control engineering with mechanical engineering is increasingly forming a crucial part in the design, manufacture and maintenance of a wide range of engineering products and processes. A consequence of this is the need for engineers and technicians to adopt an interdisciplinary and integrated approach to engineering. The term *mechatronics* is used to describe this integrated approach. A consequence of this approach is that engineers and technicians need skills and knowledge that are not confined to a single subject area. They need to be capable of operating and communicating across a range of engineering disciplines and linking with those having more specialised skills. This book is an attempt to provide a basic background to mechatronics and provide links through to more specialised skills.

Readership

The *first edition* was designed to cover the Business and Technology Education Council (BTEC) Mechatronics A and B Units (1413G and 1414G) for higher technicians, these units being the core units of their Higher National Certificate/Diploma courses and designed to fit alongside more specialist units such as those for design, manufacture and maintenance determined by the application area of the course. The book was widely used for such courses and has also found use in undergraduate courses in both Britain and in the United States. Following feedback from lecturers in both Britain and the United States, the *second edition* was considerably extended and with its extra depth it was not only still relevant for its original readership but also suitable for undergraduate courses. The *third edition* involves refinements of some explanations, more discussion of microcontrollers and programming, increased use of models for mechatronics systems, and the grouping together of key facts in the Appendices.

Aims

The overall aim of the book is to give a comprehensive coverage of mechatronics which can be used with courses for both technicians and undergraduates in engineering, and hence, to help the reader:

- 1 Acquire a mix of skills in mechanical engineering, electronics and computing which is necessary if he/she is to be able to comprehend and design mechatronics systems.
- 2 Become capable of operating and communicating across the range of engineering disciplines necessary in mechatronics.

In the various chapters, the book aims to help the reader:

Chapter 1: Mechatronics

Appreciate what mechatronics is about.

Comprehend the various forms and elements of control systems: open-loop, closed-loop and sequential.

Recognise the need for models of systems in order to predict their behaviour.

Chapter 2: Sensors and transducers

Describe the performance of commonly used sensors.

Evaluate sensors used in the measurement of: displacement, position and proximity; velocity and motion; force; fluid pressure; liquid flow; liquid level; temperature; light.

Explain the problem of bouncing when mechanical switches are used for inputting data.

Chapter 3: Signal conditioning

Explain the requirements for signal conditioning.

Explain how operational amplifiers can be used, the requirements for protection and filtering, the principle of the Wheatstone bridge and, in particular, how it is used with strain gauges, the principles and main methods of analogue-to-digital and digital-to-analogue converters, multiplexers and data acquisition using DAQ boards.

Explain the principle of digital signal processing.

Explain the principle of pulse-modulation.

Chapter 4: Data presentation systems

Explain the problem of loading.

Describe the basic principles of use of commonly used data presentation elements: meters, analogue chart recorders, oscilloscopes, visual display units, printers.

Explain the principles of magnetic recording on floppy and hard discs.

Explain the principles of displays and, in particular, the use of LED seven-segment and dot matrix displays and the use of driver circuits.

Explain how data presentation can occur with the use of DAQ boards.
Design measurement systems.

Chapter 5: Pneumatic and hydraulic actuation systems

Interpret system drawings, and design simple systems, for sequential control systems involving valves and cylinders.
Explain the principle of process control valves, their characteristics and sizing.

Chapter 6: Mechanical actuation systems

Evaluate mechanical systems involving linkages, cams, gears, ratchet and pawl, belt and chain drives, and bearings.

Chapter 7: Electrical actuation systems

Evaluate the operational characteristics of electrical actuation systems: relays, solid-state switches (thyristors, bipolar transistors and MOSFETs, solenoid actuated systems, d.c. motors, a.c. motors and steppers).

Chapter 8: Basic system models

Devise models from basic building blocks for mechanical, electrical, fluid and thermal systems.

Chapter 9: System models

Devise models for rotational-translational, electro-mechanical and hydraulic-mechanical systems.

Chapter 10: Dynamic responses of systems

Model dynamic systems by means of differential equations.
Determine the response of first- and second-order systems to simple inputs.

Chapter 11: System transfer functions

Define the transfer function and determine the responses of systems to simple inputs by its means, using Laplace transforms.
Identify the effect of pole location on transient response.
Use MATLAB and SIMULINK to model systems.

Chapter 12: Frequency response

Analyse the frequency response of systems subject to sinusoidal inputs.
Plot and interpret Bode plots, using such plots for system identification.

Chapter 13: Closed-loop controllers

Predict the behaviour of systems with proportional, integral, derivative, proportional plus integral, proportional plus derivative and PID control.

Explain how such modes of control can be realised with operational amplifiers and digital controllers and controller settings determined.

Explain what is meant by velocity feedback and adaptive control.

Chapter 14: Digital logic

Use the binary, octal, hexadecimal and binary coded decimal number systems; explain how numbers can be signed and the two's complement method of handling negative numbers.

Explain the advantages of the Gray code.

Describe parity methods of error detection.

Recognise the symbols and Boolean representation of, write truth tables for and use in applications, the logic gates of AND, OR, NOT, NAND, NOR and XOR.

Use Boolean algebra to simplify Boolean expressions and present them in the form of sums of products or product of sums.

Use Karnaugh maps to determine the Boolean expressions to represent truth tables.

Explain the operation of decoders.

Explain how SR, JK and D flip-flops can be used in control systems.

Chapter 15: Microprocessors

Describe the basic structure of a microprocessor system.

Describe the architecture of common microprocessors and how they can be incorporated in microprocessor systems.

Describe the basic structure of microcontrollers and the architecture of commonly encountered microcontrollers and how their registers are used to carry out tasks.

Explain how programs can be developed using flow charts or pseudocode.

Chapter 16: Assembly language

Use assembly language to write programs.

Chapter 17: C language

Use C to write programs.

Chapter 18: Input/output systems

Identify interface requirements and how they can be realised; in particular buffers, handshaking, polling and serial interfacing.

Explain how interrupts are used with microcontrollers.

Explain the function of peripheral interface adapters and program them for particular situations.

Explain the function of asynchronous communications interface adapters.

Chapter 19: Programmable logic controllers

Describe the basic structure of PLCs.

Program a PLC, recognising how the logic functions, latching and sequencing can be realised.

Develop programs involving timers, internal relays, counters, shift registers, master relays, jumps and data handling.

Chapter 20: Communication systems

Describe centralised, hierarchical and distributed control systems, network configurations and methods of transmitting data, describing protocols used in the transmission of data.

Describe the Open Systems Interconnection communication model.

Describe commonly used communication interfaces: RS-232, Centronics, IEEE-488, personal computer buses, VXIbus, and I²C bus.

Chapter 21: Fault finding

Recognise the techniques used to identify faults in microprocessor-based systems, including both hardware and software.

Explain the use of emulation and simulation.

Explain how fault finding can be developed with PLC systems.

Chapter 22: Mechatronics systems

Compare and contrast possible solutions to design problems when considered from the traditional and the mechatronic points of view, recognising the widespread use of embedded systems.

Analyse case studies of mechatronics solutions.

Design mechatronics solutions to problems.

Structure of the book

Each chapter of the book is copiously illustrated and contains problems, answers to which are supplied at the end of the book. With Chapter 22 research and design assignments are also included, clues as to their possible answers also being given.

The diagram on the next page indicates the overall structure of the book. Chapter 1 is a general introduction to mechatronics. Chapters 2 to 7 form a coherent block on basic systems hardware, Chapters 8 to 13 are concerned with developing system models, Chapters 14 to 21 are concerned with digital and microprocessor systems with Chapter 22 providing an overall conclusion in considering the design of mechatronics systems.

An introduction				
Chapter 1 Mechatronics				
Basic system elements	Actuation	System models	Basic digital principles	Microprocessor systems
Chapter 2 Sensors and transducers	Chapter 5 Pneumatic and hydraulic actuation systems	Chapter 8 Basic system models	Chapter 14 Digital logic	Chapter 15 Microprocessors
Chapter 3 Signal conditioning	Chapter 6 Mechanical actuation systems	Chapter 9 System models		Chapter 16 Assembly language
Chapter 4 Data presentation systems	Chapter 7 Electrical actuation systems	Chapter 10 Dynamic responses of systems		Chapter 17 C language
		Chapter 11 System transfer functions		Chapter 18 Input/output systems
		Chapter 12 Frequency response		Chapter 19 Programmable logic controllers
		Chapter 13 Closed-loop controllers		Chapter 20 Communication systems
A conclusion				
Chapter 22 Mechatronics systems				
				Chapter 21 Fault finding

Support materials

An Instructor's Guide and OHTs are available for lecturers to download at:

www.booksites.net/bolton

Acknowledgements

A large debt is owed to the publications of the manufacturers of the equipment referred to in the text. I would also like to thank those reviewers in both Britain and the United States who painstakingly read through the first edition and made suggestions for improvements and those lecturers who have since written to me.

W. Bolton

1 Mechatronics

1.1 What is mechatronics?

Consider the modern auto-focus, auto-exposure camera. To use the camera all you need to do is point it at the subject and press the button to take the picture. The camera automatically adjusts the focus so that the subject is in focus and automatically adjusts the aperture and shutter speed so that the correct exposure is given. Consider a truck smart suspension. Such a suspension adjusts to uneven loading to maintain a level platform, adjusts to cornering, moving across rough ground, etc. to maintain a smooth ride. Consider an automated production line. Such a line may involve a number of production processes which are all automatically carried out in the correct sequence and in the correct way. The automatic camera, the truck suspension, and the automatic production line are examples of a marriage between electronic control systems and mechanical engineering.

Such control systems generally use microprocessors as controllers and have electrical sensors extracting information from the mechanical inputs and outputs via electrical actuators to mechanical systems. The term *mechatronics* is used for this integration of microprocessor control systems, electrical systems and mechanical systems. A mechatronic system is not just a marriage of electrical and mechanical systems and is more than just a control system; it is a complete integration of all of them.

In the design of cars, robots, machine tools, washing machines, cameras, and very many other machines, such an integrated and interdisciplinary approach to engineering design is increasingly being adopted. The integration across the traditional boundaries of mechanical engineering, electrical engineering, electronics and control engineering has to occur at the earliest stages of the design process if cheaper, more reliable, more flexible systems are to be developed. Mechatronics has to involve a concurrent approach to these disciplines rather than a sequential approach of developing, say, a mechanical system then designing the electrical part and the microprocessor part.

Mechatronics brings together areas of technology involving sensors and measurement systems, drive and actuation systems, analysis of the behaviour of systems, control systems, and micro-processor systems. That essentially is a summary of this book. This chapter is an introduction to the topic, developing some of the basic concepts in order to give a framework for the rest of the book in which the details will be developed.

1.2 Systems



Fig. 1.1 An example of a system




Fig. 1.2 An example of a measurement system

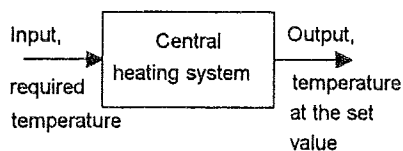



Fig. 1.3 An example of a control system

1.3 Measurement systems

Measurement systems can, in general, be considered to be made up of three elements (as illustrated in Fig. 1.4):

- 1 A *sensor* which responds to the quantity being measured by giving as its output a signal which is related to the quantity. For example, a thermocouple is a temperature sensor. The input to the sensor is a temperature and the output is an e.m.f. which is related to the temperature value.

Fig. 1.4 A measurement system and its constituent elements

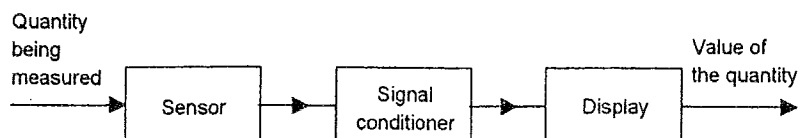

- 2 A *signal conditioner* takes the signal from the sensor and manipulates it into a condition which is suitable for either display, or, in the case of a control system, for use to exercise control. Thus, for example, the output from a thermocouple is a rather small e.m.f. and might be fed through an amplifier to obtain a bigger signal. The amplifier is the signal conditioner.
- 3 A *display system* where the output from the signal conditioner is displayed. This might, for example, be a pointer moving across a scale or a digital readout.

As an example, consider a digital thermometer. This has an input of temperature to a sensor, probably a semiconductor diode. The potential difference across the sensor is, at constant current, a measure of the temperature. This potential difference is then amplified by an operational amplifier to give a voltage which can directly drive a display. The sensor and operational amplifier may be incorporated on the same silicon chip.

Sensors are discussed in Chapter 2 and signal conditioners in Chapter 3. Measurement systems involving all elements are discussed in Chapter 4. For further details of measurement systems, readers are referred to texts more specifically concerned with measurement, e.g. *Instrumentation Reference Book* edited by B.E. Nolingk (Butterworth-Heinemann 1995), *Measurement and Instrumentation Principles* by A.S. Morris (Newnes 2001) or *Newnes Instrumentation and Measurement* by W. Bolton (Newnes 1991, 1996, 2000).

1.4 Control systems

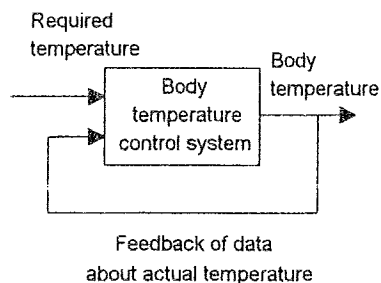


Fig. 1.5 Feedback control for human body temperature

Your body temperature, unless you are ill, remains almost constant regardless of whether you are in a cold or hot environment. To maintain this constancy your body has a temperature control system. If your temperature begins to increase above the normal you sweat, if it decreases you shiver. Both these are mechanisms which are used to restore the body temperature back to its normal value. The control system is maintaining constancy of temperature. The system has an input from sensors which tell it what the temperature is and then compares this data with what the temperature should be and provides the appropriate response in order to obtain the required temperature. This is an example of *feedback control*; signals are fed back from the output, i.e. the actual temperature, in order to modify the reaction of the body to enable it to restore the temperature to the 'normal' value. *Feedback control* is exercised by the control system comparing the fed back actual output of the system with what is required and adjusting its output accordingly. Figure 1.5 illustrates this feedback control system.

One way to control the temperature of a centrally heated house is for a human to stand near the furnace on/off switch with a

4 Mechatronics

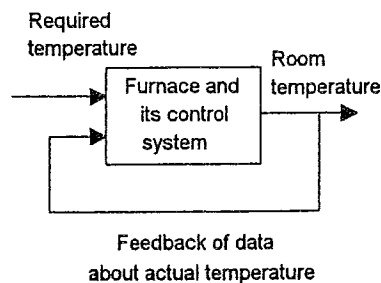


Fig. 1.6 Feedback control for room temperature

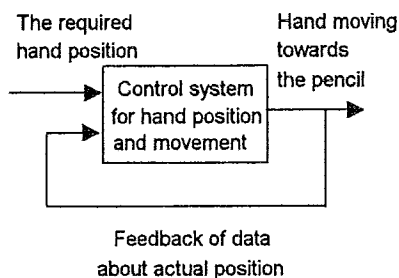


Fig. 1.7 Feedback control for picking up a pencil

thermometer and switch the furnace on or off according to the thermometer reading. That is a crude form of feedback control using a human as a control element. The term feedback is used because signals are fed back from the output in order to modify the input. The more usual feedback control system has a thermostat or controller which automatically switches the furnace on or off according to the difference between the set temperature and the actual temperature (Fig. 1.6). This control system is maintaining constancy of temperature.

If you go to pick up a pencil from a bench there is a need for you to use a control system to ensure that your hand actually ends up at the pencil. This is done by you observing the position of your hand relative to the pencil and making adjustments in its position as it moves towards the pencil. There is a feedback of information about your actual hand position so that you can modify your reactions to give the required hand position and movement (Fig. 1.7). This control system is controlling the positioning and movement of your hand.

Feedback control systems are widespread, not only in nature and the home but also in industry. There are many industrial process and machines where control, whether by humans or automatically, is required. For example, there is process control where such things as temperature, liquid level, fluid flow, pressure, etc. are maintained constant. Thus in a chemical process there may be a need to maintain the level of a liquid in a tank to a particular level or to a particular temperature. There are also control systems which involve consistently and accurately positioning a moving part or maintaining a constant speed. This might be, for example, a motor designed to run at a constant speed or perhaps a machining operation in which the position, speed and operation of a tool is automatically controlled.

1.4.1 Open- and closed-loop systems

There are two basic forms of control system, one being called *open loop* and the other *closed loop*. The difference between these can be illustrated by a simple example. Consider an electric fire which has a selection switch which allows a 1 kW or a 2 kW heating element to be selected. If a person used the heating element to heat a room, he or she might just switch on the 1 kW element if the room is not required to be at too high a temperature. The room will heat up and reach a temperature which is only determined by the fact the 1 kW element was switched on and not the 2 kW element. If there are changes in the conditions, perhaps someone opening a window, there is no way the heat output is adjusted to compensate. This is an example of open-loop control in that there is no information fed back to the element to adjust it and maintain a constant temperature. The heating system with the heating element could be made a closed-loop system if the person has a thermometer and switches the

1 kW and 2 kW elements on or off, according to the difference between the actual temperature and the required temperature, to maintain the temperature of the room constant. In this situation there is feedback, the input to the system being adjusted according to whether its output is the required temperature. This means that the input to the switch depends on the deviation of the actual temperature from the required temperature, the difference between them determined by a comparison element – the person in this case. Figure 1.8 illustrates these two types of system.

To illustrate further the differences between open- and closed-loop systems, consider a motor. With an open-loop system the speed of rotation of the shaft might be determined solely by the initial setting of a knob which affects the voltage applied to the motor. Any changes in the supply voltage, the characteristics of the motor as a result of temperature changes, or the shaft load will change the shaft speed but not be compensated for. There is no feedback loop. With a closed-loop system, however, the initial setting of the control knob will be for a particular shaft speed and this will be maintained by feedback, regardless of any changes in supply voltage, motor characteristics or load. In an open-loop control system the output from the system has no effect on the input signal. In a closed-loop control system the output does have an effect on the input signal, modifying it to maintain an output signal at the required value.

Open-loop systems have the advantage of being relatively simple and consequently low cost with generally good reliability. However, they are often inaccurate since there is no correction for error. Closed-loop systems have the advantage of being relatively accurate in matching the actual to the required values. They are, however, more complex and so more costly with a greater chance of breakdown as a consequence of the greater number of components.

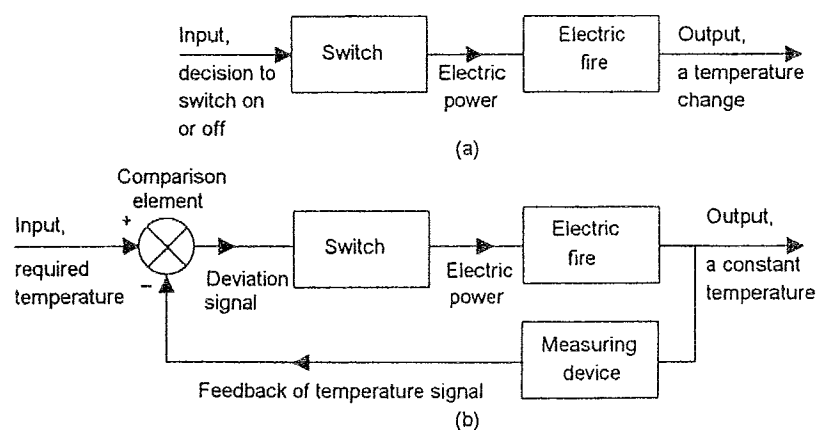


Fig. 1.8 Heating a room:
 (a) an open-loop system,
 (b) a closed-loop system

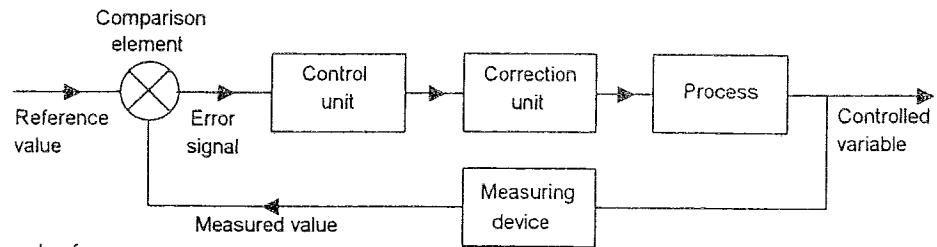


Fig. 1.9 The elements of a closed-loop control system

1.4.2 Basic elements of a closed-loop system

Figure 1.9 shows the general form of a basic closed-loop system. It consists of the following elements:

1 *Comparison element*

This compares the required or reference value of the variable condition being controlled with the measured value of what is being achieved and produces an error signal. It can be regarded as adding the reference signal, which is positive, to the measured value signal, which is negative in this case:

$$\begin{aligned} \text{Error signal} &= \text{reference value signal} \\ &\quad - \text{measured value signal} \end{aligned}$$

The symbol used, in general, for an element at which signals are summed is a segmented circle, inputs going into segments. The inputs are all added, hence the feedback input is marked as negative and the reference signal positive so that the sum gives the difference between the signals. A *feedback loop* is a means whereby a signal related to the actual condition being achieved is fed back to modify the input signal to a process. The feedback is said to be *negative feedback* when the signal which is fed back subtracts from the input value. It is negative feedback that is required to control a system. *Positive feedback* occurs when the signal fed back adds to the input signal.

2 *Control element*

This decides what action to take when it receives an error signal. It may be, for example, a signal to operate a switch or open a valve. The control plan being used by the element may be just to supply a signal which switches on or off when there is an error, as in a room thermostat, or perhaps a signal which proportionally opens or closes a valve according to the size of the error. Control plans may be *hard-wired systems* in which the control plan is permanently fixed by the way the elements are connected together or *programmable systems*

where the control plan is stored within a memory unit and may be altered by reprogramming it. Controllers are discussed in Chapter 11.

3 *Correction element*

The correction element produces a change in the process to correct or change the controlled condition. Thus it might be a switch which switches on a heater and so increases the temperature of the process or a valve which opens and allows more liquid to enter the process. The term *actuator* is used for the element of a correction unit that provides the power to carry out the control action. Correction units are discussed in Chapters 5 and 6.

4 *Process element*

The process is what is being controlled. It could be a room in a house with its temperature being controlled or a tank of water with its level being controlled.

5 *Measurement element*

The measurement element produces a signal related to the variable condition of the process that is being controlled. It might be, for example, a switch which is switched on when a particular position is reached or a thermocouple which gives an e.m.f. related to the temperature.

With the closed-loop system illustrated in Figure 1.8 for a person controlling the temperature of a room, the various elements are:

Controlled variable	-	the room temperature
Reference value	-	the required room temperature
Comparison element	-	the person comparing the measured value with the required value of temperature
Error signal	-	the difference between the measured and required temperatures
Control unit	-	the person
Correction unit	-	the switch on the fire
Process	-	the heating by the fire
Measuring device	-	a thermometer

An automatic control system for the control of the room temperature could involve a temperature sensor, after suitable signal conditioning, feeding an electrical signal to the input of a computer where it is compared with the set value and an error signal generated. This is then acted on by the computer to give at

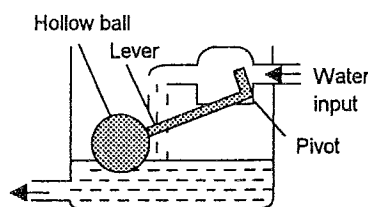


Fig. 1.10 The automatic control of water level

its output a signal, which, after suitable signal conditioning, might be used to control a heater and hence the room temperature. Such a system can readily be programmed to give different temperatures at different times of the day.

Figure 1.10 shows an example of a simple control system used to maintain a constant water level in a tank. The reference value is the initial setting of the lever arm arrangement so that it just cuts off the water supply at the required level. When water is drawn from the tank the float moves downwards with the water level. This causes the lever arrangement to rotate and so allows water to enter the tank. This flow continues until the ball has risen to such a height that it has moved the lever arrangement to cut off the water supply. It is a closed-loop control system with the elements being:

Controlled variable	-	water level in tank
Reference value	-	initial setting of the float and lever position
Comparison element	-	the lever
Error signal	-	the difference between the actual and initial settings of the lever positions
Control unit	-	the pivoted lever
Correction unit	-	the flap opening or closing the water supply
Process	-	the water level in the tank
Measuring device	-	the floating ball and lever

The above is an example of a closed-loop control system involving just mechanical elements. We could, however, have controlled the liquid level by means of an electronic control system. We thus might have had a level sensor supplying an electrical signal which is used, after suitable signal conditioning, as an input to a computer where it is compared with a set value signal and the difference between them, the error signal, then used to give an appropriate response from the computer output. This is then, after suitable signal conditioning, used to control the movement of an actuator in a flow control valve and so determine the amount of water fed into the tank.

Figure 1.11 shows a simple automatic control system for the speed of rotation of a shaft. A potentiometer is used to set the reference value, i.e. what voltage is supplied to the differential amplifier as the reference value for the required speed of rotation. The differential amplifier is used to both compare and amplify the difference between the reference and feedback values, i.e. it amplifies the error signal. The amplified error signal is then fed to a motor which in turn adjusts the speed of the rotating shaft.

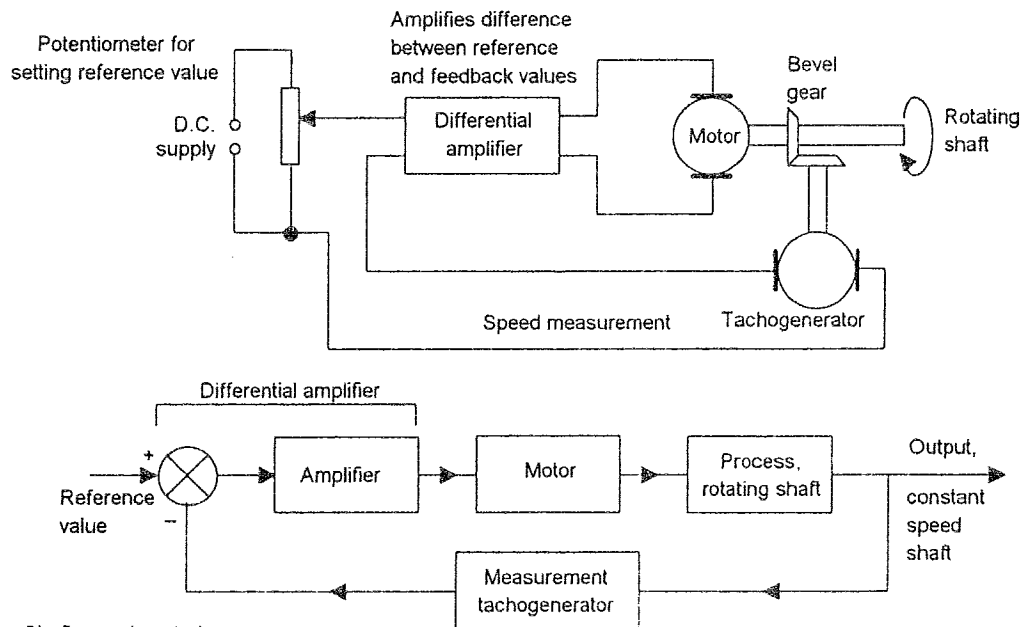


Fig. 1.11 Shaft speed control

The speed of the rotating shaft is measured using a tachogenerator, connected to the rotating shaft by means of a pair of bevel gears. The signal from the tachogenerator is then fed back to the differential amplifier.

1.4.3 Sequential controllers

There are many situations where control is exercised by items being switched on or off at particular preset times or values in order to control processes and give a step sequence of operations. For example, after step 1 is complete then step 2 starts. When step 2 is complete then step 3 starts, etc.

The term *sequential control* is used when control is such that actions are strictly ordered in a time or event driven sequence. Such control could be obtained by an electrical circuit with sets of relays or cam-operated switches which are wired up in such a way as to give the required sequence. Such hard-wired circuits are now more likely to have been replaced by a microprocessor-controlled system, with the sequencing being controlled by means of a software program.

As an illustration of sequential control, consider the domestic washing machine. A number of operations have to be carried out in the correct sequence. These may involve a pre-wash cycle when the clothes in the drum are given a wash in cold water, followed by a main wash cycle when they are washed in hot water, then a rinse cycle when the clothes are rinsed with cold

water a number of times, followed by spinning to remove water from the clothes. Each of these operations involves a number of steps. For example, a pre-wash cycle involves opening a valve to fill the machine drum to the required level, closing the valve, switching on the drum motor to rotate the drum for a specific time, and operating the pump to empty the water from the drum. The operating sequence is called a *program*, the sequence of instructions in each program being predefined and 'built' into the controller used.

Figure 1.12 shows the basic washing machine system and gives a rough idea of its constituent elements. The system that used to be used for the washing machine controller was a mechanical system which involved a set of cam-operated switches, i.e. mechanical switches. Figure 1.13 shows the basic principle of one such switch. When the machine is switched on, a small electric motor slowly rotates its shaft, giving an amount of rotation proportional to time. Its rotation turns the controller cams so that each in turn operates electrical switches and so switches on circuits in the correct sequence. The contour of a cam determines the time at which it operates a switch. Thus the contours of the cams are the means by which the program is specified and stored in the machine. The sequence of instructions and the instructions used in a particular washing program are determined by the set of cams chosen. With modern washing machines the controller is a microprocessor and the program is not supplied by the mechanical arrangement of cams but by a software program.

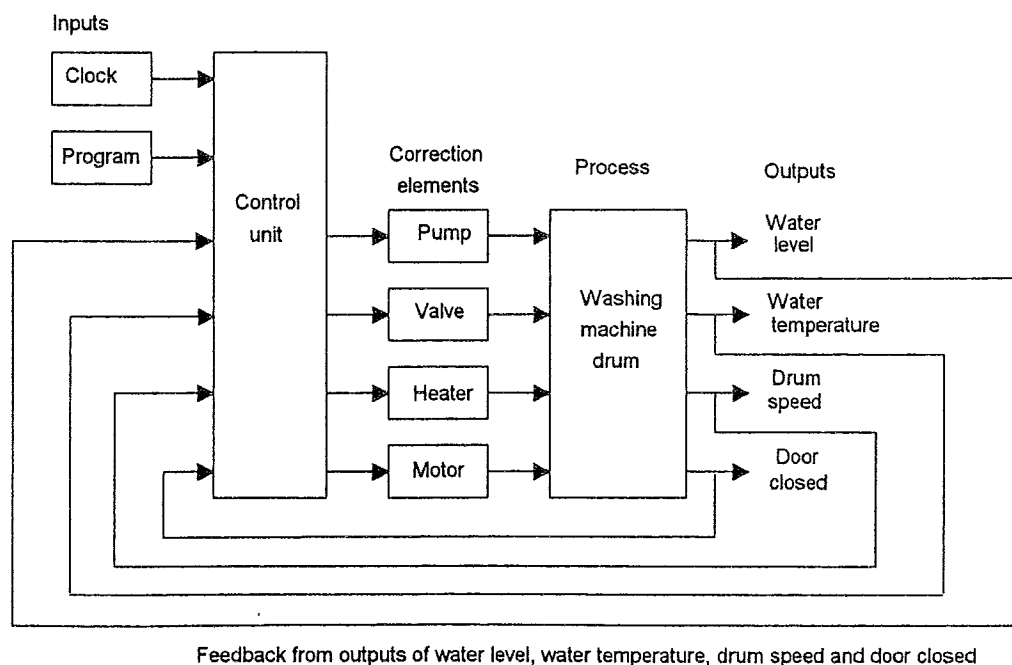


Fig. 1.12 Washing machine system

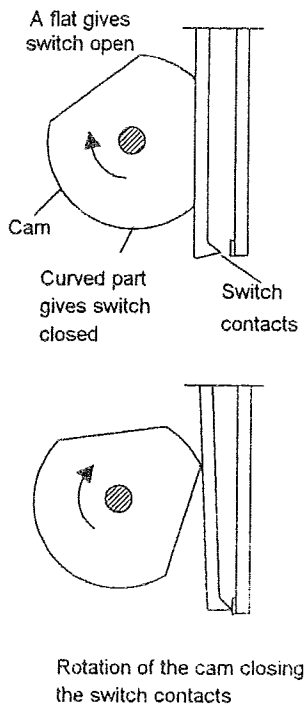


Fig. 1.13 Cam-operated switch

For the pre-wash cycle an electrically operated valve is opened when a current is supplied and switched off when it ceases. This valve allows cold water into the drum for a period of time determined by the profile of the cam or the output from the microprocessor used to operate its switch. However, since the requirement is a specific level of water in the washing machine drum, there needs to be another mechanism which will stop the water going into the tank, during the permitted time, when it reaches the required level. A sensor is used to give a signal when the water level has reached the preset level and give an output from the microprocessor which is used to switch off the current to the valve. In the case of a cam-controlled valve, the sensor actuates a switch which closes the valve admitting water to the washing machine drum. When this event is completed the microprocessor, or the rotation of the cams, initiates a pump to empty the drum.

For the main wash cycle, the microprocessor gives an output which starts when the pre-wash part of the program is completed; in the case of the cam-operated system the cam has a profile such that it starts in operation when the pre-wash cycle is completed. It switches a current into a circuit to open a valve to allow cold water into the drum. This level is sensed and the water shut off when the required level is reached. The microprocessor or cams then supply a current to activate a switch which applies a larger current to an electric heater to heat the water. A temperature sensor is used to switch off the current when the water temperature reaches the preset value. The microprocessor or cams then switch on the drum motor to rotate the drum. This will continue for the time determined by the microprocessor or cam profile before switching off. Then the microprocessor or a cam switches on the current to a discharge pump to empty the water from the drum.

The rinse part of the operation is now switched as a sequence of signals to open valves which allow cold water into the machine, switch it off, operate the motor to rotate the drum, operate a pump to empty the water from the drum, and repeat this sequence a number of times.

The final part of the operation is when the microprocessor or a cam switches on just the motor, at a higher speed than for the rinsing, to spin the clothes.

1.5 Microprocessor-based controllers

Microprocessors are now rapidly replacing the mechanical cam-operated controllers and being used in general to carry out control functions. They have the great advantage that a greater variety of programs become feasible. In many simple systems there might be just an embedded microcontroller, this being a microprocessor with memory all integrated on one chip, which has been specifically programmed for the task concerned. A more adaptable form is the *programmable logic controller*. This is a

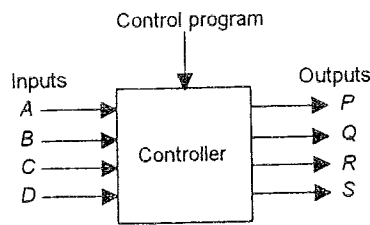


Fig. 1.14 Programmable logic controller

microprocessor-based controller which uses programmable memory to store instructions and to implement functions such as logic, sequence, timing counting and arithmetic to control events and can be readily reprogrammed for different tasks. Figure 1.14 shows the control action of a programmable logic controller, the inputs being signals from, say, switches being closed and the program used to determine how the controller should respond to the inputs and the output it should then give.

The following examples of control systems illustrate how microprocessor-based systems have not only been able to carry out tasks that previously were done 'mechanically' but also able to do tasks that were not easily automated before.

1.5.1 The automatic camera

The modern camera is likely to have automatic focusing and exposure. Figure 1.15 illustrates the basic aspects of a microprocessor-based system that can be used to control the focusing and exposure.

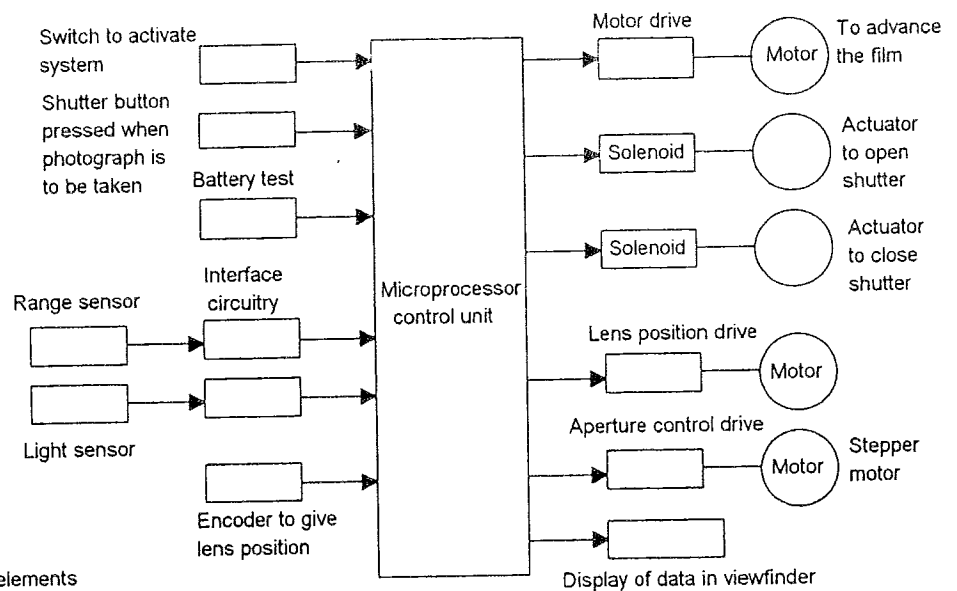


Fig. 1.15 Basic elements of the control system for an automatic camera

When the switch is operated to activate the system and the camera pointed at the object being photographed, the microprocessor takes in the input from the range sensor and sends an output to the lens position drive to move the lens to achieve focusing. The lens position is fed back to the microprocessor so that the feedback signal can be used to modify the lens position according to the input from the range sensor. The light sensor

gives an input to the microprocessor which then gives an output to determine, if the photographer has selected the shutter controlled rather than aperture controlled mode, the time for which the shutter will be opened. When the photograph has been taken, the microprocessor gives an output to the motor drive to advance the film ready for the next photograph.

The program for the microprocessor is a number of steps where the microprocessor is making simple decisions of the form: is there an input signal on a particular input line or not and if there is output a signal on a particular output line. The decisions are logic decisions with the input and output signals either being low or high to give on-off states. A few steps of the program for the automatic camera might be of the form:

```
begin
  if battery check input OK
    then continue
    otherwise stop
loop
  read input from range sensor
  calculate lens movement
  output signal to lens position drive
  input data from lens position encoder
  compare calculated output with actual output
  stop output when lens in correct position
  send in-focus signal to viewfinder display
  etc.
```

1.5.2 The engine management system

The engine management system of a car is responsible for managing the ignition and fuelling requirements of the engine. With a four-stroke internal combustion engine there are several cylinders, each of which has a piston connected to a common crankshaft and each of which carries out a four-stroke sequence of operations (Fig. 1.16).

When the piston moves down a valve opens and the air-fuel mixture is drawn into the cylinder. When the piston moves up again the valve closes and the air-fuel mixture is compressed. When the piston is near the top of the cylinder the spark plug ignites the mixture with a resulting expansion of the hot gases. This expansion causes the piston to move back down again and so the cycle is repeated. The pistons of each cylinder are connected to a common crankshaft and their power strokes occur at different times so that there is continuous power for rotating the crankshaft.

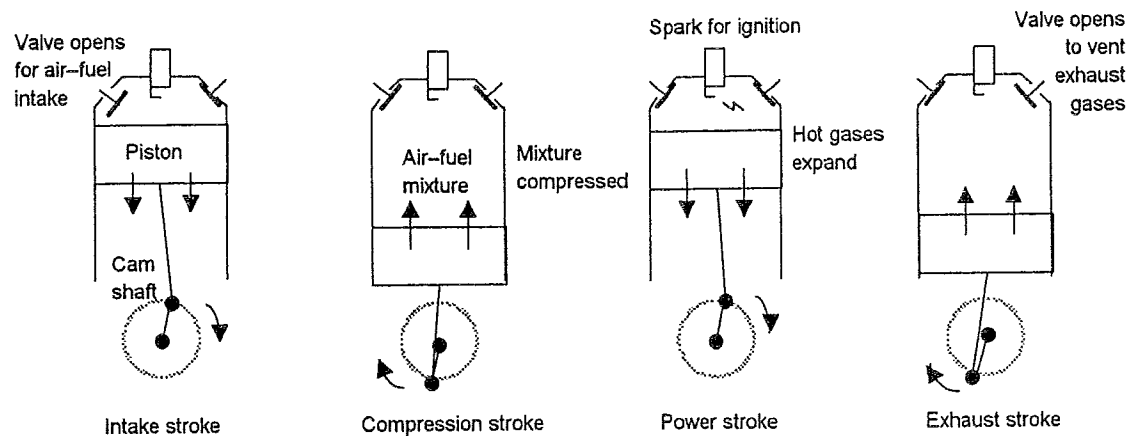


Fig. 1.16 Four-stroke sequence

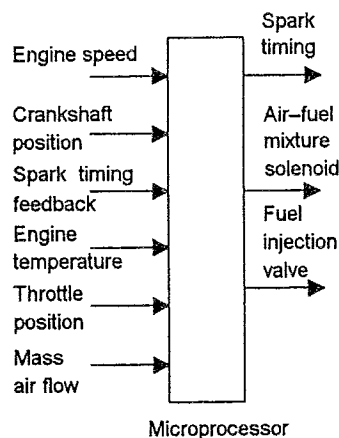


Fig. 1.17 Elements of an engine management system

The power and speed of the engine are controlled by varying the ignition timing and the air-fuel mixture. With modern car engines this is done by a microprocessor. Figure 1.17 shows the basic elements of a microprocessor control system. For ignition timing, the crankshaft drives a distributor which makes electrical contacts for each spark plug in turn and a timing wheel. This timing wheel generates pulses to indicate the crankshaft position. The microprocessor then adjusts the timing at which high voltage pulses are sent to the distributor so they occur at the 'right' moments of time. To control the amount of air-fuel mixture entering a cylinder during the intake strokes, the microprocessor varies the time for which a solenoid is activated to open the intake valve on the basis of inputs received of the engine temperature and the throttle position. The amount of fuel to be injected into the air stream can be determined by an input from a sensor of the mass rate of air flow, or computed from other measurements, and the microprocessor then gives an output to control a fuel injection valve.

The above is a very simplistic indication of engine management; for more detail the reader is referred to texts such as *Automobile Electrical and Electronic Systems* by T. Denton (Arnold 1995) or manufacturers' data sheets.

1.6 Response of systems

The response of any system to an input is not instantaneous. For example, if you switch on a kettle it takes some time for the water in the kettle to reach boiling point (Fig. 1.18). When a microprocessor controller gives a signal to, say, move the lens for focusing in an automatic camera then it takes time before the lens reaches its position for correct focusing. When you step onto the bathroom scales, the system does not immediately indicate your

1.7 The mechatronics approach

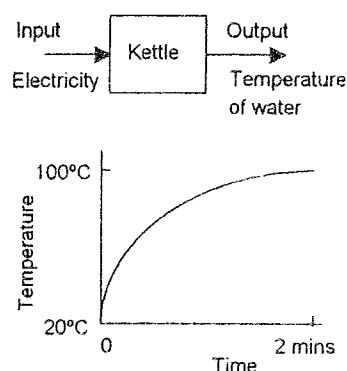


Fig. 1.18 The response to an input for a kettle system

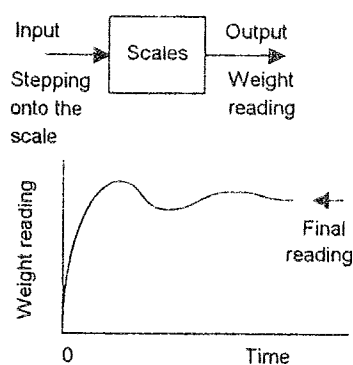


Fig. 1.18 The response to an input for a bathroom scales system

weight but gives a response which oscillates before settling down to indicate the weight value (Fig. 1.19). The responses of systems are functions of time. Thus, in order to know how systems behave when there are inputs to them, we need to devise models for systems which relate the output to the input so that we can work out, for a given input, how the output will vary with time and what it will settle down to.

The domestic washing machine (referred to earlier in this chapter) that used cam-operated switches in order to control the washing cycle is now out-of-date. Such mechanical switches are being replaced by microprocessors. A microprocessor may be considered as being essentially a collection of logic gates and memory elements that are not wired up as individual components but whose logical functions are implemented by means of software. The microprocessor-controlled washing machine can be considered an example of a mechatronics approach in that a mechanical system has become integrated with electronic controls. As a consequence, a bulky mechanical system is replaced by a much more compact microprocessor system which is readily adjustable to give a greater variety of programs.

1.7.1 In conclusion

Mechatronics involves the bringing together of a number of technologies: mechanical engineering, electronic engineering, electrical engineering, computer technology, and control engineering. This can be considered to be the application of computer-based digital control techniques, through electronic and electric interfaces, to mechanical engineering problems. Mechatronics provides an opportunity to take a new look at problems, with mechanical engineers not just seeing a problem in terms of mechanical principles but having to see it in terms of a range of technologies. The electronics, etc., should not be seen as a bolt-on item to existing mechanical hardware. A mechatronics approach needs to be adopted right from the design phase. There needs to be a complete rethink of the requirements in terms of what an item is required to do.

There are many applications of mechatronics in the mass-produced products used in the home. Microprocessor-based controllers are to be found in domestic washing machines, dish washers, microwave ovens, cameras, camcorders, watches, hi-fi and video recorder systems, central heating controls, sewing machines, etc. They are to be found in cars in the active suspension, antiskid brakes, engine control, speedometer display, transmission, etc.

A larger scale application of mechatronics is a flexible manufacturing engineering system (FMS) involving computer-

controlled machines, robots, automatic material conveying and overall supervisory control.

Problems

- 1 Identify the sensor, signal conditioner and display elements in the measurement systems of (a) a mercury-in-glass thermometer, (b) a Bourdon pressure gauge.
- 2 Explain the difference between open- and closed-loop control.
- 3 Identify the various elements that might be present in a control system involving a thermostatically controlled electric heater.
- 4 The automatic control system for the temperature of a bath of liquid consists of a reference voltage fed into a differential amplifier. This is connected to a relay which then switches on or off the electrical power to a heater in the liquid. Negative feedback is provided by a measurement system which feeds a voltage into the differential amplifier. Sketch a block diagram of the system and explain how the error signal is produced.
- 5 Explain the function of a programmable logic controller.
- 6 Explain what is meant by sequential control and illustrate your answer by an example.
- 7 State steps that might be present in the sequential control of a dishwasher.
- 8 Compare and contrast the traditional design of a watch with that of the mechatronics-designed product involving a microprocessor.
- 9 Compare and contrast the control system for the domestic central heating system involving a bimetallic thermostat and that involving a microprocessor.

2 Sensors and transducers

2.1 Sensors and transducers

The term *sensor* is used for an element which produces a signal relating to the quantity being measured. Thus in the case of, say, an electrical resistance temperature element, the quantity being measured is temperature and the sensor transforms an input of temperature into a change in resistance. The term *transducer* is often used in place of the term sensor. Transducers are defined as elements that when subject to some physical change experience a related change. Thus sensors are transducers. However, a measurement system may use transducers, in addition to the sensor, in other parts of the system to convert signals in one form to another form.

This chapter is about transducers and in particular those used as sensors. The terminology that is used to specify the performance characteristics of transducers is defined and examples of transducers commonly used in engineering are discussed.

2.2 Performance terminology

The following terms are used to define the performance of transducers, and often measurement systems as a whole.

- 1 *Range and span* The range of a transducer defines the limits between which the input can vary. The span is the maximum value of the input minus the minimum value. Thus, for example, a load cell for the measurement of forces might have a range of 0 to 50 kN and a span of 50 kN.
- 2 *Error* Error is the difference between the result of the measurement and the true value of the quantity being measured.

$$\text{Error} = \text{measured value} - \text{true value}$$

Thus if a measurement system gives a temperature reading of 25°C when the actual temperature is 24°C, then the error is +1°C. If the actual temperature had been 26°C then the error

would have been -1°C . A sensor might give a resistance change of $10.2\ \Omega$ when the true change should have been $10.5\ \Omega$. The error is $-0.3\ \Omega$.

- 3 *Accuracy* Accuracy is the extent to which the value indicated by a measurement system might be wrong. It is thus the summation of all the possible errors that are likely to occur, as well as the accuracy to which the transducer has been calibrated. A temperature-measuring instrument might, for example, be specified as having an accuracy of $\pm 2^{\circ}\text{C}$. This would mean that the reading given by the instrument can be expected to lie within $+ \text{ or } - 2^{\circ}\text{C}$ of the true value. Accuracy is often expressed as a percentage of the full range output or full-scale deflection. The percentage of full-scale deflection term results from when the outputs of measuring systems were displayed almost exclusively on a circular or linear scale. A sensor might, for example, be specified as having an accuracy of $\pm 5\%$ of full range output. Thus if the range of the sensor was, say, 0 to 200°C , then the reading given can be expected to be within $+ \text{ or } - 10^{\circ}\text{C}$ of the true reading.
- 4 *Sensitivity* The sensitivity is the relationship indicating how much output you get per unit input, i.e. output/input. For example, a resistance thermometer may have a sensitivity of $0.5\ \Omega/^{\circ}\text{C}$. This term is also frequently used to indicate the sensitivity to inputs other than that being measured, i.e. environmental changes. Thus there can be the sensitivity of the transducer to temperature changes in the environment or perhaps fluctuations in the mains voltage supply. A transducer for the measurement of pressure might be quoted as having a temperature sensitivity of $\pm 0.1\%$ of the reading per $^{\circ}\text{C}$ change in temperature.
- 5 *Hysteresis error* Transducers can give different outputs from the same value of quantity being measured according to whether that value has been reached by a continuously increasing change or a continuously decreasing change. This effect is called hysteresis. Figure 2.1 shows such an output with the hysteresis error as the maximum difference in output for increasing and decreasing values.
- 6 *Non-linearity error* For many transducers a linear relationship between the input and output is assumed over the working range, i.e. a graph of output plotted against input is assumed to give a straight line. Few transducers, however, have a truly linear relationship and thus errors occur as a result of the assumption of linearity. The error is defined as the maximum difference from the straight line. Various methods are used for the numerical expression of the non-linearity error. The differences occur in determining the

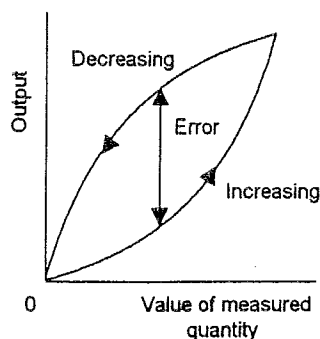


Fig. 2.1 Hysteresis

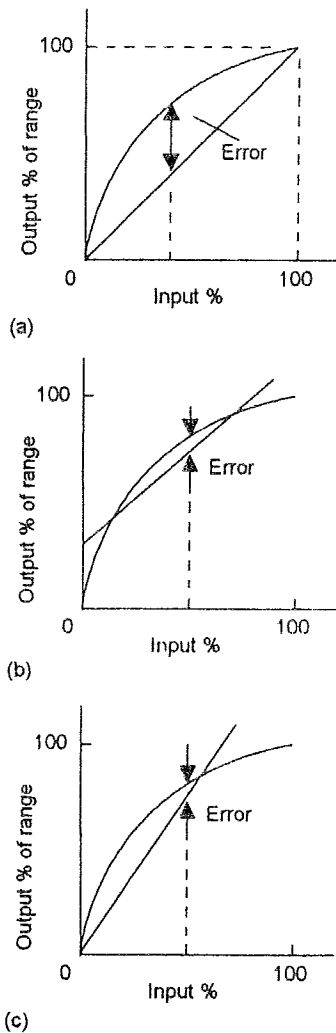


Fig. 2.2 Non-linearity error using:
 (a) end-range values,
 (b) best straight line for all values,
 (c) best straight line through zero point

straight line relationship against which the error is specified. One method is to draw the straight line joining the output values at the end points of the range; another is to find the straight line by using the method of least squares to determine the best fit line when all data values are considered equally likely to be in error; another is to find the straight line by using the method of least squares to determine the best fit line which passes through the zero point. Figure 2.2 illustrates these three methods and how they can affect the non-linearity error quoted. The error is generally quoted as a percentage of the full range output. For example, a transducer for the measurement of pressure might be quoted as having a non-linearity error of $\pm 0.5\%$ of the full range.

- 7 *Repeatability/reproducibility* The terms repeatability and reproducibility of a transducer are used to describe its ability to give the same output for repeated applications of the same input value. The error resulting from the same output not being given with repeated applications is usually expressed as a percentage of the full range output.

$$\text{Repeatability} = \frac{\text{max.} - \text{min. values given}}{\text{full range}} \times 100$$

A transducer for the measurement of angular velocity typically might be quoted as having a repeatability of $\pm 0.01\%$ of the full range at a particular angular velocity.

- 8 *Stability* The stability of a transducer is its ability to give the same output when used to measure a constant input over a period of time. The term *drift* is often used to describe the change in output that occurs over time. The drift may be expressed as a percentage of the full range output. The term *zero drift* is used for the changes that occur in output when there is zero input.

- 9 *Dead band/time* The dead band or dead space of a transducer is the range of input values for which there is no output. For example, bearing friction in a flow meter using a rotor might mean that there is no output until the input has reached a particular velocity threshold. The dead time is the length of time from the application of an input until the output begins to respond and change.
- 10 *Resolution* When the input varies continuously over the range, the output signals for some sensors may change in small steps. A wire-wound potentiometer is an example of such a sensor, the output going up in steps as the potentiometer slider moves from one wire turn to the next. The resolution is the smallest change in the input value that

will produce an observable change in the output. For a wire-wound potentiometer the resolution might be specified as, say, 0.5° or perhaps a percentage of the full-scale deflection. For a sensor giving a digital output the smallest change in output signal is 1 bit. Thus for a sensor giving a data word of N bits, i.e. a total of 2^N bits, the resolution is generally expressed as $1/2^N$.

- 11 *Output impedance* When a sensor giving an electrical output is interfaced with an electronic circuit it is necessary to know the output impedance since this impedance is being connected in either series or parallel with that circuit. The inclusion of the sensor can thus significantly modify the behaviour of the system to which it is connected. See Section 4.1.1 for a discussion of loading.

To illustrate the above, consider the significance of the terms in the following specification of a strain gauge pressure transducer:

Ranges: 70 to 1000 kPa, 2000 to 70 000 kPa

Supply voltage: 10 V d.c. or a.c. r.m.s.

Full range output: 40 mV

Non-linearity and hysteresis: $\pm 0.5\%$ full range output

Temperature range: -54°C to $+120^\circ\text{C}$ when operating

Thermal zero shift: 0.030% full range output/ $^\circ\text{C}$

The range indicates that the transducer can be used to measure pressures between 70 and 1000 kPa or 2000 and 70 000 kPa. It requires a supply of 10 V d.c. or a.c. r.m.s. for its operation and will give an output of 40 mV when the pressure on the lower range is 1000 kPa and on the upper range 70 000 kPa. Non-linearity and hysteresis will lead to errors of $\pm 0.5\%$ of 1000, i.e. ± 5 kPa on the lower range and $\pm 0.5\%$ of 70 000, i.e. ± 350 kPa on the upper range. The transducer can be used between the temperatures of -54 and $+120^\circ\text{C}$. When the temperature changes by 1°C the output of the transducer for zero input will change by 0.030% of 1000 = 0.3 kPa on the lower range and 0.030% of 70 000 = 21 kPa on the upper range.

2.2.1 Static and dynamic characteristics

The *static characteristics* are the values given when steady-state conditions occur, i.e. the values given when the transducer has settled down after having received some input. The terminology defined above refers to such a state. The *dynamic characteristics* refer to the behaviour between the time that the input value changes and the time that the value given by the transducer settles down to the steady-state value. Dynamic characteristics are stated in terms of the response of the transducer to inputs in particular forms. For example, this might be a step input when the input is

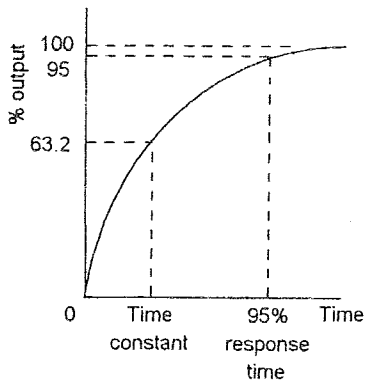


Fig. 2.3 Response to a step input

suddenly changed from 0 to a constant value, or a ramp input when the input is changed at a steady rate, or a sinusoidal input of a specified frequency. Thus we might find the following terms (see Chapter 8 for a more detailed discussion of dynamic systems):

- 1 *Response time* This is the time which elapses after a constant input, a step input, is applied to the transducer up to the point at which the transducer gives an output corresponding to some specified percentage, e.g. 95%, of the value of the input (Fig. 2.3). For example, if a mercury-in-glass thermometer is put into a hot liquid there can be quite an appreciable time lapse, perhaps as much as 100 s or more, before the thermometer indicates 95% of the actual temperature of the liquid.
- 2 *Time constant* This is the 63.2% response time. A thermocouple in air might have a time constant of perhaps 40 to 100 s. The time constant is a measure of the inertia of the sensor and so how fast it will react to changes in its input; the bigger the time constant the slower will be its reaction to a changing input signal. See Section 10.2.3 for a mathematical discussion of the time constant in terms of the behaviour of a system when subject to a step input.
- 3 *Rise time* This is the time taken for the output to rise to some specified percentage of the steady-state output. Often the rise time refers to the time taken for the output to rise from 10% of the steady-state value to 90 or 95% of the steady-state value.
- 4 *Settling time* This is the time taken for the output to settle to within some percentage, e.g. 2%, of the steady-state value.

To illustrate the above, consider the following data which indicates how an instrument reading changed with time, being obtained from a thermometer plunged into a liquid at time $t = 0$. The 95% response time is required.

Time (s)	0	30	60	90	120	150	180
Temp. (°C)	20	28	34	39	43	46	49

Time (s)	210	240	270	300	330	360
Temp. (°C)	51	53	54	55	55	55

Figure 2.4 shows the graph of how the temperature indicated by the thermometer varies with time. The steady-state value is 55°C and so, since 95% of 55 is 52.25°C, the 95% response time is about 228 s.

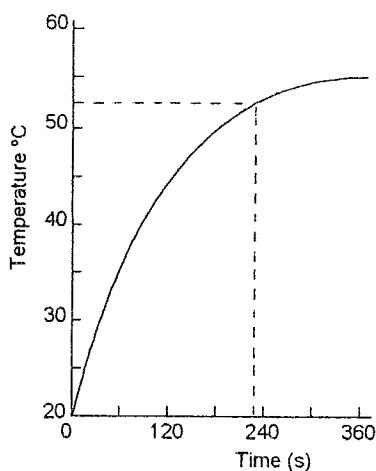


Fig. 2.4 Thermometer in liquid

2.3 Displacement, position and proximity

The following sections give examples of transducers grouped according to what they are being used to measure. The measurements considered are those frequently encountered in mechanical engineering, namely: displacement, proximity, velocity, force, pressure, fluid flow, liquid level, temperature, and light intensity. For a more comprehensive coverage of transducers the reader is referred to more specialist texts, e.g. *Instrumentation Reference Book* edited by B.E. Noltingk (Butterworth 1988, 1995), *Measurement and Instrumentation Systems* by W. Bolton (Newnes 1996) and the concise *Newnes Instrumentation and Measurement Pocket Book* by W. Bolton (Newnes 1991, 1996, 2000). Examples of the types of specifications that might be expected from electrical transducers are given in *Transducer Handbook* by H.B. Boyle (Newnes 1992).

Displacement sensors are concerned with the measurement of the amount by which some object has been moved; position sensors are concerned with the determination of the position of some object with reference to some reference point. Proximity sensors are a form of position sensor and are used to determine when an object has moved to within some particular critical distance of the sensor. They are essentially devices which give on-off outputs.

In selecting a displacement, position or proximity sensor, consideration has to be given to:

- 1 The size of the displacement; are we talking of fractions of a millimetre, many millimetres or perhaps metres? For a proximity sensor; how close should the object be before it is detected?
- 2 Whether the displacement is linear or angular; linear displacement sensors might be used to monitor the thickness or other dimensions of sheet materials, the separation of rollers, the position or presence of a part, the size of a part, etc. while angular displacement methods might be used to monitor the angular displacement of shafts.
- 3 The resolution required.
- 4 The accuracy required.
- 5 What material the measured object is made of; some sensors will only work with ferromagnetic materials, some with only metals, some with only insulators.
- 6 The cost.

Displacement and position sensors can be grouped into two basic types: contact sensors in which the measured object comes into mechanical contact with the sensor or non-contacting where there is no physical contact between the measured object and the sensor. For those linear displacement methods involving contact, there is usually a sensing shaft which is in direct contact with the object being monitored. The displacement of this shaft is then

monitored by a sensor. The movement of the shaft may be used to cause changes in electrical voltage, resistance, capacitance, or mutual inductance. For angular displacement methods involving mechanical connection the rotation of a shaft might directly drive, through gears, the rotation of the transducer element. Non-contacting sensors might involve the presence in the vicinity of the measured object causing a change in the air pressure in the sensor, or perhaps a change in inductance or capacitance. The following are examples of commonly used displacement sensors.

2.3.1 Potentiometer sensor

A *potentiometer* consists of a resistance element with a sliding contact which can be moved over the length of the element. Such elements can be used for linear or rotary displacements, the displacement being converted into a potential difference. The rotary potentiometer consists of a circular wire-wound track or a film of conductive plastic over which a rotatable sliding contact can be rotated (Fig. 2.5). The track may be a single turn or helical. With a constant input voltage V_s between terminals 1 and 3, the output voltage V_o between terminals 2 and 3 is a fraction of the input voltage, the fraction depending on the ratio of the resistance R_{23} between terminals 2 and 3 compared with the total resistance R_{13} between terminals 1 and 3, i.e. $V_o/V_s = R_{23}/R_{13}$. If the track has a constant resistance per unit length, i.e. per unit angle, then the output is proportional to the angle through which the slider has rotated. Hence an angular displacement can be converted into a potential difference.

With a wire-wound track the slider in moving from one turn to the other will change the voltage output in steps, each step being a movement of one turn. If the potentiometer has N turns then the resolution, as a percentage, is $100/N$. Thus the resolution of a wire track is limited by the diameter of the wire used and typically ranges from about 1.5 mm for a coarsely wound track to 0.5 mm for a finely wound one. Errors due to non-linearity of the track tend to range from less than 0.1% to about 1%. The track resistance tends to range from about 20 Ω to 200 k Ω . Conductive plastic has ideally infinite resolution, errors due to non-linearity of track of the order of 0.05% and resistance values from about 500 Ω to 80 k Ω . The conductive plastic has a higher temperature coefficient of resistance than the wire and so temperature changes have a greater effect on accuracy.

An important effect to be considered with a potentiometer is the effect of a load R_L connected across the output. The potential difference across the load V_L is only directly proportional to V_o if the load resistance is infinite. For finite loads, however, the effect of the load is to transform what was a linear relationship between output voltage and angle into a non-linear relationship. The resistance R_L is in parallel with the fraction x of the potentiometer

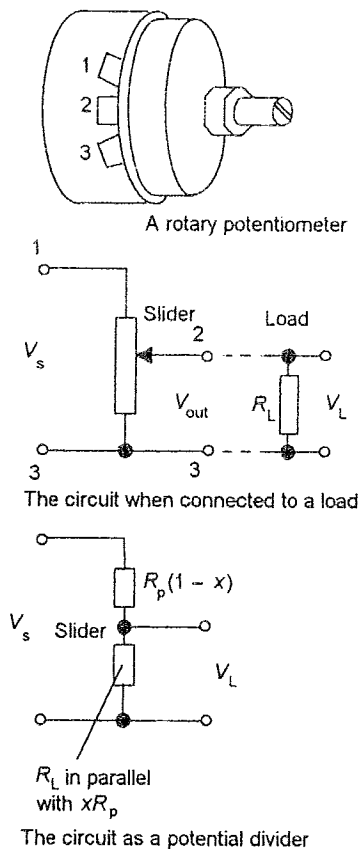


Fig. 2.5 Rotary potentiometer

resistance R_p . This combined resistance is $R_L x R_p / (R_L + x R_p)$. The total resistance across the source voltage is thus:

$$\text{total resistance} = R_p(1 - x) + R_L x R_p / (R_L + x R_p)$$

The circuit is a potential divider circuit and thus the voltage across the load is the fraction the resistance across the load is of the total resistance across which the applied voltage is connected:

$$\begin{aligned} \frac{V_L}{V_s} &= \frac{x R_L R_p / (R_L + x R_p)}{R_p(1 - x) + x R_L R_p / (R_L + x R_p)} \\ &= \frac{x}{(R_p/R_L)x(1 - x) + 1} \end{aligned}$$

If the load is of infinite resistance then we have $V_L = x V_s$. Thus the error introduced by the load having a finite resistance is:

$$\begin{aligned} \text{error} &= x V_s - V_L = x V_s - \frac{x V_s}{(R_p/R_L)x(1 - x) + 1} \\ &= V_s \frac{R_p}{R_L} (x^2 - x^3) \end{aligned}$$

To illustrate the above, consider the non-linearity error with a potentiometer of resistance 500 Ω , when at a displacement of half its maximum slider travel, which results from there being a load of resistance 10 k Ω . The supply voltage is 4 V. Using the equation derived above:

$$\text{error} = 4 \times \frac{500}{10\,000} (0.5^2 - 0.5^3) = 0.025$$

As a percentage of the full range reading, this is 0.625%.

2.3.2 Strain-gauged element

The electrical resistance strain gauge (Fig. 2.6) is a metal wire, metal foil strip, or a strip of semiconductor material which is wafer-like and can be stuck onto surfaces like a postage stamp. When subject to strain, its resistance R changes, the fractional change in resistance $\Delta R/R$ being proportional to the strain ϵ , i.e.

$$\frac{\Delta R}{R} = G \epsilon$$

where G , the constant of proportionality, is termed the gauge factor. Since strain is the ratio (change in length/original length) then the resistance change of a strain gauge is a measurement of the change in length of the element to which the strain gauge is attached. The gauge factor of metal wire or foil strain gauges with the metals generally used is about 2.0. Silicon p- and n-type

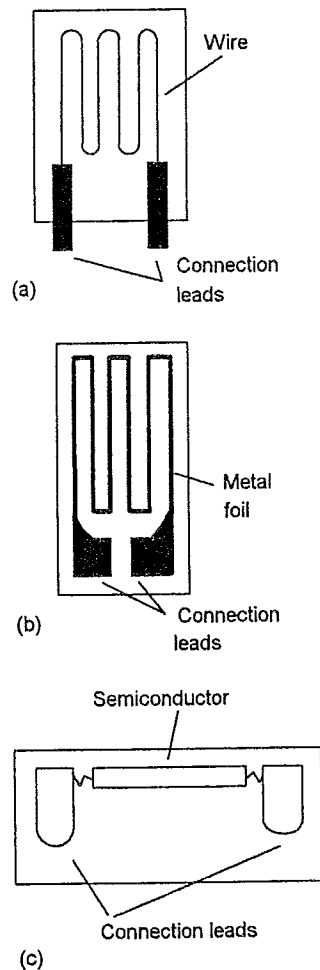


Fig. 2.6 Strain gauges: (a) metal wire, (b) metal foil, (c) semiconductor

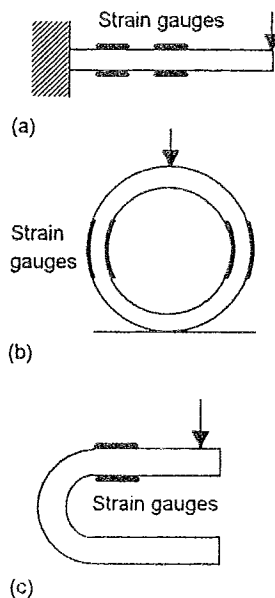


Fig. 2.7 Strain-gauged elements

semiconductor strain gauges have gauge factors of about +100 or more for p-type silicon and -100 or more for n-type silicon. The gauge factor is normally supplied by the manufacturer of the strain gauges from a calibration made of a sample of strain gauges taken from a batch. The calibration involves subjecting the sample gauges to known strains and measuring their changes in resistance. A problem with all strain gauges is that their resistance not only changes with strain but also with temperature. Ways of eliminating the temperature effect have to be used and are discussed in Chapter 3. Semiconductor strain gauges have a much greater sensitivity to temperature than metal strain gauges.

To illustrate the above, consider an electrical resistance strain gauge with a resistance of $100\ \Omega$ and a gauge factor of 2.0. What is the change in resistance of the gauge when it is subject to a strain of 0.001? The fractional change in resistance is equal to the gauge factor multiplied by the strain, thus:

$$\text{Change in resistance} = 2.0 \times 0.001 \times 100 = 0.2\ \Omega$$

One form of displacement sensor has strain gauges attached to flexible elements in the form of cantilevers, rings or U-shapes (Fig. 2.7). When the flexible element is bent or deformed as a result of forces being applied by a contact point being displaced, then the electrical resistance strain gauges mounted on the element are strained and so give a resistance change which can be monitored. The change in resistance is thus a measure of the displacement or deformation of the flexible element. Such arrangements are typically used for linear displacements of the order of 1 mm to 30 mm and have a non-linearity error of about $\pm 1\%$ of full range.

2.3.3 Capacitive element

The capacitance C of a parallel plate capacitor is given by

$$C = \frac{\epsilon_r \epsilon_0 A}{d}$$

where ϵ_r is the relative permittivity of the dielectric between the plates, ϵ_0 a constant called the permittivity of free space, A the area of overlap between the two plates and d the plate separation. Capacitive sensors for the monitoring of linear displacements might thus take the forms shown in Figure 2.8. In (a) one of the plates is moved by the displacement so that the plate separation changes; in (b) the displacement causes the area of overlap to change; in (c) the displacement causes the dielectric between the plates to change.

For the displacement changing the plate separation (Fig. 2.8(a)), if the separation d is increased by a displacement x then the capacitance becomes:

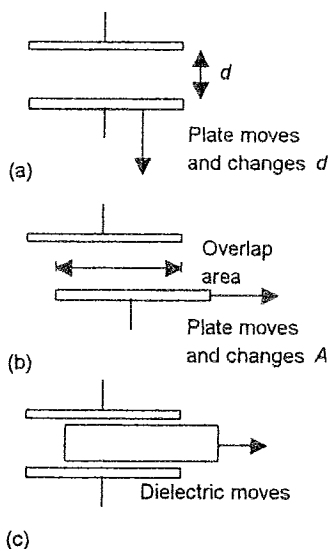


Fig. 2.8 Forms of capacitive sensing element

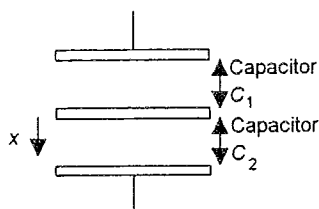


Fig. 2.9 Push-pull sensor




Fig. 2.10 Capacitive proximity sensor

$$C - \Delta C = \frac{\epsilon_0 \epsilon_r A}{d + x}$$

Hence the change in capacitance ΔC as a fraction of the initial capacitance is given by:

$$\frac{\Delta C}{C} = -\frac{d}{d+x} - 1 = -\frac{x/d}{1 + (x/d)}$$

There is thus a non-linear relationship between the change in capacitance ΔC and the displacement x . This non-linearity can be overcome by using what is termed a *push-pull displacement sensor* (Fig. 2.9). This has three plates with the upper pair forming one capacitor and the lower pair another capacitor. The displacement moves the central plate between the two other plates. The result of, for example, the central plate moving downwards is to increase the plate separation of the upper capacitor and decrease the separation of the lower capacitor. We thus have:

$$C_1 = \frac{\epsilon_0 \epsilon_r A}{d + x}$$

$$C_2 = \frac{\epsilon_0 \epsilon_r A}{d - x}$$

When C_1 is in one arm of an a.c. bridge and C_2 in the other, then the resulting out-of-balance voltage is proportional to x . Such a sensor is typically used for monitoring displacements from a few millimetres to hundreds of millimetres. Non-linearity and hysteresis are about $\pm 0.01\%$ of full range.

One form of capacitive proximity sensor consists of a single capacitor plate probe with the other plate being formed by the object, which has to be metallic and earthed (Fig. 2.10). As the object approaches so the 'plate separation' of the capacitor changes, becoming significant and detectable when the object is close to the probe.

2.3.4 Differential transformers

The linear variable differential transformer, generally referred to by the abbreviation LVDT, consists of three coils symmetrically spaced along an insulated tube (Fig. 2.11). The central coil is the primary coil and the other two are identical secondary coils which are connected in series in such a way that their outputs oppose each other. A magnetic core is moved through the central tube as a result of the displacement being monitored.

When there is an alternating voltage input to the primary coil, alternating e.m.f.s are induced in the secondary coils. With the magnetic core central, the amount of magnetic material in each of the secondary coils is the same. Thus the e.m.f.s induced in each coil are the same. Since they are so connected that their outputs oppose each other, the net result is zero output.

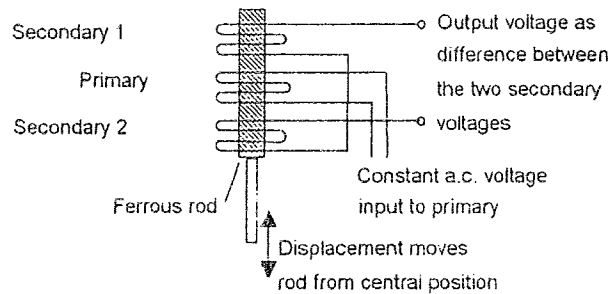


Fig. 2.11 LVDT

However, when the core is displaced from the central position there is a greater amount of magnetic core in one coil than the other, e.g. more in secondary coil 2 than coil 1. The result is that a greater e.m.f. is induced in one coil than the other. There is then a net output from the two coils. Since a greater displacement means even more core in one coil than the other, the output, the difference between the two e.m.f.s increases the greater the displacement being monitored (Fig. 2.12).

The e.m.f. induced in a secondary coil by a changing current i in the primary coil is given by:

$$e = M \frac{di}{dt}$$

where M is the mutual inductance, its value depending on the number of turns on the coils and the ferromagnetic core. Thus, for a sinusoidal input current of $i = I \sin \omega t$ to the primary coil, the e.m.f.s induced in the two secondary coils 1 and 2 can be represented by:

$$v_1 = k_1 \sin(\omega t - \phi) \text{ and } v_2 = k_2 \sin(\omega t - \phi)$$

where the values of k_1 , k_2 and ϕ depend on the degree of coupling between the primary and secondary coils for a particular core position. ϕ is the phase difference between the primary alternating voltage and the secondary alternating voltages. Because the two outputs are in series, their difference is the output:

$$\text{output voltage} = v_1 - v_2 = (k_1 - k_2) \sin(\omega t - \phi)$$

When the core is equally in both coils, k_1 equals k_2 and so the output voltage is zero. When the core is more in 1 than in 2 we have $k_1 > k_2$ and:

$$\text{output voltage} = (k_1 - k_2) \sin(\omega t - \phi)$$

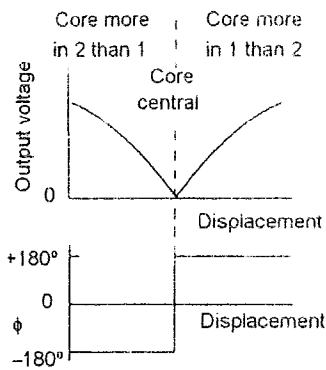


Fig. 2.12 LVDT output

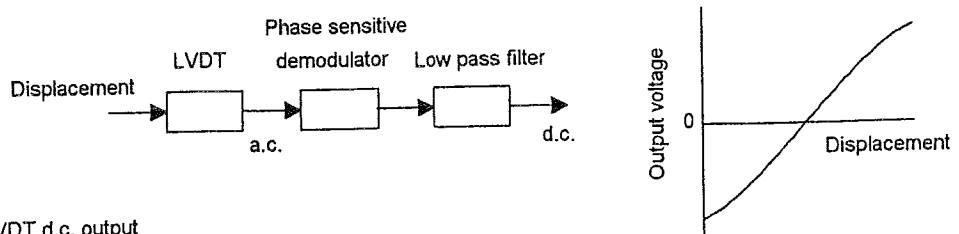


Fig. 2.13 LVDT d.c. output

When the core is more in 2 than in 1 we have $k_1 < k_2$. A consequence of k_1 being less than k_2 is that there is a phase change of 180° in the output when the core moves from more in 1 to more in 2. Thus:

$$\begin{aligned} \text{output voltage} \\ = -(k_1 - k_2) \sin(\omega t - \phi) = (k_2 - k_1) \sin[\omega t + (\pi - \phi)] \end{aligned}$$

Figure 2.12 shows how the size and phase of the output changes with the displacement of the core.

With this form of output, the same amplitude output voltage is produced for two different displacements. To give an output voltage which is unique to each value of displacement we need to distinguish between where the amplitudes are the same but there is a phase difference of 180° . A phase sensitive demodulator, with a low pass filter, is used to convert the output into a d.c. voltage which gives a unique value for each displacement (Fig. 2.13). Such circuits are available as integrated circuits.

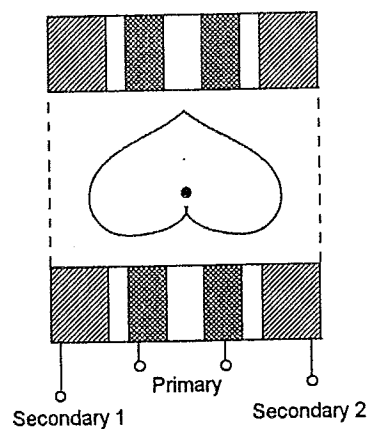


Fig. 2.14 RVDT

Typically, LVDTs have operating ranges from about ± 2 mm to ± 400 mm with non-linearity errors of about $\pm 0.25\%$. LVDTs are very widely used as primary transducers for monitoring displacements. The free end of the core may be spring loaded for contact with the surface being monitored, or threaded for mechanical connection. They are also used as secondary transducers in the measurement of force, weight and pressure; these variables are transformed into displacements which can then be monitored by LVDTs.

A rotary variable differential transformer (RVDT) can be used for the measurement of rotation (Fig. 2.14); it operates on the same principle as the LVDT. The core is a cardioid-shaped piece of magnetic material and rotation causes more of it to pass into one secondary coil than the other. The range of operation is typically $\pm 40^\circ$ with a linearity error of about $\pm 0.5\%$ of the range.

2.3.5 Eddy current proximity sensors

If a coil is supplied with an alternating current, an alternating magnetic field is produced. If there is a metal object in close proximity to this alternating magnetic field, then eddy currents are induced in it. The eddy currents themselves produce a

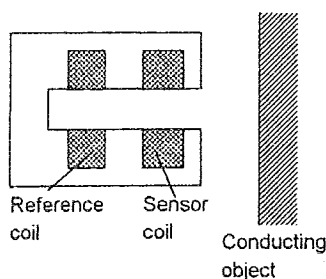


Fig. 2.15 Eddy current sensor

magnetic field. This distorts the magnetic field responsible for their production. As a result, the impedance of the coil changes and so the amplitude of the alternating current. At some preset level, this change can be used to trigger a switch. Figure 2.15 shows the basic form of such a sensor; it is used for the detection of non-magnetic but conductive materials. They have the advantages of being relatively inexpensive, small in size, with high reliability and can have high sensitivity to small displacements.

2.3.6 Inductive proximity switch

This consists of a coil wound round a core. When the end of the coil is close to a metal object its inductance changes. This change can be monitored by its effect on a resonant circuit and the change used to trigger a switch. It can only be used for the detection of metal objects and is best with ferrous metals.

2.3.7 Optical encoders

An *encoder* is a device that provides a digital output as a result of a linear or angular displacement. Position encoders can be grouped into two categories: *incremental encoders* that detect changes in rotation from some datum position and absolute encoders which give the actual angular position.

Figure 2.16(a) shows the basic form of an *incremental encoder* for the measurement of angular displacement. A beam of light passes through slots in a disc and is detected by a suitable light sensor. When the disc is rotated, a pulsed output is produced by the sensor with the number of pulses being proportional to the angle through which the disc rotates. Thus the angular position of the disc, and hence the shaft rotating it, can be determined by the number of pulses produced since some datum position. In practice three concentric tracks with three sensors are used (Fig. 2.16(b)). The inner track has just one hole and is used to locate the 'home' position of the disc. The other two tracks have a series of equally spaced holes that go completely round the disc but with the holes in the middle track offset from the holes in the outer track by one-half the width of a hole. This offset enables the direction of rotation to be determined. In a clockwise direction the pulses in the outer track lead those in the inner, in the anti-clockwise direction they lag. The resolution is determined by the number of slots on the disc. With 60 slots occurring with 1 revolution then, since 1 revolution is a rotation of 360° , the resolution is $360/60 = 6^\circ$.

Figure 2.17 shows the basic form of an *absolute encoder* for the measurement of angular displacement. This gives an output in the form of a binary number of several digits, each such number representing a particular angular position. The rotating disc has three concentric circles of slots and three sensors to detect the

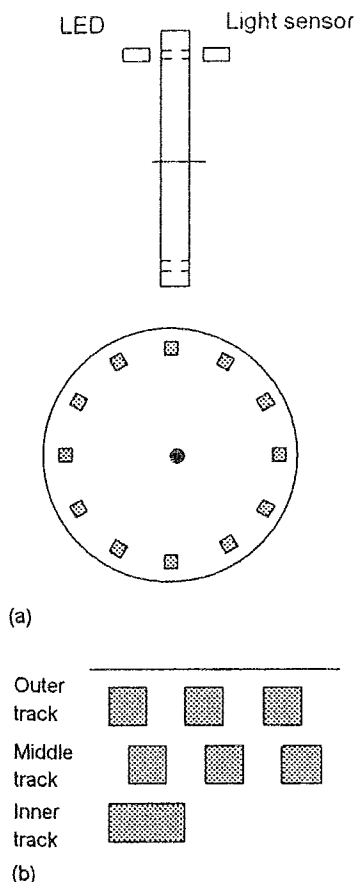


Fig. 2.16 Incremental encoder:
(a) the basic principle, (b) concentric tracks

light pulses. The slots are arranged in such a way that the sequential output from the sensors is a number in the binary code. Typical encoders tend to have up to 10 or 12 tracks. The number of bits in the binary number will be equal to the number of tracks. Thus with 10 tracks there will be 10 bits and so the number of positions that can be detected is 2^{10} , i.e. 1024, a resolution of $360/1024 = 0.35^\circ$.

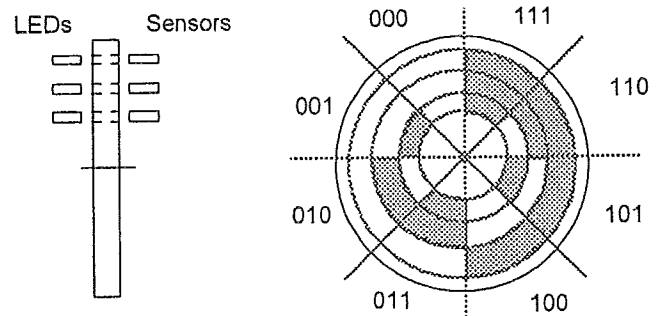


Fig. 2.17 A 3-bit absolute encoder

	Normal binary	Gray code
0	0000	0000
1	0001	0001
2	0010	0011
3	0011	0010
4	0100	0110
5	0101	0111
6	0110	0101
7	0111	0100
8	1000	1100
9	1001	1101
10	1010	1111

Fig. 2.18 Binary and Gray codes

The normal form of binary code is generally not used because changing from one binary number to the next can result in more than one bit changing and if, through some misalignment, one of the bits changes fractionally before the others then an intermediate binary number is momentarily indicated and so can lead to false counting. To overcome this the *Gray code* is generally used. With this code only one bit changes in moving from one number to the next. Figure 2.18 shows the tracks with normal binary code and the Gray code.

Optical encoders, e.g. HEDS-5000 from Hewlett Packard, are supplied for mounting on shafts and contain an LED light source and a code wheel. Interface integrated circuits are also available to decode the encoder and give a binary output suitable for a microprocessor. For an absolute encoder with 7 tracks on its code disc, each track will give one of bits in the binary number and thus we have 2^7 positions specified, i.e. 128.

2.3.8 Pneumatic sensors

Pneumatic sensors involve the use of compressed air, displacement or the proximity of an object being transformed into a change in air pressure. Figure 2.19 shows the basic form of such a sensor. Low-pressure air is allowed to escape through a port in the front of the sensor. This escaping air, in the absence of any close-by object, escapes and in doing so also reduces the pressure in the nearby sensor output port. However, if there is a close-by object, the air cannot so readily escape and the result is that the pressure increases in the sensor output port. The output pressure from the sensor thus depends on the proximity of objects.

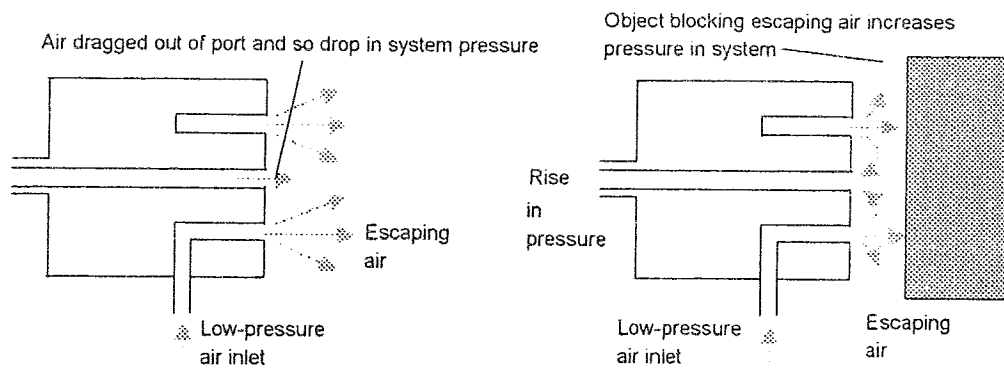


Fig. 2.19 Pneumatic proximity sensor

Such sensors are used for the measurement of displacements of fractions of millimetres in ranges which typically are about 3 to 12 mm.

2.3.9 Proximity switches

There are a number of forms of switch which can be activated by the presence of an object in order to give a proximity sensor with an output which is either on or off.

The *microswitch* is a small electrical switch which requires physical contact and a small operating force to close the contacts. For example, in the case of determining the presence of an item on a conveyor belt, this might be actuated by the weight of the item on the belt depressing the belt and hence a spring-loaded platform under it, with the movement of this platform then closing the switch. Figure 2.20 shows examples of ways such switches can be actuated.

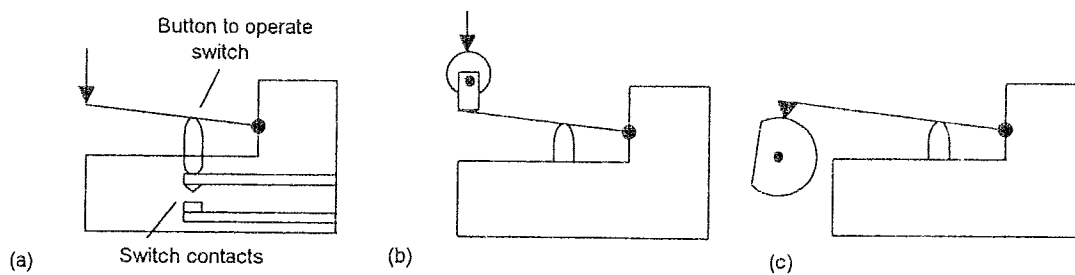


Fig. 2.20 (a) Lever-operated, (b) roller-operated, (c) cam-operated switches



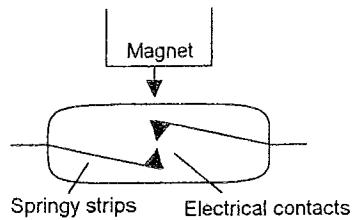


Fig. 2.21 Reed switch

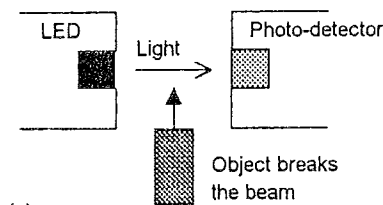

(a)



(b)

Fig. 2.22 Using photoelectric sensors to detect objects by (a) the object breaking the beam, (b) it reflecting light

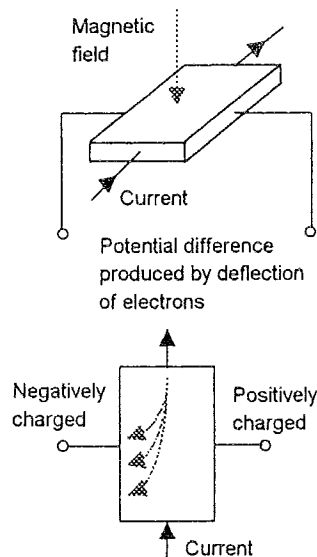


Fig. 2.23 Hall effect

Figure 2.21 shows the basic form of a *reed switch*. It consists of two magnetic switch contacts sealed in a glass tube. When a magnet is brought close to the switch, the magnetic reeds are attracted to each other and close the switch contacts. It is a non-contact proximity switch. Such a switch is very widely used for checking the closure of doors. It is also used with such devices as tachometers which involve the rotation of a toothed wheel past the reed switch. If one of the teeth has a magnet attached to it, then every time it passes the switch it will momentarily close the contacts and hence produce a current/voltage pulse in the associated electrical circuit.

Photosensitive devices can be used to detect the presence of an opaque object by it breaking a beam of light, or infrared radiation, falling on such a device or by detecting the light reflected back by the object (Fig. 2.22).

2.3.10 Hall effect sensors

When a beam of charged particles passes through a magnetic field, forces act on the particles and the beam is deflected from its straight line path. A current flowing in a conductor is like a beam of moving charges and thus can be deflected by a magnetic field. This effect was discovered by E.R. Hall in 1879 and is called the *Hall effect*. Consider electrons moving in a conductive plate with a magnetic field applied at right angles to the plane of the plate (Fig. 2.23). As a consequence of the magnetic field, the moving electrons are deflected to one side of the plate and thus that side becomes negatively charged while the opposite side becomes positively charged since the electrons are directed away from it. This charge separation produces an electric field in the material. The charge separation continues until the forces on the charged particles from the electric field just balance the forces produced by the magnetic field. The result is a transverse potential difference V given by:

$$V = K_H \frac{BI}{t}$$

where B is the magnetic flux density at right angles to the plate, I the current through it, t the plate thickness and K_H a constant called the *Hall coefficient*. Thus if a constant current source is used with a particular sensor, the Hall voltage is a measure of the magnetic flux density.

Hall effect sensors are generally supplied as an integrated circuit with the necessary signal processing circuitry. There are two basic forms of such sensor, linear where the output varies in a reasonably linear manner with the magnetic flux density (Fig. 2.24(a)) and threshold where the output shows a sharp drop at a particular magnetic flux density (Fig. 2.24(b)). The linear output Hall effect sensor 634SS2 gives an output which is fairly linear over the range -40 to $+40$ mT (-400 to $+400$ gauss) at about

10 mV per mT (1 mV per gauss) when there is a supply voltage of 5 V. The threshold Hall effect sensor Allegro UGN3132U gives an output which switches from virtually zero to about 145 mV when the magnetic flux density is about 3 mT (30 gauss). Hall effect sensors have the advantages of being able to operate as switches which can operate up to 100 kHz repetition rate, cost less than electromechanical switches and do not suffer from the problems associated with such switches of contact bounce occurring and hence a sequence of contacts rather than a single clear contact. The Hall effect sensor is immune to environmental contaminants and can be used under severe service conditions.

Fig. 2.24 Hall effect sensors:
(a) linear. (b) threshold

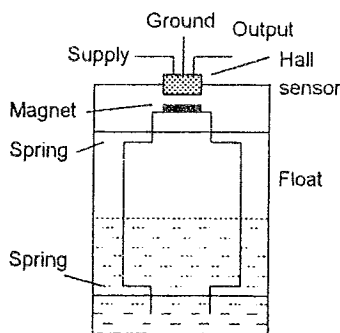
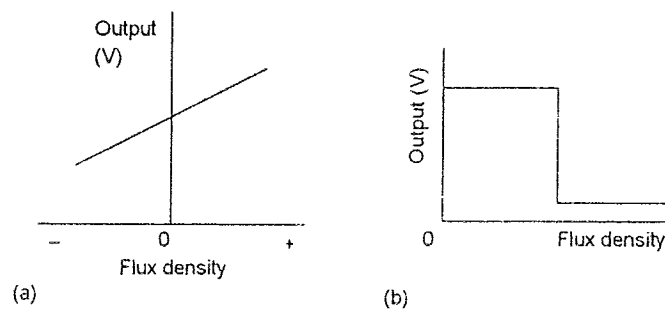


Fig. 2.25 Fluid level detector

Such sensors can be used as position, displacement and proximity sensors if the object being sensed is fitted with a small permanent magnet. As an illustration, such a sensor can be used to determine the level of fuel in an automobile fuel tank. A magnet is attached to a float and as the level of fuel changes so the float distance from the Hall sensor changes (Fig. 2.25). The result is a Hall voltage output which is a measure of the distance of the float from the sensor and hence the level of fuel in the tank.

Another application of Hall effect sensors is in brushless d.c. motors. With such motors it is necessary to determine when the permanent magnet rotor is correctly aligned with the windings on the stator so that the current through the windings can be switched on at the right instant to maintain the rotor rotation. Hall effect sensors are used to detect when the alignment is right.

2.4 Velocity and motion

The following are examples of sensors that can be used to monitor linear and angular velocities and detect motion. The application of motion detectors includes security systems used to detect intruders and interactive toys and appliances, e.g. the cash machine screen which becomes active when you get near to it.

2.4.1 Incremental encoder

The incremental encoder described in Section 2.3.7 can be used for a measurement of angular velocity, the number of pulses produced per second being determined.

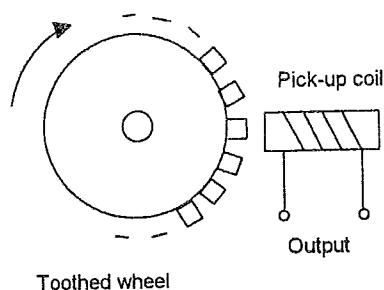


Fig. 2.26 Variable reluctance tachogenerator

2.4.2 Tachogenerator

The tachogenerator is used to measure angular velocity. One form, the *variable reluctance tachogenerator*, consists of a toothed wheel of ferromagnetic material which is attached to the rotating shaft (Fig. 2.26). A pick-up coil is wound on a permanent magnet. As the wheel rotates, so the teeth move past the coil and the air gap between the coil and the ferromagnetic material changes. We have a magnetic circuit with an air gap which periodically changes. Thus the flux linked by a pick-up coil changes. The resulting cyclic change in the flux linked produces an alternating e.m.f. in the coil.

If the wheel contains n teeth and rotates with an angular velocity ω , then the flux change with time for the coil can be considered to be of the form:

$$\Phi = \Phi_0 + \Phi_a \cos n\omega t$$

where Φ_0 is the mean value of the flux and Φ_a the amplitude of the flux variation. The induced e.m.f. e in the N turns of the pick-up coil is thus:

$$e = -N \frac{d\Phi}{dt} = -N \frac{d}{dt} (\Phi_0 + \Phi_a \cos n\omega t) = N\Phi_a n\omega \sin n\omega t$$

and so we can write:

$$e = E_{\max} \sin \omega t$$

where the maximum value of the induced e.m.f. E_{\max} is $N\Phi_a n\omega$ and so is a measure of the angular velocity.

Instead of using the maximum value of the e.m.f. as a measure of the angular velocity, a pulse-shaping signal conditioner can be used to transform the output into a sequence of pulses which can be counted by a counter, the number counted in a particular time interval being a measure of the angular velocity.

Another form of tachogenerator is essentially an *a.c. generator*. It consists of a coil, termed the rotor, which rotates with the rotating shaft. This coil rotates in the magnetic field produced by a stationary permanent magnet or electromagnet (Fig. 2.27) and so an alternating e.m.f. is induced in it. The amplitude or frequency of this alternating e.m.f. can be used as a measure of the angular velocity of the rotor. The output may be rectified to give a d.c. voltage with a size which is proportional to the angular velocity. Non-linearity for such sensors is typically of the order of $\pm 0.15\%$ of the full range and the sensors typically used for rotations up to about 10 000 rev/minute.

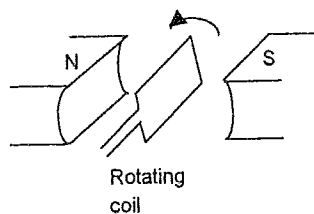


Fig. 2.27 A.C. generator form of tachogenerator

Fig. 2.28 Polarising a pyroelectric material

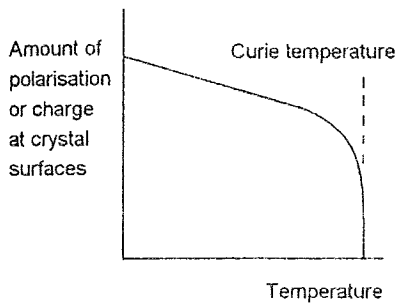
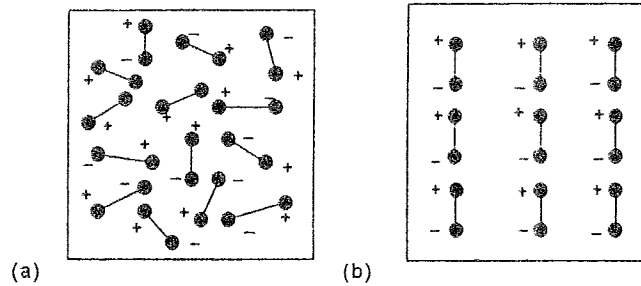


Fig. 2.29 Effect of temperature on amount of polarisation

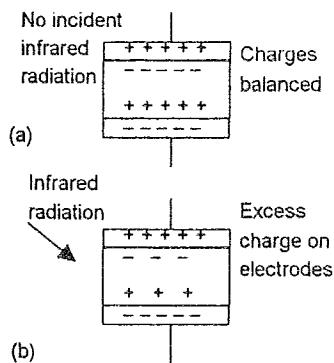


Fig. 2.30 Pyroelectric sensor




Fig. 2.31 Equivalent circuit

2.4.3 Pyroelectric sensors

Pyroelectric materials, e.g. lithium tantalate, are crystalline materials which generate charge in response to heat flow. When such a material is heated to a temperature just below the Curie temperature, this being about 610°C for lithium tantalate, in an electric field and the material cooled while remaining in the field, electric dipoles within the material line up and it becomes polarised (Fig. 2.28, (a) leading to (b)). When the field is then removed the material retains its polarisation; the effect is rather like magnetising a piece of iron by exposing it to a magnetic field. When the pyroelectric material is exposed to infrared radiation, its temperature rises and this reduces the amount of polarisation in the material, the dipoles being shaken up more and losing their alignment (Fig. 2.29).

A pyroelectric sensor consists of a polarised pyroelectric crystal with thin metal film electrodes on opposite faces. Because the crystal is polarised with charged surfaces, ions are drawn from the surrounding air and electrons from any measurement circuit connected to the sensor to balance the surface charge (Fig. 2.30(a)). If infrared radiation is incident on the crystal and changes its temperature, the polarisation in the crystal is reduced and consequently that is a reduction in the charge at the surfaces of the crystal. There is then an excess of charge on the metal electrodes over that needed to balance the charge on the crystal surfaces (Fig. 2.30(b)). This charge leaks away through the measurement circuit until the charge on the crystal once again is balanced by the charge on the electrodes. The pyroelectric sensor thus behaves as a charge generator which generates charge when there is a change in its temperature as a result of the incidence of infrared radiation. For the linear part of the graph in Figure 2.29, when there is a temperature change the change in charge Δq is proportional to the change in temperature Δt :

$$\Delta q = k_p \Delta t$$

where k_p is a sensitivity constant for the crystal. Figure 2.31 shows the equivalent circuit of a pyroelectric sensor, it effectively being a capacitor charged by the excess charge with a resistance R

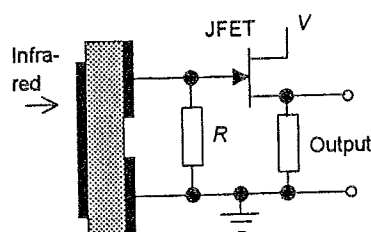


Fig. 2.32 Dual pyroelectric sensor

to represent either internal leakage resistance or that combined with the input resistance of an external circuit.

To detect the motion of a human or other heat source, the sensing element has to distinguish between general background heat radiation and that given by a moving heat source. A single pyroelectric sensor would not be capable of this and so a dual element is used (Fig. 2.32). One form has the sensing element with a single front electrode but two, separated, back electrodes. The result is two sensors which can be connected so that when both receive the same heat signal their outputs cancel. When a heat source moves so that the heat radiation moves from one of the sensing elements to the other then the resulting current through the resistor alternates from being first in one direction and then reversed to the other direction. Typically a moving human gives an alternating current of the order of 10^{-12} A. The resistance R has thus to be very high to give a significant voltage. For example, $50\text{ G}\Omega$ with such a current gives 50 mV . For this reason a JFET transistor is included in the circuit as a voltage follower in order to bring the output impedance down to a few $\text{k}\Omega$.

A focusing device is needed to direct the infrared radiation onto the sensor. While parabolic mirrors can be used a more commonly used method is a Fresnel plastic lens. Such a lens also protects the front surface of the sensor and is the form commonly used for sensors to trigger intruder alarms or switch on a light when someone approaches.

2.5 Force

A spring balance is an example of a force sensor in which a force, a weight, is applied to the scale pan and causes a displacement, i.e. the spring stretches. The displacement is then a measure of the force. Forces are commonly measured by the measurement of displacements, the following method illustrating this.

2.5.1 Strain gauge load cell

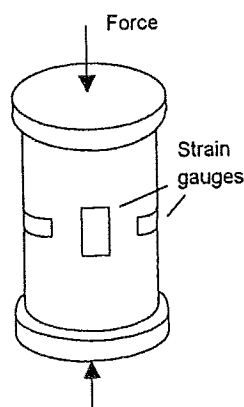


Fig. 2.33 Strain gauge load cell

A very commonly used form of force-measuring transducer is based on the use of electrical resistance strain gauges to monitor the strain produced in some member when stretched, compressed or bent by the application of the force. The arrangement is generally referred to as a *load cell*. Figure 2.33 shows an example of such a cell. This is a cylindrical tube to which strain gauges have been attached. When forces are applied to the cylinder to compress it, then the strain gauges give a resistance change which is a measure of the strain and hence the applied forces. Since temperature also produces a resistance change, the signal conditioning circuit used has to be able to eliminate the effects due to temperature (see Section 3.5.1). Typically such load cells are used for forces up to about 10 MN , the non-linearity error being about $\pm 0.03\%$ of full range, hysteresis error $\pm 0.02\%$ of full

2.6 Fluid pressure

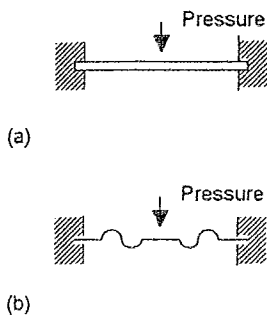


Fig. 2.34 Diaphragms. (a) flat.
(b) corrugated

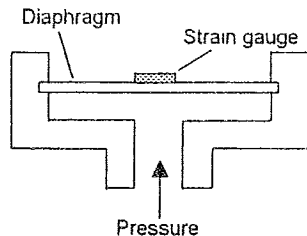


Fig. 2.35 Diaphragm pressure gauge

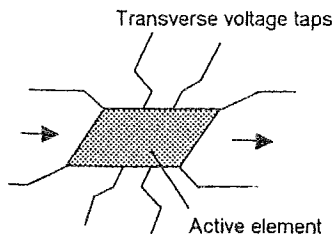


Fig. 2.36 Pressure sensor element

range and repeatability error $\pm 0.02\%$ of full range. Strain gauge load cells based on the bending of a strain-gauged metal element tend to be used for smaller forces, e.g. with ranges varying from 0 to 5 N up to 0 to 50 kN. Errors are typically a non-linearity error of about $\pm 0.03\%$ of full range, hysteresis error $\pm 0.02\%$ of full range and repeatability error $\pm 0.02\%$ of full range.

Many of the devices used to monitor fluid pressure in industrial processes involve the monitoring of the elastic deformation of diaphragms, capsules, bellows and tubes. The types of pressure measurements that can be required are: absolute pressure where the pressure is measured relative to zero-pressure, i.e. a vacuum, differential pressure where a pressure difference is measured and gauge pressure where the pressure is measured relative to the barometric pressure.

For a diaphragm (Fig. 2.34(a) and (b)), when there is a difference in pressure between the two sides then the centre of the diaphragm becomes displaced. Corrugations in the diaphragm result in a greater sensitivity. This movement can be monitored by some form of displacement sensor, e.g. a strain gauge, as illustrated in Figure 2.35. A specially designed strain gauge is often used, consisting of four strain gauges with two measuring the strain in a circumferential direction while two measure strain in a radial direction. The four strain gauges are then connected to form the arms of a Wheatstone bridge (see Chapter 3). While strain gauges can be stuck on a diaphragm, an alternative is to create a silicon diaphragm with the strain gauges as specially doped areas of the diaphragm.

Another form of silicon diaphragm pressure sensor is used for the Motorola MPX pressure sensors. The strain gauge element is integrated, together with a resistive network, in a single silicon diaphragm chip. When a current is passed through the strain gauge element and pressure applied at right angles to it, a voltage is produced in a transverse direction (Fig. 2.36). This, together with signal conditioning and temperature compensation circuitry, is packaged as the MPX sensor. The output voltage is directly proportional to the pressure. Such sensors are available for use for the measurement of absolute pressure (the MX numbering system ends with A, AP, AS or ASX), differential pressure (the MX numbering system ends with D or DP) and gauge pressure (the MX numbering system ends with GP, GVP, GS, GVS, GSV or GVSX). For example, the MPX2100 series has a pressure range of 100 kPa and with a supply voltage of 16 V, d.c., gives in the absolute pressure and differential pressure forms a voltage output over the full range of 40 mV. The response time, 10 to 90%, for a step change from 0 to 100 kPa is about 1.0 ms and the output impedance is of the order of 1.4 to 3.0 k Ω . The absolute pressure sensors are used for such applications as altimeters and barometers, the differential pressure sensors for air flow

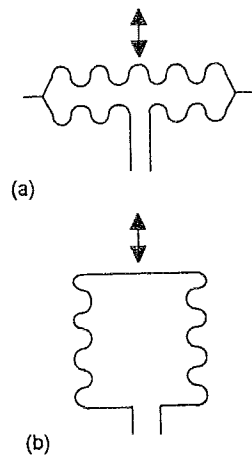


Fig. 2.37 (a) Capsule,
(b) bellows

measurements and the gauge pressure sensors for engine pressure and tyre pressure.

Capsules (Fig. 2.37(a)) can be considered to be just two corrugated diaphragms combined and give even greater sensitivity. A stack of capsules is just a bellows (Fig. 2.37(b)) and even more sensitive. Figure 2.38 shows how a bellows can be combined with a LVDT to give a pressure sensor with an electrical output. Diaphragms, capsules and bellows are made from such materials as stainless steel, phosphor bronze, and nickel, with rubber and nylon also being used for some diaphragms. Pressures in the range of about 10^3 to 10^8 Pa can be monitored with such sensors.

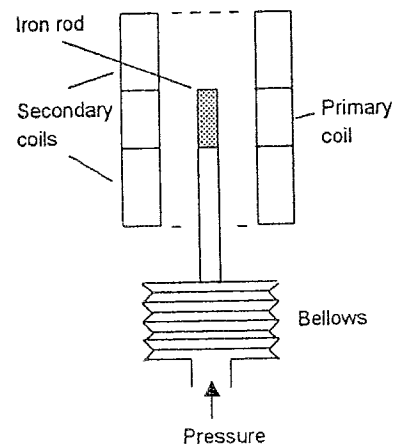


Fig. 2.38 LVDT with bellows

A different form of deformation is obtained using a tube with an elliptical cross-section (Fig. 2.39(a)). Increasing the pressure in such a tube causes it to tend to a more circular cross-section. When such a tube is in the form of a C-shaped tube (Fig. 2.39(b)), this being generally known as a *Bourdon tube*, the C opens up to some extent when the pressure in the tube increases. A helical form of such a tube (Fig. 2.39(c)) gives a greater sensitivity. The tubes are made from such materials as stainless steel and phosphor bronze and are used for pressures in the range 10^3 to 10^8 Pa.

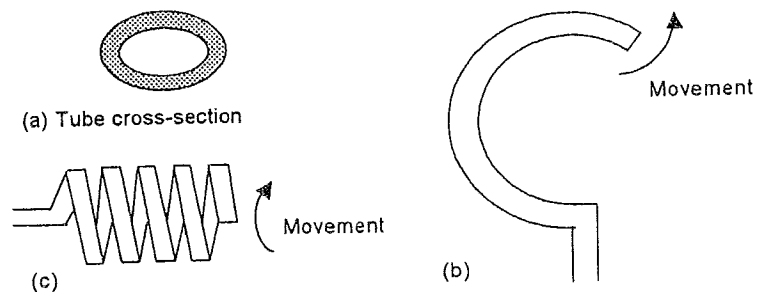


Fig. 2.39 Tube pressure
sensors




Fig. 2.40 Piezoelectricity




Fig. 2.41 Piezoelectric capacitor

2.6.1 Piezoelectric sensors

Piezoelectric materials when stretched or compressed generate electric charges with one face of the material becoming positively charged and the opposite face negatively charged (Fig. 2.40). As a result a voltage is produced. Piezoelectric materials are ionic crystals which when stretched or compressed results in the charge distribution in the crystal changing so that there is a net displacement of charge with one face of the material becoming positively charged and the other negatively charged. The net charge q on a surface is proportional to the amount x by which the charges have been displaced, and since the displacement is proportional to the applied force F :

$$q = kx = SF$$

where k is a constant and S a constant termed the *charge sensitivity*. The charge sensitivity depends on the material concerned and the orientation of its crystals. Quartz has a charge sensitivity of 2.2 pC/N when the crystal is cut in one particular direction and the forces applied in a specific direction; barium titanate has a much higher charge sensitivity of the order of 130 pC/N and lead zirconate-titanate about 265 pC/N.

Metal electrodes are deposited on opposite faces of the piezoelectric crystal (Fig. 2.41). The capacitance C of the piezoelectric material between the plates is:

$$C = \frac{\epsilon_0 \epsilon_r A}{t}$$

where ϵ_r is the relative permittivity of the material, A is area and t its thickness. Since the charge $q = Cv$, where v is the potential difference produced across a capacitor, then:

$$v = \frac{St}{\epsilon_0 \epsilon_r A} F$$

The force F is applied over an area A and so the applied pressure p is F/A and if we write $S_v = (S/\epsilon_0 \epsilon_r)$, this being termed the *voltage sensitivity factor*:

$$v = S_v t p$$

The voltage is proportional to the applied pressure. The voltage sensitivity for quartz is about 0.055 V/m Pa. For barium titanate it is about 0.011 V/m Pa.

Piezoelectric sensors are used for the measurement of pressure, force and acceleration. The applications have, however, to be such that the charge produced by the pressure does not have much time to leak off and thus tends to be used mainly for transient rather than steady pressures.

The equivalent electrical circuit for a piezoelectric sensor is a charge generator in parallel with capacitance C_s and in parallel with the resistance R_s arising from leakage through the dielectric (Fig. 2.42(a)). When the sensor is connected via a cable, of capacitance C_c , to an amplifier of input capacitance C_A and resistance R_A we have effectively the circuit shown in Figure 2.42(b) and a total circuit capacitance of $C_s + C_c + C_A$ in parallel with resistance of $R_A R_s / (R_A + R_s)$. When the sensor is subject to pressure it becomes charged, but because of the resistance the capacitor will discharge with time. The time taken for the discharge will depend on the time constant of the circuit.

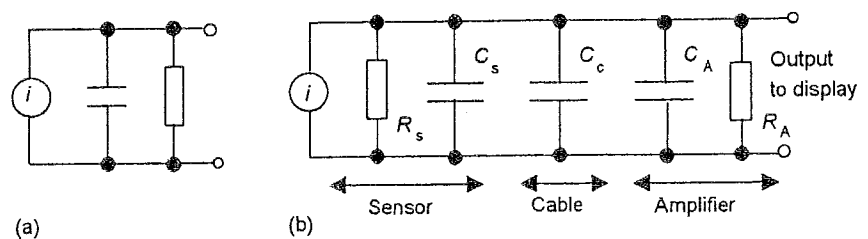


Fig. 2.42 (a) Sensor equivalent circuit,
(b) sensor connected to charge amplifier

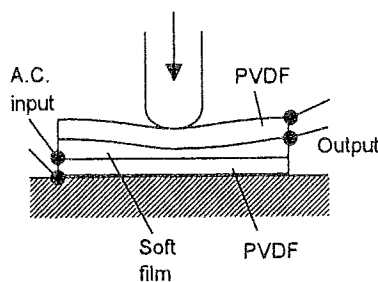


Fig. 2.43 PVDF tactile sensor

2.6.2 Tactile sensor

A tactile sensor is a particular form of pressure sensor. Such a sensor is used on the 'fingertips' of robotic 'hands' to determine when a 'hand' has come into contact with an object. They are also used for 'touch display' screens where a physical contact has to be sensed. One form of tactile sensor uses piezoelectric polyvinylidene fluoride (PVDF) film. Two layers of the film are used and are separated by a soft film which transmits vibrations (Fig. 2.43). The lower PVDF film has an alternating voltage applied to it and this results in mechanical oscillations of the film (the piezoelectric effect described above in reverse). The intermediate film transmits these vibrations to the upper PVDF film. As a consequence of the piezoelectric effect, these vibrations cause an alternating voltage to be produced across the upper film. When pressure is applied to the upper PVDF film its vibrations are affected and the output alternating voltage is changed.

2.7 Liquid flow

The traditional methods of measuring the flow rate of liquids involves devices based on the measurement of the pressure drop occurring when the fluid flows through a constriction (Fig. 2.44). For a horizontal tube, where v_1 is the fluid velocity, P_1 the pressure and A_1 the cross-sectional area of the tube prior to the




Fig. 2.44 Fluid flow through a constriction

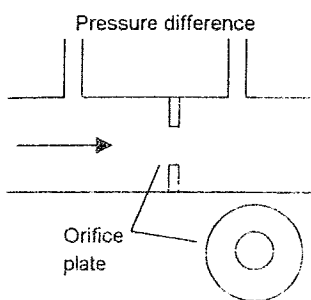


Fig. 2.45 Orifice plate

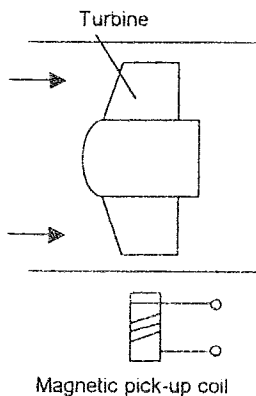


Fig. 2.46 Turbine flowmeter

constriction, v_2 the velocity, P_2 the pressure and A_2 the cross-sectional area at the constriction, ρ the fluid density, then Bernoulli's equation gives

$$\frac{v_1^2}{2g} + \frac{P_1}{\rho g} = \frac{v_2^2}{2g} + \frac{P_2}{\rho g}$$

Since the mass of liquid passing per second through the tube prior to the constriction must equal that passing through the tube at the constriction, we have $A_1 v_1 \rho = A_2 v_2 \rho$. But the quantity Q of liquid passing through the tube per second is $A_1 v_1 = A_2 v_2$. Hence

$$Q = \frac{A_2}{\sqrt{1 - (A_2/A_1)^2}} \sqrt{\frac{2(P_1 - P_2)}{\rho}}$$

Thus the quantity of fluid flowing through the pipe per second is proportional to $\sqrt{(\text{pressure difference})}$. Measurements of the pressure difference can thus be used to give a measure of the rate of flow. There are many devices based on this principle, and the following example of the orifice plate is probably one of the most common

2.7.1 Orifice plate

The orifice plate (Fig. 2.45) is simply a disc, with a central hole, which is placed in the tube through which the fluid is flowing. The pressure difference is measured between a point equal to the diameter of the tube upstream and a point equal to half the diameter downstream. The orifice plate is simple, cheap, with no moving parts, and is widely used. It, however, does not work well with slurries. The accuracy is typically about $\pm 1.5\%$ of full range, it is non-linear, and does produce quite an appreciable pressure loss in the system to which it is connected.

2.7.2 Turbine meter

The turbine flowmeter (Fig. 2.46) consists of a multi-bladed rotor that is supported centrally in the pipe along which the flow occurs. The fluid flow results in rotation of the rotor, the angular velocity being approximately proportional to the flow rate. The rate of revolution of the rotor can be determined using a magnetic pick-up. The pulses are counted and so the number of revolutions of the rotor can be determined. The meter is expensive with an accuracy of typically about $\pm 0.3\%$.

2.8 Liquid level

The level of liquid in a vessel can be measured directly by monitoring the position of the liquid surface or indirectly by measuring some variable related to the height. Direct methods can involve floats; indirect methods include the monitoring of the



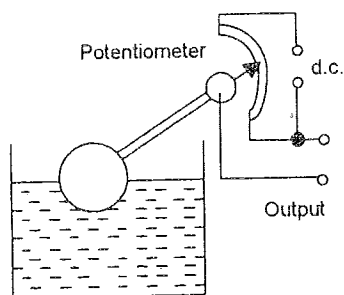


Fig. 2.47 Float system

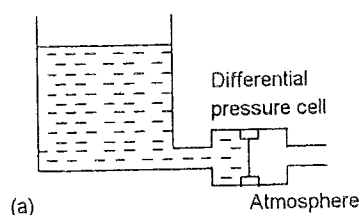

(a)



(b) Differential pressure cell

Fig. 2.48 Using a differential pressure sensor

2.9 Temperature

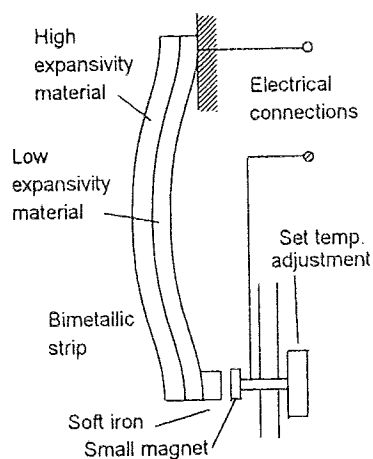


Fig. 2.49 Bimetallic thermostat

weight of the vessel by, perhaps, load cells. The weight of the liquid is $Ah\rho g$, where A is the cross-sectional area of the vessel, h the height of liquid, ρ its density and g the acceleration due to gravity. Thus changes in the height of liquid give weight changes. More commonly, indirect methods involve the measurement of the pressure at some point in the liquid, the pressure due to a column of liquid of height h being $h\rho g$, where ρ is the liquid density.

2.8.1 Floats

A direct method of monitoring the level of liquid in a vessel is by monitoring the movement of a float. Figure 2.47 illustrates this with a simple float system. The displacement of the float causes a lever arm to rotate and so move a slider across a potentiometer. The result is an output of a voltage related to the height of liquid. Other forms of this involve the lever causing the core in a LVDT to become displaced, or stretch or compress a strain-gauged element.

2.8.2 Differential pressure

Figure 2.48 shows two forms of level measurement based on the measurement of differential pressure. In Figure 2.48(a), the differential pressure cell determines the pressure difference between the liquid at the base of the vessel and atmospheric pressure, the vessel being open to atmospheric pressure. With a closed or open vessel the system illustrated in (b) can be used. The differential pressure cell monitors the difference in pressure between the base of the vessel and the air or gas above the surface of the liquid.

Changes that are commonly used to monitor temperature are the expansion or contraction of solids, liquids or gases, the change in electrical resistance of conductors and semiconductors and thermoelectric e.m.f.s. The following are some of the methods that are commonly used with temperature control systems.

2.9.1 Bimetallic strips

This device consists of two different metal strips bonded together. The metals have different coefficients of expansion and when the temperature changes the composite strip bends into a curved strip, with the higher coefficient metal on the outside of the curve. This deformation may be used as a temperature-controlled switch, as in the simple thermostat which was commonly used with domestic heating systems (Fig. 2.49). The small magnet enables the sensor to exhibit hysteresis, meaning that the switch contacts close at a different temperature from that at which they open.

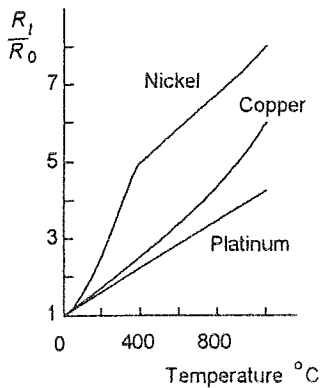


Fig. 2.50 Variation of resistance with temperature for metals

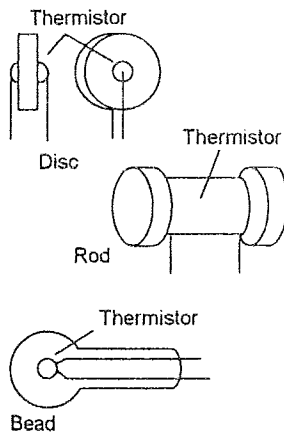


Fig. 2.51 Thermistors

2.9.2 Resistance temperature detectors (RTDs)

The resistance of most metals increases, over a limited temperature range, in a reasonably linear way with temperature (Fig. 2.50). For such a linear relationship:

$$R_t = R_0(1 + \alpha t)$$

where R_t is the resistance at a temperature $t^\circ\text{C}$, R_0 the resistance at 0°C and α a constant for the metal termed the temperature coefficient of resistance. Resistance temperature detectors (RTDs) are simple resistive elements in the form of coils of wire of such metals as platinum, nickel or nickel-copper alloys; platinum is the most widely used. Thin film platinum elements are often made by depositing the metal on a suitable substrate, wire-wound elements involving a platinum wire held by a high temperature glass adhesive inside a ceramic tube. Such detectors are highly stable and give reproducible responses over long periods of time. They tend to have response times of the order of 0.5 to 5 s or more.

2.9.3 Thermistors


Thermistors are small pieces of material made from mixtures of metal oxides, such as those of chromium, cobalt, iron, manganese and nickel. These oxides are semiconductors. The material is formed into various forms of element, such as beads, discs and rods (Fig. 2.51). The resistance of conventional metal-oxide thermistors decreases in a very non-linear manner with an increase in temperature, as illustrated in Figure 2.52. Such thermistors having negative temperature coefficients (NTC). Positive temperature coefficient (PTC) thermistors are, however, available. The change in resistance per degree change in temperature is considerably larger than that which occurs with metals. The resistance-temperature relationship for a thermistor can be described by an equation of the form

$$R_t = K e^{\beta/t}$$

where R_t is the resistance at temperature t , with K and β being constants. Thermistors have many advantages when compared with other temperature sensors. They are rugged and can be very small, so enabling temperatures to be monitored at virtually a point. Because of their small size they respond very rapidly to changes in temperature. They give very large changes in resistance per degree change in temperature. Their main disadvantage is their non-linearity.



Fig. 2.52 Variation of resistance with temperature for a typical thermistor

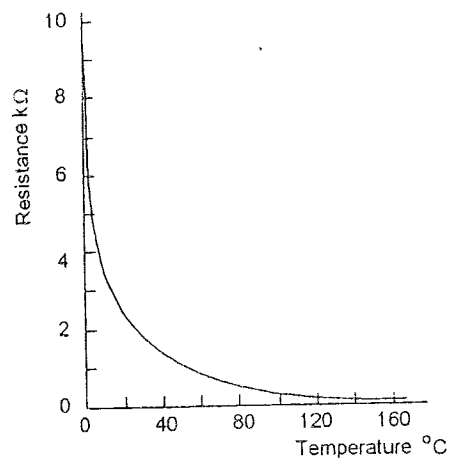

2.9.4 Thermodiodes and transistors

A junction semiconductor diode is widely used as a temperature sensor. When the temperature of doped semiconductors changes, the mobility of their charge carriers changes and this affects the rate at which electrons and holes can diffuse across a p-n junction. Thus when a p-n junction has a potential difference V across it, the current I through the junction is a function of the temperature, being given by:

$$I = I_0(e^{eV/kT} - 1)$$

where T is the temperature on the Kelvin scale, e the charge on an electron, and k and I_0 are constants. By taking logarithms we can write the equation in terms of the voltage as:

$$V = \left(\frac{kT}{e}\right) \ln\left(\frac{I}{I_0} + 1\right)$$

Thus, for a constant current, we have V proportional to the temperature on the Kelvin scale and so a measurement of the potential difference across a diode at constant current can be used as a measure of the temperature. Such a sensor is compact like a thermistor but has the great advantage of giving a response which is a linear function of temperature. Diodes for use as temperature sensors, together with the necessary signal conditioning, are supplied as integrated circuits, e.g. LM3911, and give a very small compact sensor. The output voltage from LM3911 is proportional to the temperature at the rate of 10 mV/°C.

In a similar manner to the thermodiode, for a thermo-transistor the voltage across the junction between the base and the emitter depends on the temperature and can be used as a measure of




Fig. 2.53 LM35

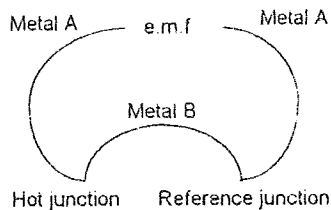


Fig. 2.54 A thermocouple

temperature. A common method is to use two transistors with different collector currents and determine the difference in the base-emitter voltages between them, this difference being directly proportional to the temperature on the Kelvin scale. Such transistors can be combined with other circuit components on a single chip to give a temperature sensor with its associated signal conditioning, e.g. LM35 (Fig. 2.53). This sensor can be used in the range -40°C to 110°C and gives an output of $10\text{ mV}/^{\circ}\text{C}$.

2.9.5 Thermocouples

If two different metals are joined together, a potential difference occurs across the junction. The potential difference depends on the metals used and the temperature of the junction. A thermocouple is a complete circuit involving two such junctions (Fig. 2.54). If both junctions are at the same temperature there is no net e.m.f. If, however, there is a difference in temperature between the two junctions, there is an e.m.f. The value of this e.m.f. E depends on the two metals concerned and the temperatures t of both junctions. Usually one junction is held at 0°C and then, to a reasonable extent, the following relationship holds:


$$E = at + bt^2$$

where a and b are constants for the metals concerned. Commonly used thermocouples are shown in Table 2.1, with the temperature ranges over which they are generally used and typical sensitivities. These commonly used thermocouples are given reference letters. For example, the iron-constantan thermocouple is called a type J thermocouple. Figure 2.55 shows how the e.m.f. varies with temperature for a number of commonly used pairs of metals.

Table 2.1 Thermocouples

Ref.	Materials	Range $^{\circ}\text{C}$	$\mu\text{V}/^{\circ}\text{C}$
B	Platinum 30% rhodium/platinum 6% rhodium	0 to 1800	3
E	Chromel/constantan	-200 to 1000	63
J	Iron/constantan	-200 to 900	53
K	Chromel/alumel	-200 to 1300	41
N	Nirosil/nisil	-200 to 1300	28
R	Platinum/platinum 13% rhodium	0 to 1400	6
S	Platinum/platinum 10% rhodium	0 to 1400	6
T	Copper/constantan	-200 to 400	43

Fig. 2.55 Thermoelectric e.m.f.-temperature graphs

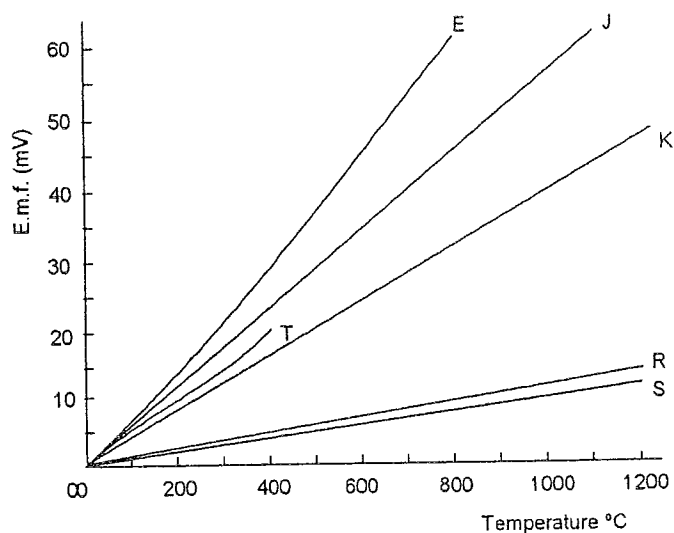

The above is equivalent to:



Fig. 2.56 Law of intermediate temperatures

A thermocouple circuit can have other metals in the circuit and they will have no effect on the thermoelectric e.m.f. provided all their junctions are at the same temperature. A thermocouple can be used with the reference junction at a temperature other than 0°C. The standard tables, however, assume a 0°C junction and hence a correction has to be applied before the tables can be used.

The correction is applied using what is known as the *law of intermediate temperatures*, namely

$$E_{t,0} = E_{t,I} + E_{I,0}$$

The e.m.f. $E_{t,0}$ at temperature t when the cold junction is at 0°C equals the e.m.f. $E_{t,I}$ at the intermediate temperature I plus the e.m.f. $E_{I,0}$ at temperature I when the cold junction is at 0°C (Fig. 2.56). To maintain one junction of a thermocouple at 0°C, i.e. have it immersed in a mixture of ice and water, is often not convenient. A compensation circuit can, however, be used to provide an e.m.f. which varies with the temperature of the cold junction in such a way that when it is added to the thermocouple e.m.f. it generates a combined e.m.f. which is the same as would have been generated if the cold junction had been at 0°C (Fig. 2.57). The compensating e.m.f. can be provided by the voltage drop across a resistance thermometer element.

The base-metal thermocouples, E, J, K and T, are relatively cheap but deteriorate with age. They have accuracies which are typically about ± 1 to 3%. Noble-metal thermocouples, e.g. R, are more expensive but are more stable with longer life. They have accuracies of the order of $\pm 1\%$ or better.

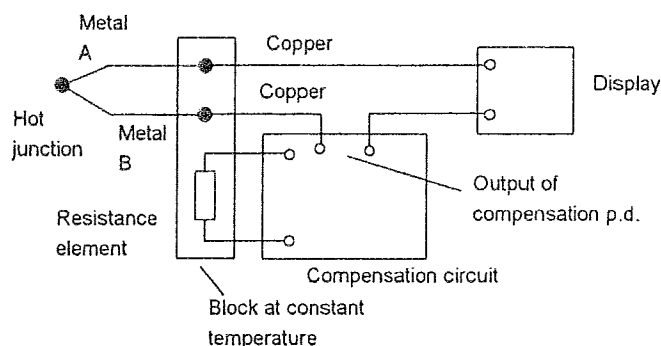


Fig. 2.57 Cold junction compensation

Thermocouples are generally mounted in a sheath to give them mechanical and chemical protection. The type of sheath used depends on the temperatures at which the thermocouple is to be used. In some cases the sheath is packed with a mineral which is a good conductor of heat and a good electrical insulator. The response time of an unsheathed thermocouple is very fast. With a sheath this may be increased to as much as a few seconds if a large sheath is used. In some instances a group of thermocouples are connected in series so that there are perhaps ten or more hot junctions sensing the temperature. The e.m.f. produced by each is added together. Such an arrangement is known as a thermopile.

To illustrate the above, consider a type E thermocouple which is to be used for the measurement of temperature with a cold junction at 20°C. What will be the thermoelectric e.m.f. at 200°C? The following is data from standard tables.

Temp. (°C)	0	20	200
e.m.f. (mV)	0	1.192	13.419

Using the law of intermediate temperatures

$$E_{200,0} = E_{200,20} + E_{20,0} = 13.419 - 1.192 = 12.227 \text{ mV}$$

Note that this is not the e.m.f. given by the tables for a temperature of 180°C with a cold junction at 0°C, namely 11.949 mV.

2.10 Light sensors

Photodiodes are semiconductor junction diodes (see Section 7.3.1 for discussion of diodes) which are connected into a circuit in reverse bias, so giving a very high resistance, so that when light falls on the junction the diode resistance drops and the current in the circuit rises appreciably. For example, the current in the absence of light with a reverse bias of 3 V might be 25 μA and

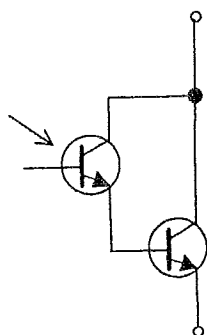


Fig. 2.58 Photo Darlington

when illuminated by 25 000 lumens/m² the current rises to 375 μ A. The resistance of the device with no light is $3/(25 \times 10^{-6}) = 120 \text{ k}\Omega$ and with light is $3/(375 \times 10^{-6}) = 8 \text{ k}\Omega$. A photodiode can thus be used as a variable resistance device controlled by the light incident on it. Photodiodes have a very fast response to light.

The *phototransistors* (see Section 7.3.3 for a discussion of transistors) have a light-sensitive collector-base p-n junction. When there is no incident light there is a very small collector-to-emitter current. When light is incident, a base current is produced that is directly proportional to the light intensity. This leads to the production of a collector current which is then a measure of the light intensity. Phototransistors are often available as integrated packages with the phototransistor connected in a Darlington arrangement with a conventional transistor (Fig. 2.58). Because this arrangement gives a higher current gain, the device gives a much greater collector current for a given light intensity.

A *photoresistor* has a resistance which depends on the intensity of the light falling on it, decreasing linearly as the intensity increases. The cadmium sulphide photoresistor is most responsive to light having wavelengths shorter than about 515 nm and the cadmium selenide photoresistor for wavelengths less than about 700 nm.

An array of light sensors is often required in a small space in order to determine the variations of light intensity across that space, e.g. in the automatic camera to determine the exposure that will be most appropriate to take account of the varying light intensities across the image. To this end array devices are available with large numbers of photodiodes in an array.

2.11 Selection of sensors

In selecting a sensor for a particular application there are a number of factors that need to be considered:

- 1 The nature of the measurement required, e.g. the variable to be measured, its nominal value, the range of values, the accuracy required, the required speed of measurement, the reliability required, the environmental conditions under which the measurement is to be made.
- 2 The nature of the output required from the sensor, this determining the signal conditioning requirements in order to give suitable output signals from the measurement.
- 3 Then possible sensors can be identified, taking into account such factors as their range, accuracy, linearity, speed of response, reliability, maintainability, life, power supply requirements, ruggedness, availability, cost.

The selection of sensors cannot be taken in isolation from a consideration of the form of output that is required from the

system after signal conditioning, and thus there has to be a suitable marriage between sensor and signal conditioner.

To illustrate the above, consider the selection of a sensor for the measurement of the level of a corrosive acid in a vessel. The level can vary from 0 to 2 m in a circular vessel which has a diameter of 1 m. The empty vessel has a weight of 100 kg. The minimum variation in level to be detected is 10 cm. The acid has a density of 1050 kg/m^3 . The output from the sensor is to be electrical.

Because of the corrosive nature of the acid an indirect method of determining the level seems appropriate. Thus it is possible to use a load cell, or load cells, to monitor the weight of the vessel. Such cells would give an electrical output. The weight of the liquid changes from 0 when empty to, when full, $1050 \times 2 \times \pi(1^2/4) \times 9.8 = 16.2 \text{ kN}$. Adding this to the weight of the empty vessel gives a weight that varies from about 1 to 17 kN. The resolution required is for a change of level of 10 cm, i.e. a change in weight of $0.10 \times 1050 \times \pi(1^2/4) \times 9.8 = 0.8 \text{ kN}$. If three load cells are used to support the tank then each will require a range of about 0 to 6 kN with a resolution of 0.27 kN. Manufacturers' catalogues can then be consulted to see if such load cells can be obtained.

2.12 Inputting data by switches

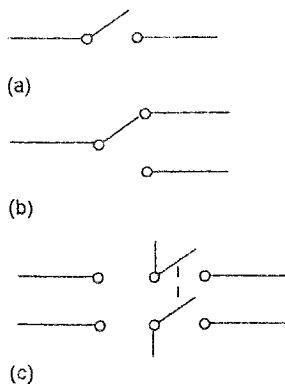


Fig. 2.59 Switches: (a) SPST, (b) SPDT, (c) DPDT

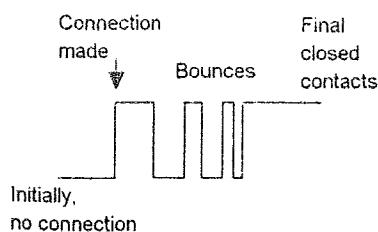


Fig. 2.60 Switch bounce on closing a switch

Mechanical switches consist of one or more pairs of contacts which can be mechanically closed or opened and in doing so make or break electrical circuits. Thus 0 or 1 signals can be transmitted by the act of opening or closing a switch.

Mechanical switches are specified in terms of their number of poles and throws. *Poles* are the number of separate circuits that can be completed by the same switching action and *throws* are the number of individual contacts for each pole. Figure 2.59(a) shows a single pole-single throw (SPST) switch, Figure 2.59(b) a single pole-double throw (DPDT) switch and Figure 2.59(c) a double pole-double throw (DPDT) switch.

2.12.1 Debouncing

A problem that occurs with mechanical switches is *switch bounce*. When a mechanical switch is switched to close the contacts, we have one contact being moved towards the other. It hits the other and, because the contacting elements are elastic, bounces. It may bounce a number of times (Fig. 2.60) before finally settling to its closed state after, typically, some 20 ms. Each of the contacts during this bouncing time can register as a separate contact. Thus, to a microprocessor, it might appear that perhaps two or more separate switch actions have occurred. Similarly, when a mechanical switch is opened, bouncing can occur. To overcome this problem either hardware or software can be used.

With software, the microprocessor is programmed to detect if the switch is closed and then wait, say, 20 ms. After checking that

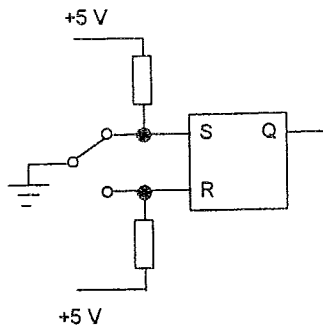


Fig. 2.61 Debouncing a SPDT switch




Fig. 2.62 Debouncing a SPDT switch

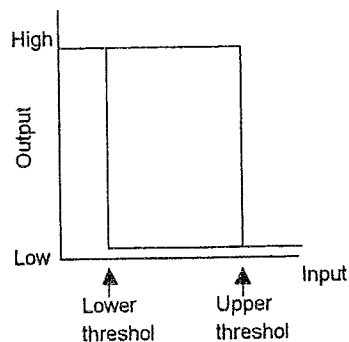


Fig. 2.63 Schmitt trigger

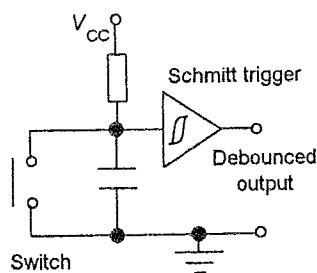


Fig. 2.64 Debouncing

bouncing has ceased and the switch is in the same closed position, the next part of the program can take place. The hardware solution to the bounce problem is based on the use of a flip-flop. Figure 2.61 shows a circuit for debouncing a SPDT switch which is based on the use of a SR flip-flop (see Section 14.7). As shown, we have S at 0 and R at 1 with an output of 0. When the switch is moved to its lower position, initially S becomes 1 and R becomes 0. This gives an output of 1. Bouncing in changing S from 1 to 0 to 1 to 0, etc. gives no change in the output. Such a flip-flop can be derived from two NOR or two NAND gates. A SPDT switch can be debounced by the use of a D flip-flop (see Section 14.7). Figure 2.62 shows the circuit. The output from such a flip-flop only changes when the clock signal changes. Thus by choosing a clock period which is greater than the time for which the bounces last, say 20 ms, the bounce signals will be ignored.

An alternative method of debouncing using hardware is to use a *Schmitt trigger*. This device has the 'hysteresis' characteristic shown in Figure 2.63. When the input voltage is beyond an upper switching threshold and giving a low output, then the input voltage needs to fall below the lower threshold before the output can switch to high. Conversely, when the input voltage is below the lower switching threshold and giving a high, then the input needs to rise above the upper threshold before the output can switch to low. Such a device can be used to sharpen slowly changing signals; when the signal passes the switching threshold it becomes a sharply defined edge between two well-defined logic levels. The circuit shown in Figure 2.64 can be used for debouncing, note the circuit symbol for a Schmitt trigger. With the switch open, the capacitor becomes charged and the voltage applied to the Schmitt trigger becomes high and so it gives a low output. When the switch is closed, the capacitor discharges very rapidly and so the first bounce discharges the capacitor; the Schmitt trigger thus switches to give a high output. Successive switch bounces do not have time to recharge the capacitor to the required threshold value and so further bounces do not switch the Schmitt trigger.

2.12.2 Keypads

A keypad is an array of switches, perhaps the keyboard of a computer or the touch input membrane pad for some device such as a microwave oven. A contact type key of the form generally used with a keyboard is shown in Figure 2.65(a), depressing the key plunger forces the contacts together with the spring returning the key to the off position when the key is released. A typical membrane switch (Fig. 2.65(b)) is built up from two wafer-thin plastic films on which conductive layers have been printed. These layers are separated by a spacer layer. When the switch area of the membrane is pressed, the top contact layer closes with the

bottom one to make the connection and then opens when the pressure is released.

While each switch in such arrays could be connected to individually give signals when closed, a more economical method is to connect them in an array in that an individual output is not needed for each key but each key gives a unique row-column combination. Figure 2.66 shows the connections for a 16-way keypad.

Problems

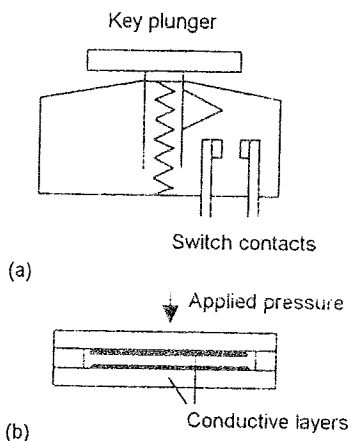


Fig. 2.65 (a) Contact key,
(b) membrane key

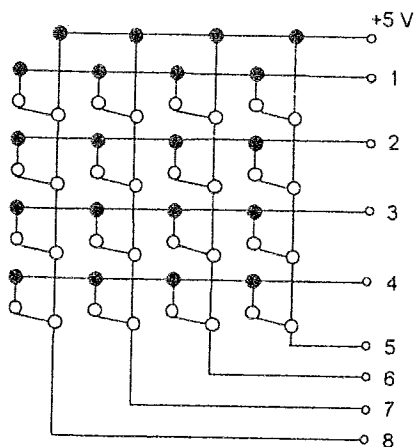


Fig. 2.66 16-way keypad

- 1 Explain the significance of the following information given in the specification of transducers:
 - (a) A piezoelectric accelerometer.
Non-linearity: $\pm 0.5\%$ of full range.
 - (b) A capacitive linear displacement transducer.
Non-linearity and hysteresis: $\pm 0.01\%$ of full range
 - (c) A resistance strain gauge force measurement transducer.
Temperature sensitivity: $\pm 1\%$ of full range over normal environmental temperatures.
 - (d) A capacitance fluid pressure transducer.
Accuracy: $\pm 1\%$ of displayed reading.
 - (e) Thermocouple.
Sensitivity: nickel chromium-nickel aluminium thermocouple: $0.039 \text{ mV}/^\circ\text{C}$ when the cold junction is at 0°C .
 - (f) Gyroscope for angular velocity measurement.
Repeatability: $\pm 0.01\%$ of full range.
 - (g) Inductive displacement transducer.
Linearity: $\pm 1\%$ of rated load.
 - (h) Load cell.
Total error due to non-linearity, hysteresis and non-repeatability: $\pm 0.1\%$.
- 2 A copper-constantan thermocouple is to be used to measure temperatures between 0 and 200°C . The e.m.f. at 0°C is 0 mV , at 100°C it is 4.277 mV and at 200°C it is 9.286 mV . What will be the non-linearity error at 100°C as a percentage of the full range output if a linear relationship is assumed between e.m.f. and temperature over the full range?
- 3 A thermocouple element when taken from a liquid at 50°C and plunged into a liquid at 100°C at time $t = 0$ gave the following e.m.f. values. Determine the 95% response time.

Time (s)	0	20	40	60	80	100	120
e.m.f. (mV)	2.5	3.8	4.5	4.8	4.9	5.0	5.0
- 4 What is the non-linearity error, as a percentage of full range, produced when a $1 \text{ k}\Omega$ potentiometer has a load of $10 \text{ k}\Omega$ and is at one-third of its maximum displacement?

- 5 What will be the change in resistance of an electrical resistance strain gauge with a gauge factor of 2.1 and resistance $50\ \Omega$ if it is subject to a strain of 0.001?
- 6 You are offered a choice of an incremental shaft encoder or an absolute shaft encoder for the measurement of an angular displacement. What is the principal difference between the results that can be obtained by these methods?
- 7 A shaft encoder is to be used with a 50 mm radius tracking wheel to monitor linear displacement. If the encoder produces 256 pulses per revolution, what will be the number of pulses produced by a linear displacement of 200 mm?
- 8 A rotary variable differential transformer has a specification which includes the following information:

Ranges: $\pm 30^\circ$, linearity error $\pm 0.5\%$ full range
 $\pm 60^\circ$, linearity error $\pm 2.0\%$ full range

Sensitivity: 1.1 (mV/V input)/degree

Impedance: Primary $750\ \Omega$, Secondary $2000\ \Omega$

What will be (a) the error in a reading of 40° due to non-linearity when the RDVT is used on the $\pm 60^\circ$ range, and (b) the output voltage change that occurs per degree if there is an input voltage of 3 V?

- 9 What are the advantages and disadvantages of the plastic film type of potentiometer when compared with the wire-wound potentiometer?
- 10 A pressure sensor consisting of a diaphragm with strain gauges bonded to its surface has the following information in its specification:

Ranges: 0 to 1400 kPa, 0 to 35 000 kPa

Non-linearity error: $\pm 0.15\%$ of full range

Hysteresis error: $\pm 0.05\%$ of full range

What is the total error due to non-linearity and hysteresis for a reading of 1000 kPa on the 0 to 1400 kPa range?

- 11 The water level in an open vessel is to be monitored by a differential pressure cell responding to the difference in pressure between that at the base of the vessel and the atmosphere. Determine the range of differential pressures the cell will have to respond to if the water level can vary between zero height above the cell measurement point and 2 m above it.
- 12 An iron-constantan thermocouple is to be used to measure temperatures between 0 and 400°C . What will be the non-linearity error as a percentage of the full-scale reading at 100°C if a linear relationship is assumed between e.m.f. and temperature?

E.m.f. at $100^\circ\text{C} = 5.268\ \text{mV}$; e.m.f. at $400^\circ\text{C} = 21.846\ \text{mV}$

- 13 A platinum resistance temperature detector has a resistance of $100.00\ \Omega$ at 0°C , $138.50\ \Omega$ at 100°C and $175.83\ \Omega$ at 200°C . What will be the non-linearity error in $^\circ\text{C}$ at 100°C if the detector is assumed to have a linear relationship between 0 and 200°C ?
- 14 A strain gauge pressure sensor has the following specification. Will it be suitable for the measurement of pressure of the order of $100\ \text{kPa}$ to an accuracy of $\pm 5\ \text{kPa}$ in an environment where the temperature is reasonably constant at about 20°C ?
- Ranges: 2 to $70\ \text{MPa}$, $70\ \text{kPa}$ to $1\ \text{MPa}$
 Excitation: $10\ \text{V d.c.}$ or a.c. (r.m.s.)
 Full range output: $40\ \text{mV}$
 Non-linearity and hysteresis errors: $\pm 0.5\ \%$
 Temperature range: -54 to $+120^\circ\text{C}$
 Thermal shift zero: 0.030% full range output/ $^\circ\text{C}$
 Thermal shift sensitivity: 0.030% full range output/ $^\circ\text{C}$
- 15 A float sensor for the determination of the level of water in a vessel has a cylindrical float of mass $2.0\ \text{kg}$, cross-sectional area $20\ \text{cm}^2$ and a length of $1.5\ \text{m}$. It floats vertically in the water and presses upwards against a beam attached to its upward end. What will be the minimum and maximum upthrust forces exerted by the float on the beam? Suggest a means by which the deformation of the beam under the action of the upthrust force could be monitored.
- 16 Suggest a sensor that could be used as part of the control system for a furnace to monitor the rate at which the heating oil flows along a pipe. The output from the measurement system is to be an electrical signal which can be used to adjust the speed of the oil pump. The system must be capable of operating continuously and automatically, without adjustment, for long periods of time.
- 17 Suggest a sensor that could be used, as part of a control system, to determine the difference in levels between liquids in two containers. The output is to provide an electrical signal for the control system.
- 18 Suggest a sensor that could be used as part of a system to control the thickness of rolled sheet by monitoring its thickness as it emerges from rollers. The sheet metal is in continuous motion and the measurement needs to be made quickly to enable corrective action to be made quickly. The measurement system has to supply an electrical signal.

3 Signal conditioning

3.1 Signal conditioning

The output signal from the sensor of a measurement system has generally to be processed in some way to make it suitable for the next stage of the operation. The signal may be, for example, too small and have to be amplified, contain interference which has to be removed, be non-linear and require linearisation, be analogue and have to be made digital, be digital and have to be made analogue, be a resistance change and have to be made into a current change, be a voltage change and have to be made into a suitable size current change, etc. All these changes can be referred to as *signal conditioning*. For example, the output from a thermocouple is a small voltage, a few millivolts. A signal conditioning module might then be used to convert this into a suitable size current signal, provide noise rejection, linearisation, and cold junction compensation (i.e. compensating for the cold junction not being at 0°C).

3.1.1 Interfacing with a microprocessor

Input and output devices are connected to a microprocessor system through *ports*. The term *interface* is used for the item that is used to make connections between devices and a port. Thus there could be inputs from sensors, switches, and keyboards and outputs to displays and actuators. The simplest interface could be just a piece of wire. However, the interface often contains signal conditioning and protection, the protection being to prevent damage to the microprocessor system. For example, inputs needing to be protected against excessive voltages or signals of the wrong polarity.

Microprocessors require inputs which are digital, thus a conversion of analogue to digital signal is necessary if the output from a sensor is analogue. However, many sensors generate only a very small signal, perhaps a few millivolts. Such a signal is insufficient to be directly converted from analogue to digital without first being amplified. Signal conditioning might also be

needed with digital signals to improve their quality. The interface may thus contain a number of elements.

There is also the output from a microprocessor, perhaps to operate an actuator. A suitable interface is also required here. The actuator might require an analogue signal and so the digital output from the microprocessor needs converting to an analogue signal. There can also be a need for protection to stop any signal becoming inputted back through the output port to damage the microprocessor.

3.1.2 Signal-conditioning processes

The following are some of the processes that can occur in conditioning a signal:

- 1 *Protection* to prevent damage to the next element, e.g. a microprocessor, as a result of high current or voltage. Thus there can be series current-limiting resistors, fuses to break if the current is too high, polarity protection and voltage limitation circuits (see Section 3.3).
- 2 Getting the signal into the *right type of signal*. This can mean making the signal into a d.c. voltage or current. Thus, for example, the resistance change of a strain gauge has to be converted into a voltage change. This can be done by the use of a Wheatstone bridge and using the out-of-balance voltage (see Section 3.5). It can mean making the signal digital or analogue (see Section 3.6 for analogue-to-digital and analogue-to-digital converters).
- 3 Getting the *level* of the signal right. The signal from a thermocouple might be just a few millivolts. If the signal is to be fed into an analogue-to-digital converter for inputting to a microprocessor then it needs to be made much larger, volts rather than millivolts. Operational amplifiers are widely used for amplification (see Section 3.2).
- 4 Eliminating or reducing *noise*. For example, filters might be used to eliminate mains noise from a signal (see Section 3.4).
- 5 *Signal manipulation*, e.g. making it a linear function of some variable. The signals from some sensors, e.g. a flowmeter, are non-linear and thus a signal conditioner might be used so that the signal fed on to the next element is linear (see Section 3.2.6).

The following sections outline some of the elements that might be used in signal conditioning.

3.2 The operational amplifier

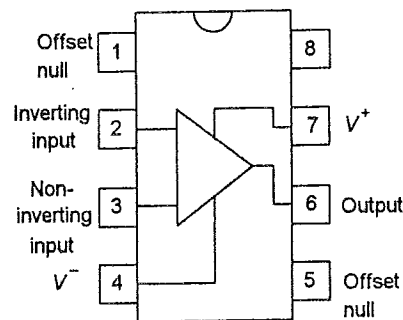


Fig. 3.1 Pin connections for a 741 operational amplifier

The basis of many signal conditioning modules is the *operational amplifier*. The operational amplifier is a high gain d.c. amplifier, the gain typically being of the order of 100 000 or more, that is supplied as an integrated circuit on a silicon chip. It has two inputs, known as the inverting input (-) and the non-inverting input (+). The output depends on the connections made to these inputs. There are other inputs to the operational amplifier, namely a negative voltage supply, a positive voltage supply and two inputs termed offset null, these being to enable corrections to be made for the non-ideal behaviour of the amplifier (see Section 3.2.8). Figure 3.1 shows the pin connections for a 741 type operational amplifier.

The following indicates the types of circuits that might be used with operational amplifiers when used as signal conditioners. For more details the reader is referred to more specialist texts, e.g. *Feedback Circuits and Op. Amps* by D.H. Horrocks (Chapman and Hall 1990) or *Analysis and Design of Analog Integrated Circuits* by P.R. Gray and R.G. Meyer (Wiley 1993).

3.2.1 Inverting amplifier

Figure 3.2 shows the connections made to the amplifier when used as an *inverting amplifier*. The input is taken to the inverting input through a resistor R_1 with the non-inverting input being connected to ground. A feedback path is provided from the output, via the resistor R_2 to the inverting input. The operational amplifier has a voltage gain of about 100 000 and the change in output voltage is typically limited to about ± 10 V. The input voltage must then be between $+0.0001$ V and -0.0001 V. This is virtually zero and so point X is at virtually earth potential. For this reason it is called a *virtual earth*. The potential difference across R_1 is $(V_{in} - V_X)$. Hence, for an ideal operational amplifier with an infinite gain, and hence $V_X = 0$, the input potential V_{in} can be considered to be across R_1 . Thus

$$V_{in} = I_1 R_1$$

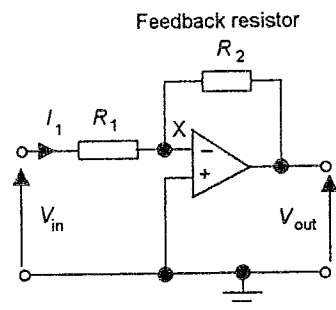


Fig. 3.2 Inverting amplifier

The operational amplifier has a very high impedance between its input terminals; for a 741 about $2 \text{ M}\Omega$. Thus virtually no current flows through X into it. For an ideal operational amplifier the input impedance is taken to be infinite and so there is no current flow through X. Hence the current I_1 through R_1 must be the current through R_2 . The potential difference across R_2 is $(V_X - V_{out})$ and thus, since V_X is zero for the ideal amplifier, the potential difference across R_2 is $-V_{out}$. Thus

$$-V_{out} = I_1 R_2$$

Dividing these two equations:

$$\text{Voltage gain of circuit} = \frac{V_{\text{out}}}{V_{\text{in}}} = -\frac{R_2}{R_1}$$

Thus the voltage gain of the circuit is determined solely by the relative values of R_2 and R_1 . The negative sign indicates that the output is inverted, i.e. 180° out of phase, with respect to the input.

To illustrate the above, consider an inverting operational amplifier circuit which has a resistance of $1 \text{ M}\Omega$ in the inverting input line and a feedback resistance of $10 \text{ M}\Omega$. What is the voltage gain of the circuit?

$$\text{Voltage gain of circuit} = \frac{V_{\text{out}}}{V_{\text{in}}} = -\frac{R_2}{R_1} = -\frac{10}{1} = -10$$

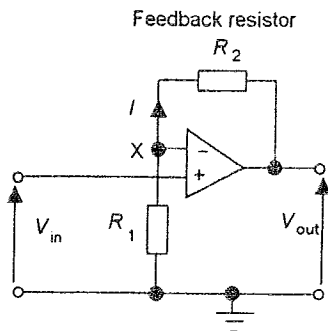


Fig. 3.3 Non-inverting amplifier

3.2.2 Non-inverting amplifier

Figure 3.3 shows the operational amplifier connected as a non-inverting amplifier. The output can be considered to be taken from across a potential divider circuit consisting of R_1 in series with R_2 . The voltage V_X is then the fraction $R_1/(R_1 + R_2)$ of the output voltage.

$$V_X = \frac{R_1}{R_1 + R_2} V_{\text{out}}$$

Since there is virtually no current through the operational amplifier between the two inputs there can be virtually no potential difference between them. Thus, with the ideal operational amplifier, we must have $V_X = V_{\text{in}}$. Hence

$$\text{Voltage gain of circuit} = \frac{V_{\text{out}}}{V_{\text{in}}} = \frac{R_1 + R_2}{R_1} = 1 + \frac{R_2}{R_1}$$

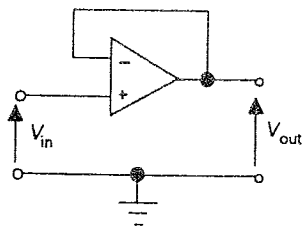


Fig. 3.4 Voltage follower

A particular form of this amplifier is when the feedback loop is a short circuit, i.e. $R_2 = 0$. Then the voltage gain is 1. The input to the circuit is into a large resistance, the input resistance typically being $2 \text{ M}\Omega$. The output resistance, i.e. the resistance between the output terminal and the ground line is, however, much smaller, e.g. 75Ω . Thus the resistance in the circuit that follows is a relatively small one and is less likely to load that circuit. Such an amplifier is referred to as a *voltage follower*; Figure 3.4 showing the basic circuit.

3.2.3 Summing amplifier

Figure 3.5 shows the circuit of a summing amplifier. As with the inverting amplifier (Section 3.2.1), X is a virtual earth. Thus the sum of the currents entering X must equal that leaving it. Hence

$$I = I_A + I_B + I_C$$

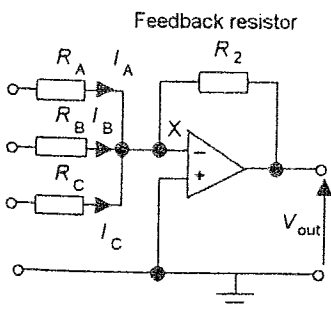


Fig. 3.5 Summing amplifier

But $I_A = V_A/R_A$, $I_B = V_B/R_B$ and $I_C = V_C/R_C$. Also we must have the same current I passing through the feedback resistor. The potential difference across R_2 is $(V_X - V_{out})$. Hence, since V_X can be assumed to be zero, it is $-V_{out}$ and so $I = -V_{out}/R_2$. Thus

$$-\frac{V_{out}}{R_2} = \frac{V_A}{R_A} + \frac{V_B}{R_B} + \frac{V_C}{R_C}$$

The output is thus the scaled sum of the inputs, i.e.

$$V_{out} = -\left(\frac{R_2}{R_A}V_A + \frac{R_2}{R_B}V_B + \frac{R_2}{R_C}V_C\right)$$

If $R_A = R_B = R_C = R_1$ then

$$V_{out} = -\frac{R_1}{R_2}(V_A + V_B + V_C)$$

To illustrate the above, consider the design of a circuit that can be used to produce an output voltage which is the average of the input voltages from three sensors. Assuming that an inverted output is acceptable, a circuit of the form shown in Figure 3.5 can be used. Each of the three inputs must be scaled to 1/3 to give an output of the average. Thus a voltage gain of the circuit of 1/3 for each of the input signals is required. Hence, if the feedback resistance is 4 k Ω the resistors in each input arm will be 12 k Ω .

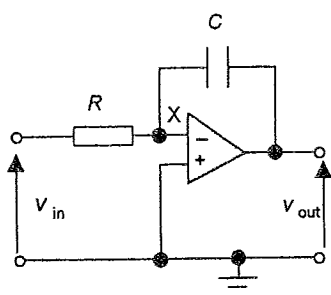


Fig. 3.6 Integrating amplifier

3.2.4 Integrating amplifier

Consider an inverting operational amplifier circuit with the feedback being via a capacitor, as illustrated in Figure 3.6. Current is the rate of movement of charge q and since for a capacitor the charge $q = Cv$, where v is the voltage across it, then the current through the capacitor $i = dq/dt = C dv/dt$. The potential difference across C is $(v_X - v_{out})$ and since v_X is effectively zero, being the virtual earth, it is $-v_{out}$. Thus the current through the capacitor is $-C dv_{out}/dt$. But this is also the current through the input resistance R . Hence

$$\frac{v_{in}}{R} = -C \frac{dv_{out}}{dt}$$

Rearranging this gives

$$dv_{out} = -\left(\frac{1}{RC}\right)v_{in} dt$$

Integrating both sides gives

$$v_{out}(t_2) - v_{out}(t_1) = -\frac{1}{RC} \int_{t_1}^{t_2} v_{in} dt$$

$v_{out}(t_2)$ is the output voltage at time t_2 and $v_{out}(t_1)$ is the output voltage at time t_1 . The output is proportional to the integral of the input voltage, i.e. the area under a graph of input voltage with time.

A differentiation circuit can be produced if the capacitor and resistor are interchanged in the circuit for the integrating amplifier.

3.2.5 Differential amplifier

A differential amplifier is one that amplifies the difference between two input voltages. Figure 3.7 shows the circuit. Since there is virtually no current through the high resistance in the operational amplifier between the two input terminals, there is no potential drop and thus both the inputs X will be at the same potential. The voltage V_2 is across resistors R_1 and R_2 in series. Thus the potential V_X at X is

$$\frac{V_X}{V_2} = \frac{R_2}{R_1 + R_2}$$

The current through the feedback resistance must be equal to that from V_1 through R_1 . Hence

$$\frac{V_1 - V_X}{R_1} = \frac{V_X - V_{out}}{R_2}$$

This can be rearranged to give

$$\frac{V_{out}}{R_2} = V_X \left(\frac{1}{R_2} + \frac{1}{R_1} \right) - \frac{V_1}{R_1}$$

Hence substituting for V_X using the earlier equation,

$$V_{out} = \frac{R_2}{R_1} (V_2 - V_1)$$

The output is thus a measure of the difference between the two input voltages.

As an illustration of the use of such a circuit with a sensor, Figure 3.8 shows it used with a thermocouple. The difference in voltage between the e.m.f.s of the two junctions of the thermocouple is being amplified. The values of R_1 and R_2 can, for example, be chosen to give a circuit with an output of 10 mV for a temperature difference between the thermocouple junctions of 10°C if such a temperature difference produces an e.m.f. difference between the junctions of 530 μ V. For the circuit we have

$$V_{out} = \frac{R_2}{R_1} (V_2 - V_1)$$


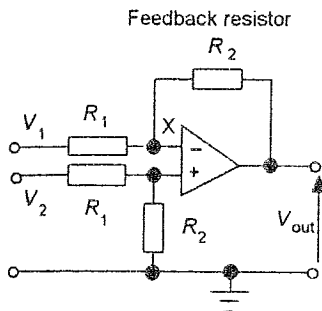


Fig. 3.7 Differential amplifier

Fig. 3.8 Differential amplifier with a thermocouple

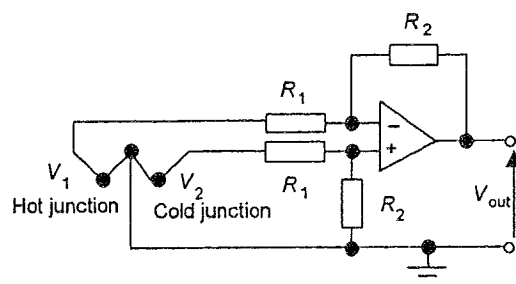

$$10 \times 10^{-3} = \frac{R_2}{R_1} \times 530 \times 10^{-6}$$

Hence $R_2/R_1 = 18.9$. Thus if we take for R_1 a resistance of $10 \text{ k}\Omega$ then R_2 must be $189 \text{ k}\Omega$.

A differential amplifier might be used with a Wheatstone bridge (see Section 3.5), perhaps one with strain gauge sensors in its arms, to amplify the out-of-balance potential difference that occurs when the resistance in one or more arms changes. When the bridge is balanced both the output terminals of the bridge are at the same potential; there is thus no output potential difference. The output terminals from the bridge might both be at, say, 5.00 V . Thus the differential amplifier has both its inputs at 5.00 V . When the bridge is no longer balanced we might have one output terminal at 5.01 V and the other at 4.99 V and so the inputs to the differential amplifier are 5.01 and 4.99 V . The amplifier amplifies this difference in the voltages of 0.02 V . The original 5.00 V signal which is common to both inputs is termed the *common mode voltage* V_{CM} . For the amplifier only to amplify the difference between the two signals assumes that the two input channels are perfectly matched and the operational amplifier has the same, high, gain for both of them. In practice this is not perfectly achieved and thus the output is not perfectly proportional to the difference between the two input voltages. Thus we write for the output:

$$V_{out} = G_d \Delta V + G_{CM} V_{CM}$$

where G_d is the gain for the voltage difference ΔV , G_{CM} the gain for the common mode voltage V_{CM} . The smaller the value of G_{CM} the smaller the effect of the common mode voltage on the output. The extent to which an operational amplifier deviates from the ideal situation is specified by the *common mode rejection ratio* (CMRR):

$$\text{CMRR} = \frac{G_d}{G_{CM}}$$

To minimise the effect of the common mode voltage on the output, a high CMRR is required. Common mode rejection ratios are generally specified in decibels (dB). Thus, on the decibel scale a CMRR of, say, 10 000 would be $20 \lg 10\,000 = 80$ dB. A typical operational amplifier might have a CMRR between about 80 and 100 dB.

A common form of *instrumentation amplifier* involves three operational amplifiers (Fig. 3.9), rather than just a single differential amplifier, and is available as a single integrated circuit. Such a circuit is designed to have a high input impedance, typically about $300\text{ M}\Omega$, a high voltage gain and excellent CMRR, typically more than 100 dB. The first stage involves the amplifiers A_1 and A_2 , one being connected as an inverting amplifier and the other as a non-inverting amplifier. Amplifier A_3 is a differential amplifier with inputs from A_1 and A_2 .

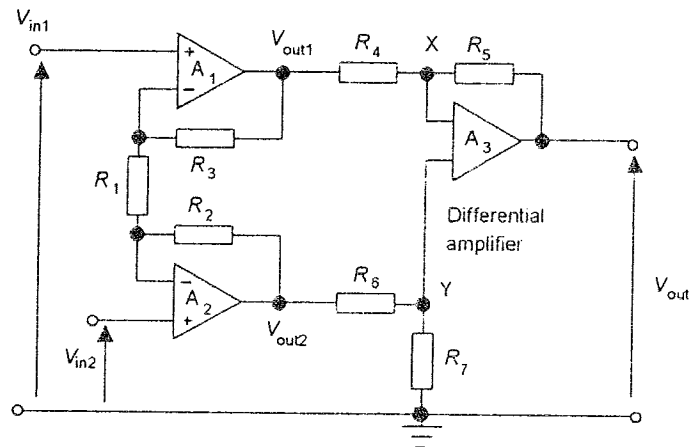


Fig. 3.9 Instrumentation amplifier

Because virtually no current passes through A_3 , the current through R_4 will be the same as that through R_5 . Hence:

$$\frac{V_{out1} - V_X}{R_4} = \frac{V_X - V_{out}}{R_5}$$

The differential input to A_3 is virtually zero so $V_Y = V_X$. Hence the above equation can be written as:

$$V_{out} = \left(1 + \frac{R_5}{R_4}\right) V_Y - \frac{R_5}{R_4} V_{out1}$$

R_6 and R_7 form a potential divider for the voltage V_{out2} so that:

$$V_Y = \frac{R_6}{R_6 + R_7} V_{out2}$$

Hence we can write:

$$V_{out} = \frac{1 + \frac{R_5}{R_4}}{1 + \frac{R_7}{R_6}} V_{out2} - \frac{R_5}{R_4} V_{out1}$$

Hence by suitable choice of resistance values we obtain equal multiplying factors for the two inputs to the differential amplifier. This requires:

$$1 + \frac{R_5}{R_4} = \left(1 + \frac{R_7}{R_6}\right) \frac{R_5}{R_4}$$

and hence $R_4/R_5 = R_6/R_7$.

We can apply the principle of superposition, i.e. we can consider the output produced by each source acting alone and then add them to obtain the overall response. Amplifier A_1 has an input of the differential signal V_{in1} on its non-inverting input and amplifies this with a gain of $1 + R_3/R_1$. It also has an input of V_{in2} on its inverting input and this is amplified to give a gain of $-R_3/R_1$. Also the common mode voltage V_{cm} on the non-inverting input is amplified by A_1 . Thus the output of A_1 is:

$$V_{out1} = \left(1 + \frac{R_3}{R_1}\right) V_{in1} - \left(\frac{R_3}{R_1}\right) V_{in2} + \left(1 + \frac{R_3}{R_1}\right) V_{cm}$$

Amplifier A_2 likewise gives:

$$V_{out2} = \left(1 + \frac{R_2}{R_1}\right) V_{in2} - \left(\frac{R_2}{R_1}\right) V_{in1} + \left(1 + \frac{R_2}{R_1}\right) V_{cm}$$

The differential input to A_3 is $V_{out1} - V_{out2}$ and so:


$$V_{out2} - V_{out1} = \left(1 + \frac{R_3}{R_1} + \frac{R_2}{R_1}\right) V_{in1} - \left(1 + \frac{R_2}{R_3} + \frac{R_3}{R_1}\right) V_{in2} + \left(\frac{R_3}{R_1} - \frac{R_2}{R_1}\right) V_{cm}$$

With $R_2 = R_3$ the common mode voltage term disappears, thus:

$$V_{out2} - V_{out1} = \left(1 + \frac{2R_2}{R_1}\right) (V_{in1} - V_{in2})$$

The overall gain is thus $(1 + 2R_2/R_1)$ and is generally set by varying R_1 .

Figure 3.10 shows the pin connections and some specification details for a low cost, general-purpose instrumentation amplifier (Burr-Brown INA114) using this three op-amps form of design. The gain is set by connecting an external resistor R_G between pins 1 and 8, the gain then being $1 + 50/R_G$ when R_G is in $k\Omega$. The 50 $k\Omega$ term arises from the sum of the two internal feedback resistors.

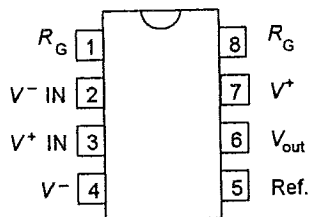

Input impedance, differential
common mode: $10^{10} \Omega$ in parallel
with 6 pF
Input common mode range: ± 13.5 V
Common mode rejection,
G = 1: 90 dB, G = 1000: 110 dB
Gain range 1 to 10 000
Gain error: 2% max.
Output voltage: ± 13.7 V ($V_s = \pm 15$ V)

Fig. 3.10 INA114

3.2.6 Logarithmic amplifier

Some sensors have outputs which are non-linear. For example, the output from a thermocouple is not a perfectly linear function of the temperature difference between its junctions. A signal conditioner might then be used to linearise the output from such a sensor. This can be done using an operational amplifier circuit which is designed to have a non-linear relationship between its input and output so that when its input is non-linear the output is linear. This is achieved by a suitable choice of component for the feedback loop.

The logarithmic amplifier shown in Figure 3.11 is an example of such a signal conditioner. The feedback loop contains a diode (or a transistor with a grounded base). The diode has a non-linear characteristic. It might be represented by $V = C \ln I$, where C is a constant. Then, since the current through the feedback loop is the same as the current through the input resistance and the potential difference across the diode is $-V_{out}$, we have

$$V_{out} = -C \ln (V_{in}/R) = K \ln V_{in}$$

where K is some constant. However, if the input V_{in} is provided by a sensor with an input t , where $V_{in} = A e^{at}$, with A and a being constants, then

$$V_{out} = K \ln V_{in} = K \ln (A e^{at}) = K \ln A + Kat$$

The result is a linear relationship between V_{out} and t .

3.2.7 Comparator

A comparator indicates which of two voltages is the larger. An operational amplifier used with no feedback or other components can be used as a comparator. One of the voltages is applied to the inverting input and the other to the non-inverting input (Fig. 3.12(a)). Figure 3.12(b) shows the relationship between the output voltage and the difference between the two input voltages. When the two inputs are equal there is no output. However, when the non-inverting input is greater than the inverting input by more than a small fraction of a volt then the output jumps to a steady positive saturation voltage of typically +10 V. When the inverting input is greater than the non-inverting input then the output jumps to a steady negative saturation voltage of typically -10 V. Such a circuit can be used to determine when a voltage exceeds a certain level, the output then being used to perhaps initiate some action.

As an illustration of such a use, consider the circuit shown in Figure 3.13. This is designed so that when a critical temperature is reached a relay is activated and initiates some response. The circuit has a Wheatstone bridge with a thermistor in one arm. The

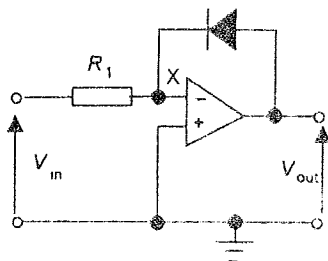


Fig. 3.11 Logarithmic amplifier

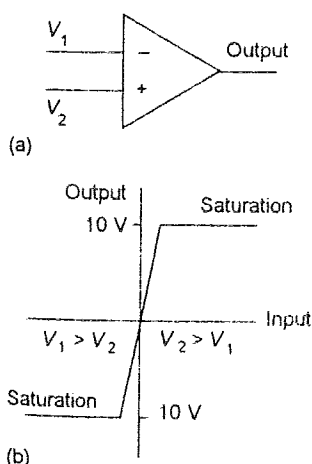


Fig. 3.12 Comparator

resistors in the bridge have their resistances selected so that at the critical temperature the bridge will be balanced. When the temperature is below this value the thermistor resistance R_1 is more than R_2 and the bridge is out-of-balance. As a consequence there is a voltage difference between the inputs to the operational amplifier and it gives an output at its lower saturated level. This keeps the transistor off, i.e. both the base-emitter and base-collector junctions are reverse biased, and so no current passes through the relay coil. When the temperature rises and the resistance of the thermistor falls, the bridge becomes balanced and the operational amplifier then switches to its upper saturation level. Consequently the transistor is switched on, i.e. its junctions become forward biased, and the relay energised.

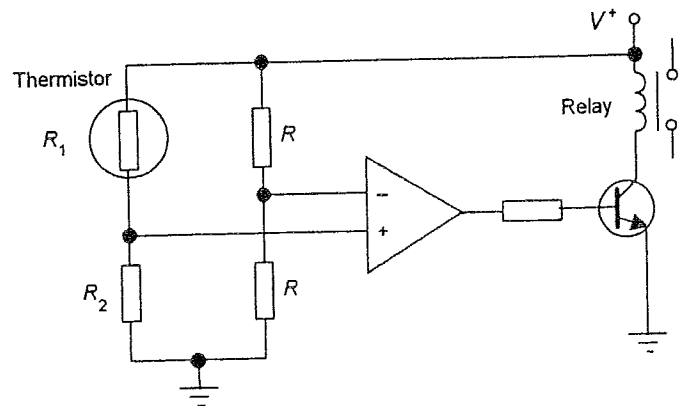


Fig. 3.13 Temperature switch circuit

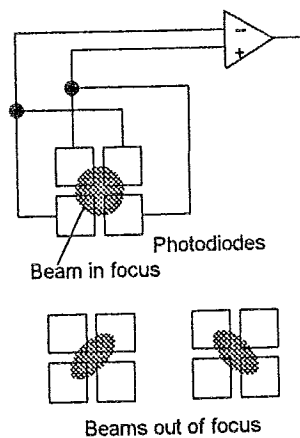


Fig. 3.14 Focusing system for a CD player

As another illustration of the use of a comparator, consider the system used to ensure that in a compact disc player the laser beam is focused on the disc surface. With a CD player, lenses are used to focus a laser beam onto a CD, this having the audio information stored as a sequence of microscopic pits and flats. The light is reflected back from the disc to an array of four photodiodes (Fig. 3.14). The output from these photodiodes is then used to reproduce the sound. The reason for having four photodiodes is that the array can also be used to determine whether the beam of laser light is in focus. When the beam is in focus on the disc then a circular spot of light falls on the photodiode array with equal amounts of light falling on each photodiode. As a result the output from the operational amplifier, which is connected as a comparator, is zero. When the beam is out of focus an elliptical spot of light is produced. This results in different amounts of light falling on each of the photocells. The outputs from the two diagonal sets of cells are compared and, because they are different, the comparator gives an output which indicates that the beam is out of focus and in which direction it is out of focus. The output can then be used to initiate correcting action by adjusting the lenses focusing the beam onto the disc.

3.2.8 Amplifier errors

Operational amplifiers are not in the real world the perfect (ideal) element discussed in the previous sections of this chapter. A particularly significant problem is that of the *offset voltage*.

An operational amplifier is a high gain amplifier which amplifies the difference between its two inputs. Thus if the two inputs are shorted we might expect to obtain no output. However, in practice this does not occur and quite a large output voltage might be detected. This effect is produced by imbalances in the internal circuitry in the operational amplifier. The output voltage can be made zero by applying a suitable voltage between the input terminals. This is known as the *offset voltage*. Many operational amplifiers are provided with arrangements for applying such an offset voltage via a potentiometer. With the 741 this is done by connecting a 10 k Ω potentiometer between pins 1 and 5 (see Fig. 3.1) and connecting the sliding contact of the potentiometer to a negative voltage supply (Fig. 3.15). The imbalances within the operational amplifier are corrected by adjusting the position of the slider until with no input to the amplifier there is no output.

For more details of this, and other non-ideal characteristics, the reader is referred to the texts listed in Section 3.1




Fig. 3.15 Correcting the offset voltage

3.3 Protection

There are many situations where the connection of a sensor to the next unit, e.g. a microprocessor, can lead to the possibility of damage as a result of perhaps a high current or high voltage. A high current can be protected against by the incorporation in the input line of a series resistor to limit the current to an acceptable level and a fuse to break if the current does exceed a safe level. High voltages, and wrong polarity, may be protected against by the use of a Zener diode circuit (Fig. 3.16). Zener diodes behave like ordinary diodes up to some breakdown voltage when they become conducting. Thus to allow a maximum voltage of 5 V but stop voltages above 5.1 V getting through, a Zener diode with a voltage rating of 5.1 V might be chosen. When the voltage rises to 5.1 V the Zener diode breakdown and its resistance drops to a very low value. The result is that the voltage across the diode, and hence that outputted to the next circuit, drops. Because the Zener diode is a diode with a low resistance for current in one direction through it and a high resistance for the opposite direction, it also provides protection against wrong polarity. It is connected with the correct polarity to give a high resistance across the output and so a high voltage drop. When the supply polarity is reversed, the diode has low resistance and so little voltage drop occurs across the output.

In some situations it is desirable to isolate circuits completely and remove all electrical connections between them. This can be done using an *optoisolator*. Thus we might have the output from a microprocessor applied to a light-emitting diode (LED) which

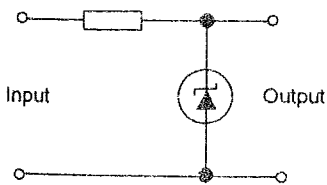


Fig. 3.16 Zener diode protection circuit

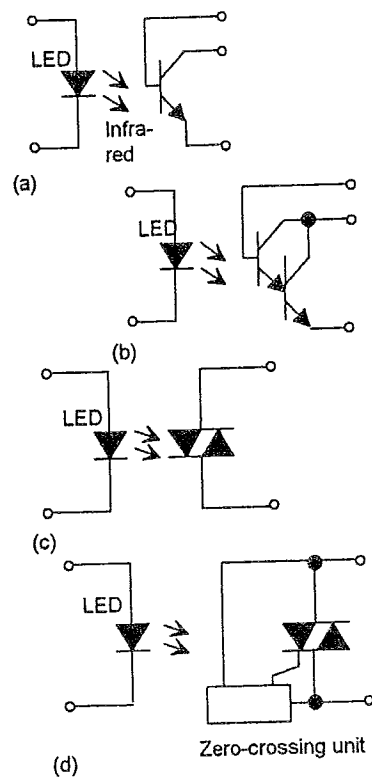


Fig. 3.17 Optoisolators:
(a) transistor, (b) Darlington, (c) triac,
(d) triac with zero-crossing unit

emits infrared radiation. This radiation is detected by a phototransistor or triac and gives rise to a current which replicates the changes occurring in the voltage applied to the LED. Figure 3.17 shows a number of forms of optoisolator. The term *transfer ratio* is used to specify the ratio of the output current to the input current. Typically, a simple transistor optoisolator (Fig. 3.17(a)) gives an output current which is smaller than the input current and a transfer ratio of perhaps 30% with a maximum value of 7 mA. However, the Darlington form (Fig. 3.17(b)) gives an output current larger than the input current, e.g. the Siemens 6N139 gives a transfer ratio of 800% with a maximum output value of 60 mA. Another form of optoisolator (Fig. 3.17(c)) uses the triac and so can be used with alternating current, a typical triac optoisolator being able to operate with the mains voltage. Yet another form (Fig. 3.17(d)) uses a triac with a zero-crossing unit, e.g. Motorola MOC3011, to reduce transients and electromagnetic interference.

Optoisolator outputs can be used to directly switch low-power load circuits. Thus a Darlington optoisolator might be used as the interface between a microprocessor and lamps or relays. To switch a high-power circuit, an optocoupler might be used to operate a relay and so use the relay to switch the high-power device.

A protection circuit for a microprocessor input is thus likely to be like that shown in Figure 3.18; to prevent the LED having the wrong polarity or too high an applied voltage, it is also likely to be protected by the Zener diode circuit shown in Figure 3.16 and if there is alternating signal in the input a diode would be put in the input line to rectify it.

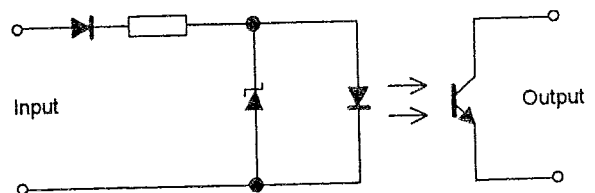


Fig. 3.18 Protection circuit

3.4 Filtering

The term *filtering* is used to describe the process of removing a certain band of frequencies from a signal and permitting others to be transmitted. The range of frequencies passed by a filter is known as the *pass band*, the range not passed as the *stop band* and the boundary between stopping and passing as the *cut-off frequency*. Filters are classified according to the frequency ranges they transmit or reject. A *low-pass filter* (Fig. 3.19(a)) has a pass band which allows all frequencies from 0 up to some frequency to be transmitted. A *high-pass filter* (Fig. 3.19(b)) has a pass band which allows all frequencies from some value up to infinity to be transmitted. A *band-pass filter* (Fig. 3.19(c)) allows all the

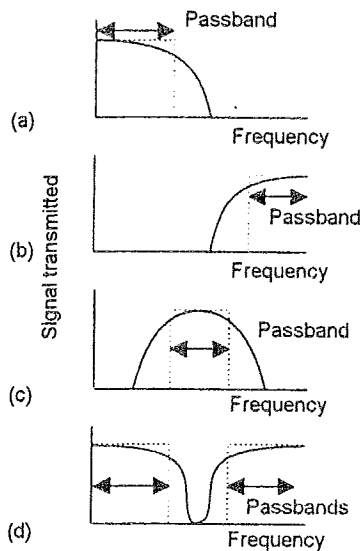


Fig. 3.19 Characteristics of ideal filters: (a) low pass, (b) high pass, (c) band pass, (d) band stop

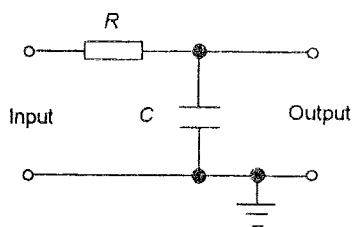


Fig. 3.20 Low-pass passive filter

3.5 Wheatstone bridge

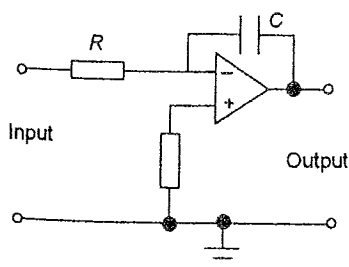


Fig. 3.21 Low-pass active filter

frequencies within a specified band to be transmitted. A *band-stop filter* (Fig. 3.19(d)) stops all frequencies with a particular band from being transmitted. In all cases the cut-off frequency is defined as being that at which the output voltage is 70.7% of that in the pass band. The term *attenuation* is used for the ratio of input and output powers, this being written as the ratio of the logarithm of the ratio and so gives the attenuation in units of bels. Since this is a rather large unit, decibels (dB) are used and then attenuation in dB = $10 \lg (\text{input power/output power})$. Since the power through an impedance is proportional to the square of the voltage the attenuation in dB = $20 \lg (\text{input voltage/output voltage})$. The output voltage of 70.7% of that in the pass band is thus an attenuation of 3 dB.

The term *passive* is used to describe a filter made up using only resistors, capacitors and inductors, the term *active* being used when the filter also involves an operational amplifier. Passive filters have the disadvantage that the current that is drawn by the item that follows can change the frequency characteristic of the filter. This problem does not occur with an active filter.

Low-pass filters are very commonly used as part of signal conditioning. This is because most of the useful information being transmitted is low frequency. Since noise tends to occur at higher frequencies, a low-pass filter can be used to block it off. Thus a low-pass filter might be selected with a cut-off frequency of 40 Hz, thus blocking off any inference signals from the a.c. mains supply and noise in general. Figure 3.20 shows the basic forms that might be used for a passive low-pass filter and Figure 3.21 a very basic form of an active low-pass filter. For more details of filters the reader is referred to *Filter Handbook* by S. Niewiadomski (Heinemann Newnes 1989).

The *Wheatstone bridge* can be used to convert a resistance change to a voltage change. Figure 3.22 shows the basic form of such a bridge. When the output voltage V_o is zero, then the potential at B must equal that at D. The potential difference across R_1 , i.e. V_{AB} , must then equal that across R_3 , i.e. V_{AD} . Thus $I_1 R_1 = I_2 R_2$. It also means that the potential difference across R_2 , i.e. V_{BC} , must equal that across R_4 , i.e. V_{DC} . Since there is no current through BD then the current through R_2 must be the same as that through R_1 and the current through R_4 the same as that through R_3 . Thus $I_1 R_2 = I_2 R_4$. Dividing these two equations gives

$$\frac{R_1}{R_2} = \frac{R_3}{R_4}$$

The bridge is said to be *balanced*.

Now consider what happens when one of the resistances changes from this balanced condition. The supply voltage V_s is connected

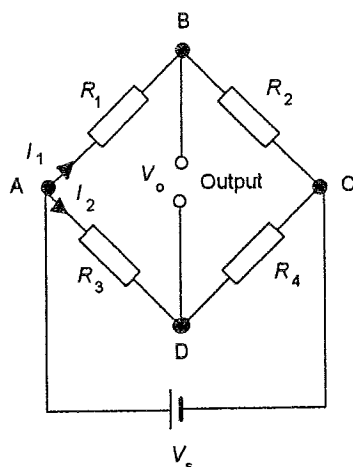


Fig. 3.22 Wheatstone bridge

between points A and C and thus the potential drop across the resistor R_1 is the fraction $R_1/(R_1 + R_2)$ of the supply voltage. Hence

$$V_{AB} = \frac{V_s R_1}{R_1 + R_2}$$

Similarly, the potential difference across R_3 is

$$V_{AD} = \frac{V_s R_3}{R_3 + R_4}$$

Thus the difference in potential between B and D, i.e. the output potential difference V_o , is

$$V_o = V_{AB} - V_{AD} = V_s \left(\frac{R_1}{R_1 + R_2} - \frac{R_3}{R_3 + R_4} \right)$$

This equation gives the balanced condition when $V_o = 0$.

Consider resistance R_1 to be a sensor which has a resistance change. A change in resistance from R_1 to $R_1 + \delta R_1$ gives a change in output from V_o to $V_o + \delta V_o$, where

$$V_o + \delta V_o = V_s \left(\frac{R_1 + \delta R_1}{R_1 + \delta R_1 + R_2} - \frac{R_3}{R_3 + R_4} \right)$$

Hence

$$(V_o + \delta V_o) - V_o = V_s \left(\frac{R_1 + \delta R_1}{R_1 + \delta R_1 + R_2} - \frac{R_1}{R_1 + R_2} \right)$$

If δR_1 is much smaller than R_1 then the above equation approximates to

$$\delta V_o \approx V_s \left(\frac{\delta R_1}{R_1 + R_2} \right)$$

With this approximation, the change in output voltage is thus proportional to the change in the resistance of the sensor. This gives the output voltage when there is no load resistance across the output. If there is such a resistance then the loading effect has to be considered.

To illustrate the above, consider a platinum resistance temperature sensor which has a resistance at 0°C of $100\ \Omega$ and forms one arm of a Wheatstone bridge. The bridge is balanced, at this temperature, with each of the other arms also being $100\ \Omega$. If the temperature coefficient of resistance of platinum is $0.0039\ \text{/K}$, what will be the output voltage from the bridge per degree change in temperature if the load across the output can be assumed to be infinite? The supply voltage, with negligible internal resistance, is $6.0\ \text{V}$. The variation of the resistance of the platinum with temperature can be represented by

$$R_t = R_0(1 + \alpha t)$$

where R_t is the resistance at $t^\circ\text{C}$, R_0 the resistance at 0°C and α the temperature coefficient of resistance. Thus

$$\text{Change in resistance} = R_t - R_0 = R_0 \alpha t$$

$$= 100 \times 0.0039 \times 1 = 0.39 \, \Omega/\text{K}$$

Since this resistance change is small compared to the $100 \, \Omega$, the approximate equation can be used. Hence

$$\delta V_o \approx V_s \left(\frac{\delta R_1}{R_1 + R_2} \right) = \frac{6.0 \times 0.39}{100 + 100} = 0.012 \, \text{V}$$

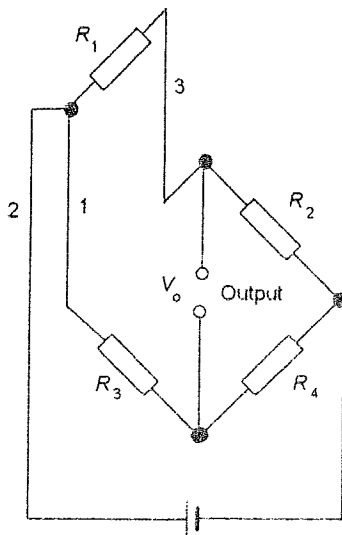


Fig. 3.23 Compensation for leads

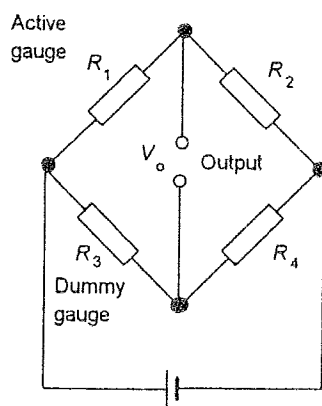


Fig. 3.24 Compensation with strain gauges

3.5.1 Temperature compensation

In many measurements involving a resistive sensor the actual sensing element may have to be at the end of long leads. Not only the sensor but the resistance of these leads will be affected by changes in temperature. For example, a platinum resistance temperature sensor consists of a platinum coil at the ends of leads. When the temperature changes, not only will the resistance of the coil change but so also will the resistance of the leads. What is required is just the resistance of the coil and so some means has to be employed to compensate for the resistance of the leads to the coil. One method of doing this is to use three leads to the coil, as shown in Figure 3.23. The coil is connected into the Wheatstone bridge in such a way that lead 1 is in series with the R_3 resistor while lead 3 is in series with the platinum resistance coil R_1 . Lead 2 is the connection to the power supply. Any change in lead resistance is likely to affect all three leads equally, since they are of the same material, diameter and length and held close together. The result is that changes in lead resistance occur equally in two arms of the bridge and cancel out if R_1 and R_3 are the same resistance.

The electrical resistance strain gauge is another sensor where compensation has to be made for temperature effects. The strain gauge changes resistance when the strain applied to it changes. Unfortunately, it also changes if the temperature changes. One way of eliminating the temperature effect is to use a *dummy strain gauge*. This is a strain gauge which is identical to the one under strain, the active gauge, and is mounted on the same material but is not subject to the strain. It is positioned close to the active gauge so that it suffers the same temperature changes. Thus a temperature change will cause both gauges to change resistance by the same amount. The active gauge is mounted in one arm of a Wheatstone bridge (Fig. 3.24) and the dummy gauge in another arm so that the effects of temperature-induced resistance changes cancel out.

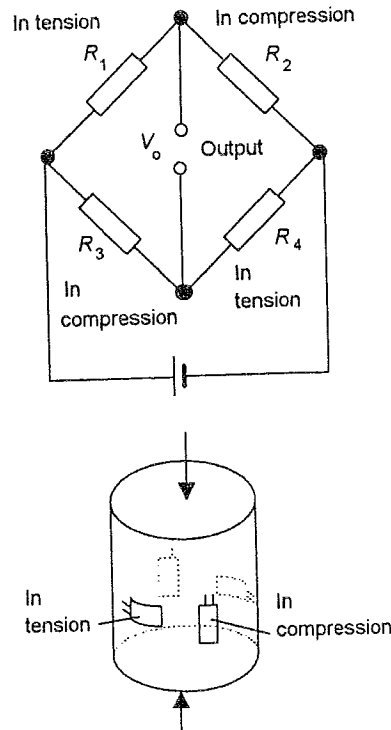


Fig. 3.25 Four active arm strain gauge bridge

Strain gauges are often used with other sensors such as load cells or diaphragm pressure gauges to give measures of the amount of displacement occurring. In such situations, temperature compensation is still required. While dummy gauges could be used, a better solution is to use four strain gauges. Two of them are attached so that when forces are applied they are in tension and the other two in compression. The load cell in Figure 3.25 shows such a mounting. The gauges that are in tension will increase in resistance while those in compression will decrease in resistance. As the gauges are connected as the four arms of a Wheatstone bridge (Fig. 3.25), then since all will be equally affected by any temperature changes the arrangement is temperature compensated. It also gives a much greater output voltage than would occur with just a single active gauge.

To illustrate this, consider a load cell with four strain gauges arranged as shown in Figure 3.25 which is to be used with a four active arm strain gauge bridge. The gauges have a gauge factor of 2.1 and a resistance of $100\ \Omega$. When the load cell is subject to a compressive force, the vertical gauges show compression and, because when you squash an item there is a consequential sideways extension, the horizontal gauges are subject to tensile strain (the ratio of the transverse to longitudinal strains is called Poisson's ratio and is usually about 0.3). Thus, if the compressive gauges suffer a strain of -1.0×10^{-5} and the tensile gauges $+0.3 \times 10^{-5}$, the supply voltage for the bridge is 6 V and the output voltage from the bridge is amplified by a differential operational amplifier circuit, what will be the ratio of the feedback resistance to that of the input resistances in the two inputs of the amplifier if the load is to produce an output of 1 mV?

The change in resistance of a gauge subject to the compressive strain is given by $\Delta R/R = G\varepsilon$:

$$\begin{aligned}\text{Change in resistance} &= G\varepsilon R = -2.1 \times 1.0 \times 10^{-5} \times 100 \\ &= -2.1 \times 10^{-3}\ \Omega\end{aligned}$$

For a gauge subject to tension we have

$$\begin{aligned}\text{Change in resistance} &= G\varepsilon R = 2.1 \times 0.3 \times 10^{-5} \times 100 \\ &= 6.3 \times 10^{-4}\ \Omega\end{aligned}$$

The out-of-balance potential difference is given by (see Section 3.5)

$$\begin{aligned}V_o &= V_s \left(\frac{R_1}{R_1 + R_2} - \frac{R_3}{R_3 + R_4} \right) \\ &= V_s \left(\frac{R_1(R_3 + R_4) - R_3(R_1 + R_2)}{(R_1 + R_2)(R_3 + R_4)} \right)\end{aligned}$$

$$= V_s \left(\frac{R_1 R_4 - R_2 R_3}{(R_1 + R_2)(R_3 + R_4)} \right)$$

We now have each of the resistors changing. We can, however, neglect the changes in relation to the denominators where the effect of the changes on the sum of the two resistances is insignificant. Thus

$$V_o = V_s \left(\frac{(R_1 + \delta R_1)(R_4 + \delta R_4) - (R_2 + \delta R_2)(R_3 + \delta R_3)}{(R_1 + R_2)(R_3 + R_4)} \right)$$

Neglecting products of δ terms and since we have an initially balanced bridge with $R_1 R_4 = R_2 R_3$, then

$$V_o = \frac{V_s R_1 R_4}{(R_1 + R_2)(R_3 + R_4)} = \left(\frac{\delta R_1}{R_1} - \frac{\delta R_2}{R_2} - \frac{\delta R_3}{R_3} + \frac{\delta R_4}{R_4} \right)$$

Hence

$$V_o = \frac{6 \times 100 \times 100}{200 \times 200} \left(\frac{2 \times 6.3 \times 10^{-4}}{100} + \frac{2 \times 2.1 \times 10^{-3}}{100} \right)$$

The output is thus 3.6×10^{-5} V. This becomes the input to the differential amplifier; hence, using the equation developed in Section 3.2.7,

$$V_o = \frac{R_2}{R_1} (V_2 - V_1)$$

$$1.0 \times 10^{-3} = \frac{R_2}{R_1} \times 3.6 \times 10^{-5}$$

Thus $R_2/R_1 = 27.8$.

3.5.2 Thermocouple compensation

A thermocouple gives an e.m.f. which depends on the temperature of its two junctions (see Section 2.9.5). Ideally one junction is kept at 0°C , then the temperature relating to the e.m.f. can be directly read from tables. However, this is not always feasible and the cold junction is often allowed to be at the ambient temperature. To compensate for this a potential difference has to be added to the thermocouple. This must be the same as the e.m.f. that would be generated by the thermocouple with one junction at 0°C and the other at the ambient temperature. Such a potential difference can be produced by using a resistance temperature sensor in a Wheatstone bridge. The bridge is balanced at 0°C and the output voltage from the bridge provides the correction potential difference at other temperatures.

The resistance of a metal resistance temperature sensor can be described by the relationship

$$R_t = R_0(1 + at)$$

where R_t is the resistance at $t^\circ\text{C}$, R_0 the resistance at 0°C and a the temperature coefficient of resistance. Thus

$$\text{change in resistance} = R_t - R_0 = R_0 at$$

The output voltage for the bridge, taking R_1 to be the resistance temperature sensor, is given by

$$\delta V_o \approx V_s \left(\frac{\delta R_1}{R_1 + R_2} \right) = \frac{V_s R_0 at}{R_0 + R_2}$$

The thermocouple e.m.f. e is likely to vary with temperature t in a reasonably linear manner over the small temperature range being considered – from 0°C to the ambient temperature. Thus $e = at$, where a is a constant, i.e. the e.m.f. produced per degree change in temperature. Hence for compensation we must have

$$at = \frac{V_s R_0 at}{R_0 + R_2}$$

and so

$$aR_2 = R_0(V_s a - a)$$

For an iron–constantan thermocouple giving $51 \mu\text{V}/^\circ\text{C}$, compensation can be provided by a nickel resistance element with a resistance of 10Ω at 0°C and a temperature coefficient of resistance of $0.0067/\text{K}$, a supply voltage for the bridge of 1.0 V , and R_2 as 1304Ω .

3.6 Digital signals

The output from most sensors tends to be in analogue form. Where a microprocessor is used as part of the measurement or control system, the analogue output from the sensor has to be converted into a digital form before it can be used as an input to the microprocessor. Likewise, most actuators operate with analogue inputs and so the digital output from a microprocessor has to be converted into an analogue form before it can be used as an input by the actuator.

The *binary system* is based on just the two symbols or states 0 and 1. These are termed *binary digits* or *bits*. When a number is represented by this system, the digit position in the number indicates the weight attached to each digit, the weight increasing by a factor of 2 as we proceed from right to left:

...	2^3	2^2	2^1	2^0
	bit 3	bit 2	bit 1	bit 0

For example, the decimal number 15 is $2^0 + 2^1 + 2^2 + 2^3 = 1111$ in the binary system. In a binary number the bit 0 is termed the *least significant bit* (LSB) and the highest bit the *most significant bit* (MSB). The combination of bits to represent a number is termed a *word*. Thus 1111 is a four-bit word. The term byte is used for a group of 8 bits. See Chapter 14 for more discussion of binary numbers.

3.6.1 Analogue-to-digital conversion

Analogue-to-digital conversion involves converting analogue signals into binary words. Figure 3.26 shows the basic elements of analogue-to-digital conversion.




Fig. 3.26 Analogue-to-digital conversion

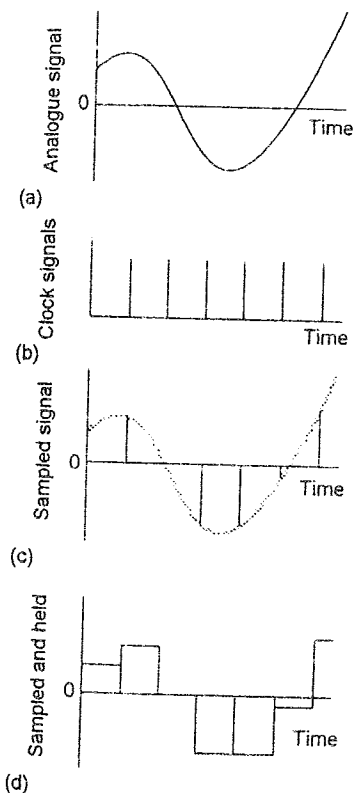


Fig. 3.27 Signals: (a) analogue, (b) clock, (c) sampled, (d) sampled and held

The procedure used is that a clock supplies regular time signal pulses to the analogue-to-digital converter (ADC) and every time it receives a pulse it samples the analogue signal. Figure 3.27 illustrates this analogue-to-digital conversion by showing the types of signals involved at the various stages. Figure 3.27(a) shows the analogue signal and Figure 3.27(b) the clock signal which supplies the time signals at which the sampling occurs. The result of the sampling is a series of narrow pulses (Fig. 3.27(c)). A *sample and hold* unit is then used to hold each sampled value until the next pulse occurs, with the result shown in Figure 3.27(d). The sample and hold unit is necessary because the analogue-to-digital converter requires a finite amount of time, termed the *conversion time*, to convert the analogue signal into a digital one.

The relationship between the sampled and held input and the output for an analogue-to-digital converter is illustrated by the graph shown in Figure 3.28 for a digital output which is restricted to three bits. With three bits there are $2^3 = 8$ possible output levels. Thus, since the output of the ADC to represent the analogue input can be only one of these eight possible levels, there is a range of inputs for which the output does not change. The eight possible output levels are termed *quantisation levels* and the difference in analogue voltage between two adjacent levels is termed the *quantisation interval*. Thus for the ADC given in Figure 3.28, the quantisation interval is 1 V. Because of the step-like nature of the relationship, the digital output is not always proportional to the analogue input and thus there will be error, this being termed the *quantisation error*. When the input is centred over the interval the quantisation error is zero, the maximum error being equal to one-half of the interval or $\pm \frac{1}{2}$ bit.

The word length possible determines the *resolution* of the element, i.e. the smallest change in input which will result in a change in the digital output. The smallest change in digital output is one bit in the least significant bit position in the word, i.e. the far right bit. Thus with a word length of n bits the full-scale analogue input V_{FS} is divided into 2^n pieces and so the minimum change in input that can be detected, i.e. the *resolution*, is $V_{FS}/2^n$.

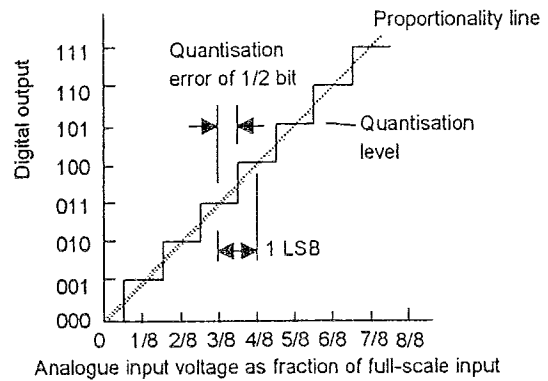


Fig. 3.28 Input-output for an ADC

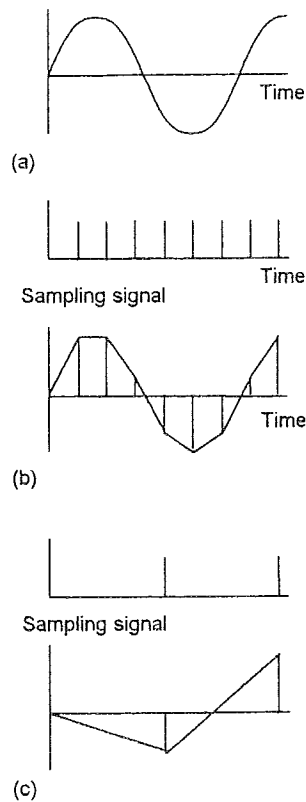


Fig. 3.29 Effect of sampling frequency: (a) analogue signal, (b) sampled signal, (c) sampled signal

Thus if we have an analogue-to-digital converter having a word length of 10 bits and the analogue signal input range is 10 V, then the number of levels with a 10-bit word is $2^{10} = 1024$ and thus the resolution is $10/1024 = 9.8$ mV.

Consider a thermocouple giving an output of 0.5 mV/ $^{\circ}\text{C}$. What will be the word length required when its output passes through an analogue-to-digital converter if temperatures from 0 to 200°C are to be measured with a resolution of 0.5°C ? The full-scale output from the sensor is $200 \times 0.5 = 100$ mV. With a word length n , this voltage will be divided into $100/2^n$ mV steps. For a resolution of 0.5°C we must be able to detect a signal from the sensor of $0.5 \times 0.5 = 0.25$ mV. Thus we require

$$0.25 = \frac{100}{2^n}$$

Hence $n = 8.6$. Thus a 9-bit word length is required.

3.6.2 Sampling theorem

Analogue-to-digital converters sample analogue signals at regular intervals and convert these values to binary words. How often should an analogue signal be sampled in order to give an output which is representative of the analogue signal?

Figure 3.29 illustrates the problem with different sampling rates being used for the same analogue signal. When the signal is reconstructed from the samples, it is only when the sampling rate is at least twice that of the highest frequency in the analogue signal that the sample gives the original form of signal. This

criterion is known as the *Nyquist criterion* or *Shannon's sampling theorem*. When the sampling rate is less than twice the highest frequency the reconstruction can represent some other analogue signal and we obtain a false image of the real signal. This is termed *aliasing*. In Figure 3.29(c) this could be an analogue signal with a much smaller frequency than that of the analogue signal that was sampled.

Whenever a signal is sampled too slowly, there can be a false interpretation of high frequency components as arising from lower frequency aliases. High frequency noise can also create errors in the conversion process. To minimise errors due to both aliasing and high frequency noise, a low-pass filter is used to precede the ADC, the filter having a bandwidth such that it passes only low frequencies for which the sampling rate will not give aliasing errors. Such a filter is termed an *anti-aliasing filter*.

3.6.3 Digital-to-analogue conversion

The input to a digital-to-analogue converter (DAC) is a binary word; the output is an analogue signal that represents the weighted sum of the non-zero bits represented by the word. Thus, for example, an input of 0010 must give an analogue output which is twice that given by an input of 0001. Figure 3.30 illustrates this for an input to a DAC with a resolution of 1 V for unsigned binary words. Each additional bit increases the output voltage by 1 V.

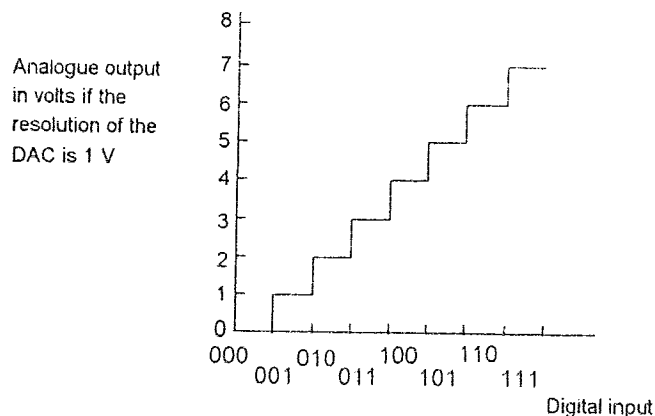


Fig. 3.30 Input-output for a DAC

Consider the situation where a microprocessor gives an output of an 8-bit word. This is fed through an 8-bit digital-to-analogue converter to a control valve. The control valve requires 6.0 V to be fully open. If the fully open state is indicated by 11111111 what will be the output to the valve for a change of 1 bit?

The full-scale output voltage of 6.0 V will be divided into 2^8 intervals. A change of 1 bit is thus a change in the output voltage of $6.0/2^8 = 0.023$ V.

3.6.4 Digital-to-analogue converters

A simple form of digital-to-analogue converter uses a summing amplifier (see Section 3.2.3) to form the weighted sum of all the non-zero bits in the input word (Fig. 3.31). The reference voltage is connected to the resistors by means of electronic switches which respond to binary 1. The values of the input resistances depend on which bit in the word a switch is responding to, the value of the resistor for successive bits from the LSB being halved. Hence the sum of the voltages is a weighted sum of the digits in the word. Such a system is referred to as a *weighted-resistor network*.

A problem with the weighted-resistor network is that accurate resistances have to be used for each of the resistors and it is difficult to obtain such resistors over the wide range needed. As a result this form of DAC tends to be limited to 4-bit conversions.

Another, more commonly used, version uses a *R-2R ladder network* (Fig. 3.32). This overcomes the problem of obtaining accurate resistances over a wide range of values, only two values being required. The output voltage is generated by switching sections of the ladder to either the reference voltage or 0 V according to whether there is a 1 or 0 in the digital input.

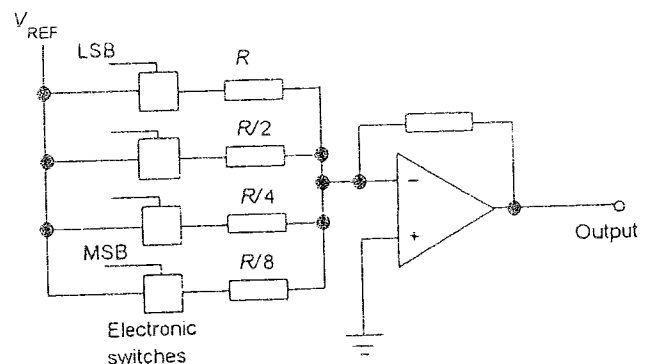


Fig. 3.31 Weighted-resistor DAC

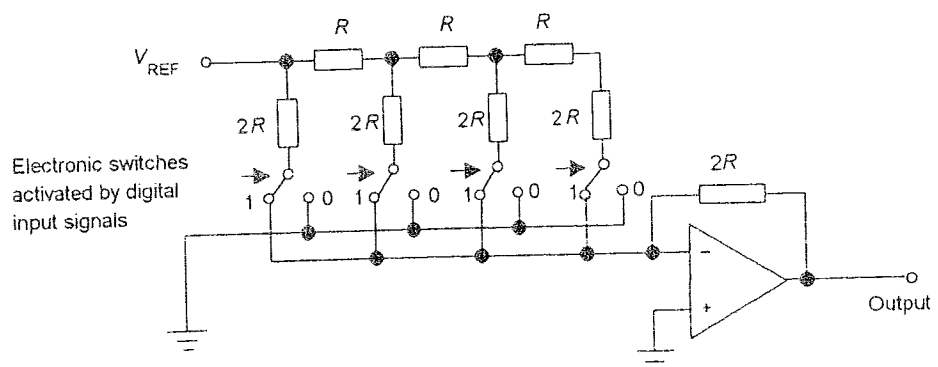


Fig. 3.32 R-2R ladder DAC

Figure 3.33 shows details of the GEC Plessey ZN558D 8-bit latched input digital-to-analogue converter using a $R-2R$ ladder network. After the conversion is complete, the 8-bit result is placed in an internal latch until the next conversion is complete. Data is held in the latch when ENABLE is high, the latch being said to be transparent when ENABLE is low. A *latch* is just a device to retain the output until a new one replaces it. When a DAC has a latch it may be interfaced directly to the data bus of a microprocessor and treated by it as just an address to send data. A DAC without a latch would be connected via a peripheral interface adapter (PIA), such a device providing latching (see Section 18.4). Figure 3.34 shows how the ZN558D might be used with a microprocessor when the output is required to be a voltage which varies between zero and the reference voltage, this being termed *unipolar operation*. With $V_{ref\ un} = 2.5\text{ V}$, the output range is $+5\text{ V}$ when $R_1 = 8\text{ k}\Omega$ and $R_2 = 8\text{ k}\Omega$ and the range is $+10\text{ V}$ when $R_1 = 16\text{ k}\Omega$ and $R_2 = 5.33\text{ k}\Omega$.

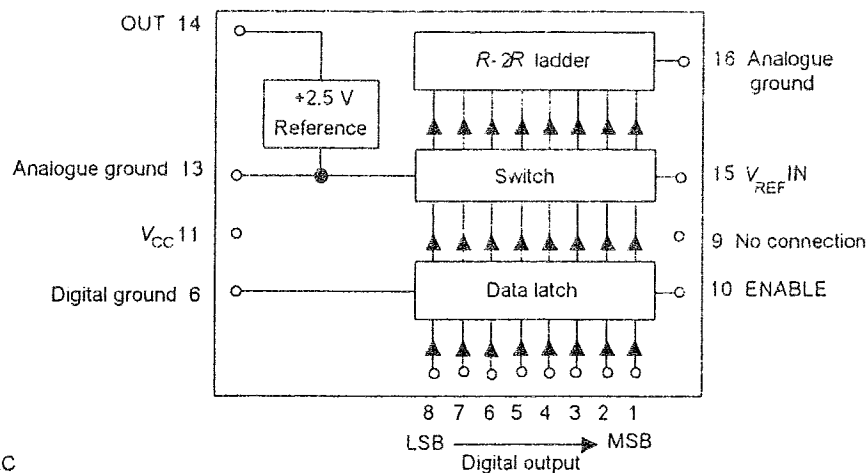


Fig. 3.33 ZN558D DAC

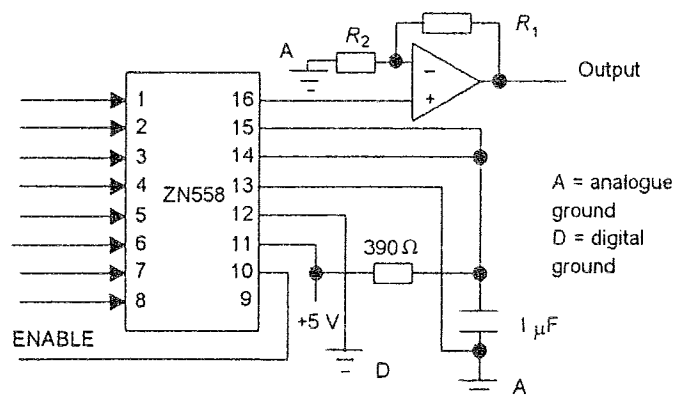


Fig. 3.34 Unipolar operation

The specifications of DACs include such terms as:

- 1 The *full-scale output*, i.e. the output when the input word is all 1s. For the ZN558D this is typically 2.550 V.
- 2 The *resolution*, 8-bit DACs generally being suitable for most microprocessor control systems. The ZN558D is 8-bit.
- 3 The *settling time*, this being the time taken by the DAC to reach within $\frac{1}{2}$ LSB of its new voltage after a binary change. This is 800 ns for the ZN558D.
- 4 The *linearity*, this being the maximum deviation from the straight line through zero and the full range of the output. This is a maximum of ± 0.5 LSB for the ZN558D.

3.6.5 Analogue-to-digital converters

The input to an analogue-to-digital converter is an analogue signal and the output is a binary word that represents the level of the input signal. There are a number of forms of analogue-to-digital converter, the most common being successive approximations, ramp, dual ramp and flash.

Successive approximations is probably the most commonly used method. Figure 3.35 illustrates the subsystems involved. A voltage is generated by a clock emitting a regular sequence of pulses which are counted, in a binary manner, and the resulting binary word converted into an analogue voltage by a digital-to-analogue converter. This voltage rises in steps and is compared with the analogue input voltage from the sensor. When the clock-generated voltage passes the input analogue voltage the pulses from the clock are stopped from being counted by a gate being closed. The output from the counter at that time is then a digital representation of the analogue voltage. While the comparison could be accomplished by starting the count at 1, the least significant bit, and then proceeding bit by bit upwards, a faster method is by successive approximations. This involves selecting the most significant bit that is less than the analogue value, then adding successive lesser bits for which the total does not exceed the analogue value. For example, we might start the comparison with 1000. If this is too large we try 0100. If this is too small we then try 0110. If this is too large we try 0101. Because each of the bits in the word is tried in sequence, with an n -bit word it only takes n steps to make the comparison. Thus if the clock has a frequency f , the time between pulses is $1/f$. Hence the time taken to generate the word, i.e. the conversion time, is n/f .

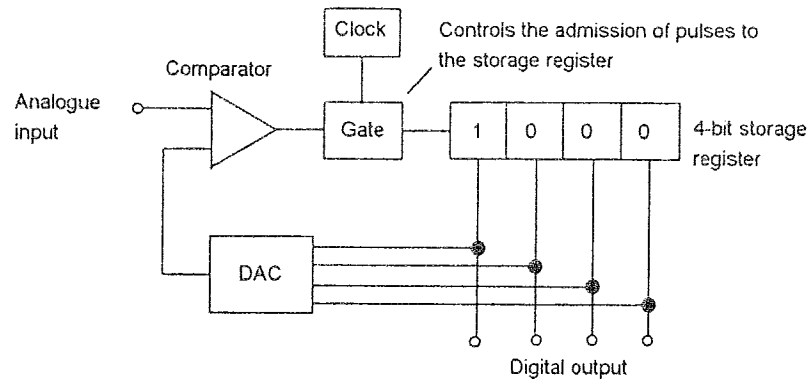


Fig. 3.35 Successive approximations ADC

Figure 3.36 shows the typical form of an 8-bit analogue-to-digital converter (GEC Plessey ZN439) designed for use with microprocessors and using the successive approximations method. Figure 3.37 shows how it can be connected so that it is controlled by a microprocessor and sends its digital output to the microprocessor. All the active circuitry, including the clock, is contained on a single chip. The ADC is first selected by taking the chip select pin low. When the start conversion pin receives a negative-going pulse the conversion starts. At the end of the conversion the status pin goes low. The digital output is sent to an internal buffer where it is held until read as a result of the output enable pin being taken low.

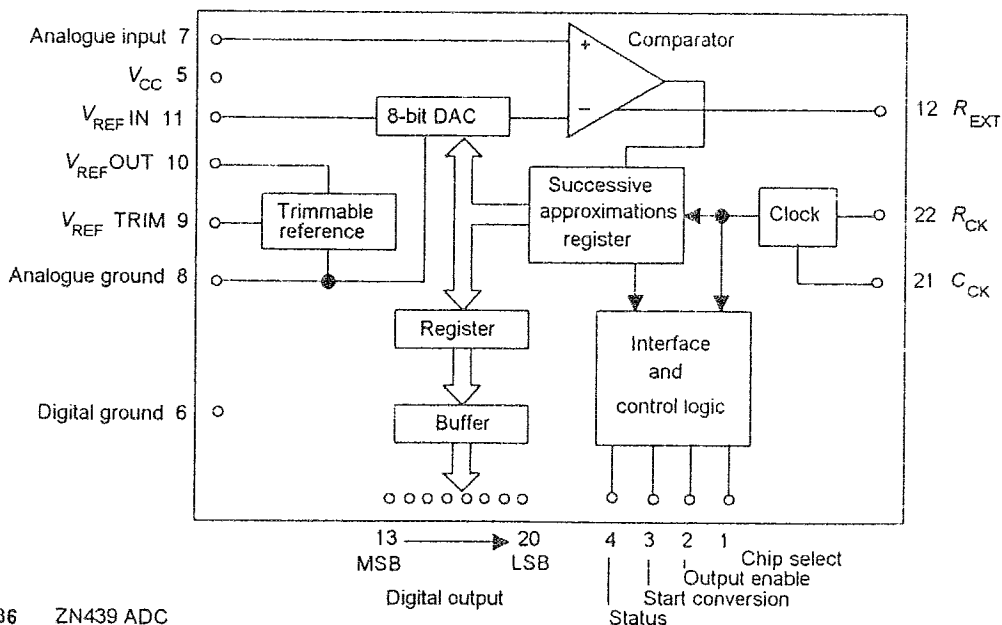


Fig. 3.36 ZN439 ADC

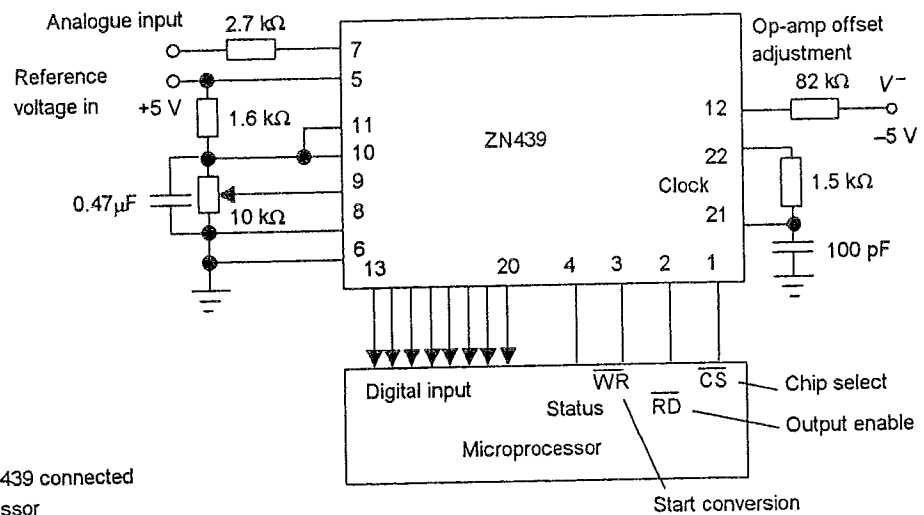


Fig. 3.37 ZN439 connected to a microprocessor

The *ramp* form of analogue-to-digital converter involves an analogue voltage which is increased at a constant rate, a so-called ramp voltage, and applied to a comparator where it is compared with the analogue voltage from the sensor. The time taken for the ramp voltage to increase to the value of the sensor voltage will depend on the size of the sampled analogue voltage. When the ramp voltage starts, a gate is opened which starts a binary counter counting the regular pulses from a clock. When the two voltages are equal, the gate closes and the word indicated by the counter is the digital representation of the sampled analogue voltage. Figure 3.38 indicates the subsystems involved in the ramp form of analogue-to-digital converter.

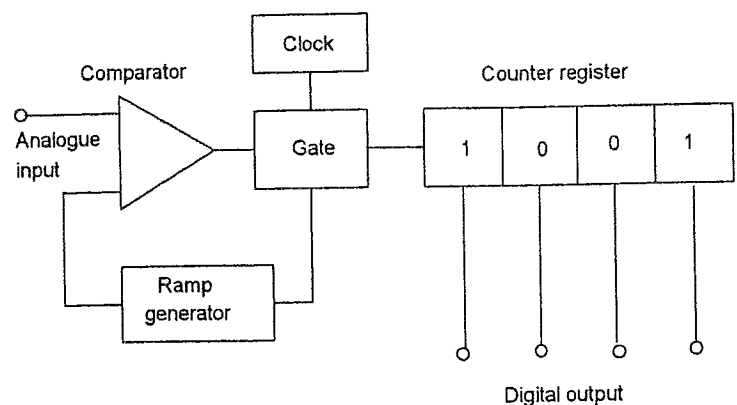


Fig. 3.38 Ramp ADC

The *dual ramp converter* is more common than the single ramp. Figure 3.39 shows the basic circuit. The analogue voltage is applied to an integrator which drives a comparator. The output from the comparator goes high as soon as the integrator output is more than a few millivolts. When the comparator output is high, an AND gate passes pulses to a binary counter. The counter counts pulses until it overflows. The counter then resets to zero, sends a signal to a switch which disconnects the unknown voltage and connects a reference voltage, and starts counting again. The polarity of the reference voltage is opposite to that of the input voltage. The integrator voltage then decreases at a rate proportional to the reference voltage. When the integrator output reaches zero, the comparator goes low, bringing the AND gate low and so switching the clock off. The count is then a measure of the analogue input voltage. Dual ramp analogue-to-digital converters have excellent noise rejection because the integral action averages out random negative and positive contributions over the sampling period. They are, however, very slow.

The *flash analogue-to-digital converter* is very fast. For an n -bit converter, $2^n - 1$ separate voltage comparators are used in parallel, with each having the analogue input voltage as one input (Fig. 3.40). A reference voltage is applied to a ladder of resistors so that the voltage applied as the other input to each comparator is one bit larger in size than the voltage applied to the previous comparator in the ladder. Thus when the analogue voltage is applied to the ADC, all those comparators for which the analogue voltage is greater than the reference voltage of a comparator will give a high output and those for which it is less will be low. The resulting outputs are fed in parallel to a logic gate system which translates them into a digital word.

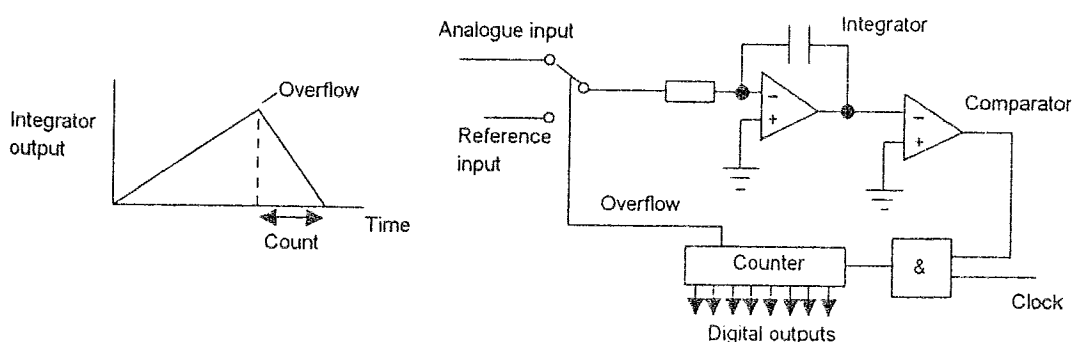


Fig. 3.39 Dual ramp ADC

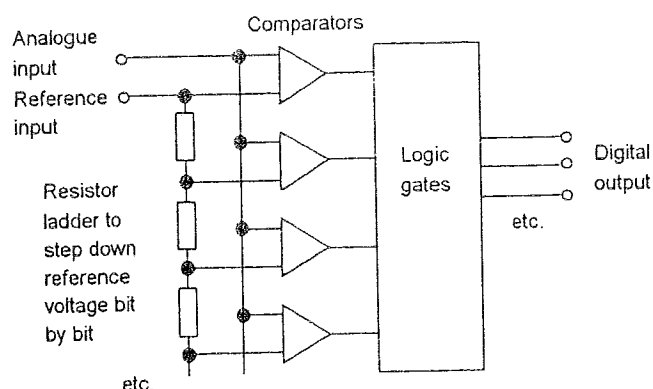


Fig. 3.40 Flash ADC

In considering the specifications of ADCs the following terms will be encountered:

- 1 *Conversion time*, i.e. the time required to complete a conversion of the input signal. It establishes the upper signal frequency that can be sampled without aliasing; the maximum frequency is $1/(2 \times \text{conversion time})$.
- 2 *Resolution*, this being the full-scale signal divided by 2^n , where n is the number of bits. It is often just specified by a statement of the number of bits.
- 3 *Linearity error*, this being the deviation from a straight line drawn through zero and full-scale. It is a maximum of $\pm 1/2$ LSB.

Table 3.1 shows some specification details of commonly used analogue-to-digital converters.

Table 3.1 Analogue-to-digital converters

ADC	Type	Resolution (bits)	Conversion time (ns)	Linearity error (LSB)
ZN439	SA	8	5 000	$\pm 1/2$
ZN448E	SA	8	9 000	$\pm 1/2$
ADS7806	SA	12	20 000	$\pm 1/2$
ADS7078C	SA	16	20 000	$\pm 1/2$
ADC302	F	8	20	$\pm 1/2$

SA = successive approximations, F = flash.

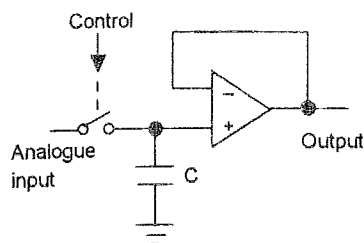


Fig. 3.41 Sample and hold

3.6.6 Sample and hold amplifiers

It takes a finite time for an ADC to convert an analogue signal to digital and problems can arise if the analogue signal changes during the conversion time. To overcome this, a sample-and-hold system is used to sample the analogue signal and hold it while the conversion takes place.

The basic circuit (Fig. 3.41) consists of an electronic switch to take the sample, with a capacitor for the hold and an operational amplifier voltage follower. The electronic switch is controlled so that the sample is taken at the instant dictated by the control input. When the switch closes, the input voltage is applied across the capacitor and the output voltage becomes the same as the input voltage. If the input voltage changes while the switch is closed the voltage across the capacitor and the output voltage change accordingly. When the switch opens, the capacitor retains its charge and the output voltage remains equal to the input voltage at the instant the switch was opened. The voltage is thus held until such time as the switch closes again. The time required for the capacitor to charge to a new sample of the input analogue voltage is called the *acquisition time* and depends on the value of the capacitance and the circuit resistance when the switch is on. Typical values are of the order of $4\ \mu\text{s}$.

3.7 Multiplexers

A *multiplexer* is a circuit that is able to have inputs of data from a number of sources and then, by selecting an input channel, give an output from just one of them. In applications where there is a need for measurements to be made at a number of different locations, rather than use a separate ADC and microprocessor for each measurement, a multiplexer can be used to select each input in turn and switch it through a single ADC and microprocessor (Fig. 3.42). The multiplexer is essentially an electronic switching device which enables each of the inputs to be sampled in turn.

As an illustration of the types of analogue multiplexers available, the DG508ACJ has eight input channels with each channel having a 3-bit binary address for selection purposes. The transition time between taking samples is $0.6\ \mu\text{s}$.

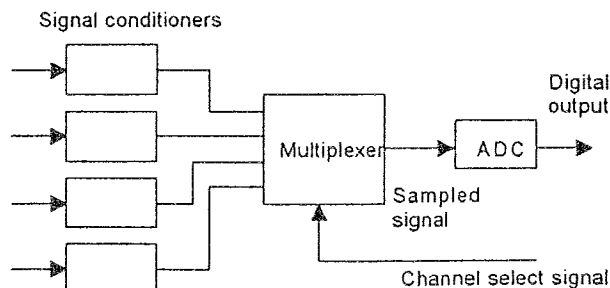


Fig. 3.42 Multiplexer

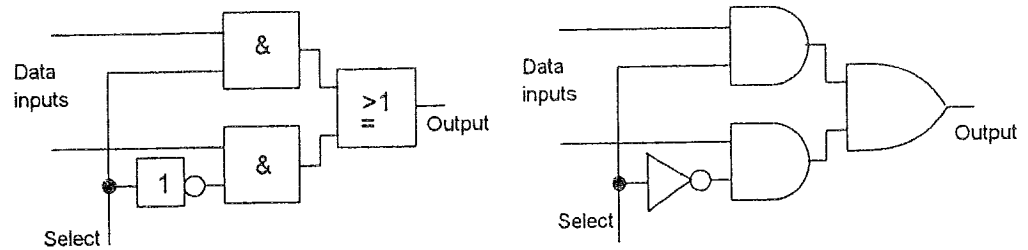


Fig. 3.43 Two channel multiplexer

3.7.1 Digital multiplexer

Figure 3.43 shows the basic principle of a multiplexer which can be used to select digital data inputs; for simplicity only a two input channel system is shown. The logic level applied to the select input determines which AND gate is enabled so that its data input passes through the OR gate to the output. A number of forms of multiplexers are available in integrated packages. The 151 types enable one line from eight to be selected, the 153 type one line from four inputs which are supplied as data on two lines each, the 157 types one line from two inputs which are supplied as data on four lines.

3.7.2 Time division multiplexing

Often there is a need for a number of peripheral devices to share the same input/output lines from a microprocessor. So that each peripheral can be supplied with different data it is necessary to allocate each a particular time slot during which data is transmitted. This is termed *time division multiplexing*. Figure 3.44 illustrates how this can be used to drive two display devices. In Figure 3.44(a) the system is not time multiplexed, in (b) it is.

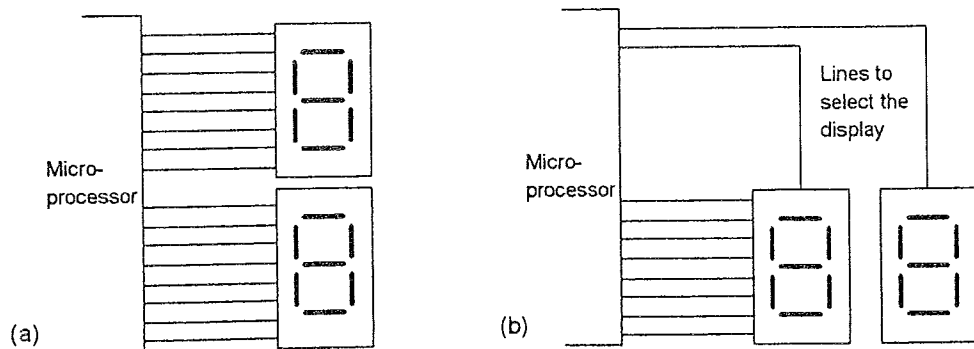


Fig. 3.44 Time division multiplexing

3.8 Data acquisition

The term *data acquisition*, or DAQ, is used for the process of taking data from sensors and inputting that data into a computer for processing. The sensors are connected, generally via some signal conditioning, to a data acquisition board which is plugged into the back of a computer (Fig. 3.45(a)). The DAQ board is a printed circuit board that, for analogue inputs, basically provides a multiplexer, amplification, analogue-to-digital conversion, registers and control circuitry so that sampled digital signals are applied to the computer system. Figure 3.45(b) shows the basic elements of such a board.

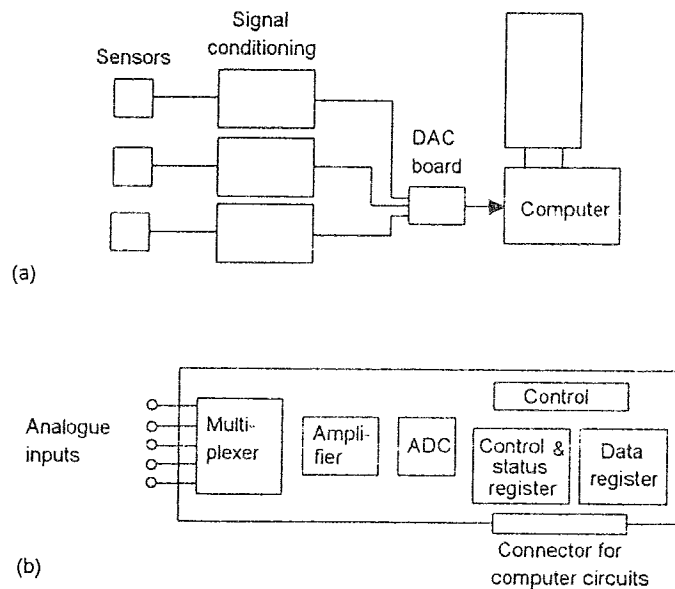


Fig. 3.45 DAQ system

Computer software is used to control the acquisition of data via the DAQ board. When the program requires an input from a particular sensor, it activates the board by sending a control word to the control and status register. Such a word indicates the type of operation the board has to carry out. As a consequence the board switches the multiplexer to the appropriate input channel. The input from the sensor connected to that input channel is then passed via an amplifier to the analogue-to-digital converter. After conversion the resulting digital signal is passed to the data register and the word in the control and status register changes to indicate that the signal has arrived. Following that signal, the computer then issues a signal for the data to be read and taken into the computer for processing. This signal is necessary to ensure that the computer does not wait doing nothing while the board carries out its acquisition of data, but uses this to signal to the computer when the acquisition is complete and then the

computer can interrupt any program it is implementing, read the data from the DAQ and then continue with its program. A faster system does not involve the computer in the transfer of the data into memory but transfers the acquired data directly from the board to memory without involving the computer, this being termed *direct memory address* (DMA).

The specifications for a DAQ board include the sampling rate for analogue inputs, this might be 100 kS/s (100 thousand samples per second). The Nyquist criteria for sampling indicate that the maximum frequency of analogue signal that can be sampled with such a board is 50 kHz, the sample rate having to be twice the maximum frequency component. In addition to the above basic functions of a DAQ board, it may also supply analogue outputs, timers and counters which can be used to provide triggers for the sensor system.

As an example of a low cost multifunction board for use with an IBM computer, Figure 3.46 shows the basic structure of the National Instruments DAQ board PC-LPM-16. This board has 16 analogue input channels, a sampling rate of 50 kS/s, an 8-bit digital input and an 8-bit digital output and a counter/timer which can give an output. Channels can be scanned in sequence, taking one reading from each channel in turn, or there can be continuous scanning of a single channel.

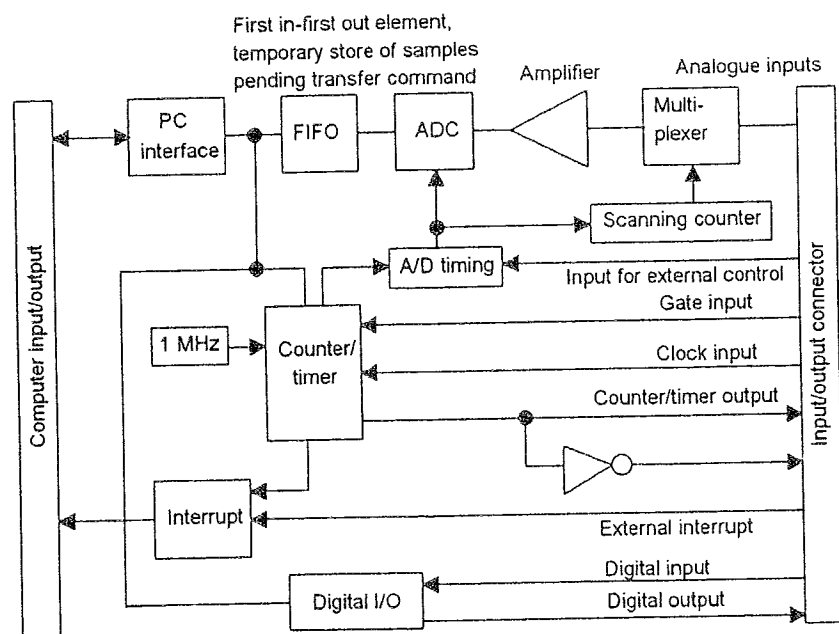


Fig. 3.46 PC-LPM-16 DAQ board

3.9 Digital signal processing

The term *digital signal processing* or *discrete-time signal processing* is used for the processing applied to a signal by a microprocessor. Digital signals are discrete time signals in that they are not continuous functions of time but exist at only discrete times. Whereas signal conditioning of analogue signals requires components such as amplifiers and filter circuits, digital signal conditioning can be carried out by a program applied to a microprocessor, i.e. processing the signal. To change the characteristics of a filter used with analogue signals it is necessary to change hardware components, whereas to change the characteristics of a digital filter all that is necessary is to change the software, i.e. the program of instructions given to a microprocessor.

With a digital signal processing system there is an input of a word representing the size of a pulse and an output of another word. The output pulse at a particular instant is computed by the system as a result of processing the present input pulse input, together with previous pulse inputs and possibly previous system outputs.

For example, the program used by the microprocessor might read the value of the present input and add to it the previous output value to give the new output. If we consider the present input to be the k th pulse in the input sequence of pulses we can represent this pulse as $x[k]$. The k th output of a sequence of pulses can be represented by $y[k]$. The previous output, i.e. the $(k - 1)$ th pulse, can be represented by $y[k - 1]$. Thus we can describe the program which gives an output obtained by adding to the value of the present input the previous output by:

$$y[k] = x[k] + y[k - 1]$$

Such an equation is called a *difference equation*. It gives the relationship between the output and input for a discrete-time system and is comparable with a differential equation which is used to describe the relationship between the output and input for a system having inputs and outputs which vary continuously with time.

For the above difference equation, suppose we have an input of a sampled sine wave signal which gives a sequence of pulses of:

$$0.5, 1.0, 0.5, -0.5, -1.0, -0.5, 0.5, 1.0, \text{ etc.}$$

The $k = 1$ input pulse has a size of 0.5. If we assume that previously the output was zero then $y[k - 1] = 0$ and so $y[1] = 0.5 + 0 = 0.5$. The $k = 2$ input pulse has a size of 1.0 and so $y[2] = x[2] + y[2 - 1] = 1.0 + 0.5 = 1.5$. The $k = 3$ input pulse has a size of 0.5 and so $y[3] = x[3] + y[3 - 1] = 0.5 + 1.5 = 2.0$. The $k = 4$ input pulse has a size of -0.5 and so $y[4] = x[4] + y[4 - 1] = -0.5 + 2.0 = 1.5$. The $k = 5$ input pulse has a size of -1.0 and so $y[5] = x[5] + y[5 - 1] = -1.0 + 1.5 = 0.5$. The output is thus the pulses:

0.5, 1.5, 2.0, 1.5, 0.5, ...

We can continue in this way to obtain the output for all the pulses.

As another example of a difference equation we might have:

$$y[k] = x[k] + ay[k-1] - by[k-2]$$

The output is the value of the current input plus a times the previous output and minus b times the last but one output. If we have $a = 1$ and $b = 0.5$ and consider the input to be the sampled sine wave signal considered above, then the output now becomes:

0.5, 1.5, 1.75, 0.5, -1.37, ...

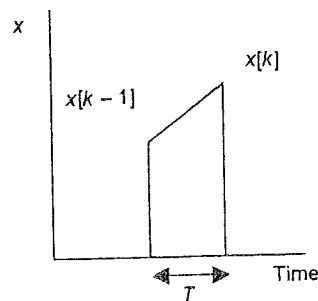


Fig. 3.47 Integration

We can have a difference equation which produces an output which is similar to that which would have been obtained by integrating a continuous-time signal. Integration of a continuous-time signal between two times can be considered to be the area under the continuous-time function between those times. Thus if we consider two discrete-time signals $x[k]$ and $x[k-1]$ occurring with a time interval of T between them (Fig. 3.47), the change in area is $\frac{1}{2}T(x[k] + x[k-1])$. Thus if the output is to be the sum of the previous area and this change in area, the difference equation is:

$$y[k] = y[k-1] + \frac{1}{2}T(x[k] + x[k-1])$$

This is known as *Tustin's approximation* for integration.

Differentiation can be approximated by determining the rate at which the input changes. Thus when the input changes from $x[k-1]$ to $x[k]$ in time T the output is:

$$y[k] = (x[k] - x[k-1])/T$$

3.10 Pulse-modulation

A problem that is often encountered with dealing with the transmission of low-level d.c. signals from sensors is that the gain of an operational amplifier used to amplify them may drift and so the output drifts. This problem can be overcome if the signal is a sequence of pulses rather than a continuous-time signal.

One way this conversion can be achieved is by chopping the d.c. signal in the way suggested in Figure 3.48. The output from the chopper is a chain of pulses, the heights of which are related to the d.c. level of the input signal. This process is called *pulse amplitude modulation*. After amplification and any other signal conditioning, the modulated signal can be demodulated to give a d.c. output. With pulse amplitude modulation, the height of the pulses is related to the size of the d.c. voltage.

Fig. 3.48 Pulse amplitude modulation


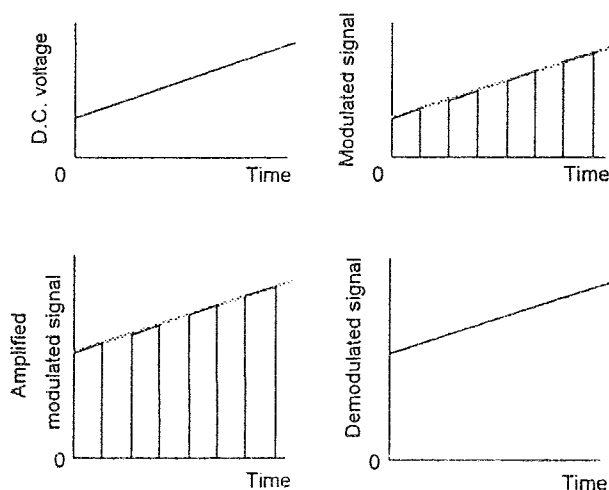



Fig. 3.49 Pulse width modulation

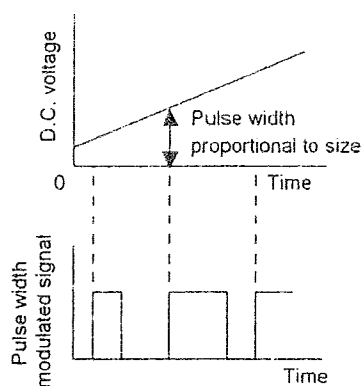

An alternative to this is *pulse width modulation* (PWM) where the width, i.e. duration, of a pulse rather than its amplitude depends on the size of the voltage (Fig. 3.49).

Pulse width modulation is widely used with control systems as a means of controlling the average value of a d.c. voltage. Thus if there is a constant analogue voltage and it is chopped into pulses, by varying the width of the pulses so the average value of the voltage can be changed. Figure 3.50 illustrates this. The term *duty cycle* is used for the fraction of each cycle for which the voltage is high. Thus for a PWM signal where the signal is high for half of each cycle, the duty cycle is $\frac{1}{2}$ or 50%. If it is only on for a quarter of each cycle then the duty cycle is $\frac{1}{4}$ or 25%.

Fig. 3.50 PWM for voltage control: (a) duty cycle 50%, (b) duty cycle 25%

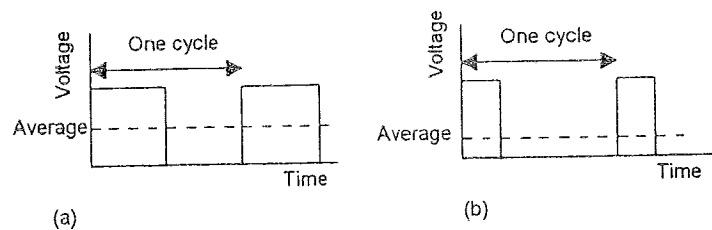

Problems

- 1 Design an operational amplifier circuit that can be used to produce an output that ranges from 0 to -5 V when the input goes from 0 to 100 mV.
- 2 An inverting amplifier has an input resistance of $2\text{ k}\Omega$. Determine the feedback resistance needed to give a voltage gain of 100.
- 3 Design a summing amplifier circuit that can be used to produce an output that ranges from -1 to -5 V when the input goes from 0 to 100 mV.
- 4 A differential amplifier is used with a thermocouple sensor in the way shown in Figure 3.8. What values of R_1 and R_2 would give a circuit which has an output of 10 mV for a temperature difference between the thermocouple junctions of 100°C with a copper-constantan thermocouple if the thermocouple is assumed to have a constant sensitivity of $43\text{ }\mu\text{V}/^\circ\text{C}$?
- 5 The output from the differential pressure sensor used with an orifice plate for the measurement of flow rate is non-linear, the output voltage being proportional to the square of the flow rate. Determine the form of characteristic required for the element in the feedback loop of an operational amplifier signal conditioner circuit in order to linearise this output.
- 6 A differential amplifier is to have a voltage gain of 100. What will be the feedback resistance required if the input resistances are both $1\text{ k}\Omega$?
- 7 A differential amplifier has a differential voltage gain of 2000 and a common mode gain of 0.2. What is the common mode rejection ratio in dB?
- 8 Digital signals from a sensor are polluted by noise and mains interference and are typically of the order of 100 V or more. Explain how protection can be afforded for a microprocessor to which these signals are to be inputted.
- 9 A platinum resistance temperature sensor has a resistance of $120\text{ }\Omega$ at 0°C and forms one arm of a Wheatstone bridge. At this temperature the bridge is balanced with each of the other arms being $120\text{ }\Omega$. The temperature coefficient of resistance of the platinum is 0.0039 /K . What will be the output voltage from the bridge for a change in temperature of 20°C ? The

loading across the output is effectively open-circuit and the supply voltage to the bridge is from a source of 6.0 V with negligible internal resistance.

- 10 A diaphragm pressure gauge employs four strain gauges to monitor the displacement of the diaphragm. The four active gauges form the arms of a Wheatstone bridge, in the way shown in Figure 3.24. The gauges have a gauge factor of 2.1 and resistance $120\ \Omega$. A differential pressure applied to the diaphragm results in two of the gauges on one side of the diaphragm being subject to a tensile strain of 1.0×10^{-5} and the two on the other side a compressive strain of 1.0×10^{-5} . The supply voltage for the bridge is 10 V. What will be the voltage output from the bridge?
- 11 A Wheatstone bridge has a single strain gauge in one arm and the other arms are resistors with each having the same resistance as the unstrained gauge. Show that the output voltage from the bridge is given by $\frac{1}{4}V_s G \epsilon$, where V_s is the supply voltage to the bridge, G the gauge factor of the strain gauge and ϵ the strain acting on it.
- 12 What is the resolution of an analogue-to-digital converter with a word length of 12 bits and an analogue signal input range of 100 V?
- 13 A sensor gives a maximum analogue output of 5 V. What word length is required for an analogue-to-digital converter if there is to be a resolution of 10 mV?
- 14 A R - $2R$ DAC ladder of resistors has its output fed through an inverting operational amplifier with a feedback resistance of $2R$. If the reference voltage is 5 V, determine the resolution of the converter.
- 15 For a binary weighted-resistor DAC how should the values of the input resistances be weighted for a 4-bit DAC?
- 16 What is the conversion time for a 12-bit ADC with a clock frequency of 1 MHz?
- 17 In monitoring the inputs from a number of thermocouples the following sequence of modules is used for each thermocouple in its interface with a microprocessor.

Protection, cold junction compensation, amplification, linearisation, sample and hold, analogue-to-digital converter, buffer, multiplexer.

Explain the function of each of the modules.

- 18 Suggest the modules that might be needed to interface the output of a microprocessor with an actuator.

4 Data presentation systems

4.1 Displays

This chapter is about how data can be displayed, e.g. as digits on a LED display or as a display on a computer screen, and stored, e.g. on a computer hard disc.

Measurement systems consist of three elements: sensor, signal conditioner and display or data presentation element (see Section 1.3). There are a very wide range of elements that can be used for the presentation of data. Traditionally they have been classified into two groups: indicators and recorders. *Indicators* give an instant visual indication of the sensed variable while *recorders* record the output signal over a period of time and give automatically a permanent record. The recorder will be the most appropriate choice if the event is high speed or transient and cannot be followed by an observer, or there are large amounts of data, or it is essential to have a record of the data.

Both indicators and recorders can be subdivided into two groups of devices, *analogue* and *digital*. An example of an analogue indicator is a meter which has a pointer moving across a scale, while a digital meter would be just a display of a series of numbers. An example of an analogue recorder is a chart recorder which has a pen moving across a moving sheet of paper, while a digital recorder has the output printed out on a sheet of paper as a sequence of numbers.

This chapter can also be considered as the completion of the group of chapters concerned with measurement systems, i.e. sensors, signal conditioning and now display, and so the chapter is used to bring the items together in a consideration of examples of complete measurement systems.

4.1.1 Loading

A general point that has to be taken account of when putting together any measurement system is *loading*, i.e. the effect of connecting a load across the output terminals of any element of a measurement system.

Connecting an ammeter into a circuit to make a measurement of the current changes the resistance of the circuit and so changes the current. The act of attempting to make such a measurement has modified the current that was being measured. When a voltmeter is connected across a resistor then we effectively have put two resistances in parallel, and if the resistance of the voltmeter is not considerably higher than that of the resistor the current through the resistor is markedly changed and so the voltage being measured is changed. The act of attempting to make the measurement has modified the voltage that was being measured. Such acts are termed *loading*.

Loading can also occur within a measurement system when the connection of one element to another modifies the characteristics of the preceding element. Consider, for example, a measurement system consisting of a sensor, an amplifier and a display element (Fig 4.1). The sensor has an open-circuit output voltage of V_s and a resistance R_s . The amplifier has an input resistance of R_{in} . This is thus the load across the sensor. Hence the input voltage from the sensor is divided so that the potential difference across this load, and so the input voltage V_{in} to the amplifier, is

$$V_{in} = \frac{V_s R_{in}}{R_s + R_{in}}$$

If the amplifier has a voltage gain of G then the open-circuit voltage output from it will be GV_{in} . If the amplifier has an output resistance of R_{out} then the output voltage from the amplifier is divided so that the potential difference V_d across the display element, resistance R_d , is:

$$\begin{aligned} V_d &= \frac{GV_{in} R_d}{R_{out} + R_d} = \frac{GV_s R_{in} R_d}{(R_{out} + R_d)(R_s + R_{in})} \\ &= \frac{GV_s}{\left(\frac{R_{out}}{R_d} + 1\right)\left(\frac{R_s}{R_{in}} + 1\right)} \end{aligned}$$

Thus if loading effects are to be negligible we require $R_{out} \gg R_d$ and $R_s \gg R_{in}$.

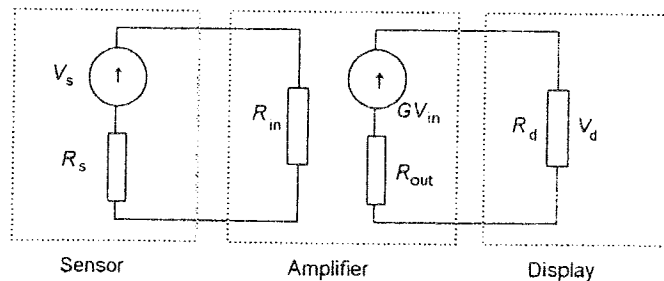


Fig. 4.1 Measurement system loading

4.2 Data presentation elements

This section is a brief overview of commonly used examples of data presentation elements.

4.2.1 Analogue and digital meters

The *moving coil meter* is an analogue indicator with a pointer moving across a scale. The basic instrument movement is a d.c. microammeter with shunts, multipliers and rectifiers being used to convert it to other ranges of direct current and measurement of alternating current, direct voltage, and alternating voltage. With alternating current and voltages, the instrument is restricted to between about 50 Hz and 10 kHz. The accuracy of such a meter depends on a number of factors, among which are temperature, the presence nearby of magnetic fields or ferrous materials, the way the meter is mounted, bearing friction, inaccuracies in scale marking during manufacture, etc. In addition there are errors involved in reading the meter, e.g. parallax errors when the position of the pointer against the scale is read from an angle other than directly at right angles to the scale and errors arising from estimating the position of the pointer between scale markings. The overall accuracy is generally of the order of ± 0.1 to $\pm 5\%$. The time taken for a moving coil meter to reach a steady deflection is typically in the region of a few seconds. The low resistance of the meter can present loading problems.

The *digital voltmeter* gives its reading in the form of a sequence of digits. Such a form of display eliminates parallax and interpolation errors and can give accuracies as high as $\pm 0.005\%$. The digital voltmeter is essentially just a sample and hold unit feeding an analogue-to-digital converter with its output counted by a counter (Fig. 4.2). It has a high resistance, of the order of $10\text{ M}\Omega$, and so loading effects are less likely than with the moving coil meter with its lower resistance. Thus, if a digital voltmeter specification includes the statement 'sample rate approximately 5 readings per second' then this means that every 0.2 s the input voltage is sampled. It is the time taken for the instrument to process the signal and give a reading. Thus, if the input voltage is changing at a rate which results in significant changes during 0.2 s then the voltmeter reading can be in error. A low cost digital voltmeter has typically a sample rate of 3 per second and an input impedance of $100\text{ M}\Omega$.



Fig. 4.2 Principle of digital voltmeter

For details of the 'mechanics' of meters the reader is referred to such texts as *Electrical and Electronic Measurement and Testing* by W. Bolton (Longman 1992) or *Electronic Instruments and Measurement Techniques* by F.F. Mazda (Cambridge University Press 1987).

4.2.2 Analogue chart recorders

There are three basic types of analogue chart recorders: the direct reading recorder, the galvanometric recorder and the potentiometric or closed-loop recorder. The data can be recorded on paper by fibre-tipped ink pens, by the impact of a pointer pressing a carbon ribbon against the paper, by the use of thermally sensitive paper which changes colour when a heated pointer moves across it, by a beam of ultraviolet light falling on paper sensitive to it and by a tungsten wire stylus moving across the surface of specially coated paper, a thin layer of aluminium over coloured dye, and the electrical discharge removing the aluminium and exposing the dye.

The *direct reading recorder* (Fig. 4.3) has a pen or stylus directly moved by the displacement action of the measurement system. For temperature measurement this might be the displacement of a bimetallic strip, for a pressure gauge the displacement of a Bourdon tube. A circular chart is used and rotates at a constant rate, typically one revolution in 12 hours, 24 hours or 7 days. The pen moves along curved radial lines and thus paper with curved lines has to be used for the plotting. This makes interpolation difficult. Simultaneous recording with up to four separate variables is possible with four separate pens. The instrument is fairly robust with an accuracy of the order of $\pm 0.5\%$ of the full-scale deflection.

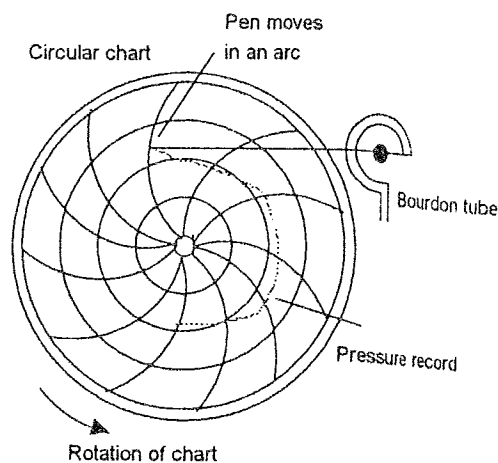


Fig. 4.3 Direct reading recorder

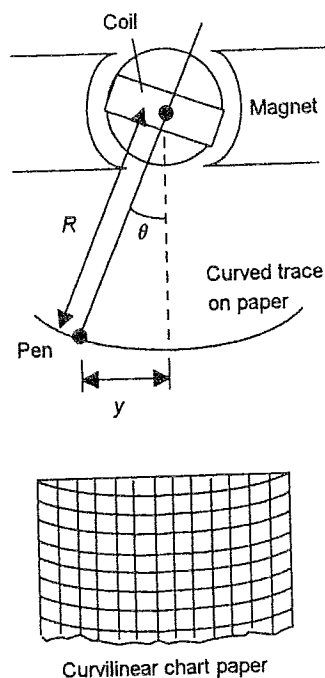


Fig. 4.4 Galvanometric recorder

The *galvanometric type* of chart recorder (Fig. 4.4) works on the same principle as the moving coil meter movement. The coil is suspended between two fixed points by a suspension wire. When a current passes through the coil a torque acts on it, causing it to rotate and twist the suspension. The coil rotates to an angle at which the torque is balanced by the opposing torque resulting from the twisting of the suspension. The rotation of the coil results in a pen being moved across a chart.

If R is the length of the pointer and θ the angular deflection of the coil, then the displacement y of the pen is $y = R \sin \theta$. Since θ is proportional to the current i through the coil, then y is proportional to $\sin i$. This is a non-linear relationship. However, if the angular deflections are restricted to less than $\pm 10^\circ$, then the relationship is reasonably linear, the non-linearity error being less than 0.5%. A greater problem is, however, the fact that the pen moves in an arc rather than a straight line and thus curvilinear paper (Fig. 4.4) has to be used for the plotting. With such forms of chart there are difficulties in interpolation for points between the lines.

Figure 4.5 illustrates the general principles of the *potentiometric recorder*. Such a recorder is sometimes referred to as a *closed-loop recorder* or a *closed-loop servo recorder*. The position of the pen is monitored by means of a slider which moves along a linear potentiometer. The position of the slider determines the potential applied to an operational amplifier. The operational amplifier subtracts the slider signal, which is obtained from the input signal, from the sensor/signal conditioner. The output from the amplifier is thus a signal that is related to the difference between the pen and sensor signals. This signal is used to operate a servo motor which in turn controls the movement of the pen across the chart. The pen thus ends up moving to a position where there is no difference between the pen and sensor signals. The pen is thus made to track the sensor signal.

Potentiometric recorders have high input resistances, higher accuracies than galvanometric recorders (about $\pm 0.1\%$ of full-scale reading) but considerably slower response times. Response times are typically of the order of 1 to 2 s and can only be used for d.c. signals or very low frequencies, up to about 2 Hz. They can thus only be used for slowly changing signals. Because of friction, a minimum current is required to operate the motor and thus there is an error due to the recorder not responding to a small input signal. This error is known as the *dead band*. Typically it is about $\pm 0.3\%$ of the range of the instrument. Thus, for a range of 5 mV the dead band amounts to about ± 0.015 mV.

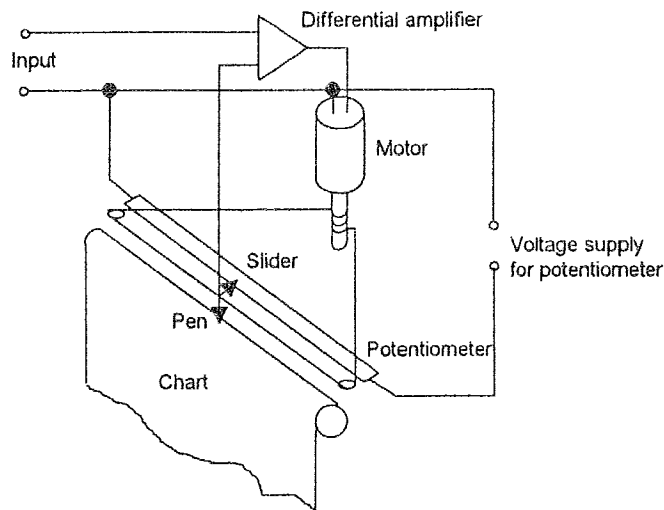


Fig. 4.5 Potentiometric recorder

4.2.3 Cathode-ray oscilloscope

The cathode-ray oscilloscope is a voltage-measuring instrument which is capable of displaying extremely high frequency signals. A general-purpose instrument can respond to signals up to about 10 MHz while more specialist instruments can respond up to about 1 GHz. Double-beam oscilloscopes enable two separate traces to be observed simultaneously on the screen while storage oscilloscopes enable the trace to remain on the screen after the input signal has ceased, only being removed by a deliberate action of erasure. Digital storage oscilloscopes digitise the input signal and store the digital signal in a memory. It can then be analysed and manipulated and the analogue display on the oscilloscope screen obtained from reconstructing the analogue signal. Permanent records of traces can be made with special-purpose cameras that attach directly to the oscilloscope.

A general-purpose oscilloscope is likely to have vertical deflection, i.e. Y-deflection, sensitivities which vary between 5 mV per scale division to 20 V per scale division. In order that a.c. components can be viewed in the presence of high d.c. voltages, a blocking capacitor can be switched into the input line. When the amplifier is in its a.c. mode its bandwidth typically extends from about 2 Hz to 10 MHz and when in the d.c. mode from d.c. to 10 MHz. The Y-input impedance is typically about 1 M Ω shunted with about 20 pF capacitance. When an external circuit is connected to the Y-input, problems due to loading and interference can distort the input signal. While interference can be reduced by the use of coaxial cable, the capacitance of the coaxial cable and any probe attached to it can be enough, particularly at low frequencies, to introduce a relatively low impedance across the input impedance of the oscilloscope and so

introduce significant loading. A number of probes exist for connection to the input cable and which are designed to increase the input impedance and avoid this loading problem. A passive voltage probe that is often used is a 10 to 1 attenuator (Fig. 4.6). This has a $9\text{ M}\Omega$ resistor and variable capacitor in the probe tip. However, this not only reduces the capacitive loading but also the voltage sensitivity and so an active voltage probe using an FET is often used.

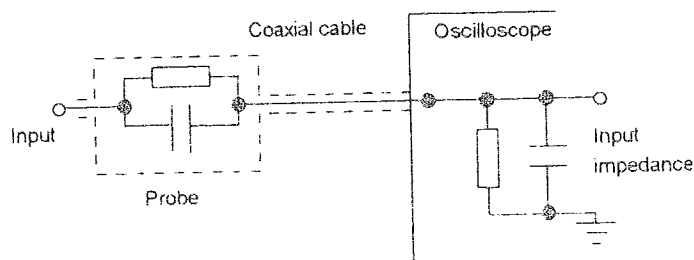



Fig. 4.6 Passive voltage probe

For details of the 'mechanics' of cathode-ray oscilloscopes the reader is referred to such texts as *Newnes Instrumentation and Measurement* by W. Bolton (Newnes 1991, 1996, 2000), *Principles of Electronic Instrumentation and Measurement* by H.M. Berlin and F.C. Getz (Merrill 1988) or *Electronic Instruments and Measurement Techniques* by F.F. Mazda (Cambridge University Press 1987).

4.2.4 Visual display unit

Output data is increasingly being presented using a television type of display, termed a visual display unit (VDU). This builds up a picture on a cathode-ray tube screen by moving the spot formed by the electron beam in a series of horizontal scan lines, one after another down the screen. The image is built up by varying the intensity of the spot on the screen as each line is scanned. This raster form of display is termed *non-interlaced* (Fig. 4.7(a)). To reduce the effects of flicker two scans down the screen are used to trace a complete picture. On the first scan all the odd-numbered lines are traced out and on the second the even-numbered lines are traced. This technique is called *interlaced scanning* (Fig. 4.7(b)).

The screen of the visual display unit is coated with a large number of phosphor dots, these dots forming the *pixels*. The term pixel is used for the smallest addressable dot on any display device. A text character or a diagram is produced on the screen by selectively lighting these dots. Figure 4.8 shows how, for a 7 by 5 matrix, characters are built up by the electron beam moving in its zigzag path down the screen. The input data to the VDU is usually in digital *ASCII* (*American Standard Code for*

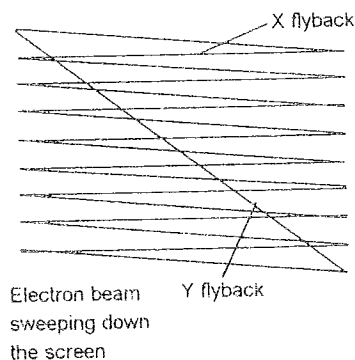


(a)




(b)

Fig. 4.7 (a) Non-interlaced

(b) interlaced displays



7 by 5 matrix of pixels

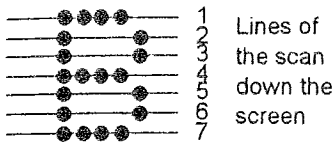

Lines of the scan down the screen

Fig. 4.8 Character build-up by selective lighting

Information Interchange) format. This is a 7-bit code and so can be used to represent $2^7 = 128$ characters. It enables all the standard keyboard characters to be covered, as well as some control functions such as RETURN which is used to indicate the return from the end of a line to the start of the next line. Table 4.1 gives an abridged list of the code.

4.2.5 Printers

Printers provide a record of data on paper. There are a number of versions of such printers: the dot matrix printer, the ink/bubble jet printer and the laser printer.

The *dot matrix printer* has a print head (Fig. 4.9) which consists of either 9 or 24 pins in a vertical line. Each pin is controlled by an electromagnet which when turned on propels the pin onto the inking ribbon. This transfers a small blob of ink onto the paper behind the ribbon. A character is formed by moving the print head in horizontal lines back-and-forth across the paper and firing the appropriate pins.

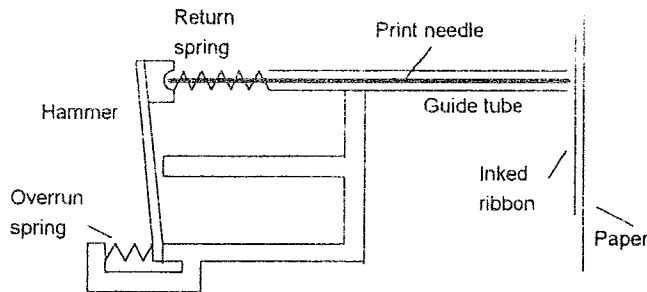


Fig. 4.9 Dot matrix print head mechanism

Table 4.1 ASCII code

Character	ASCII	Character	ASCII	Character	ASCII
A	100 0001	N	100 1110	0	011 0000
B	100 0010	O	100 1111	1	011 0001
C	100 0011	P	101 0000	2	011 0010
D	100 0100	Q	101 0001	3	011 0011
E	100 0101	R	101 0010	4	011 0100
F	100 0110	S	101 0011	5	011 0101
G	100 0111	T	101 0100	6	011 0110
H	100 1000	U	101 0101	7	011 0111
I	100 1001	V	101 0110	8	011 1000
J	100 1010	W	101 0111	9	011 1001
K	100 1011	X	101 1000		
L	100 1100	Y	101 1001		
M	100 1101	Z	101 1010		




Fig. 4.10 Producing a stream of drops


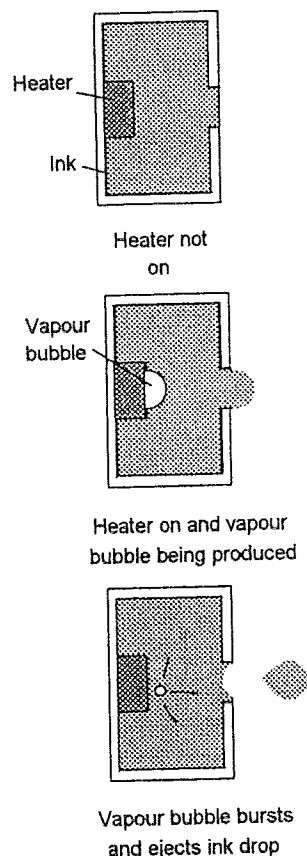


Fig. 4.11 Principle of the bubble jet

The *ink jet printer* uses a conductive ink which is forced through a small nozzle to produce a jet of very small drops of ink of constant diameter at a constant frequency. With one form a constant stream of ink passes along a tube and is pulsed to form fine drops by a piezoelectric crystal which vibrates at a frequency of about 100 kHz (Fig. 4.10). Another form uses a small heater in the print head with vaporised ink in a capillary tube, so producing gas bubbles which push out drops of ink (Fig. 4.11). In one printer version each drop of ink is given a charge as a result of passing through a charging electrode and the charged drops are deflected by passing between plates between which an electric field is maintained; in another version a vertical stack of nozzles is used and each jet is just switched on or off on demand. Inkjet printers can give colour prints by the use of three different colour ink jet systems. The fineness of the drops is such that prints can be produced with more than 600 dots per inch.

The *laser printer* has a photosensitive drum which is coated with a selenium-based light-sensitive material (Fig. 4.12). In the dark the selenium has a high resistance and consequently becomes charged as it passes close to the charging wire; this is a wire at a high voltage and off which charge leaks. A light beam is made to scan along the length of the drum by a small rotating eight-sided mirror. When light strikes the selenium its resistance drops and it can no longer remain charged. By controlling the brightness of the beam of light, so points on the drum can be discharged or left charged. As the drum passes the toner reservoir, the charged areas attract particles of toner which thus stick to the areas that have not been exposed to light and do not stick on the areas that have been exposed to light. The paper is given a charge as it passes another charging wire, the so-called corona wire, so that as it passes close to the drum it attracts the toner off the drum. A hot fusing roller is then used to melt the toner particles so that, after passing between rollers, they firmly adhere to the paper. General-use laser printers are currently able to produce 600 dots per inch.

Fig. 4.12 Basic elements of a laser printer

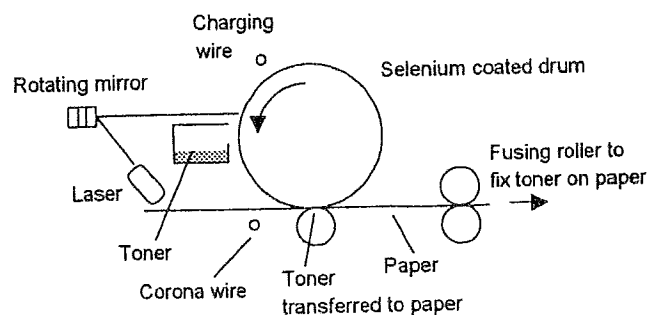

4.3 Magnetic recording

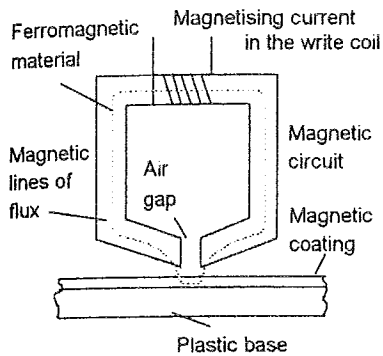


Fig. 4.13 Basis of magnetic recording head

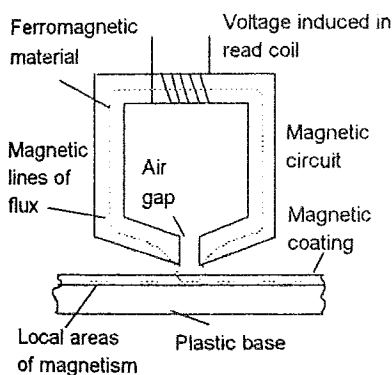


Fig. 4.14 Basis of magnetic replay head

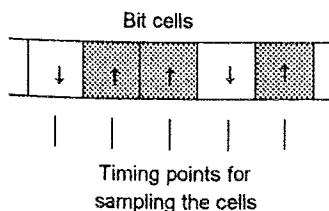


Fig. 4.15 Bit cells

Magnetic recording is used for the storage of data on the floppy discs and hard discs of computers. The basic principles are that a recording head, which responds to the input signal, produces corresponding magnetic patterns on a thin layer of magnetic material and a read head gives an output by converting the magnetic patterns on the magnetic material to electrical signals. In addition to these heads the systems requires a transport system which moves the magnetic material in a controlled way under the heads.

Figure 4.13 shows the basic elements of the recording head, it consists of a core of ferromagnetic material which has a non-magnetic gap. When electrical signals are fed to the coil which is wound round the core, magnetic flux is produced in the core. The proximity of the magnetic coated plastic to the non-magnetic gap means that the magnetic flux readily follows a path through the core and that part of the magnetic coating in the region of the gap. When there is magnetic flux passing through a region of the magnetic coating it becomes permanently magnetised. Hence a magnetic record is produced of the electrical input signal. Reversing the direction of the current reverses the flux direction.

The replay head (Fig. 4.14) has a similar construction to that of the recording head. When a piece of magnetised coating bridges the non-magnetised gap then magnetic flux is induced in the core. Flux changes in the core induce e.m.f.s in the coil wound round the core. Thus the output from the coil is an electrical signal which is related to the magnetic record on the coating.

4.3.1 Magnetic recording codes

Digital recording involves the recording of signals as a coded combination of bits. A bit cell is the element of the magnetic coating where the magnetism is either completely saturated in one direction or completely saturated in the reverse direction. Saturation is when the magnetising field has been increased to such an extent that the magnetic material has reached its maximum amount of magnetic flux and further increases in magnetising current produce no further change.

The bit cells on the magnetic surface might then appear in the form shown in Figure 4.15. An obvious method of putting data on the magnetic material might seem to be to use the magnetic flux in one direction to represent a 0 and in the reverse direction a 1. However, it is necessary to read each cell and thus accurate timing points are needed in order to clearly indicate when sampling should take place. Problems can arise if some external clock is used to give the timing signals, a small mismatch between the timing signals and the rate at which the magnetic surface is moving under the read head can result in perhaps a cell being missed or even read twice. Synchronisation is essential. Such synchronisation is achieved by using the bit cells themselves

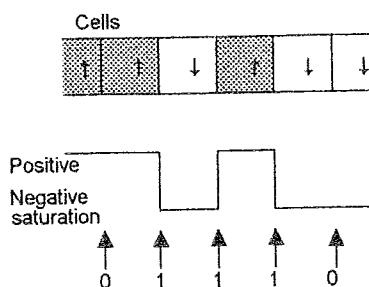


Fig. 4.16 Non-return-to-zero recording

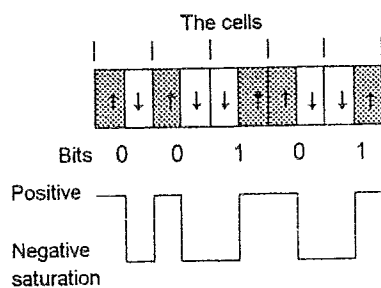


Fig. 4.17 Phase encoding

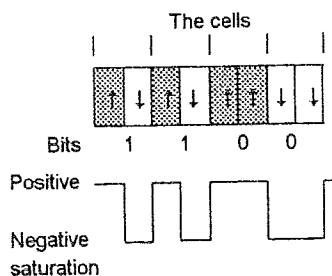


Fig. 4.18 Frequency modulation

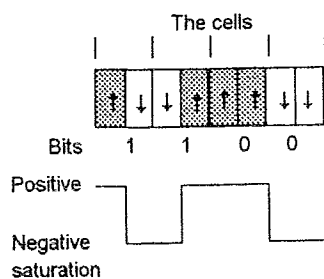


Fig. 4.19 Modified FM

to generate the signals for taking samples. One method is to use transitions on the magnetic surface from saturation in one direction to saturation in the other, i.e. where the demarcation between two bits is clearly evident, to give feedback to the timing signal generation in order to adjust it so that it is in synchronisation with the bit cells.

If the flux reversals do not occur sufficiently frequently, this method of synchronisation can still result in errors occurring. One way of overcoming this problem is to use a form of encoding. The following are some of the methods commonly used:

1 Non-return-to-zero (NRZ)

With this system the flux is recorded on the tape such that no change in flux represents 0 and a change in flux 1 (Fig. 4.16). It is, however, not self-clocking.

2 Phase encoding (PE)

Phase encoding has the advantage of being self-clocking with no external clock signals being required. Each cell is split in two with one half having positive saturation flux and the other a negative saturation flux. A digit 0 is then recorded as a half-bit positive saturation followed by a half-bit negative saturation; a 1 digit is represented by a half-bit negative saturation followed by a half-bit positive saturation. The mid-cell transition of positive to negative thus indicates a 0 and a negative to positive transition a 1 (Fig. 4.17).

3 Frequency modulation (FM)

This is self-clocking and similar to phase encoding but there is always a flux direction reversal at the beginning of each cell (Fig. 4.18). For a 0 bit there is then no additional flux reversal during the cell but for a 1 there is an additional flux reversal during the cell.

4 Modified frequency modulation (MFM)

This is a modification of the frequency modulation code, the difference being that the flux reversal at the beginning of each bit code is only present if the current and previous bit was 0 (Fig. 4.19). This means that only one flux reversal is required for each bit. This and the run length limited code are the codes generally used for magnetic discs.

5 Run length limited (RLL)

This is a group of self-clocking codes which specify a minimum and maximum distance, i.e. run, between flux reversals. The maximum run is short enough to ensure that the flux reversals are sufficiently frequent for the code to be self-clocking. A commonly used form of this code is RLL_{2,7}, the 2,7 indicating the minimum distance between flux reversals is to be 2 bits and the maximum is to be 7. The

sequence of codes is described as a sequence of S-codes and R-codes. An S-code, a space code, has no reversals of flux while an R-code, a reversal code, has a reversal during the bit. Two S/R-codes are used to represent each bit. The bits are grouped into sequences of 2, 3 and 4 bits and a code assigned to each group, the codes being:

Bit sequence	Code sequence
10	SRSS
11	RSSS
000	SSSRSS
010	RSSRSS
011	SSRSSS
0010	SSRSSRSS
0011	SSSSRSSS

Figure 4.20 shows the coding for the sequence 0110010, it being broken into groups 011 and 0010 and so represented by SSRSSSRSSRSS. There are at least two S-codes between R-codes and there can be no more than seven S-codes between R-codes.

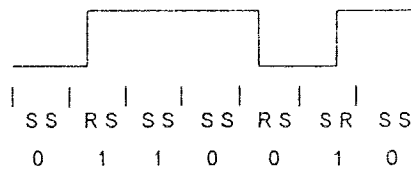


Fig. 4.20 RLL code

The optimum code is the one that allows the bits to be packed as close as possible and which can be read without error. The read heads can locate reversals quite easily but they must not be too close together. The RLL code has the advantage of being more compact than the other codes, PE and FM taking up the most space. MFM and NRZ take up the same amount of space. NRZ has the disadvantage of, unlike the other codes, not being self-clocking.

4.3.2 Magnetic discs

Digital recording is very frequently to a floppy or hard disc. The digital data is stored on the disc surface along concentric circles called tracks, a single disc having many such tracks. A single read/write head is used for each disc surface and the heads are moved, by means of a mechanical actuator, backwards and forwards to access different tracks. The disc is spun by the drive and the read/write heads read or write data into a track.

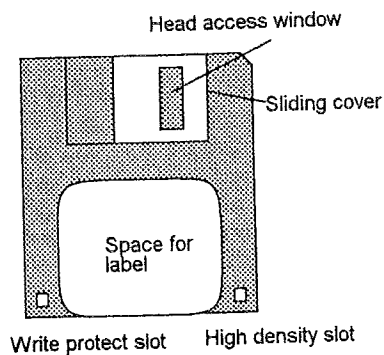


Fig. 4.21 Floppy disc

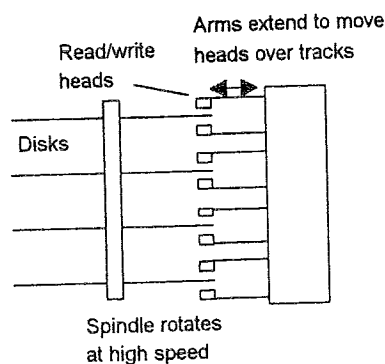


Fig. 4.22 Hard disc

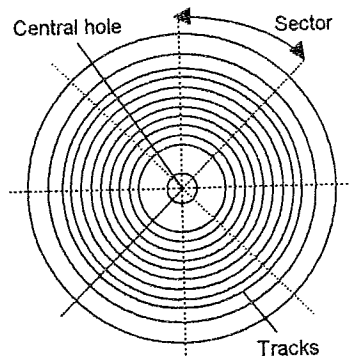


Fig. 4.23 Tracks and sectors

4.4 Displays

The 3½ inch floppy disc (Fig. 4.21) used in the personal computer has 135 tracks per inch and can store 1.4 Mbytes of data. No part of the disc is exposed when it is outside the computer, there being a sliding protective metal cover which only opens to reveal the magnetic surface when the disc is in the computer.

Hard discs (Fig. 4.22) are sealed units with data stored on the disc surface along concentric circles. A hard disc assembly has more than one such disc and the data is stored on magnetic coatings on both sides of the discs. The discs are rotated at high speeds and the tracks accessed by moving the read/write heads. Large amounts of data can be stored on such assemblies of discs; storages of the order of many Gbytes are now common.

The disc surface is divided into sectors (Fig. 4.23) and so a unit of information on a disc has an address consisting of a track number and a sector number. A floppy disc has normally between 8 and 18 sectors and about 100 tracks. A hard disc might have about 2000 tracks per surface and 32 sectors. To seek data the head must be moved to over the required track, the time this takes being termed the *seek time*, and then wait there until the required segment moves under it, this time being termed the *latency*. In order that an address can be identified it is necessary for information to have been recorded on the disc to identify segments and tracks. The writing of this information is called *formatting* and has to be carried out before data can be stored on a disc. The technique usually used is to store this location information on the tracks so that when data is stored the sequence of information on a track becomes:

index marker,
sector 0 header, sector 0 data, sector 0 trailer,
sector 1 header, sector 1 data, sector 1 trailer,
sector 2 header, sector 2 data, sector 2 trailer,
etc.

The index marker contains the track number with the sector header identifying the sector. The sector trailer contains information, e.g. a cyclic redundancy check (see Section 20.4) which can be used to check that a sector was read correctly.

Many display systems use light indicators to indicate on-off status or give alphanumeric displays. The term *alphanumeric* is a contraction of the terms alphabetic and numeric and describes displays of the letters of the alphabet and numbers 0 to 9 with decimal points. One form of such a display involves seven 'light' segments to generate the alphabetic and numeric characters. Figure 4.24 shows the segments and Table 4.2 shows how a 4-bit binary code input can be used to generate inputs to switch on the various segments.

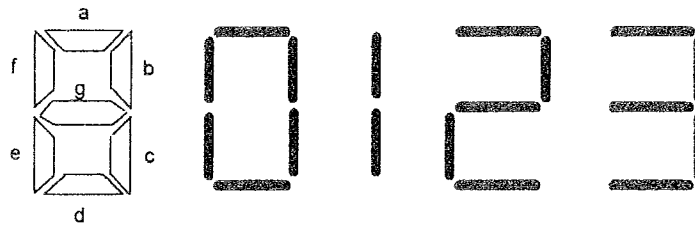


Fig. 4.24 Seven-segment display

Table 4.2 Seven-segment display

Binary input				Segments activated							Number displayed
				a	b	c	d	e	f	g	
0	0	0	0	1	1	1	1	1	1	0	0
0	0	0	1	0	1	1	0	0	0	0	1
0	0	1	0	1	1	0	1	1	0	1	2
0	0	1	0	1	1	1	1	0	0	1	3
0	1	0	0	0	1	1	0	0	1	1	4
0	1	0	1	1	0	1	1	0	1	1	5
0	1	1	0	0	0	1	1	1	1	1	6
0	1	1	1	1	1	1	0	0	0	0	7
1	0	0	0	1	1	1	1	1	1	1	8
1	0	0	1	1	1	1	0	0	1	1	9

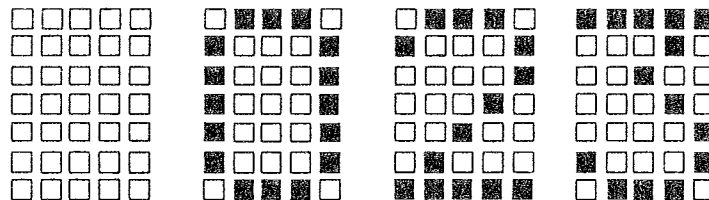


Fig. 4.25 7 by 5 dot matrix display

Another format involves a 7 by 5 or 9 by 7 dot matrix (Fig. 4.25). The characters are then generated by the excitation of appropriate dots.

4.4.1 Light indicators

The light indicators for such displays might be neon lamps, incandescent lamps, light-emitting diodes (LEDs) or liquid crystal displays (LCDs). *Neon lamps* need high voltages and low currents and can be powered directly from the mains voltage but can only be used to give a red light. *Incandescent lamps* can be

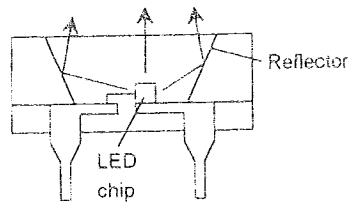


Fig. 4.26 Light-emitting diode

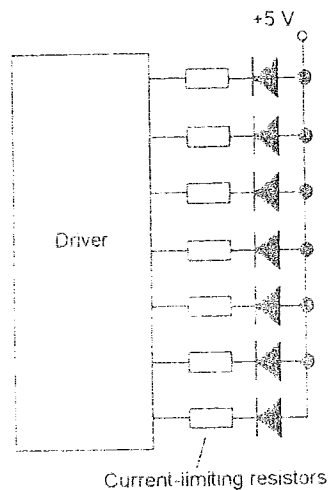


Fig. 4.27 Common anode connection for LEDs

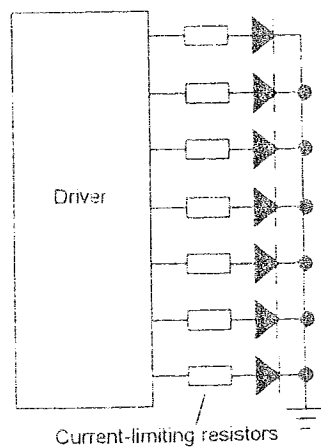


Fig. 4.28 Common cathode connection for LEDs

used with a wide range of voltages but need a comparatively high current. They emit white light so use lenses to generate any required colour. Their main advantage is their brightness.

Light-emitting diodes require low voltages and low currents and are cheap. These diodes when forward biased emit light over a certain band of wavelengths. Figure 4.26 shows the basic form of a LED, the light emitted from the diode being enhanced in one direction by means of reflectors. Commonly used LED materials are gallium arsenide, gallium phosphide and alloys of gallium arsenide with gallium phosphide. The most commonly used LEDs can give red, yellow or green colours. With microprocessor-based systems, LEDs are the most common form of indicator used.

4.4.2 LED displays

A current-limiting resistor is generally required with a LED in order to limit the current to below the maximum rated current of about 10 to 30 mA. Typically a LED might give a voltage drop across it of 2.1 V when the current is limited to 20 mA. Thus when, say, a 5 V output is applied, 2.9 V has to be dropped across a series resistor. This means a resistance of $2.9/0.020 = 145 \Omega$ is required and so a standard resistor of 150Ω is likely to be used. Some LEDs are supplied with built-in resistors so they can be directly connected to microprocessor systems.

LEDs are available as single light displays, seven- and sixteen-segment alphanumeric displays, in dot matrix format and bar graph form.

Figure 4.27 shows how seven LEDs, to give the seven segments of a display of the form shown in Figure 4.24, might be connected to a driver so that when a line is driven low, a voltage is applied and the LED in that line is switched on. The voltage has to be above a 'turn-on' value before the LED emits significant light; typical turn-on voltages are about 1.5 V. Such an arrangement is known as the *common anode* form of connection since all the LED anodes are connected together. An alternative arrangement is the *common cathode* (Fig. 4.28). The elements in common anode form are made active by the input going low, in the common cathode type by going high. Common anode is the usual choice since the direction of current flow and the size of current involved are usually most appropriate.

Example of such types of display are the seven-segment 7.6 mm and 10.9 mm high intensity displays of Hewlett Packard which are available as either common anode or common cathode form. In addition to the seven segments to form the characters there is either a left-hand or right-hand decimal point. By illuminating different segments of the display the full range of numbers and a small range of alphabetical characters can be formed.

Often the output from the driver is not in the normal binary form but in *binary coded decimal* (BCD) (see Section 14.2). With BCD, each decimal digit is coded separately in binary. For

example, the decimal number 15 has the 1 coded as 0001 and the 5 as 0101 to give the BCD code of 0001 0101. The driver output has then to be decoded into the required format for the LED display. The 7447 is a commonly used decoder for driving displays (Fig. 4.29).

See Section 18.3.4 for a discussion of the interfacing of LED displays to microprocessors.

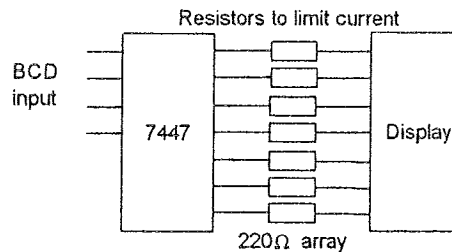


Fig. 4.29 Decoder with seven-segment display

4.4.3 A 5 by 7 dot matrix LED display

Figure 4.30 shows the basic form used for a 5 by 7 dot matrix display. The array consists of five column connectors, each connecting the anodes of seven LEDs. Each row connects to the cathodes of five LEDs. To turn on a particular LED, power is applied to its column and its row is grounded. Such a display enables all the ASCII characters to be produced.

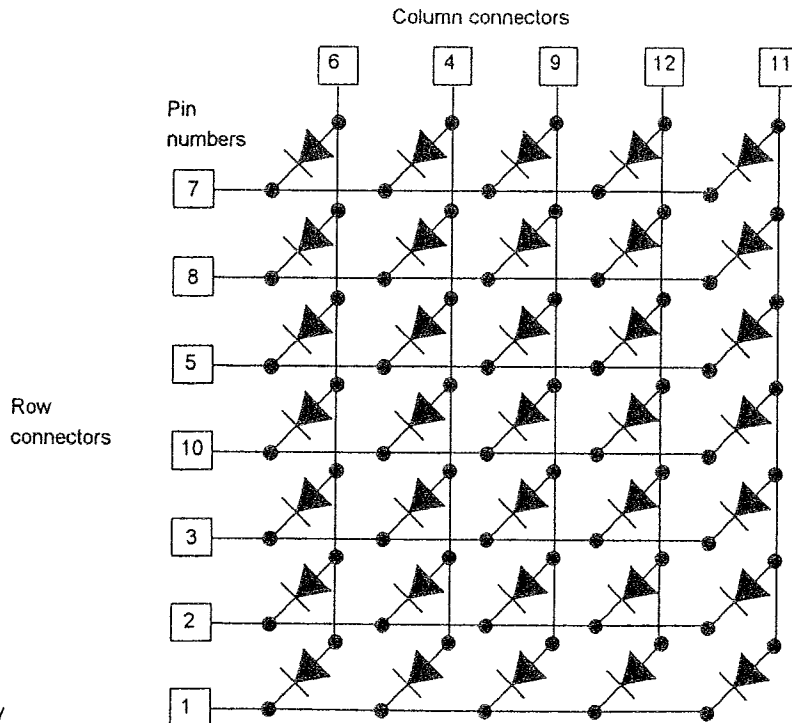


Fig. 4.30 Dot matrix display

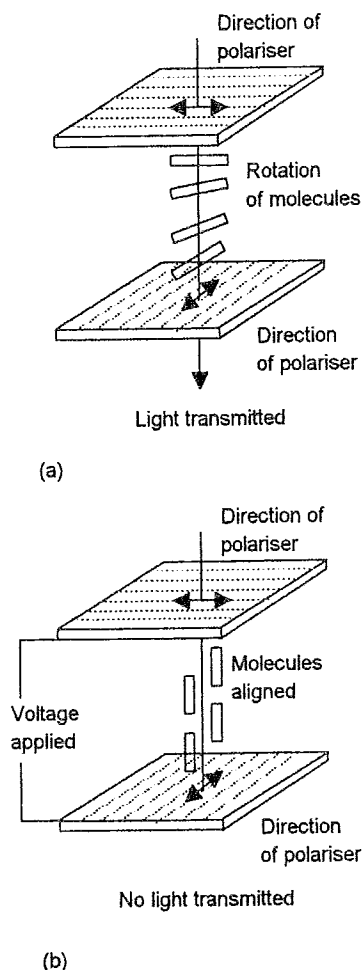


Fig. 4.31 Liquid crystal: (a) no electric field, (b) electric field

4.4.4 Liquid crystal displays

Liquid crystal displays do not produce any light of their own but rely on reflected light or transmitted light. The liquid crystal material is a compound with long rod-shaped molecules which is sandwiched between two sheets of polymer containing microscopic grooves. The upper and lower sheets are grooved in directions at 90° to each other. The molecules of the liquid crystal material align with the grooves in the polymer and adopt a smooth 90° twist between them (Fig. 4.31).

When plane polarised light is incident on the liquid crystal material its plane of polarisation is rotated as it passes through the material. Thus if it is sandwiched between two sheets of polariser with their transmission directions at right angles, the rotation allows the light to be transmitted and so the material appears light.

However, if an electric field is applied across the material, the molecules become aligned with the field and the light passing through the top polariser is not rotated and cannot pass through the lower polariser but becomes absorbed. The material then appears dark.

The arrangement is put between two sheets of glass on which are transparent electrodes in the shape of the seven-segment display and thus the application of voltages to the various display elements results in them appearing black against the lighter display where there is no electric field. This is the form of display used in battery-operated devices such as watches and calculators. Five by seven dot matrix forms are also available.

4.4.5 Alarm indicators

A wide variety of alarm systems are used with measurement and control systems. Commonly met ones are:

- 1 Temperature alarms which respond when the temperature reaches a particular value or falls to some other value. These may be based on the use of a resistance element or thermocouple to sense the temperature.
- 2 Current alarms which respond when the current reaches a particular value or falls below some other value.
- 3 Voltage alarms which respond when the voltage reaches a particular value or falls below some other value.
- 4 Weight alarms which respond when the weight in a container reaches a particular value or falls below some other value. These generally use load cells with electrical resistance strain gauges.

Alarm indicators take an analogue input from some sensor, possibly via a signal conditioner, and turn it into an on-off signal for some indicator. Figure 4.32 shows the basic form of alarm system. The input is compared with the alarm set point. The comparator takes two inputs and gives an output when, for example, input A is greater than input B. Thus when the set point is exceeded a logic 0 or 1 signal passes to the logic unit which then gives an output which triggers the switching unit and switches on, or off, an indicator. The indicator can take a variety of forms, e.g. a bell, a horn, a klaxon, a coloured light, a flashing light, a back lighted display (the light comes on behind a message on a screen).




Fig. 4.32 An alarm system

4.5 Data acquisition systems

Automated data acquisition systems can take the form of a dedicated instrument termed a data logger or a personal computer using plug-in DAQ boards.

4.5.1 Data loggers

Figure 4.33 shows the basic elements of a *data logger*. Such a unit can monitor the inputs from a large number of sensors. Inputs from individual sensors, after suitable signal conditioning, are fed into the multiplexer. The multiplexer is used to select one signal which is then fed, after amplification, to the analogue-to-digital converter. The digital signal is then processed by a microprocessor. The microprocessor is able to carry out simple arithmetic operations, perhaps taking the average of a number of measurements. The output from the system might be displayed on a digital meter that indicates the output and channel number, used to give a permanent record with a printer, stored on a floppy disc or transferred to perhaps a computer for analysis.

Because data loggers are often used with thermocouples, there are often special inputs for thermocouples, these providing cold junction compensation and linearisation. The multiplexer can be switched to each sensor in turn and so the output consists of a sequence of samples. Scanning of the inputs can be selected by programming the microprocessor to switch the multiplexer to just sample a single channel, carry out a single scan of all channels, a continuous scan of all channels, or perhaps carry out a periodic scan of all channels, say every 1, 5, 15, 30 or 60 minutes.

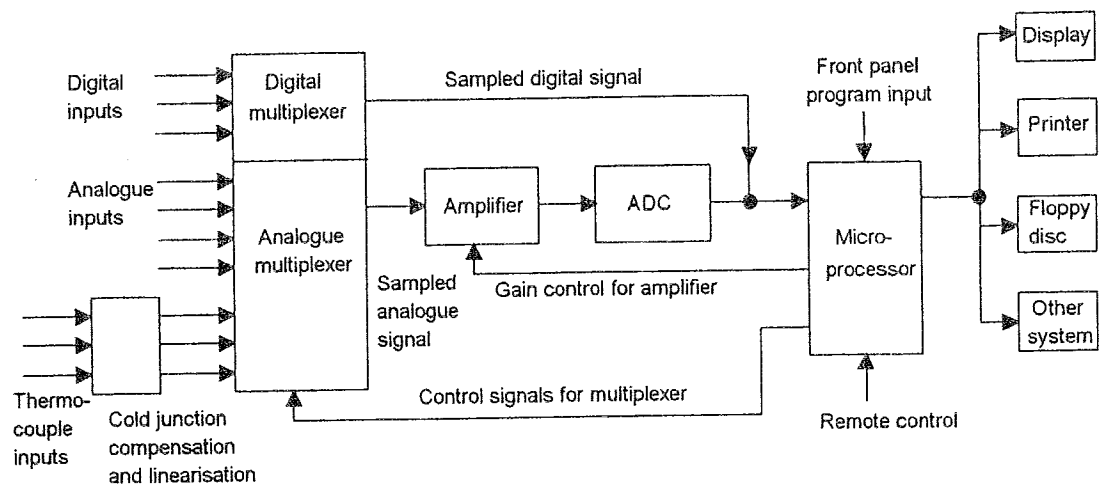


Fig. 4.33 Data logger system

Typically a data logger may handle 20 to 100 inputs, though some may handle considerably more, perhaps 1000. It might have a sample and conversion time of $10\ \mu\text{s}$ and be used to make perhaps 1000 readings per second. The accuracy is typically about 0.01% of full-scale input and linearity is about $\pm 0.005\%$ of full-scale input. Cross-talk is typically 0.01% of full-scale input on any one input. The term *cross-talk* is used to describe the interference that can occur when one sensor is being sampled as a result of signals from other sensors.

4.5.2 Computer with plug-in boards

Figure 4.34 shows the basic elements of a data acquisition system using plug-in boards with a computer. The signal conditioning prior to the inputs to the board depends on the sensors concerned, e.g. it might be for thermocouples – amplification, cold junction compensation and linearisation; for strain gauges – Wheatstone bridge, voltage supply for bridge and linearisation; for RTDs – current supply, circuitry and linearisation.

In selecting the DAQ board to be used the following criteria have to be considered:

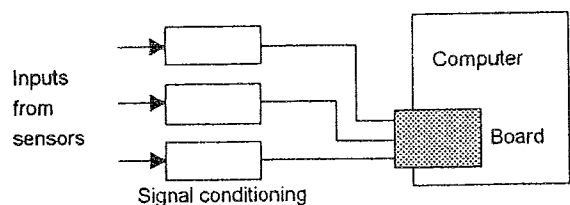


Fig. 4.34 Data acquisition system


- 1 What type of computer software system is being used, e.g. Windows, MacOS?
- 2 What type of connector is the board to be plugged into, e.g. PCMCIA for laptops, NuBus for MacOS, PCI?
- 3 How many analogue inputs will be required and what are their ranges?
- 4 How many digital inputs will be required?
- 5 What resolution will be required?
- 6 What is the minimum sampling rate required?
- 7 Are any timing or counting signals required?

All DAQ boards use *drivers*, software generally supplied by the board manufacturer with a board, to communicate with the computer and tell it what has been inserted and how the computer can communicate with the board. Before a board can be used three parameters have to be set. These are the addresses of the input and output channels, the interrupt level and the channel to be used for direct memory access. With 'plug-and-play' boards for use with Windows software, these parameters are set by the software; otherwise microswitches have to be set on the card in accordance with the instructions in the manual supplied with the board.

Application software can be used to assist in the designing of measurement systems and the analysis of the data. As an illustration of the type of application software available, LabVIEW is a graphical programming software package that has been developed by National Instruments for data acquisition and instrument control. LabVIEW programs are called *virtual instruments* because in appearance and operation they imitate actual instruments. A virtual instrument has three parts, a front panel which is the interactive user interface and simulates the front panel of an instrument by containing control knobs, push buttons and graphical displays, a block diagram which is the source code for the program with the programming being done graphically by drawing lines between connection points on selected icons on the computer screen, and representation as an icon and connector which can provide a graphical representation of the virtual instrument if it is wanted for use in other block diagrams.


Figure 4.35 shows the icon selected for a virtual instrument where one analogue sample is obtained from a specified input channel, the icon having been selected from the Analog Input palette. The 'device' is the device number assigned to the DAQ board, the 'channel' is the source of the data, a 'sample' is one analogue-to-digital conversion, and 'high limit' and 'low limit' are the voltage limits expected for the signal (the default is +10 V and -10 V and changing these values automatically changes the gain of the amplifier on the DAQ board).

Fig. 4.35 Analogue input icon

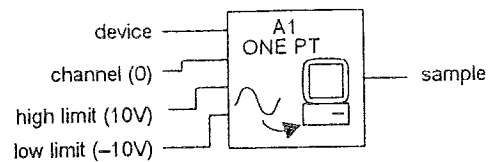

If we want a waveform from each channel in a designated channel string then the icon shown in Figure 4.36 can be selected. For each input channel a set of samples is acquired over a period of time, at a specified sampling rate, and gives a waveform output showing how the analogue quantity varies with time.

Fig. 4.36 Analogue input icon for sampling a number of channels

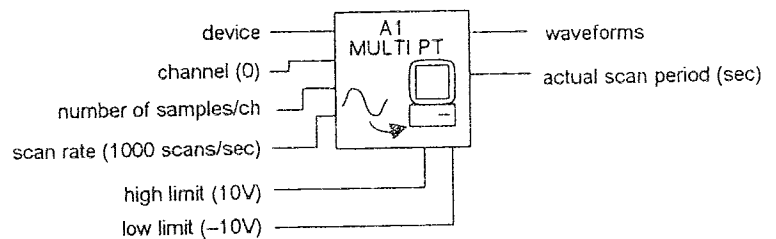

By connecting other icons to, say, the above icon, a block diagram can be built up which might take the inputs from a number of analogue channels, sample them in sequence and display the results as a sequence of graphs. The type of front panel display we might have for a simple DAQ acquisition of samples and display is shown in Figure 4.37. By using the up and down arrows the parameters can be changed and the resulting display viewed.

The above is just a simple illustration of what is possible. For more details the reader is referred to the *LabVIEW Manual* or *LabVIEW for Everyone* by L.K. Wells and J. Travis (Prentice-Hall 1997) or *LabVIEW Graphical Programming* by G.W. Johnson (McGraw-Hill 1994).

4.6 Measurement systems

The following examples illustrate some of the points involved in the design of measurement systems for particular applications.

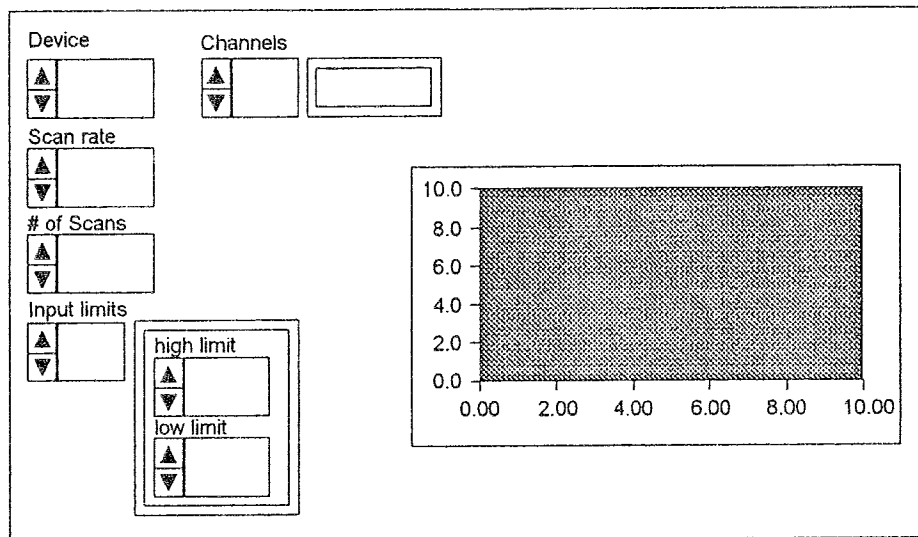


Fig. 4.37 Front panel

4.6.1 Load cell for use as a link to detect load lifted

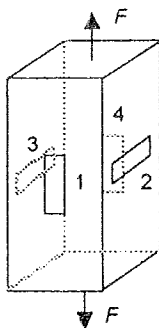


Fig. 4.38 Load cell

A link-type load cell, of the form shown in Figure 4.38, has four strain gauges attached to its surface and can be inserted in between the cable lifting a load and the load to give a measure of the load being lifted. Two of the strain gauges are in the longitudinal axis direction and two in a transverse direction. When the link is subject to tensile forces, the axial gauges will be in tension and the transverse gauges in compression. Suppose we have the design criteria for the load cell of a sensitivity such that there is an output of about 30 mV when the stress applied to the link is 500 MPa. We will assume the strain gauges may be assumed to have gauge factors of 2.0 and resistances of 100 Ω .

When a load F is applied to the link then, since the elastic modulus E is stress/strain and stress is force per unit area, the longitudinal axis strain ϵ_l is F/AE and the transverse strain ϵ_t is $-\nu F/AE$, where A is the cross-sectional area and ν is Poisson's ratio for the link material. The responses of the strain gauges (see Section 2.3.1) to these strains are

$$\frac{\delta R_1}{R_1} = \frac{\delta R_4}{R_4} = G\epsilon_l = \frac{GF}{AE}$$

$$\frac{\delta R_3}{R_3} = \frac{\delta R_2}{R_2} = G\epsilon_t = -\frac{\nu GF}{AE}$$

The output voltage from the Wheatstone bridge (see Section 3.5.1) is given by

$$V_o = \frac{V_s R_1 R_4}{(R_1 + R_2)(R_3 + R_4)} \left(\frac{\delta R_1}{R_1} - \frac{\delta R_2}{R_2} - \frac{\delta R_3}{R_3} + \frac{\delta R_4}{R_4} \right)$$

With $R_1 = R_2 = R_3 = R_4 = R$, and with $\delta R_1 = \delta R_4$ and $\delta R_2 = \delta R_3$, then

$$V_o = \frac{V_s}{2R} (\delta R_1 - \delta R_2) = \frac{V_s GF}{2\Delta E} (1 + \nu)$$

Suppose we consider steel for the link. Then tables give E as about 210 GPa and ν about 0.30. Thus with a stress ($= F/A$) of 500 MPa we have, for strain gauges with a gauge factor of 2.0,

$$V_o = 3.09 \times 10^{-3} V_s$$

For a bridge voltage with a supply voltage of 10 V this would be an output voltage of 30.9 mV. No amplification is required if this is the only load value required; if, however, this is a maximum value and we want to determine loads below this level then we might use a differential amplifier. The output can be displayed on a high-resistance voltmeter, high resistance to avoid loading problems. A digital voltmeter might thus be suitable.

4.6.2 Temperature alarm system

A measurement system is required which will set off an alarm when the temperature of a liquid rises above 40°C. The liquid is normally at 30°C. The output from the system must be a 1 V signal to operate the alarm.

Since the output is to be electrical and a reasonable speed of response is likely to be required, an obvious possibility is an electrical resistance element. To generate a voltage output the resistance element could be used with a Wheatstone bridge. The output voltage will probably be less than 1 V for a change from 30 to 40°C but a differential amplifier could be used to enable the required voltage to be obtained. A comparator can then be used to compare the value with the set value for the alarm.

Suppose a nickel element is used. Nickel has a temperature coefficient of resistance of 0.0067 /K. Thus if the resistance element is taken as being 100 Ω at 0°C then its resistance at 30°C will be

$$R_{30} = R_0(1 + \alpha t) = 100(1 + 0.0067 \times 30) = 120.1 \Omega$$

and at 40°C

$$R_{40} = 100(1 + 0.0067 \times 40) = 126.8 \Omega$$

Thus there is a change in resistance of 6.7 Ω . If this element forms one arm of a Wheatstone bridge which is balanced at 30°C, then the output voltage V_o is given by (see Section 3.5)

$$\delta V_o = \frac{V_s \delta R_1}{R_1 + R_2}$$

With the bridge balanced at 30°C and, say, all the arms the same value and a supply voltage of 4 V, then

$$\delta V_o = \frac{4 \times 6.7}{126.8 + 120.1} = 0.109$$

To amplify this to 1 V we can use a differential amplifier (see Section 3.2.5)

$$V_o = \frac{R_2}{R_1}(V_2 - V_1)$$

$$1 = \frac{R_2}{R_1} \times 0.109$$

Hence $R_2/R_1 = 9.17$ and so if we use an input resistance of 1 k Ω the feedback resistance must be 9.17 k Ω .

4.6.3 Angular position of a pulley wheel

A potentiometer is to be used to monitor the angular position of a pulley wheel. Consider the items that might be needed to enable there to be an output to a recorder of 10 mV per degree if the potentiometer has a full-scale angular rotation of 320°.

When the supply voltage V_s is connected across the potentiometer we will need to safeguard it and the wiring against possible high currents and so a resistance R_s can be put in series with the potentiometer R_p . The total voltage drop across the potentiometer is thus $V_s R_p / (R_s + R_p)$. For an angle θ with a potentiometer having a full-scale angular deflection of θ_F we will obtain an output from the potentiometer of

$$V_\theta = \frac{\theta}{\theta_F} \frac{V_s R_p}{R_s + R_p}$$

Suppose we consider a potentiometer with a resistance of 4 k Ω and let R_s be 2 k Ω . Then for 1 mV per degree we have

$$0.01 = \frac{1}{320} \frac{4V_s}{4+2}$$

Hence we would need a supply voltage of 4.8 V. To prevent loading of the potentiometer by the resistance of the recorder, a voltage follower circuit can be used. Thus the circuit might be of the form shown in Figure 4.39.

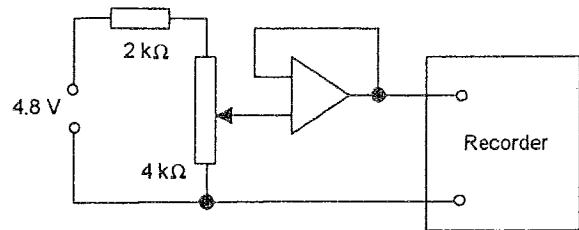


Fig. 4.39 Pulley wheel monitor

4.6.4 Temperature measurement to give a binary output

Consider the requirement for a temperature measurement system for temperatures in the range 0 to 100°C and which will give an 8-bit binary output with a change in 1 bit corresponding to a temperature change of 1°C. The output is intended for inputting to a microprocessor as part of a temperature control system.

A linear temperature sensor is required and so the thermistor LM35 can be used (see Section 2.9.4). LM35 gives an output of 10 mV/°C when it has a supply voltage of 5 V. If we apply the output from LM35 to an 8-bit analogue-to-digital converter then a digital output can be obtained. We need the resolution of the ADC to be 10 mV so that each step of 10 mV will generate a change in output of 1 bit. Suppose we use a successive approximations ADC, e.g. ADC0801, then this requires an input of a reference voltage which when subdivided into $2^8 = 256$ bits gives 10 mV per bit. Thus a reference voltage of 2.56 V is required. For this to be obtained the reference voltage input to the ADC0801 has to be $V_{ref}/2$ and so an accurate input voltage of 1.28 V is required. Such a voltage can be obtained by using a potentiometer circuit across the 5 V supply with a voltage follower to avoid loading problems. Because the voltage has to remain steady at 1.28 V, even if the 5 V supply voltage fluctuates, a voltage regulator is likely to be used, e.g. a 2.45 V voltage regulator ZN458/B. Thus the circuit might be as in Figure 4.40.

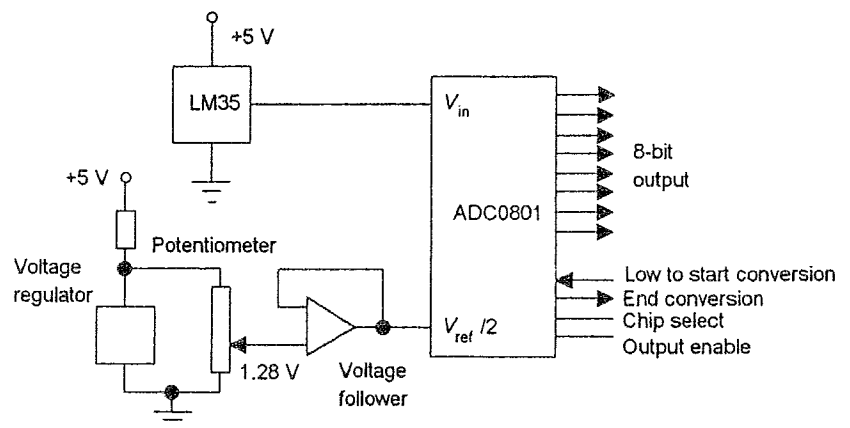


Fig. 4.40 Temperature sensor

4.7 Testing and calibration

Testing a measurement system installation falls into three stages:

- 1 *Pre-installation testing*
This is the testing of each instrument for correct calibration and operation prior to it being installed.
- 2 *Piping and cabling testing*
In the case of pneumatic lines this involves, prior to the connection of the instruments, blowing through with clear, dry air prior to connection and pressure testing to ensure they are leak free. With process piping, all the piping should be flushed through and tested prior to the connection of instruments. With instrument cables, all should be checked for continuity and insulation resistance prior to the connection of any instruments.
- 3 *Precommissioning*
This involves testing that the installation is complete, all instrument components are in full operational order when interconnected and all control room panels or displays function.

4.7.1 Calibration

Calibration consists of comparing the output of a measurement system and its subsystems against standards of known accuracy. The standards may be other instruments which are kept specially for calibration duties or some means of defining standard values. In many companies some instruments and items such as standard resistors and cells are kept in a company standards department and used solely for calibration purposes. The relationship between the calibration of an instrument in everyday use and national standards is likely to be:

- 1 National standards are used to calibrate standards for calibration centres.
- 2 Calibration centre standards are used to calibrate standards for instrument manufacturers.
- 3 Standardised instruments from instrument manufacturers are used to provide in-company standards.
- 4 In-company standards are used to calibrate process instruments.

There is a simple traceability chain from the instrument used in a process back to national standards. For a more detailed discussion of calibration the reader is referred to *Measurement and Calibration for Quality Assurance* by A.S. Morris (Prentice-Hall 1991).

The following are some examples of calibration procedures that might be used in-company:

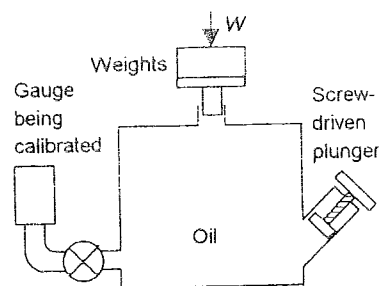


Fig. 4.41 Dead-weight calibration for pressure gauges

1 *Voltmeters*

These can be checked against standard voltmeters or standard cells giving standard e.m.f.s.

2 *Ammeters*

These can be checked against standard ammeters.

3 *Gauge factor of strain gauges*

This can be checked by taking a sample of gauges from a batch and applying measured strains to them when mounted on some test piece. The resistance changes can be measured and hence the gauge factor computed.

4 *Wheatstone bridge circuits*

The output from a Wheatstone bridge can be checked when a standard resistance is introduced into one of the arms.

5 *Load cells*

For low-capacity load cells, dead-weight loads using standard weights can be used.

6 *Pressure sensors*

Pressure sensors can be calibrated by using a dead-weight tester (Fig. 4.41). The calibration pressures are generated by adding standard weights W to the piston tray. After the weights are placed on the tray, a screw-driven plunger is forced into the hydraulic oil in the chamber to lift the piston-weight assembly. The calibration pressure is then W/A , where A is the cross-sectional area of the piston. Alternatively the dead-weight tester can be used to calibrate a pressure gauge and this gauge can be used for the calibration of other gauges.

7 *Temperature sensors*

These can be calibrated by immersion in a melt of a pure metal or water. The temperature of the substance is then slowly reduced and a temperature-time record obtained. When the substance changes state from liquid to solid, the temperature remains constant. Its value can be looked up from tables and hence an accurate reference temperature for calibration obtained. Alternatively, the temperature at which a liquid boils can be used. However, the boiling point depends on the atmospheric pressure and corrections have to be applied if it differs from the standard atmospheric pressure. Alternatively, in-company the readings given by the measurement system can be compared with those of a standard thermometer.

Problems

- 1 Explain the significance of the following terms taken from the specifications of display systems:
 - (a) Closed-loop servo recorder: dead band $\pm 0.2\%$ of span.
 - (b) The hard disc has two discs with four read/write heads, one for each surface of the discs. Each surface has 614 tracks and each track 32 sectors.
 - (c) Data logger: number of inputs 100, cross-talk on any one input 0.01% of full-scale input.
 - (d) Double-beam oscilloscope: vertical deflection with two identical channels, bandwidth d.c. to 15 MHz, deflection factor of 10 mV/div to 20 V/div in 11 calibrated steps, time base of 0.5 μ s/div to 0.5 s/div in 19 calibrated steps.
- 2 Explain the problems of loading when a measurement system is being assembled from a sensor, signal conditioner and display.
- 3 Suggest a display unit that could be used to give:
 - (a) A permanent record of the output from a thermocouple.
 - (b) A display which enables the oil pressure in a system to be observed.
 - (c) A record to be kept of the digital output from a micro-processor.
 - (d) The transient voltages resulting from monitoring of the loads on an aircraft during simulated wind turbulence.
- 4 A cylindrical load cell, of the form shown in Figure 2.33, has four strain gauges attached to its surface. Two of the gauges are in the circumferential direction and two in the longitudinal axis direction. When the cylinder is subject to a compressive load, the axial gauges will be in compression while the circumferential ones will be in tension. If the material of the cylinder has a cross-sectional area A and an elastic modulus E , then a force F acting on the cylinder will give a strain acting on the axial gauges of $-F/AE$ and on the circumferential gauges of $+vF/AE$, where v is Poisson's ratio for the material. Design a complete measurement system, using load cells, which could be used to monitor the mass of water in a tank. The tank itself has a mass of 20 kg and the water when at the required level 40 kg. The mass is to be monitored to an accuracy of ± 0.5 kg. The strain gauges have a gauge factor of 2.1 and are all of the same resistance of 120.0 Ω . For all other items, specify what your design requires. If you use mild steel for the load cell material, then the tensile modulus may be taken as 210 GPa and Poisson's ratio 0.30.
- 5 Design a complete measurement system involving the use of a thermocouple to determine the temperature of the water in a boiler and give a visual indication on a meter. The temperature will be in the range 0 to 100°C and is required to an accuracy of $\pm 1\%$ of full-scale reading. Specify the materials to be used for the thermocouple and all other items necessary. In advocating your design you must consider the

problems of cold junction and non-linearity. You will probably need to consult thermocouple tables. The following data is taken from such tables, the cold junction being at 0°C, and may be used as a guide.

Materials	e.m.f. in mV at				
	20°C	40°C	60°C	80°C	100°C
Copper-constantan	0.789	1.611	2.467	3.357	4.277
Chromel-constantan	1.192	2.419	3.683	4.983	6.317
Iron-constantan	1.019	2.058	3.115	4.186	5.268
Chromel-alumel	0.798	1.611	2.436	3.266	4.095
Platinum-10% Rh, Pt	0.113	0.235	0.365	0.502	0.645

- 6 Design a measurement system which could be used to monitor the temperatures, of the order of 100°C, in positions scattered over a number of points in a plant and present the results on a control panel.
- 7 A suggested design for the measurement of liquid level in a vessel involves a float which in its vertical motion bends a cantilever. The degree of bending of the cantilever is then taken as a measure of the liquid level. When a force F is applied to the free end of a cantilever of length L , the strain on its surface a distance x from the clamped end is given by

$$\text{Strain} = \frac{6(L-x)}{wt^2E}$$

where w is the width of the cantilever, t its thickness and E the elastic modulus of the material. Strain gauges are to be used to monitor the bending of the cantilever with two strain gauges being attached longitudinally to the upper surface and two longitudinally to the lower surface. The gauges are then to be incorporated into a four-gauge Wheatstone bridge and the output voltage, after possible amplification, then taken as a measure of the liquid level. Determine the specifications required for the components of this system if there is to be an output of 10 mV per 10 cm change in level.

- 8 Design a static pressure measurement system based on a sensor involving a 40 mm diameter diaphragm across which there is to be a maximum pressure difference of 500 MPa. For a diaphragm where the central deflection y is much smaller than the thickness t of the diaphragm,

$$y \approx \frac{3r^2P(1-\nu^2)}{16Et^3}$$

where r is the radius of the diaphragm, P the pressure difference, E the modulus of elasticity and ν Poisson's ratio.

Explain how the deflection y will be converted into a signal that can be displayed on a meter.

- 9 Suggest the elements that might be considered for the measurement systems to be used to:
- (a) Monitor the pressure in an air pressure line and present the result on a dial, no great accuracy being required.
 - (b) Continuously monitor and record the temperature of a room with an accuracy of $\pm 1^\circ\text{C}$.
 - (c) Monitor the weight of lorries passing over a weighing platform.
 - (d) Monitor the angular speed of rotation of a shaft.

5 Pneumatic and hydraulic actuation systems

5.1 Actuation systems

Actuation systems are the elements of control systems which are responsible for transforming the output of a microprocessor or control system into a controlling action on a machine or device. Thus, for example, we might have an electrical output from the controller which has to be transformed into a linear motion to move a load. Another example might be where an electrical output from the controller has to be transformed into an action which controls the amount of liquid passing along a pipe.

In this chapter pneumatic and hydraulic actuation systems are discussed. In Chapter 6 mechanical actuator systems are discussed and in Chapter 7 electrical actuation systems. For a more detailed consideration of pneumatic and hydraulic systems the reader is referred to more specialist books such as *Pneumatic and Hydraulic Systems* by W. Bolton (Butterworth-Heinemann 1997), *Power Pneumatics* by M.J. Pinches and B.J. Callear (Prentice-Hall 1996), *Pneumatic Control for Industrial Automation* by P. Rohner and G. Smith (Wiley 1987, 1990) or *Industrial Hydraulic Control* by P. Rohner (Wiley 1984, 1986, 1988, 1995).

5.2 Pneumatic and hydraulic systems

Pneumatic signals are often used to control final control elements, even when the control system is otherwise electrical. This is because such signals can be used to actuate large valves and other high power control devices and so move significant loads. The main drawback with pneumatic systems is, however, the compressibility of air. Hydraulic signals can be used for even higher power control devices but are more expensive than pneumatic systems and there are hazards associated with oil leaks which do not occur with air leaks.

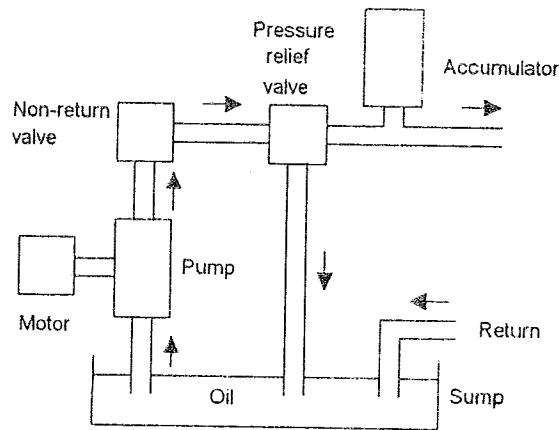


Fig. 5.1 Hydraulic power supply

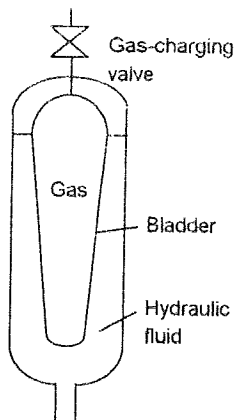


Fig. 5.2 Accumulator

5.2.1 Power supplies

With a hydraulic system, pressurised oil is provided by a pump driven by an electric motor. The pump pumps oil from a sump through a non-return valve and an accumulator to the system, from which it returns to the sump. Figure 5.1 illustrates the arrangement. A pressure relief valve is included, this being to release the pressure if it rises above a safe level, the non-return valve is to prevent the oil being back driven to the pump and the accumulator is to smooth out any short-term fluctuations in the output oil pressure. Essentially the accumulator is just a container in which the oil is held under pressure against an external force, Figure 5.2 showing the most commonly used form which is gas pressurised and involves gas within a bladder in the chamber containing the hydraulic fluid, an older type involved a spring-loaded piston. If the oil pressure rises then the bladder contracts, increases the volume the oil can occupy and so reduces the pressure. If the oil pressure falls, the bladder expands to reduce the volume occupied by the oil and so increases its pressure.

With a pneumatic power supply (Fig. 5.3) an electric motor drives an air compressor. The air inlet to the compressor is likely to be filtered and via a silencer to reduce the noise level. A pressure relief valve provides protection against the pressure in the system rising above a safe level. Since the air compressor increases the temperature of the air there is likely to be a cooling system and to remove contamination and water from the air a filter with water trap. An air receiver increases the volume of air in the system and smoothes out any short-term pressure fluctuations.

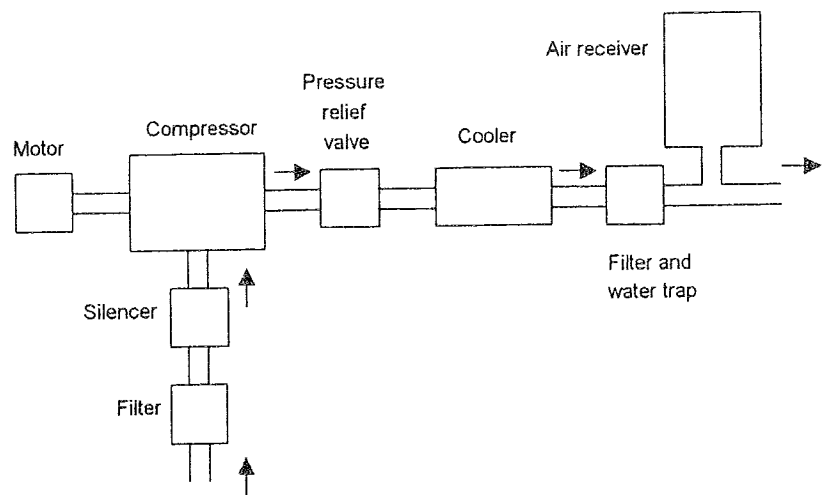


Fig. 5.3 Pneumatic power supply

5.3 Directional control valves

Pneumatic and hydraulic systems use directional control valves to direct the flow of fluid through a system. They are not intended to vary the rate of flow of fluid but are either completely open or completely closed, i.e. on/off devices. Such on/off valves are widely used to develop sequenced control systems (see later in this chapter). They might be activated to switch the fluid flow direction by means of mechanical, electrical or fluid pressure signals.

A common type of directional control valve is the *spool valve*. A spool moves horizontally within the valve body to control the flow. Figure 5.4 shows a particular form. In (a) the air supply is connected to port 1 and port 3 is closed. Thus the device connected to port 2 can be pressurised. When the spool is moved to the left (Fig. 5.4(b)) the air supply is cut off and port 2 is connected to port 3. Port 3 is a vent to the atmosphere and so the air pressure in the system attached to port 2 is vented. Thus the movement of the spool has allowed the air to firstly flow into the system and then be reversed and flow out of the system. *Rotary spool valves* have a rotating spool which, when it rotates, opens and closes ports in a similar way.

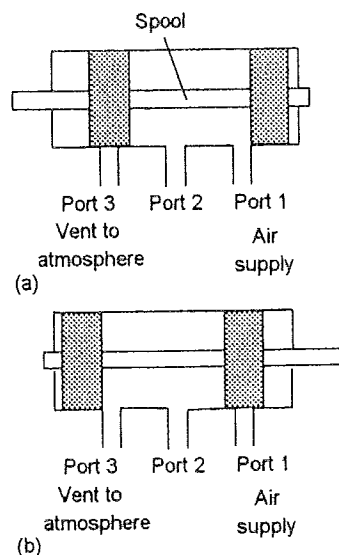


Fig. 5.4 Spool valve

Another common form of directional control valve is the *poppet valve*. Figure 5.5 shows one form. This valve is normally in the closed condition, there being no connection between port 1 to which the pressure supply is connected and port 2 to which the system is connected. In poppet valves, balls, discs or cones are used in conjunction with valve seats to control the flow. In the figure a ball is shown. When the push-button is depressed, the ball is pushed out of its seat and flow occurs as a result of port 1 being connected to port 2. When the button is released, the spring forces the ball back up against its seat and so closes off the flow.

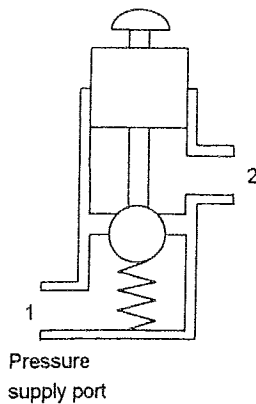


Fig. 5.5 Poppet valve

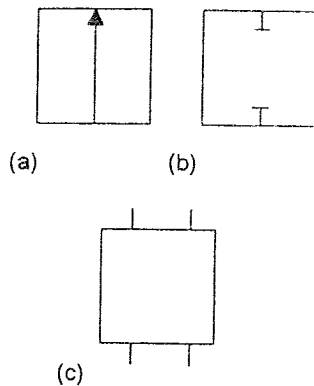


Fig. 5.6 (a) Flow path, (b) flow shut-off, (c) initial connections

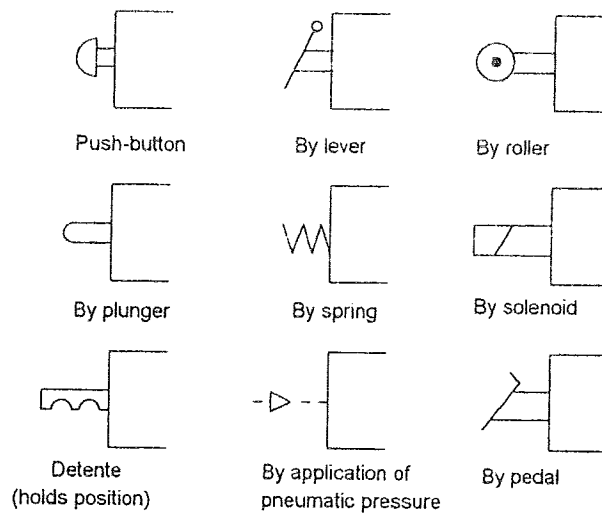


Fig. 5.7 Valve actuation symbols




Fig. 5.8 2/2 valve

5.3.1 Valve symbols

The symbol used for control valves consists of a square for each of its switching positions. Thus for the poppet valve shown in Figure 5.5, there are two positions: one with the button not pressed and one with it pressed. Thus a two-position valve will have two squares, a three-position valve three squares. Arrow-headed lines (Fig. 5.6(a)) are used to indicate the directions of flow in each of the positions, with blocked-off lines closed flow lines (Fig. 5.6(b)). The initial position of the valve has the connections (Fig. 5.6(c)) to the ports shown; in Fig. 5.6(c) the valve has four ports. Ports are labelled by a number or a letter according to their function. The ports are labelled 1 (or P) for pressure supply, 3 (or T) for hydraulic return port, 3 or 5 (or R or S) for pneumatic exhaust ports, and 2 or 5 (or B or A) for output ports.

Figure 5.7 shows examples of some of the symbols which are used to indicate the various ways the valves can be actuated. More than one of these symbols might be used with the valve symbol.

As an illustration of how these various symbols can be combined to describe how a valve operates, Figure 5.8 shows the symbol for the 2 port 2 position poppet valve of Figure 5.6. Note that a 2 port 2 position valve would be described as a 2/2 valve, the first number indicating the number of ports and the second number the number of positions.

As a further illustration, Figure 5.9 shows a solenoid operated spool valve and Figure 5.10 its symbol. The valve is actuated by a current passing through a solenoid and returned to its original position by a spring.

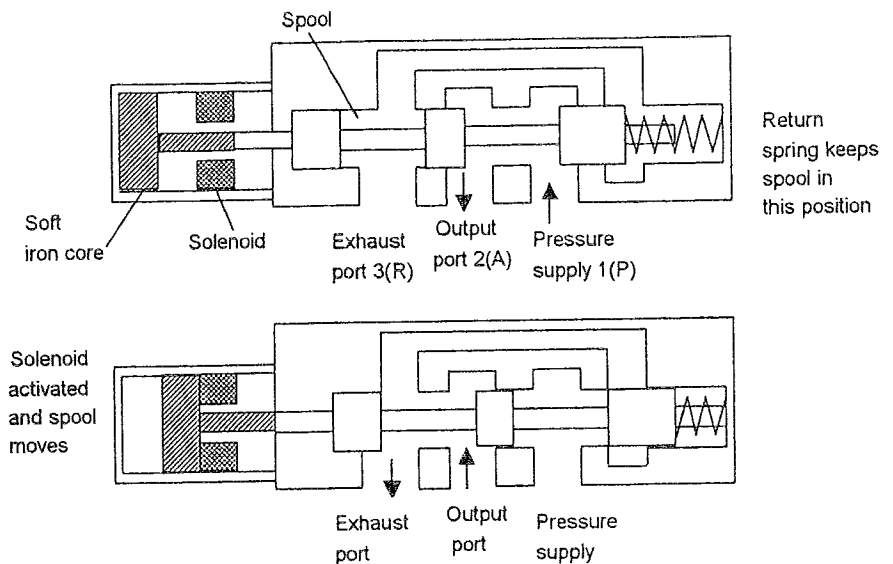


Fig. 5.9 Single-solenoid valve




Fig. 5.10 3/2 valve




Fig. 5.11 4/2 valve

Figure 5.11 shows the symbol for a 4/2 valve. The connections are shown for the initial state, i.e. 1(P) is connected to 2(A) and 3(R) closed. When the solenoid is activated it gives the state indicated by the symbols used in the square to which it is attached, i.e. we now have 1(P) closed and 2(A) connected to 3(R). When the current through the solenoid ceases, the spring pushes the valve back to its initial position. The spring movement gives the state indicated by the symbols used in the square to which it is attached.

Figure 5.12 shows a simple example of an application of valves in a pneumatic lift system. Two push-button 2/2 valves are used. When the button on the up valve is pressed, the load is lifted. When the button on the down valve is pressed, the load is lowered. Note that with pneumatic systems an open arrow is used to indicate a vent to the atmosphere.

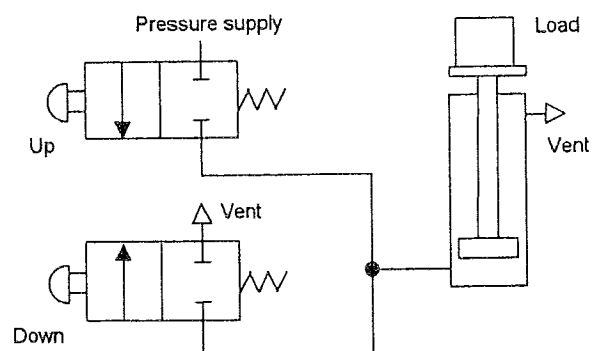


Fig. 5.12 Lift system

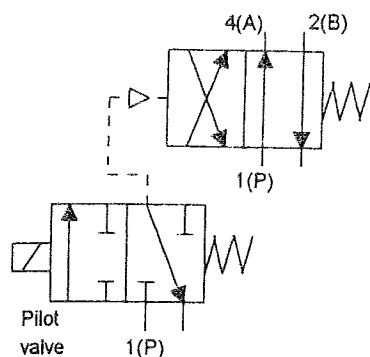


Fig. 5.13 Pilot-operated system

5.3.2 Pilot-operated valves

The force required to move the ball or shuttle in a valve can often be too large for manual or solenoid operation. To overcome this problem a *pilot-operated system* is used where one valve is used to control a second valve. Figure 5.13 illustrates this. The pilot valve is small capacity and can be operated manually or by a solenoid. It is used to allow the main valve to be operated by the system pressure. The pilot pressure line is indicated by dashes. The pilot and main valves can be operated by two separate valves but they are often combined in a single housing.

5.3.3 Directional valves

Figure 5.14 shows a simple *directional valve* and its symbol. Free flow can only occur in one direction through the valve, that which results in the ball being pressed against the spring. Flow in the other direction is blocked by the spring forcing the ball against its seat.

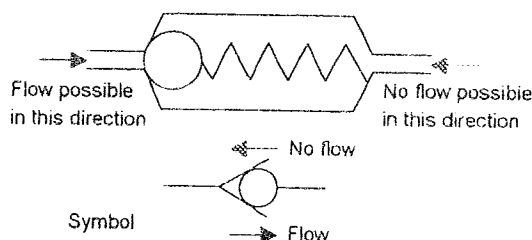


Fig. 5.14 Directional valve

5.4 Pressure control valves

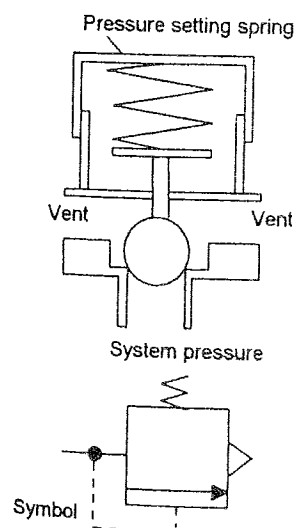


Fig. 5.15 Pressure limiting valve

There are three main types of pressure control valves:

- 1 *Pressure regulating valves*
These are used to control the operating pressure in a circuit and maintain it at a constant value.
- 2 *Pressure limiting valves*
These are used as safety devices to limit the pressure in a circuit to below some safe value. The valve opens and vents to the atmosphere, or back to the sump, if the pressure rises above the set safe value.
- 3 *Pressure sequence valves*
These valves are used to sense the pressure of an external line and give a signal when it reaches some preset value.

5.4.1 Pressure limiting valve

Figure 5.15 shows a *pressure limiting/relief valve* which has one orifice which is normally closed. When the inlet pressure overcomes the force exerted by the spring, the valve opens and




Fig. 5.16 Pressure sequence valve

5.5 Cylinders

vents to the atmosphere, or back to the sump. This can be used as a pressure relief valve to safeguard a system against excessive pressures.

5.4.2 Pressure sequence valve

With the pressure limiting valve of Figure 5.15, the limiting pressure is set by the pressure at the inlet to the valve. We can adapt such a valve to give a sequence valve. This can be used to allow flow to occur to some part of the system when the pressure has risen to the required level. For example, in an automatic machine we might require some operation to start when the clamping pressure applied to a workpiece is at some particular value. Figure 5.16 shows the symbol for a sequence valve, the valve switching on when the inlet pressure reaches a particular value and allowing the pressure to be applied to the system that follows.

Figure 5.17 shows a system where such a sequential valve is used. When the 4/3 valve first operates, the pressure is applied to cylinder 1 and its ram moves to the right. While this is happening the pressure is too low to operate the sequence valve and so no pressure is applied to cylinder 2. When the ram of cylinder 1 reaches the end stop, then the pressure in the system rises and, at an appropriate level, triggers the sequence valve to open and so apply pressure to cylinder 2 to start its ram in motion.

The *hydraulic* or *pneumatic cylinder* is an example of a linear actuator. The principles and form are the same for both hydraulic and pneumatic versions, differences being purely a matter of size as a consequence of the higher pressures used with hydraulics. The cylinder consists of a cylindrical tube along which a piston/ram can slide.

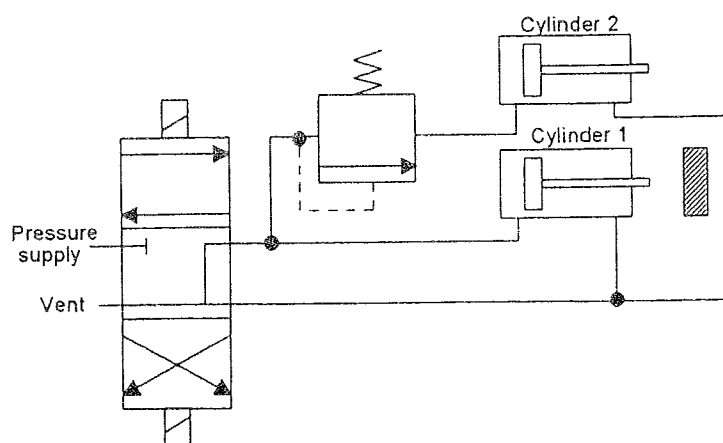


Fig. 5.17 Sequential system

The term *single acting* is used when the control pressure is applied to just one side of the piston, a spring often being used to provide the opposition to the movement of the piston. For the single-acting cylinder shown in Figure 5.18, when a current passes through the solenoid, the valve switches position and pressure is applied to move the piston along the cylinder. When the current through the solenoid ceases, the valve reverts to its initial position and the air is vented from the cylinder. As a consequence the spring returns the piston back along the cylinder.

The term *double acting* is used when the control pressures are applied to each side of the piston. A difference in pressure between the two sides then results in motion of the piston, the piston being able to move in either direction along the cylinder as a result of high pressure signals. For the double-acting cylinder shown in Figure 5.19, current through one solenoid causes the piston to move in one direction with current through the other solenoid reversing the direction of motion.

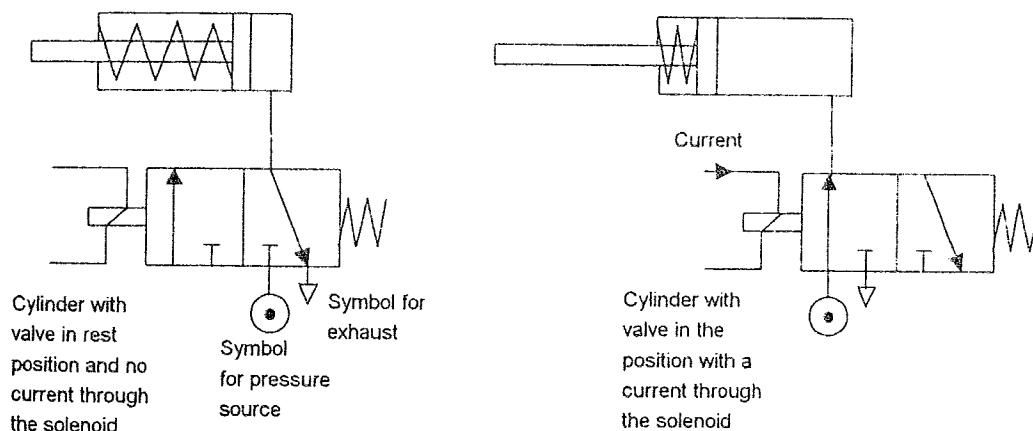


Fig. 5.18 Control of a single-acting cylinder

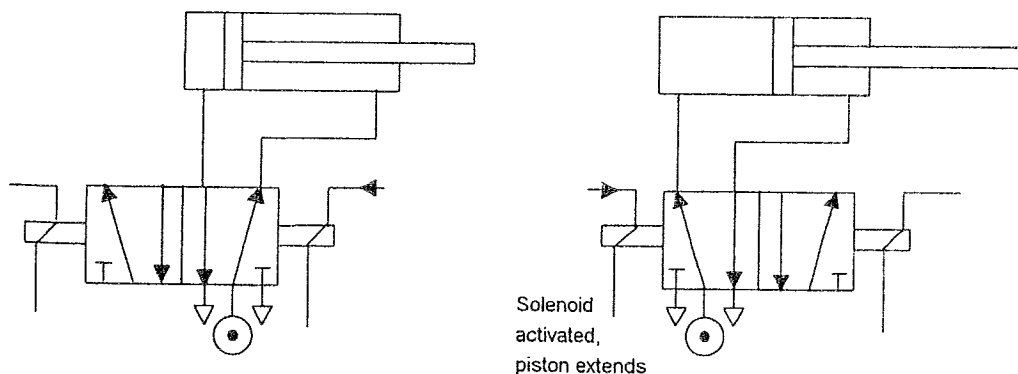


Fig. 5.19 Control of a double-acting cylinder

The choice of cylinder is determined by the force required to move the load and the speed required. Hydraulic cylinders are capable of much larger forces than pneumatic cylinders. However, pneumatic cylinders are capable of greater speeds. The force produced by a cylinder is equal to the cross-sectional area of the cylinder multiplied by the working pressure, i.e. the pressure difference between the two sides of the piston, in the cylinder. A cylinder for use with a working pneumatic pressure of 500 kPa and having a diameter of 50 mm will thus give a force of 982 N. A hydraulic cylinder with the same diameter and a working pressure of 15 000 kPa will give a force of 29.5 kN.

If the flow rate of hydraulic liquid into a cylinder is a volume of Q per second, then the volume swept out by the piston in a time of 1 s must be Q . But for a piston of cross-sectional area A this is a movement through a distance of v in 1 s, where we have $Q = Av$. Thus the speed v of a hydraulic cylinder is equal to the flow rate of liquid Q through the cylinder divided by the cross-sectional area A of the cylinder. Thus for a hydraulic cylinder of diameter 50 mm and a hydraulic fluid flow of $7.5 \times 10^{-3} \text{ m}^3/\text{s}$ the speed is 3.8 m/s. The speed of a pneumatic cylinder cannot be calculated in this way since its speed depends on the rate at which air can be vented ahead of the advancing piston. A valve to adjust this can be used to regulate the speed.

To illustrate the above consider the problem of a hydraulic cylinder to be used to move a work piece in a manufacturing operation through a distance of 250 mm in 15 s. If a force of 50 kN is required to move the work piece, what is the required working pressure and hydraulic liquid flow rate if a cylinder with a piston diameter of 150 mm is available? The cross-sectional area of the piston is $\frac{1}{4}\pi \times 0.150^2 = 0.0177 \text{ m}^2$. The force produced by the cylinder is equal to the product of the cross-sectional area of the cylinder and the working pressure. Thus the working pressure is $50 \times 10^3 / 0.0177 = 2.8 \text{ MPa}$. The speed of a hydraulic cylinder is equal to the flow rate of liquid through the cylinder divided by the cross-sectional area of the cylinder. Thus the required flow rate is $(0.250/15) \times 0.0177 = 2.95 \times 10^{-4} \text{ m}^3/\text{s}$.

5.5.1 Cylinder sequencing

Many control systems employ pneumatic or hydraulic cylinders as the actuating elements and require a sequence of extensions and retractions of the cylinders to occur. For example, we might have two cylinders A and B and require that when the start button is pressed, the piston of cylinder A extends and then, when it is fully extended, the piston of cylinder B extends. When this has happened and both are extended we might need the piston of cylinder A to retract, and when it is fully retracted we might then have the piston of B retract. In discussions of sequential control with cylinders it is common practice to give each cylinder a reference letter A, B, C, D, etc., and to indicate the state of each

cylinder by using a + sign if it is extended or a - sign if retracted. Thus the above required sequence of operations is A+, B+, A-, B-. Figure 5.20 shows a circuit that could be used to generate this sequence.

The sequence of operations is:

- 1 Initially both the cylinders have retracted pistons. Start push-button on valve 1 is pressed. This applies pressure to valve 2, as initially limit switch b- is activated, hence valve 3 is switched to apply pressure to cylinder A for extension.
- 2 Cylinder A extends, releasing limit switch a-. When cylinder A is fully extended, limit switch a+ operates. This switches valve 5 and causes pressure to be applied to valve 6 to switch it and so apply pressure to cylinder B to cause its piston to extend.
- 3 Cylinder B extends, releasing limit switch b-. When cylinder B is fully extended, limit switch b+ operates. This switches valve 4 and causes pressure to be applied to valve 3 and so applies pressure to cylinder A to start its piston retracting.
- 4 Cylinder A retracts, releasing limit switch a+. When cylinder A is fully retracted, limit switch a- operates. This switches valve 7 and causes pressure to be applied to valve 5 and so applies pressure to cylinder B to start its piston retracting.

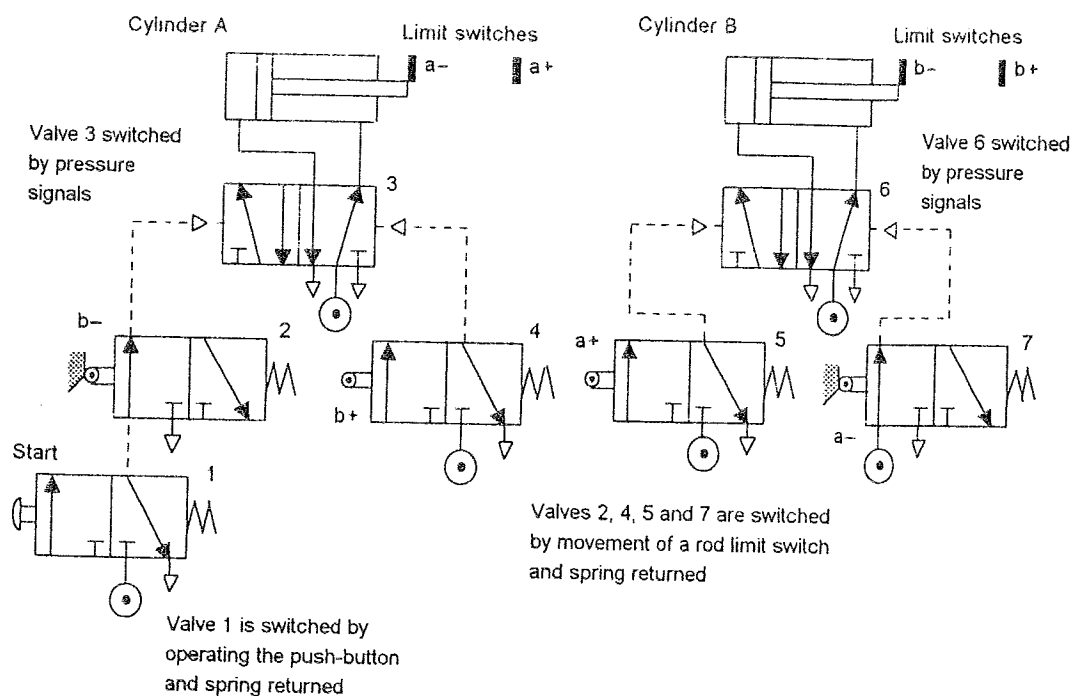


Fig. 5.20 Two-actuator sequential operation

- 5 Cylinder B retracts, releasing limit switch $b+$. When cylinder B is fully retracted, limit switch $b-$ operates to complete the cycle.

The cycle can be started again by pushing the start button. If we wanted the system to run continuously then the last movement in the sequence would have to trigger the first movement.

An alternative way of realising the above sequence involves the air supply being switched on and off to valves in groups and is termed *cascade control*. This avoids a problem that can occur with circuits, formed in the way shown in Figure 5.20, of air becoming trapped in the pressure line to control a valve and so preventing the valve from switching. With cascade control, the sequence of operations is divided into groups with no cylinder letter appearing more than once in each group. Thus for the sequence $A+$, $B+$, $B-$, $A-$ we can have the groups $A+$, $B+$ and $A-$, $B-$. A valve is then used to switch the air supply between the two groups, i.e. air to the group $A+B+$ and then the air switched to the group with $A-B-$. A start/stop valve is included in the line that selects the first group, and if the sequence is to be continuously repeated, the last operation has to supply a signal to start the sequence over again. The first function in each group is initiated by that group supply being switched on; further actions within the group are controlled by switch-operated valves, and the last valve operation initiates the next group to be selected. Figure 5.21 shows the pneumatic circuit.

5.6 Process control valves

Process control valves are used to control the rate of fluid flow and are used where, perhaps, the rate of flow of a liquid into a tank has to be controlled. The basis of such valves is an actuator being used to move a plug into the flow pipe and so alter the cross-section of the pipe through which the fluid can flow.

A common form of pneumatic actuator used with process control valves is the *diaphragm actuator*. Essentially it consists of a diaphragm with the input pressure signal from the controller on one side and atmospheric pressure on the other, this difference in pressure being termed the *gauge pressure*. The diaphragm is made of rubber which is sandwiched in its centre between two circular steel discs. The effect of changes in the input pressure is thus to move the central part of the diaphragm, as illustrated in Figure 5.22. This movement is communicated to the final control element by a shaft which is attached to the diaphragm.

The force F acting on the shaft is the force that is acting on the diaphragm and is thus the gauge pressure P multiplied by the diaphragm area A . A restoring force is provided by a spring. Thus if the shaft moves through a distance x , and assuming the compression of the spring is proportional to the force, i.e. $F = kx$ with k being a constant, then $kx = PA$ and thus the displacement of the shaft is proportional to the gauge pressure

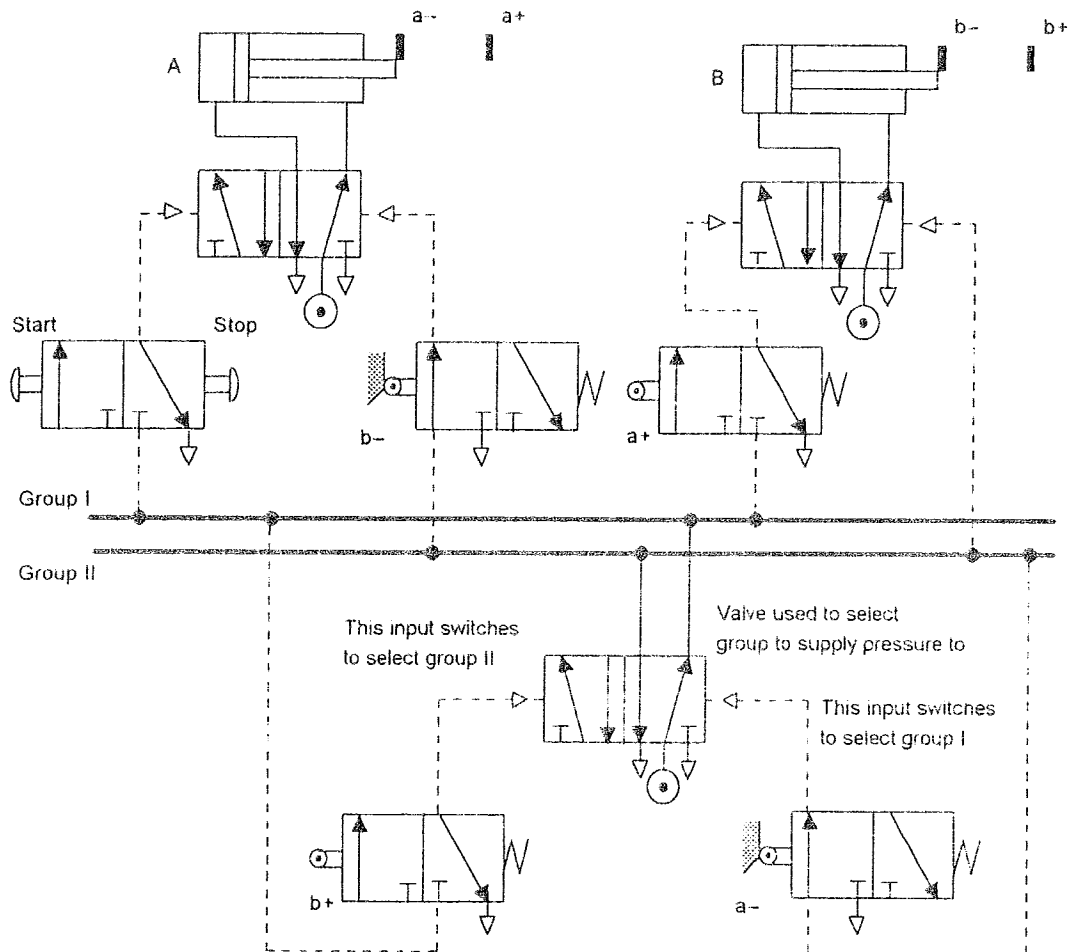


Fig. 5.21 Cascade control used to give A^+ , B^+ , B^- , A^-

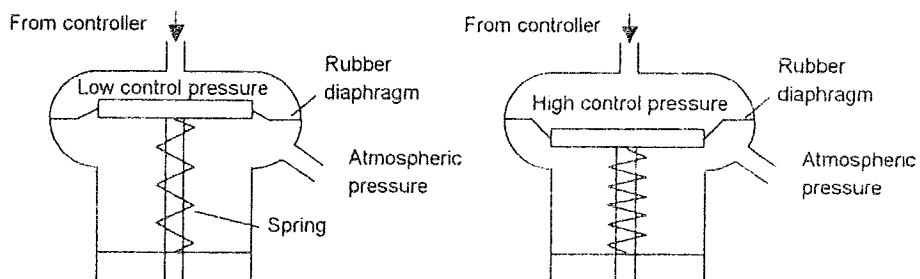


Fig. 5.22 Pneumatic diaphragm actuator

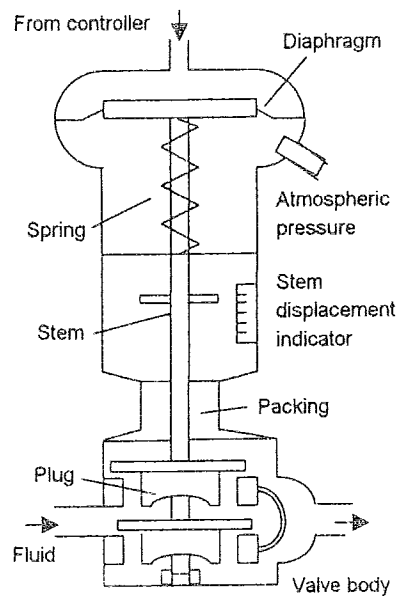


Fig. 5.23 Diaphragm-operated process control valve

To illustrate the above, consider the problem of a diaphragm actuator to be used to open a control valve if a force of 500 N must be applied to the valve. What diaphragm area is required for a control gauge pressure of 100 kPa? The force F applied to the diaphragm of area A by a pressure P is given by $P = F/A$. Hence $A = 500/(100 \times 10^3) = 0.005 \text{ m}^2$.

5.6.1 Valve bodies and plugs

Figure 5.23 shows a cross-section of a valve for the control of rate of flow of a fluid. The pressure change in the actuator causes the diaphragm to move and so consequently the valve stem. The result of this is a movement of the inner-valve plug within the valve body. The plug restricts the fluid flow and so its position determines the flow rate.

There are many forms of valve body and plug. Figure 5.24 shows some forms of valve bodies. The term *single seated* is used for a valve where there is just one path for the fluid through the valve and so just one plug is needed to control the flow. The term *double seated* is used for a valve where the fluid on entering the valve splits into two streams, as in Figure 5.23, with each stream passing through an orifice controlled by a plug. There are thus two plugs with such a valve.

A single-seated valve has the advantage that it can be closed more tightly than a double-seated one but the disadvantage that the force on the plug due to the flow is much higher and so the diaphragm in the actuator has to exert considerably higher forces on the stem. This can result in problems in accurately positioning the plug. Double-seated valves thus have an advantage here. The form of the body also determines whether an increasing air pressure will result in the valve opening or closing.

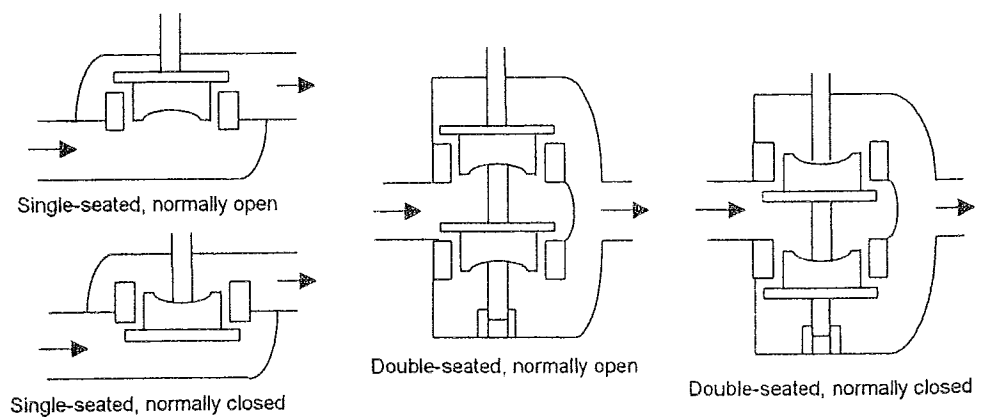


Fig. 5.24 Valve bodies

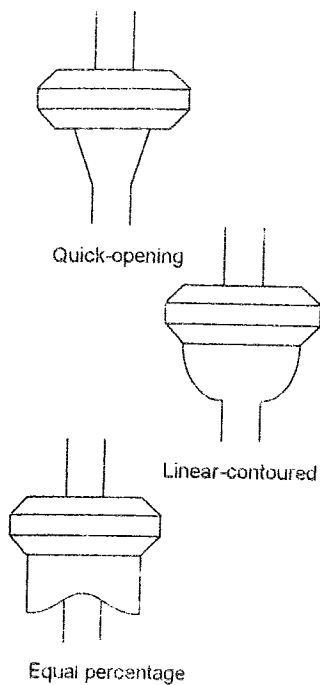


Fig. 5.25 Plug shapes

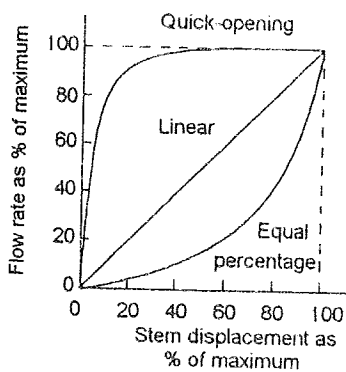


Fig. 5.26 Flow characteristics with different plugs

The shape of the plug determines the relationship between the stem movement and the effect on the flow rate. Figure 5.25 shows three commonly used types and Figure 5.26 how the percentage by which the volumetric rate of flow is related to the percentage displacement of the valve stem.

With the *quick-opening* type a large change in flow rate occurs for a small movement of the valve stem. Such a plug is used where on/off control of flow rate is required.

With the *linear-contoured* type, the change in flow rate is proportional to the change in displacement of the valve stem, i.e.

$$\text{Change in flow rate} = k (\text{change in stem displacement})$$

where k is a constant. If Q is the flow rate at a valve stem displacement S and Q_{\max} is the maximum flow rate at the maximum stem displacement S_{\max} , then we have

$$\frac{Q}{Q_{\max}} = \frac{S}{S_{\max}}$$

or percentage change in the flow rate equals the percentage change in the stem displacement

To illustrate the above consider the problem of an actuator which has a stem movement at full travel of 30 mm. It is mounted on a linear plug valve which has a minimum flow rate of 0 and a maximum flow rate of 40 m³/s. What will be the flow rate when the stem movement is (a) 10 mm, (b) 20 mm? Since the percentage flow rate is the same as the percentage stem displacement, then: (a) a percentage stem displacement of 33% gives a percentage flow rate of 33%, i.e. 13 m³/s; (b) a percentage stem displacement of 67% gives a percentage flow rate of 67%, i.e. 27 m³/s.

With the *equal percentage* type of plug, equal percentage changes in flow rate occur for equal changes in the valve stem position, i.e.

$$\frac{\Delta Q}{Q} = k \Delta S$$

where ΔQ is the change in flow rate at a flow rate of Q and ΔS the change in valve position resulting from this change. If we write this expression for small changes and then integrate it we obtain

$$\int_{Q_{\min}}^Q \frac{1}{Q} dQ = k \int_{S_{\min}}^S dS$$

Hence

$$\ln Q - \ln Q_{\min} = k(S - S_{\min})$$

If we consider the flow rate Q_{\max} which is given by S_{\max} then

$$\ln Q_{\max} - \ln Q_{\min} = k(S_{\max} - S_{\min})$$

Eliminating k from these two equations gives

$$\frac{\ln Q - \ln Q_{\min}}{\ln Q_{\max} - \ln Q_{\min}} = \frac{S - S_{\min}}{S_{\max} - S_{\min}}$$

$$\ln \frac{Q}{Q_{\min}} = \frac{S - S_{\min}}{S_{\max} - S_{\min}} \ln \frac{Q_{\max}}{Q_{\min}}$$

and so

$$\frac{Q}{Q_{\min}} = \left(\frac{Q_{\max}}{Q_{\min}} \right)^{(S - S_{\min}) / (S_{\max} - S_{\min})}$$

The term *rangeability* R is used for the ratio Q_{\max}/Q_{\min} .

To illustrate the above, consider the problem of an actuator which has a stem movement at full travel of 30 mm. It is mounted with a control valve having an equal percentage plug and which has a minimum flow rate of 2 m³/s and a maximum flow rate of 24 m³/s. What will be the flow rate when the stem movement is (a) 10 mm, (b) 20 mm? Using the equation

$$\frac{Q}{Q_{\min}} = \left(\frac{Q_{\max}}{Q_{\min}} \right)^{(S - S_{\min}) / (S_{\max} - S_{\min})}$$

we have for (a) $Q = 2 \times (24/2)^{10/30} = 4.6$ m³/s and for (b) $Q = 2 \times (24/2)^{20/30} = 10.5$ m³/s

The relationship between the flow rate and the stem displacement is the inherent characteristic of a valve. It is only realised in practice if the pressure losses in the rest of the pipework, etc., are negligible compared with the pressure drop across the valve itself. If there are large pressure drops in the pipework so that, for example, less than half the pressure drop occurs across the valve then a linear characteristic might become almost a quick-opening characteristic. The linear characteristic is thus widely used when a linear response is required and most of the system pressure is dropped across the valve. The effect of large pressure drops in the pipework with an equal percentage valve is to make it more like a linear characteristic. For this reason, if a linear response is required when only a small proportion of the system pressure is dropped across the valve, then an equal percentage valve might be used.

5.6.2 Control valve sizing

The term *control valve sizing* is used for the procedure of determining the correct size of valve body. The equation relating the rate of flow of liquid Q through a wide open valve to its size is

$$Q = A_v \sqrt{\frac{\Delta P}{\rho}}$$

where A_v is the valve flow coefficient, ΔP the pressure drop across the valve and ρ the density of the fluid. This equation is sometimes written, with the quantities in SI units, as

$$Q = 2.37 \times 10^{-5} C_v \sqrt{\frac{\Delta P}{\rho}}$$

where C_v is the valve flow coefficient. Alternatively it may be found written as

$$Q = 0.75 \times 10^{-6} C_v \sqrt{\frac{\Delta P}{G}}$$

where G is the specific gravity or relative density. These last two forms of the equation derive from its original specification in terms of US gallons. Table 5.1 shows some typical values of A_v , C_v and valve size.

To illustrate the above, consider the problem of determining the valve size for a valve that is required to control the flow of water when the maximum flow required is $0.012 \text{ m}^3/\text{s}$ and the permissible pressure drop across the valve at this flow rate is 300 kPa . Using the equation

Table 5.1 Flow coefficients and valve sizes

Flow coefficients	Valve size (mm)							
	480	640	800	960	1260	1600	1920	2560
C_v	8	14	22	30	50	75	110	200
$A_v \times 10^{-5}$	19	33	52	71	119	178	261	474

$$Q = A_v \sqrt{\frac{\Delta P}{\rho}}$$

then, since the density of water is 1000 kg/m^3 ,

$$A_v = Q \sqrt{\frac{\rho}{\Delta P}} = 0.012 \sqrt{\frac{1000}{300 \times 10^3}} = 69.3 \times 10^{-5}$$

Thus, using Table 5.1, the valve size is 960 mm

5.6.3 Example of fluid control system

Figure 5.27 shows the essential features of a system for the control of a variable such as the level of a liquid in a container by controlling the rate at which liquid enters it. The output from the liquid level sensor, after signal conditioning, is transmitted to the current to pressure converter as a current of 4 to 20 mA . It is then

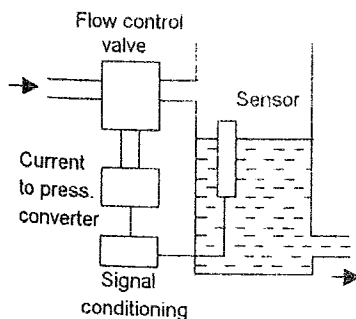


Fig. 5.27 Fluid control system

converted into a gauge pressure of 20 to 100 kPa which then actuates a pneumatic control valve and so controls the rate at which liquid is allowed to flow into the container.

Figure 5.28 shows the basic form of a current to pressure converter. The input current passes through coils mounted on a core which is attracted towards a magnet, the extent of the attraction depending on the size of the current. The movement of the core causes movement of the lever about its pivot and so the movement of a flapper above the nozzle. The position of the flapper in relation to the nozzle determines the rate at which air can escape from the system and hence the air pressure in the system. Springs on the flapper are used to adjust the sensitivity of the converter so that currents of 4 to 20 mA produce gauge pressures of 20 to 100 kPa. These are the standard values that are generally used in such systems.

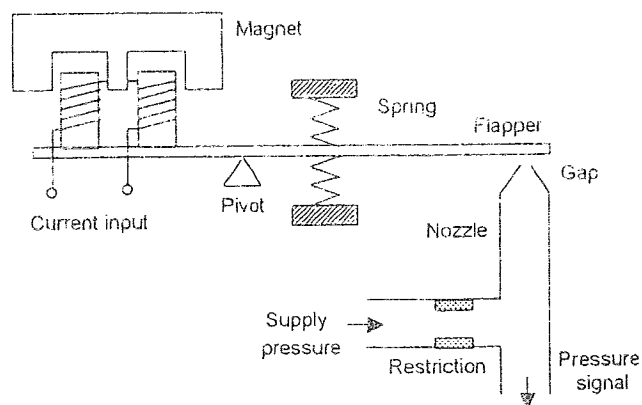


Fig. 5.28 Current to pressure converter

5.7 Rotary actuators

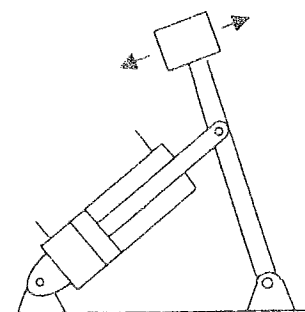


Fig. 5.29 A linear cylinder used to produce rotation

A linear cylinder can, with suitable mechanical linkages, be used to produce rotary movement through angles less than 360° , Figure 5.29 illustrating such an arrangement. Another alternative is a *semi-rotary actuator* involving a vane (Fig. 5.30). A pressure difference between the two ports causes the vane to rotate and so give a shaft rotation which is a measure of the pressure difference. Depending on the pressures, so the vane can be rotated clockwise or anti-clockwise.

For rotation through angles greater than 360° a pneumatic motor can be used, one form of such is the *vane motor* (Fig. 5.31). An eccentric rotor has slots in which vanes are forced outwards against the walls of the cylinder by the rotation. The vanes divide the chamber into separate compartments which increase in size from the inlet port round to the exhaust port. The air entering such a compartment exerts a force on a vane and causes the rotor to rotate. The motor can be made to reverse its direction of rotation by using a different inlet port.

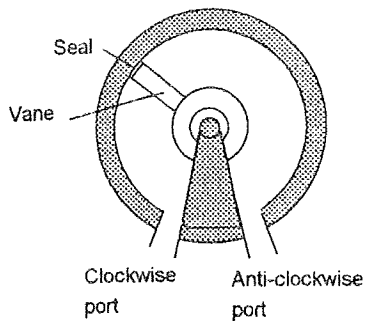


Fig. 5.30 Vane-type semi-rotary actuator

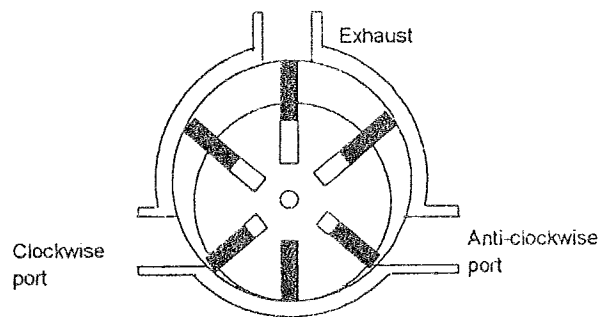


Fig. 5.31 Vane motor

Problems

- 1 Describe the basic details of (a) a poppet valve, (b) a shuttle valve.
- 2 Explain the principle of a pilot-operated valve.
- 3 Explain how a sequential valve can be used to initiate an operation only when another operation has been completed.
- 4 Draw the symbols for (a) a pressure relief valve, (b) a 2/2 valve which has actuators of a push-button and a spring, (c) a 4/2 valve, (d) a directional valve.
- 5 State the sequence of operations that will occur for the cylinders A and B in Figure 5.32 when the start button is pressed. a-, a+, b- and b+ are limit switches to detect when the cylinders are fully retracted and fully extended.
- 6 Design a pneumatic valve circuit to give the sequence A+, followed by B+ and then simultaneously followed by A- and B-.
- 7 A force of 400 N is required to open a process control valve. What area of diaphragm will be needed with a diaphragm actuator to open the valve with a control gauge pressure of 70 kPa?
- 8 A pneumatic system is operated at a pressure of 1000 kPa. What diameter cylinder will be required to move a load requiring a force of 12 kN?
- 9 A hydraulic cylinder is to be used to move a work piece in a manufacturing operation through a distance of 50 mm in 10 s. A force of 10 kN is required to move the work piece. Determine the required working pressure and hydraulic liquid flow rate if a cylinder with a piston diameter of 100 mm is available.
- 10 An actuator has a stem movement which at full travel is 40 mm. It is mounted with a linear plug process control valve which has a minimum flow rate of 0 and a maximum flow rate of 0.20 m³/s. What will be the flow rate when the stem movement is (a) 10 mm, (b) 20 mm?

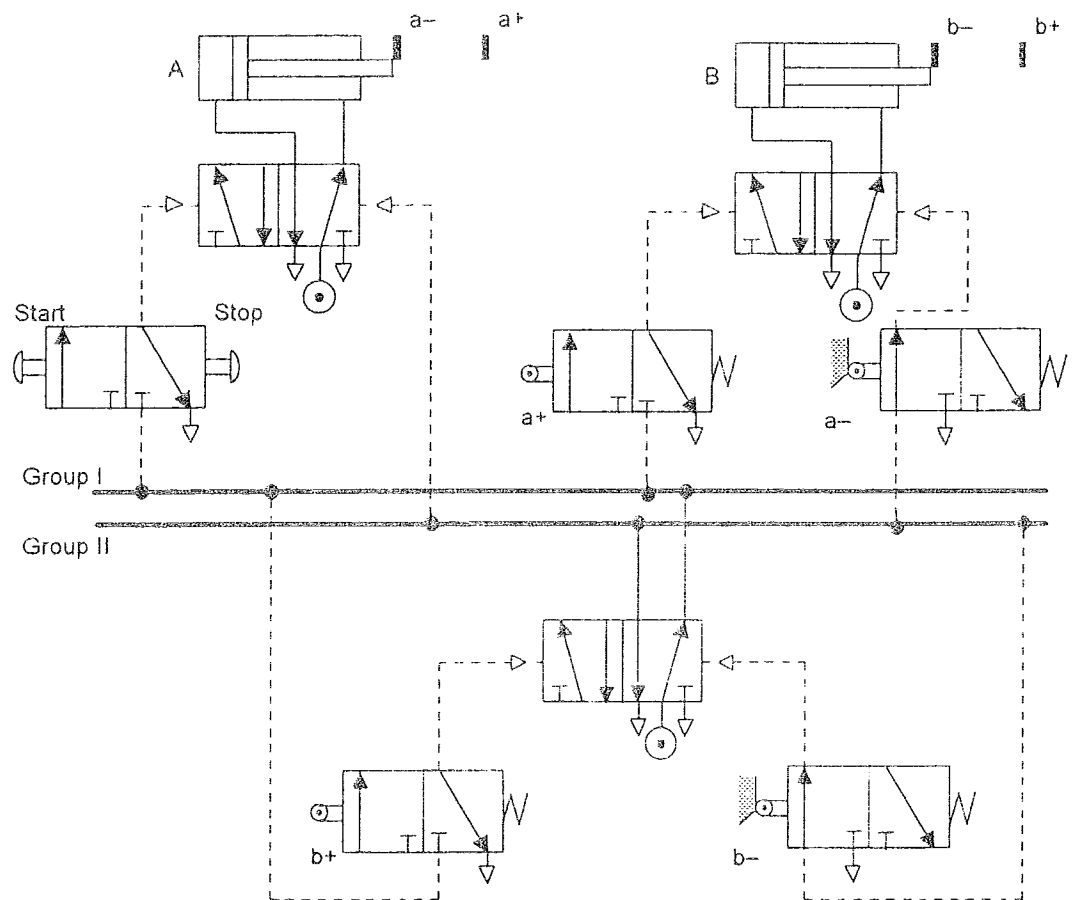


Fig. 5.32 Problem 5

- 11 An actuator has a stem movement which at full travel is 40 mm. It is mounted on a process control valve with an equal percentage plug and which has a minimum flow rate of $0.2 \text{ m}^3/\text{s}$ and a maximum flow rate of $4.0 \text{ m}^3/\text{s}$. What will be the flow rate when the stem movement is (a) 10 mm, (b) 20 mm?
- 12 What is the process control valve size required for a valve that is required to control the flow of water when the maximum flow required is $0.002 \text{ m}^3/\text{s}$ and the permissible pressure drop across the valve at this flow rate is 100 kPa? The density of water is 1000 kg/m^3 .

6 Mechanical actuation systems

6.1 Mechanical systems

This chapter is a consideration of *mechanisms*: mechanisms are devices which can be considered to be motion converters in that they transform motion from one form to some other required form. They might, for example, transform linear motion into rotational motion, or motion in one direction into a motion in a direction at right angles, or perhaps a linear reciprocating motion into rotary motion, as in the internal combustion engine where the reciprocating motion of the pistons is converted into rotation of the crank and hence the drive shaft.

Mechanical elements can include the use of linkages, cams, gears, rack-and-pinion, chains, belt drives, etc. For example, the rack-and-pinion can be used to convert rotational motion to linear motion. Parallel shaft gears might be used to reduce a shaft speed. Bevel gears might be used for the transmission of rotary motion through 90°. A toothed belt or chain drive might be used to transform rotary motion about one axis to motion about another. Cams and linkages can be used to obtain motions which are prescribed to vary in a particular manner. This chapter is a consideration of the basic characteristics of a range of such mechanisms.

Many of the actions which previously were obtained by the use of mechanisms are, however, often nowadays being obtained by the use of microprocessor systems. For example, cams on a rotating shaft were previously used for domestic washing machines in order to give a timed sequence of actions such as opening a valve to let water into the drum, switching the water off, switching a heater on, etc. Modern washing machines use a microprocessor-based system with the microprocessor programmed to switch on outputs in the required sequence.

Mechanisms still, however, have a role in mechatronics systems. For example, the mechatronics system in use in an automatic camera for adjusting the aperture for correct exposures involves a

mechanism for adjusting the size of the diaphragm. While electronics might now be used often for many functions that previously were fulfilled by mechanisms, mechanisms might still be used to provide such functions as:

- 1 Force amplification, e.g. that given by levers.
- 2 Change of speed, e.g. that given by gears.
- 3 Transfer of rotation about one axis to rotation about another, e.g. a timing belt.
- 4 Particular types of motion, e.g. that given by a quick-return mechanism.

The term *kinematics* is used for the study of motion without regard to forces. When we consider just the motions without any consideration of the forces or energy involved then we are carrying out a kinematic analysis of the mechanism. This chapter is an introduction to such a consideration. For more detail the reader is referred to general texts for mechanical engineers, such as *Mechanical Science* by W. Bolton (Blackwell Scientific Publications 1993, 1998), or more specialist texts on the principles of machines, such as *Design of Machinery* by R.L. Norton (McGraw-Hill 1992).

6.2 Types of motion

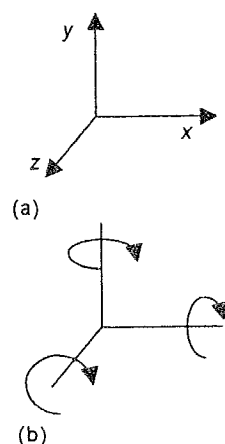


Fig. 6.1 Types of motion

A rigid body can have a very complex motion which might seem difficult to describe. However, the motion of any rigid body can be considered to be a combination of translational and rotational motions. By considering the three dimensions of space, a translation motion can be considered to be a movement which can be resolved into components along one or more of the three axes (Fig. 6.1(a)). A rotation can be considered as a rotation which has components rotating about one or more of the axes (Fig. 6.1(b)).

A complex motion may be a combination of translational and rotational motions. For example, think of the motion required for you to pick up a pencil from a table. This might involve your hand moving at a particular angle towards the table, rotation of the hand, and then all the movement associated with opening your fingers and moving them to the required positions to grasp the pencil. This is a sequence of quite complex motions. However, we can break down all these motions into combinations of translational and rotational motions. Such an analysis is particularly relevant if we are not moving a human hand to pick up the pencil but instructing a robot to carry out the task. Then it really is necessary to break down the motion into combinations of translational and rotational motions so that we can design mechanisms to carry out each of these components of the motion. For example, among the sequence of control signals sent to a mechanism might be such groupings of signals as those to instruct joint 1 to rotate by 20° and link 2 to be extended by 4 mm for translational motion.

6.2.1 Freedom and constraints

An important aspect in the design of mechanical elements is the orientation and arrangement of the elements and parts. A body that is free in space can move in three, independent, mutually perpendicular directions and rotate in three ways about those directions (Fig. 6.1). It is said to have six degrees of freedom. The number of *degrees of freedom* are the number of components of motion that are required in order to generate the motion. If a joint is constrained to move along a line then its translational degrees of freedom are reduced to one. Figure 6.2(a) shows a joint with just this one translational degree of freedom. If a joint is constrained to move on a plane then it has two translational degrees of freedom. Figure 6.2(b) shows a joint which has one translational degree of freedom and one rotational degree of freedom.

The problem in design is often to reduce the number of degrees of freedom and this then requires an appropriate number and orientation of constraints. Without any constraints a body would have six degrees of freedom. A constraint is needed for each degree of freedom that is to be prevented from occurring. Provided we have no redundant constraints then the number of degrees of freedom would be 6 minus the number of constraints. However, redundant constraints often occur and so for constraints on a single rigid body we have the basic rule:

$$6 - \text{number of constraints} = \text{number of degrees of freedom} \\ - \text{number of redundancies}$$

Thus if a body is required to be fixed, i.e. have zero degrees of freedom, then if no redundant constraints are introduced the number of constraints required is 6.

A concept that is used in design is that of the *principle of least constraint*. This states that in fixing a body or guiding it to a particular type of motion, the minimum number of constraints should be used, i.e. there should be no redundancies. This is often referred to as *kinematic design*.

For example, to have a shaft which only rotates about one axis with no translational motions, we have to reduce the number of degrees of freedom to 1. Thus the minimum number of constraints to do this is 5. Any more constraints than this will give redundancies. The mounting that might be used to mount the shaft has a ball bearing at one end and a roller bearing at the other (Fig. 6.3). The pair of bearings together prevent translational motion at right angles to the shaft, the y -axis, and rotations about the z -axis and the y -axis. The ball bearing prevents translational motion along the x -axis and along the z -axis. Thus there is a total of five constraints. This leaves just one degree of freedom, the required rotation about the x -axis. If there had been a roller bearing at each end of the shaft then both

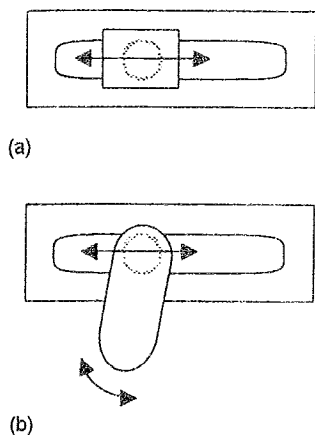


Fig. 6.2 Joints with: (a) one, (b) two degrees of freedom

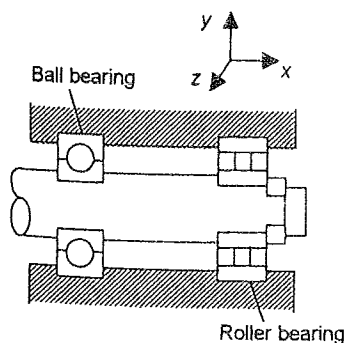


Fig. 6.3 Shaft with no redundancies

the bearings could have prevented translational motion along the x -axis and the z -axis and thus there would have been redundancy. Such redundancy might cause damage. If ball bearings are used at both ends of the shaft, then in order to prevent redundancy one of the bearings would have its outer race not fixed in its housing so that it could slide to some extent in an axial direction.

6.2.2 Loading

Mechanisms are structures and as such transmit and support loads. Analysis is thus necessary to determine the loads to be carried by individual elements. Then consideration can be given to the dimensions of the element so that it might, for example, have sufficient strength and perhaps stiffness under such loading.

6.3 Kinematic chains

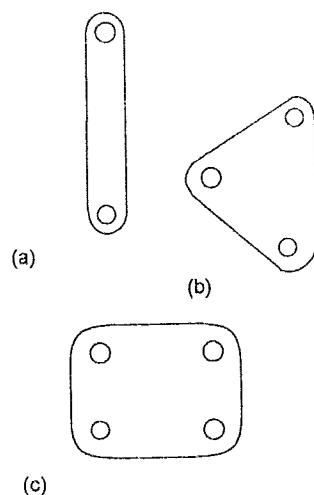


Fig. 6.4 Links: (a) with two nodes, (b) with three nodes, (c) with four nodes


When we consider the movements of a mechanism without any reference to the forces involved, we can treat the mechanism as being composed of a series of individual links. Each part of a mechanism which has motion relative to some other part is termed a *link*. A link need not necessarily be a rigid body but it must be a resistant body which is capable of transmitting the required force with negligible deformation. For this reason it is usually taken as being represented by a rigid body which has two or more points of attachment to other links, these being termed *nodes*. Each link is capable of moving relative to its neighbouring links. Figure 6.4 shows examples of links with two, three and four nodes. A *joint* is a connection between two or more links at their nodes and which allows some motion between the connected links. Levers, cranks, connecting rods and pistons, sliders, pulleys, belts and shafts are all examples of links.

A sequence of joints and links is known as a *kinematic chain*. For a kinematic chain to transmit motion, one link must be fixed. Movement of one link will then produce predictable relative movements of the others. It is possible to obtain from one kinematic chain a number of different mechanisms by having a different link as the fixed one.

As an illustration of a kinematic chain, consider a motor car engine where the reciprocating motion of a piston is transformed into rotational motion of a crankshaft on bearings mounted in a fixed frame (Fig. 6.5(a)). We can represent this as being four connected links (Fig. 6.5(b)). Link 1 is the crankshaft, link 2 the connecting rod, link 3 the fixed frame and link 4 the slider, i.e. piston, which moves relative to the fixed frame (see Section 6.3.2 for further discussion).

The designs of many mechanisms are based on two basic forms of kinematic chains, the four-bar chain and the slider-crank chain. The following illustrates some of the forms such chains can take.

Fig. 6.5 Simple engine mechanism

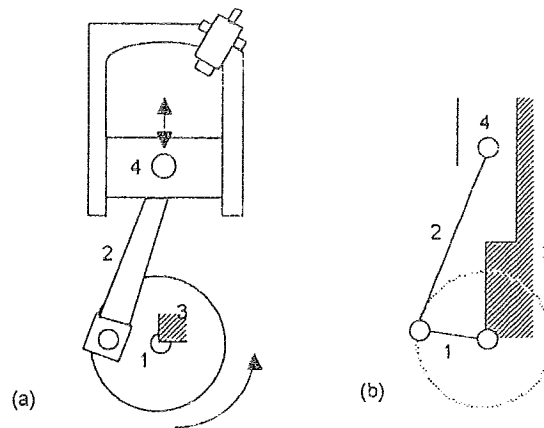

6.3.1 The four-bar chain

The four-bar chain consists of four links connected to give four joints about which turning can occur. Figure 6.6 shows a number of forms of the four-bar chain produced by altering the relative lengths of the links. If the sum of the length of the shortest link plus the length of the longest link is less than or equal to the sum of the lengths of the other two links then at least one link will be capable of making a full revolution with respect to the fixed link. If this condition is not met then no link is capable of a complete revolution. This is known as the Grashof condition. In Figure 6.6(a), link 3 is fixed and the relative lengths of the links are such that links 1 and 4 can oscillate but not rotate. The result is a *double-lever mechanism*. By shortening link 4 relative to link 1, then link 4 can rotate (Fig. 6.6(b)) with link 1 oscillating and the result is termed a *lever-crank mechanism*. With links 1 and 4 the same length and both able to rotate (Fig. 6.6(c)), then the result is a *double-crank mechanism*. By altering which link is fixed, other forms of mechanism can be produced.

Figure 6.7 illustrates how such a mechanism can be used to advance the film in a cine camera. As link 1 rotates so the end of link 2 locks into a sprocket of the film, pulls it forward before releasing and moving up and back to lock into the next sprocket.

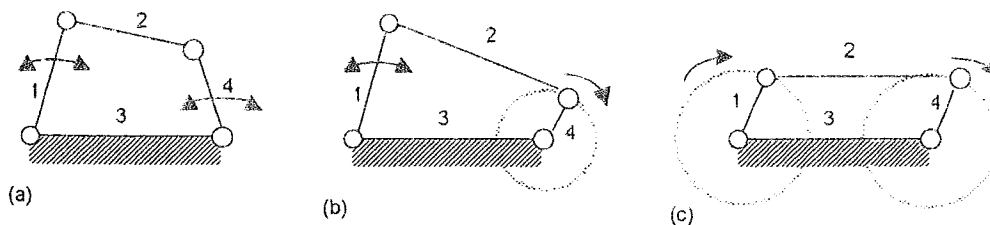


Fig. 6.6 Examples of four-bar chains

Fig. 6.7 Cine film advance mechanism


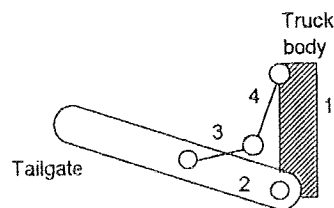
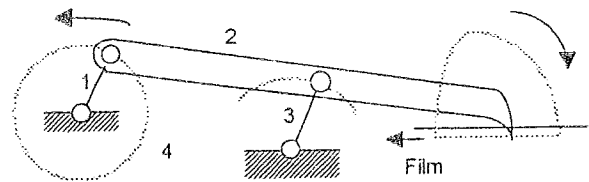


Fig. 6.8 Toggle linkage

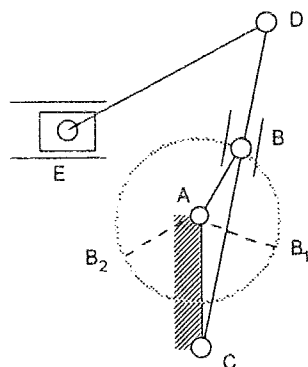


Fig. 6.9 Quick-return mechanism

Some linkages may have *toggle positions*. These are positions where the linkage will not react to any input from one of its links. Figure 6.8 illustrates such a toggle, being the linkage used to control the movement of the tailgate of a truck so that when link 2 reaches the horizontal position no further load on link 2 will cause any further movement. There is another toggle position for the linkage and that is when links 3 and 4 are both vertical and the tailgate is vertical.

6.3.2 The slider-crank mechanism

This form of mechanism consists of a crank, a connecting rod and a slider and is the type of mechanism described in Figure 6.5 which showed the simple engine mechanism. With that configuration, link 3 is fixed, i.e. there is no relative movement between the centre of rotation of the crank and the housing in which the piston slides. Link 1 is the crank that rotates, link 2 the connecting rod and link 4 the slider which moves relative to the fixed link. When the piston moves backwards and forwards, i.e. link 4 moves backwards and forwards, then the crank, link 1, is forced to rotate. Hence the mechanism transforms an input of backwards and forwards motion into rotational motion.

Figure 6.9 shows another form of this type of mechanism, a *quick-return mechanism*. It consists of a rotating crank, link AB, which rotates round a fixed centre, an oscillating lever CD, which is caused to oscillate about C by the sliding of the block at B along CD as AB rotates, and a link DE which causes E to move backwards and forwards. E might be the ram of a machine and have a cutting tool attached to it. The ram will be at the extremes of its movement when the positions of the crank are AB_1 and AB_2 . Thus as the crank moves anti-clockwise from B_1 to B_2 the ram makes a complete stroke, the cutting stroke. When the crank continues its movement from B_2 anti-clockwise to B_1 then the ram again makes a complete stroke in the opposite direction, the return stroke. With the crank rotating at constant speed, then, because the angle of crank rotation required for the cutting stroke is greater than the angle for the return stroke, the cutting stroke takes more time than the return stroke. Hence the term, quick-return for the mechanism.

6.4 Cams

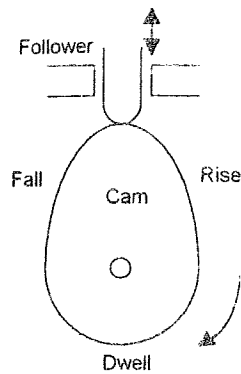


Fig. 6.10 Cam and cam follower

A *cam* is a body which rotates or oscillates and in doing so imparts a reciprocating or oscillatory motion to a second body, called the *follower*, with which it is in contact (Fig. 6.10). As the cam rotates so the follower is made to rise, dwell and fall, the lengths of times spent at each of these positions depending on the shape of the cam. The rise section of the cam is the part that drives the follower upwards, its profile determining how quickly the cam follower will be lifted. The fall section of the cam is the part that lowers the follower, its profile determining how quickly the cam follower will fall. The dwell section of the cam is the part that allows the follower to remain at the same level for a significant period of time. The dwell section of the cam is where it is circular with a radius that does not change.

The cam shape required to produce a particular motion of the follower will depend on the shape of the cam and the type of follower used. Figure 6.11 shows the types of follower displacement diagrams that can be produced with different shaped cams and either point or knife followers. The radial distance from the axis of rotation of the cam to the point of contact of the cam with the follower gives the displacement of the follower with reference to the axis of rotation of the cam. The figures show how these radial distances, and hence follower displacements, vary with the angle of rotation of the cams.

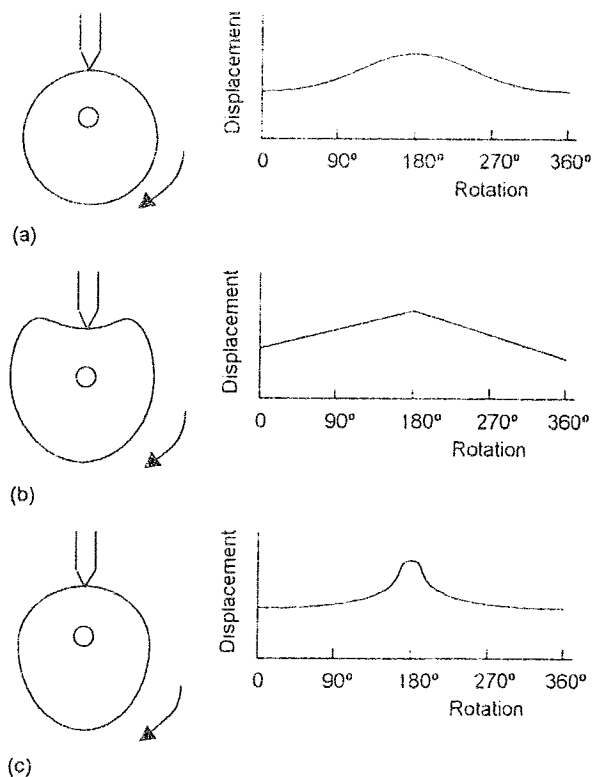


Fig. 6.11 Cams: (a) eccentric, (b) heart-shaped, (c) pear-shaped

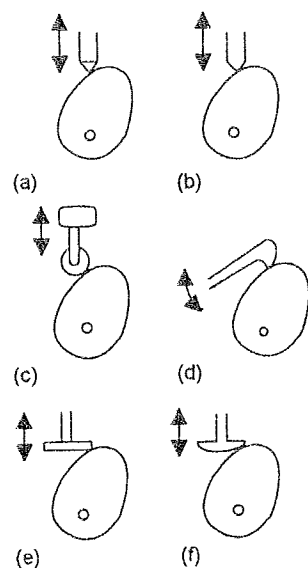


Fig. 6.12 Cam followers: (a) point, (b) knife, (c) roller, (d) sliding and oscillating, (e) flat, (f) mushroom

6.5 Gear trains



Fig. 6.13 Rolling cylinders

The eccentric cam (Fig. 6.11(a)) is a circular cam with an offset centre of rotation. It produces an oscillation of the follower which is simple harmonic motion and is often used with pumps. The heart-shaped cam (Fig. 6.11(b)) gives a follower displacement which increases at a constant rate with time before decreasing at a constant rate with time, hence a uniform speed for the follower. The pear-shaped cam (Fig. 6.11(c)) gives a follower motion which is stationary for about half a revolution of the cam and rises and falls symmetrically in each of the remaining quarter revolutions. Such a pear-shaped cam is used for engine valve control. The dwell holds the valve open while the petrol/air mixture passes into the cylinder. The longer the dwell, i.e. the greater the length of the cam surface with a constant radius, the more time is allowed for the cylinder to be completely charged with flammable vapour.

Figure 6.12 shows a number of examples of different types of cam followers. Roller followers are essentially ball or roller bearings. They have the advantage of lower friction than a sliding contact but can be more expensive. Flat-faced followers are often used because they are cheaper and can be made smaller than roller followers. Such followers are widely used with engine valve cams. While cams can be run dry, they are often used with lubrication and may be immersed in an oil bath.

Gear trains are mechanisms which are very widely used to transfer and transform rotational motion. They are used when a change in speed or torque of a rotating device is needed. For example, the car gearbox enables the driver to match the speed and torque requirements of the terrain with the engine power available.

Rotary motion can be transferred from one shaft to another by a pair of rolling cylinders (Fig. 6.13); however, there is a possibility of slip. The transfer of the motion between the two cylinders depends on the frictional forces between the two surfaces in contact. Slip can be prevented by the addition of meshing teeth to the two cylinders and the result is then a pair of meshed gear wheels.

Gears can be used for the transmission of rotary motion between parallel shafts (Fig. 6.14(a)) and for shafts which have axes inclined to one another (Fig. 6.14(b)). The term *bevel gears* is used when the lines of the shafts intersect, as illustrated in Figure 6.14(b). When two gears are in mesh, the larger gear wheel is often called the *spur* or *crown wheel* and the smaller one the *pinion*. Gears for use with parallel shafts may have axial teeth with the teeth cut along axial lines parallel to the axis of the shaft (Fig. 6.15(a)). Such gears are then termed *spur gears*. Alternatively they may have helical teeth with the teeth being cut on a helix (Fig. 6.15(b)) and are then termed *helical gears*. Helical gears have the advantage that there is a gradual

engagement of any individual tooth and consequently there is a smoother drive and generally prolonged life of the gears. However, the inclination of the teeth to the axis of the shaft results in an axial force component on the shaft bearing. This can be overcome by using double helical teeth (Fig. 6.15(c)).

Fig. 6.14 Gear axes: (a) parallel, (b) inclined to one another

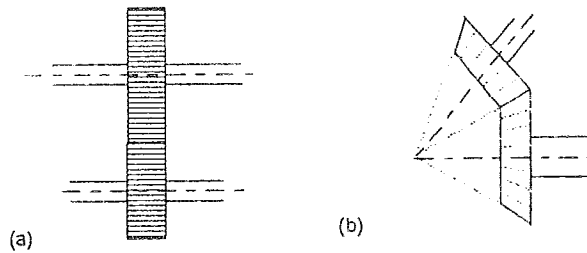


Fig. 6.15 Teeth: (a) axial, (b) helical, (c) double helical


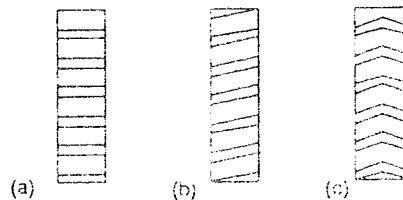


Fig. 6.16 Rack-and-pinion

Another form of gear is the *rack-and-pinion* (Fig. 6.16), this being essentially two intermeshed gears with one having a base circle of infinite radius. Such gears can be used to transform either linear motion to rotational motion or rotational motion to linear motion.

Consider two meshed gear wheels A and B (Fig. 6.17). If there are 40 teeth on wheel A and 80 teeth on wheel B, then wheel A must rotate through two revolutions in the same time as wheel B rotates through one. Thus the angular velocity ω_A of wheel A must be twice that ω_B of wheel B, i.e.

$$\frac{\omega_A}{\omega_B} = \frac{\text{number of teeth on B}}{\text{number of teeth on A}} = \frac{80}{40} = 2$$

Since the number of teeth on a wheel is proportional to its diameter, we can write:

$$\frac{\omega_A}{\omega_B} = \frac{\text{number of teeth on B}}{\text{number of teeth on A}} = \frac{d_B}{d_A}$$




Fig. 6.17 Two meshed gears

Thus for the data we have been considering, wheel B must have twice the diameter of wheel A. The term *gear ratio* is used for the ratio of the angular speeds of a pair of intermeshed gear wheels. Thus the gear ratio for this example is 2.




Fig. 6.18 Simple gear train

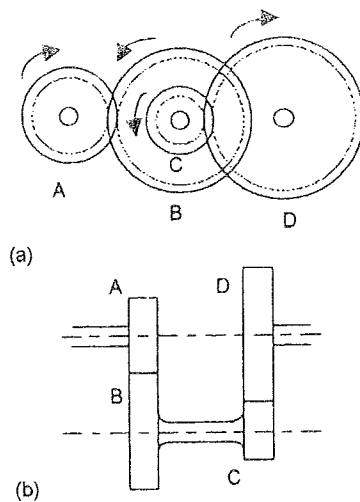


Fig. 6.19 Compound gear trains

6.5.1 Gear trains

The term *gear train* is used to describe a series of intermeshed gear wheels. The term *simple gear train* is used for a system where each shaft carries only one gear wheel, as in Figure 6.18. For such a gear train, the overall gear ratio is the ratio of the angular velocities at the input and output shafts and is thus ω_A/ω_C .

$$G = \frac{\omega_A}{\omega_C}$$

Consider a simple gear train consisting of wheels A, B and C, as in Figure 6.18, with A having 9 teeth and C having 27 teeth. Then, as the angular velocity of a wheel is inversely proportional to the number of teeth on the wheel, the gear ratio is $27/9 = 3$. The effect of wheel B is purely to change the direction of rotation of the output wheel compared with what it would have been with just the two wheels A and C intermeshed. The intermediate wheel, B, is termed the *idler wheel*.

We can rewrite this equation for the overall gear ratio G as

$$G = \frac{\omega_A}{\omega_C} = \frac{\omega_A}{\omega_B} \times \frac{\omega_B}{\omega_C}$$

But ω_A/ω_B is the gear ratio for the first pair of gears and ω_B/ω_C the gear ratio for the second pair of gears. Thus the overall gear ratio for a simple gear train is the product of the gear ratios for each successive pair of gears.

The term *compound gear train* is used to describe a gear train when two wheels are mounted on a common shaft. Figure 6.19(a) and (b) shows two examples of such a compound gear train. The gear train in Figure 6.19(b) enables the input and output shafts to be in line. An alternative way of achieving this is the epicyclic gear train discussed in the next section.

When two gear wheels are mounted on the same shaft they have the same angular velocity. Thus, for both of the compound gear trains in Figure 6.19, $\omega_B = \omega_C$. The overall gear ratio G is thus

$$G = \frac{\omega_A}{\omega_D} = \frac{\omega_A}{\omega_B} \times \frac{\omega_B}{\omega_C} \times \frac{\omega_C}{\omega_D} = \frac{\omega_A}{\omega_B} \times \frac{\omega_C}{\omega_D}$$

For the arrangement shown in Figure 6.19(b), for the input and output shafts to be in line we must also have for the radii of the gears:

$$r_A + r_B = r_D + r_C$$

Consider a compound gear train of the form shown in Figure 6.19(a), with A, the first driver, having 15 teeth, B 30 teeth, C 18 teeth and D, the final driven wheel, 36 teeth. Since the angular

velocity of a wheel is inversely proportional to the number of teeth on the wheel, the overall gear ratio is

$$G = \frac{30}{15} \times \frac{36}{18} = 4$$

Thus, if the input to wheel A is an angular velocity of 160 rev/min, then the output angular velocity of wheel D is $160/4 = 40$ rev/min.

A simple gear train of spur, helical or bevel gears is usually limited to an overall gear ratio of about 10. This is because of the need to keep the gear train down to a manageable size if the number of teeth on the pinion is to be kept above a minimum number which is usually about 10 to 20. Higher gear ratios can, however, be obtained with compound gear trains. This is because the gear ratio is the product of the individual gear ratios of parallel gear sets.

6.6 Ratchet and pawl




Fig. 6.20 Ratchet and pawl

Ratchets can be used to lock a mechanism when it is holding a load. Figure 6.20 shows a ratchet and pawl. The mechanism consists of a wheel, called a *ratchet*, with saw-shaped teeth which engage with an arm called a *pawl*. The arm is pivoted and can move back and forth to engage the wheel. The shape of the teeth is such that rotation can occur in only one direction. Rotation of the ratchet wheel in a clockwise direction is prevented by the pawl and can only take place when the pawl is lifted. The pawl is normally spring loaded to ensure that it automatically engages with the ratchet teeth.

Thus a winch used to wind up a cable on a drum may have a ratchet and pawl to prevent the cable unwinding from the drum when the handle is released.

6.7 Belt and chain drives

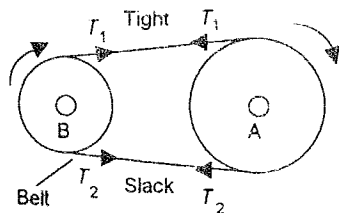


Fig. 6.21 Belt drive

Belt drives are essentially just a pair of rolling cylinders, as described in Figure 6.13 and Section 6.5, with the motion of one cylinder being transferred to the other by a belt (Fig. 6.21). Belt drives use the friction that develops between the pulleys attached to the shafts and the belt around the arc of contact in order to transmit a torque. Since the transfer relies on frictional forces then slip can occur. The transmitted torque is due to the differences in tension that occur in the belt during operation. This difference results in a tight side and a slack side for the belt. If the tension on the tight side is T_1 , and that on the slack side T_2 , then with pulley A in Figure 6.21 as the driver:

$$\text{Torque on A} = (T_1 - T_2)r_A$$

where r_A is the radius of pulley A. For the driven pulley B we have:

$$\text{Torque on B} = (T_1 - T_2)r_B$$

where r_B is the radius of pulley B. Since the power transmitted is the product of the torque and the angular velocity, and since the angular velocity is v/r_A for pulley A and v/r_B for pulley B, where v is the belt speed, then for either pulley we have:

$$\text{Power} = (T_1 - T_2)v$$

As a method of transmitting power between two shafts, belt drives have the advantage that the length of the belt can easily be adjusted to suit a wide range of shaft-to-shaft distances and the system is automatically protected against overload because slipping occurs if the loading exceeds the maximum tension that can be sustained by frictional forces. If the distances between shafts is large, a belt drive is more suitable than gears, but over small distances gears are to be preferred. Different size pulleys can be used to give a gearing effect. However, the gear ratio is limited to about 3 because of the need to maintain an adequate arc of contact between the belt and the pulleys.

The belt drive shown in Figure 6.21 gives the driven wheel rotating in the same direction as the driver wheel. Figure 6.22 shows two types of reversing drives. With both forms of drive, both sides of the belt come into contact with the wheels and so V-belts or timing belts cannot be used.

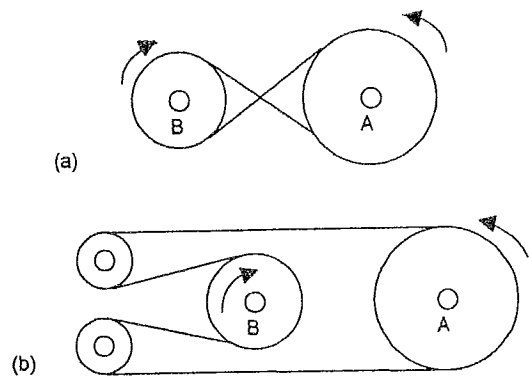


Fig. 6.22 Reversed belt drives:
a) crossed belt, (b) open belt

6.7.1 Types of belts

The four main types of belts (Fig. 6.23) are:

1 Flat

The belt has a rectangular cross-section. Such a drive has an efficiency of about 98% and produces little noise. They can transmit power over long distances between pulley centres. Crowned pulleys are used to keep the belts from running off the pulleys.

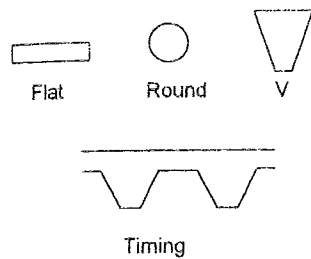


Fig. 6.23 Types of belt

2 *Round*

The belt has a circular cross-section and is used with grooved pulleys.

3 *V*

V-belts are used with grooved pulleys and are less efficient than flat belts but a number of them can be used on a single wheel and so give a multiple drive.

4 *Timing*

Timing belts require toothed wheels, having teeth which fit into the grooves on the wheels. The timing belt, unlike the other belts, does not stretch or slip and consequently transmits power at a constant angular velocity ratio. The teeth make it possible for the belt to be run at slow or fast speeds.

6.7.2 Chains

Slip can be prevented by the use of chains which lock into teeth on the rotating cylinders to give the equivalent of a pair of intermeshing gear wheels. A chain drive has the same relationship for gear ratio as a simple gear train. The drive mechanism used with a bicycle is an example of a chain drive. Chains enable a number of shafts to be driven by a single wheel and so give a multiple drive. They are not as quiet as timing belts but can be used for larger torques.

6.8 Bearings

Whenever there is relative motion of one surface in contact with another, either by rotating or sliding, the resulting frictional forces generate heat which wastes energy and results in wear. The function of a *bearing* is to guide with minimum friction and maximum accuracy the movement of one part relative to another.

Of particular importance is the need to give suitable support to rotating shafts, i.e. support radial loads. The term *thrust bearing* is used for bearings that are designed to withstand forces along the axis of a shaft when the relative motion is primarily rotation. The following sections outline the characteristics of commonly used forms of bearings.

6.8.1 Plain journal bearings

Journal bearings are used to support rotating shafts which are loaded in a radial direction; the term *journal* is used for a shaft. The bearing basically consists of an insert of some suitable material which is fitted between the shaft and the support (Fig. 6.24). Rotation of the shaft results in its surface sliding over that of the bearing surface. The insert may be a white metal, aluminium alloy, copper alloy, bronze or a polymer such as nylon

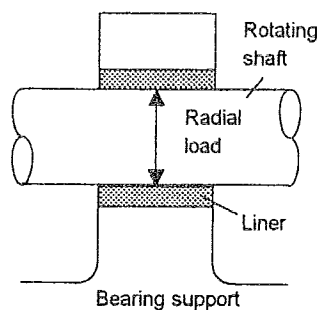


Fig. 6.24 Plain journal bearing




Fig. 6.25 Hydrodynamic journal bearing




Fig. 6.26 Basic elements of a ball bearing

or PTFE. The insert provides lower friction and less wear than if the shaft just rotated in a hole in the support. The bearing may be a dry rubbing bearing or lubricated. Plastics such as nylon and PTFE are generally used without lubrication, the coefficient of friction with such materials being exceptionally low. A widely used bearing material is sintered bronze, this is bronze with a porous structure which allows it to be impregnated with oil and so the bearing has a 'built in' lubricant.

The lubricant may be:

1 Hydrodynamic

The *hydrodynamic journal bearing* consists of the shaft rotating continuously in oil in such a way that it rides on oil and is not supported by metal (Fig. 6.25). The load is carried by the pressure generated in the oil as a result of the shaft rotating.

2 Hydrostatic

A problem with hydrodynamic lubrication is that the shaft only rides on oil when it is rotating and when at rest there is metal-to-metal contact. To avoid excessive wear at start-up and when there is only a low load, oil is pumped into the load-bearing area at a high-enough pressure to lift the shaft off the metal when at rest.

3 Solid-film

This is a coating of a solid material such as graphite or molybdenum disulphide.

4 Boundary layer

This is a thin layer of lubricant which adheres to the surface of the bearing.

6.8.2 Ball and roller bearings

With this type of bearing, the main load is transferred from the rotating shaft to its support by rolling contact rather than sliding contact. A rolling element bearing consists of four main elements: an inner race, an outer race, the rolling element of either balls or rollers, and a cage to keep the rolling elements apart (Fig. 6.26). The inner and outer races contain hardened tracks in which the rolling elements roll.

There are a number of forms of ball bearings:

1 Deep-groove (Fig. 6.27(a))

This is good at withstanding radial loads but is only moderately good for axial loads. It is a versatile bearing which can be used with a wide range of load and speed.

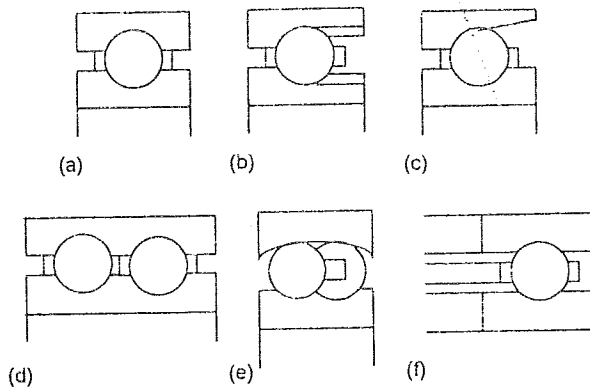


Fig. 6.27 Types of ball bearings

- 2 *Filling-slot* (Fig. 6.27(b))
This is able to withstand higher radial loads than the deep-groove equivalent but cannot be used when there are axial loads.
- 3 *Angular contact* (Fig. 6.27(c))
This is good for both radial and axial loads and is better for axial loads than the deep-groove equivalent.
- 4 *Double-row* (Fig. 6.27(d))
Double-row ball bearings are made in a number of types and are able to withstand higher radial loads than their single-row equivalents. The figure shows a double-row deep-groove ball bearing, there being double-row versions of each of the above single-row types.
- 5 *Self-aligning* (Fig. 6.27(e))
Single-row bearings can withstand a small amount of shaft misalignment but where there can be severe misalignment a self-aligning bearing is used. This is able to withstand only moderate radial loads and is fairly poor for axial loads.
- 6 *Thrust, grooved race* (Fig. 6.27(f))
These are designed to withstand axial loads but are not suitable for radial loads.

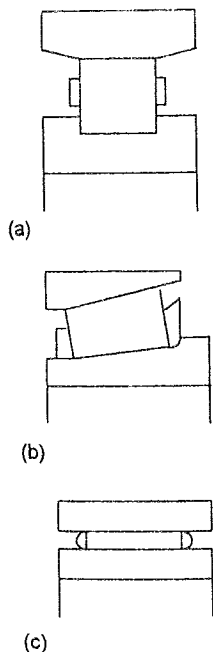


Fig. 6.28 Roller bearings

There are also a number of forms of roller bearing, the following being common examples:

- 1 *Straight roller* (Fig. 6.28(a))
This is better for radial loads than the equivalent ball bearing but is not generally suitable for axial loads. They will carry a greater load than ball bearings of the same size because of

their greater contact area. However, they are not tolerant of misalignment.

2 *Taper roller* (Fig. 6.28(b))

This is good for radial loads and good in one direction for axial loads.

3 *Needle roller* (Fig. 6.28(c))

This has a roller with a high length/diameter ratio and tends to be used in situations where there is insufficient space for the equivalent ball or roller bearing.

6.8.3 Selection of bearings

In general, dry sliding bearings tend to be only used for small diameter shafts with low load and low speed situations, ball and roller bearings, i.e. bearings involving rolling, with a much wider range of diameter shafts and higher load and higher speed, and hydrodynamic bearings for the high loads with large diameter shafts. Figure 6.29 shows a chart indicating the selection of bearings based on their load–shaft speed characteristics for a number of different diameter shafts (the data used is based on the paper by M.J. Neale in *Proc. I Mech. E.*, 182(3A), 547 (1967)). Thus suppose we want a bearing for a 25 mm diameter shaft rotating at 10 rev/s and carrying a radial load of 10 000 N. This is beyond the limit for a dry sliding bearing and is a point on the graph below the line for rolling bearings for such a diameter and speed, hence rolling bearings can be used.

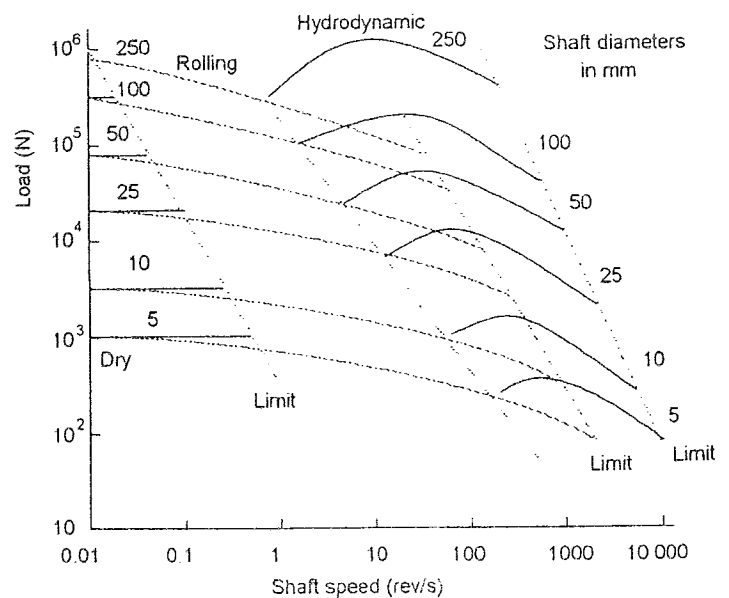


Fig. 6.29 Journal bearing selection

Failure of ball and roller bearings generally occurs as a result of fatigue. With fatigue failures there is always a scatter of values at which failure of an individual item occurs. The life of a bearing is thus defined as the number of millions of shaft revolutions that 90% of the bearings are expected to exceed before failing. This life L_{10} depends on the applied load F . For ball bearings the relationship is:

$$L_{10} = \left(\frac{C}{F}\right)^3$$

where C is a constant for a particular form of bearing. For roller bearings:

$$L_{10} = \left(\frac{C}{F}\right)^{10/3}$$

Manufacturers often tabulate data for bearings in terms of the number of hours of life at a particular speed given in units of rev/min. The life in hours = $10^3/(3600 \times n/60) \times L_0$ in millions of revs = $(16\,667/n) \times L_0$ in millions of revs; n is the number of revolutions per minute. For example, a particular ball bearing may be rated as 3000 h at 500 rev/min for a radial loading of 10 kN. This gives L_0 as 90 million revs and hence C as 44.8 kN. Thus with a load of, say, 20 kN at 400 rev/min then the life we can expect is 11.2 million revolutions or 468 h. If this is not long enough we need to select a ball bearing with a higher rating.

6.9 Mechanical aspects of motor selection

A motor drive system is mechanically required to rotate a shaft and its attached load. Factors that have to be considered are moments of inertia and torque.

6.9.1 Moments of inertia

The torque required to give a load with moment of inertia I_L an angular acceleration a is $I_L a$. The torque required to accelerate the motor shaft is $T_M = I_M a_M$ and that required to accelerate the load is $T_L = I_L a_L$. The motor shaft will, in the absence of gearing, have the same angular acceleration and same angular velocity. The power needed to accelerate the system as a whole is $T_M \omega + T_L \omega$, where ω is the angular velocities. Thus:

$$\text{power} = (I_M + I_L) a \omega$$

This power is produced by the motor torque T_M and thus the power must equal $T_M \omega$. Hence

$$T = (I_M + I_L) a$$

The torque to obtain a given angular acceleration will be minimised when $I_M = I_L$. Thus, for optimum performance, the moment of inertia of the load should be similar to that of the motor.

Consider a gear system with the motor shaft rotating at a different angular speed to the shaft rotating the load. The gear ratio $G = \omega_L/\omega_M = a_L/a_M$, where ω_L is the angular velocity of the load, ω_M the angular velocity of the motor, a_L the angular acceleration of the load and a_M the angular acceleration of the motor. The load shaft will have an angular acceleration of $a_L = Ga_M$. The torque required to accelerate the motor shaft is $T_M = I_M a_M$ and that required to accelerate the load is $T_L = I_L a_L$. The power needed to accelerate the system as a whole is $T_M \omega_M + T_L \omega_L$, where ω is the angular velocities. But $G = \omega_L/\omega_M$ and so the power is:

$$\text{power} = (I_M + G^2 I_L) a_M \omega_M$$

This power is produced by the motor torque T_M and thus the power must equal $T_M \omega_M$. Hence:

$$T_M = (I_M + G^2 I_L) a_M$$

Thus the effect of using the gearing is to give the load an effective moment of inertia of $G^2 I_L$. The torque to give a particular angular acceleration will be minimised when $I_M = G^2 I_L$.

6.9.2 Torque

Figure 6.30 shows the operating curves for a typical motor. For continuous running the stall torque value should not be exceeded. This is the maximum torque value at which overheating will not occur. For intermittent use, greater torques are possible. As the angular speed is increased so the ability of the motor to deliver torque diminishes. Thus if higher speeds and torques are required than given by a particular motor, a more powerful motor needs to be selected.

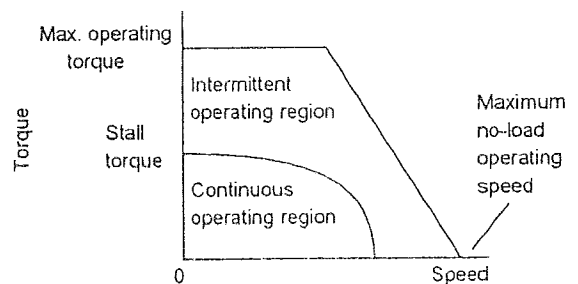


Fig. 6.30 Torque-speed graph

Problems

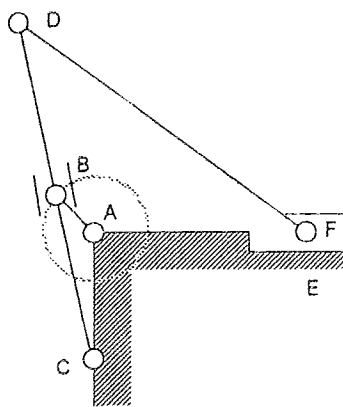


Fig. 6.31 Problem 5




Fig. 6.32 Problem 6

- 1 Explain the terms (a) mechanism, (b) kinematic chain.
- 2 Explain what is meant by the four-bar chain.
- 3 By examining the following mechanisms, state the number of degrees of freedom each has.
 - (a) A car hood hinge mechanism.
 - (b) An estate car tailgate mechanism.
 - (c) A windscreen wiper mechanism.
 - (d) Your knee.
 - (e) Your ankle.
- 4 Analyse the motions of the following mechanisms and state whether they involve pure rotation, pure translation or are a mixture of rotation and translation components.
 - (a) The keys on a computer keyboard.
 - (b) The pen in an XY plotter.
 - (c) The hour hand of a clock.
 - (d) The pointer on a moving coil ammeter.
 - (e) An automatic screwdriver.
- 5 For the mechanism shown in Figure 6.31, the arm AB rotates at a constant rate. B and F are sliders moving along CD and AE. Describe the behaviour of this mechanism.
- 6 Describe how the displacement of the cam follower shown in Figure 6.32 will vary with the angle of rotation of the cam.
- 7 A circular cam of diameter 100 mm has an eccentric axis of rotation which is offset 30 mm from the centre. When used with a knife follower with its line of action passing through the centre of rotation, what will be the difference between the maximum and minimum displacements of the follower?
- 8 Design a cam follower system to give constant follower speeds over follower displacements varying from 40 to 100 mm.
- 9 Design a mechanical system which can be used to:
 - (a) Operate a sequence of microswitches in a timed sequence.
 - (b) Move a tool at a steady rate in one direction and then quickly move it back to the beginning of the path.
 - (c) Transform a rotation into a linear back-and-forth movement with simple harmonic motion.
 - (d) Transform a rotation through some angle into a linear displacement.
 - (e) Transform a rotation of a shaft into rotation of another, parallel shaft some distance away.
 - (f) Transform a rotation of one shaft into rotation of another, close shaft which is at right angles to it.
- 10 A compound gear train consists of the final driven wheel with 15 teeth which meshes with a second wheel with 90 teeth. On the same shaft as the second wheel is a wheel with 15 teeth. This meshes with a fourth wheel, the first driver, with 60 teeth. What is the overall gear ratio?

- 11 Which types of bearings are likely to be the most suitable for the following situations?
- (a) A 50 mm diameter shaft which is carrying a load of 10 000 N and rotating at 100 rev/s.
 - (b) A 10 mm diameter shaft which is carrying a load of 1000 N and rotating at 5 rev/min.

7 Electrical actuation systems

7.1 Electrical systems

In any discussion of electrical systems used as actuators for control, the discussion has to include:

- 1 *Switching devices* such as mechanical switches, e.g. relays, or solid-state switches, e.g. diodes, thyristors, and transistors, where the control signal switches on or off some electrical device, perhaps a heater or a motor
- 2 *Solenoid type devices* where a current through a solenoid is used to actuate a soft iron core, as, for example, the solenoid operated hydraulic/pneumatic valve where a control current through a solenoid is used to actuate a hydraulic/pneumatic flow.
- 3 *Drive systems*, such as d.c. and a.c. motors, where a current through a motor is used to produce rotation.

This chapter is an overview of such devices and their characteristics.

7.2 Mechanical switches

Mechanical switches are elements which are often used as sensors to give inputs to systems (see Section 2.12), e.g. keyboards. In this chapter we are concerned with their use as actuators to perhaps switch on electric motors or heating elements, or switch on the current to actuate solenoid valves controlling hydraulic or pneumatic cylinders. The electrical *relay* is an example of a mechanical switch used in control systems as an actuator.

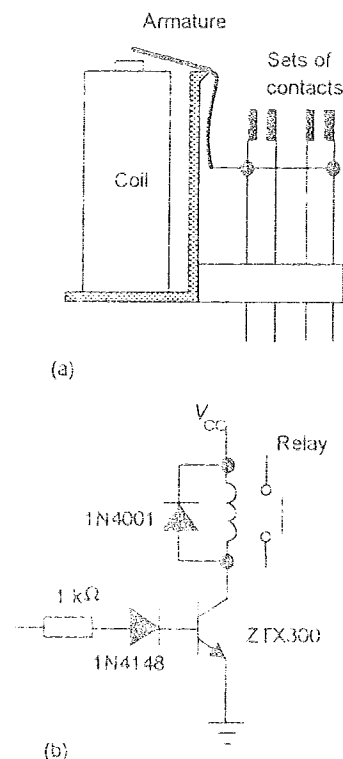


Fig. 7.1 (a) A relay and (b) a driver circuit

7.2.1 Relays

Relays are electrically operated switches in which changing a current in one electrical circuit switches a current on or off in another circuit. For the relay shown in Figure 7.1(a), when there is a current through the solenoid of the relay, a magnetic field is produced which attracts the iron armature, moves the push-rod, and so closes the normally open (NO) switch contacts and opens the normally closed (NC) switch contacts.

Relays are often used in control systems; the output from the controller is a relatively small current and a much larger current is needed to switch on or off the final correction element, e.g. the current required by an electric heater in a temperature control system or a motor. In such a situation they are likely to be used in conjunction with transistors and Figure 7.1(b) shows the type of circuit that might be used. Because relays are inductances, they can generate a back voltage when the energising current is switched off or when their input switches from a high to low signal. As a result damage can occur in the connecting circuit. To overcome this problem, a diode is connected across the relay. When the back e.m.f. occurs, the diode conducts and shorts it out.

As an illustration of the ways relays can be used in control systems, Figure 7.2 shows how two relays might be used to control the operation of pneumatic valves which in turn control the movement of pistons in three cylinders A, B and C. The sequence of operation is:

- 1 When the start switch is closed, current is applied to the A and B solenoids and results in both A and B extending, i.e. A+ and B+.
- 2 The limit switches a+ and b- are then closed, the a+ closure results in a current flowing through relay coil 1 which then closes its contacts and so supplies current to the C solenoid and results in it extending, i.e. C+.
- 3 Its extension causes limit switch c+ to close and so current to switch the A and B control valves and hence retraction of cylinders A and B, i.e. A- and B-.
- 4 Closing limit switch a- passes a current through relay coil 2; its contacts close and allows a current to valve C and cylinder C to retract, i.e. C-.

The sequence thus given by this system is A+ and B+ concurrently, then C+, followed by A- and B- concurrently and finally C-.

Time-delay relays are control relays that have a delayed switching action. The time delay is usually adjustable and can be initiated when a current flows through the relay coil or when it ceases to flow through the coil.

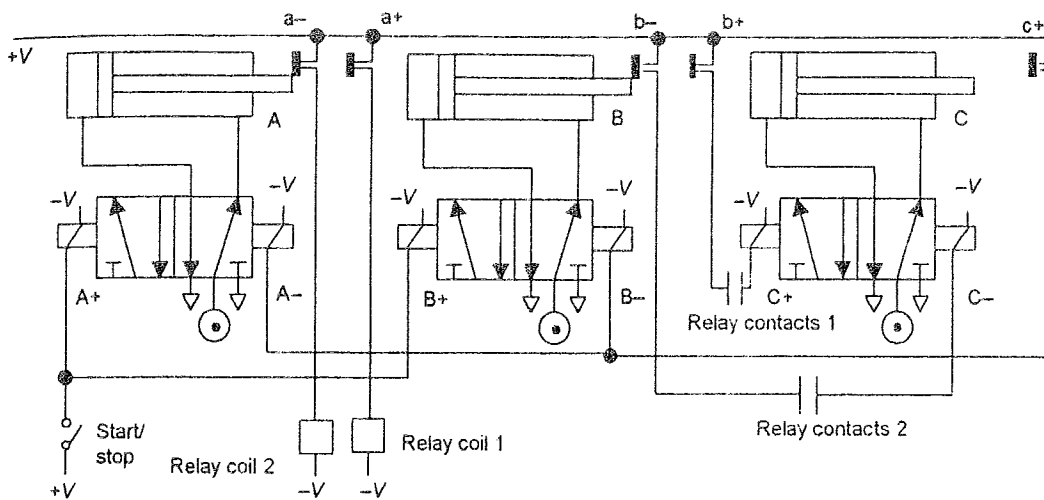


Fig. 7.2 Relay controlled system

7.3 Solid-state switches

There are a number of solid-state devices which can be used to electronically switch circuits. These include:

- 1 Diodes.
- 2 Thyristors and triacs.
- 3 Bipolar transistors.
- 4 Power MOSFETs.

7.3.1 Diodes

The *diode* has the characteristic shown in Figure 7.3 and so allows a significant current in one direction only. A diode can thus be regarded as a 'directional element', only passing a current when forward biased, i.e. with the anode being positive with respect to the cathode. If the diode is sufficiently reverse biased, i.e. a very high voltage, it will break down. If an alternating voltage is applied across a diode, it can be regarded as only switching on when the direction of the voltage is such as to forward bias it and being off in the reverse biased direction. The result is that the current through the diode is half-rectified to become just the current due to the positive halves of the input voltage (Fig. 7.4).

7.3.2 Thyristors and triacs

The *thyristor*, or *silicon-controlled rectifier* (SCR), can be regarded as a diode which has a gate controlling the conditions under which the diode can be switched on. Figure 7.5 shows the thyristor characteristic. With the gate current zero, the thyristor passes negligible current when reverse biased (unless sufficiently

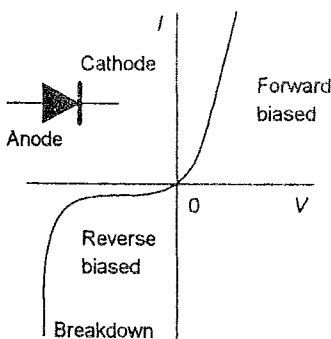


Fig. 7.3 Diode characteristic




Fig. 7.4 Half-wave rectification

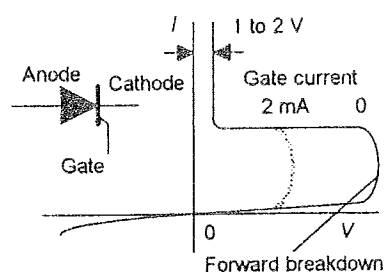


Fig. 7.5 Thyristor characteristic




Fig. 7.6 Thyristor circuit

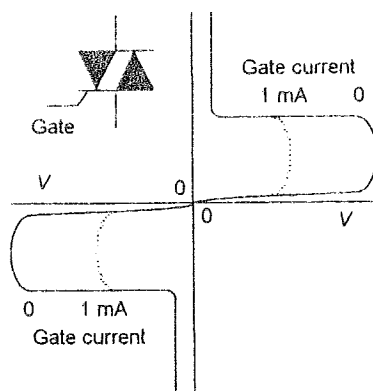
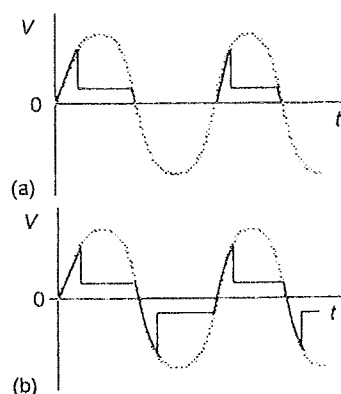


Fig. 7.7 Triac characteristic

Fig. 7.8 Voltage control:
(a) thyristor, (b) triac

reverse biased, hundreds of volts, when it breaks down). When forward biased the current is also negligible until the forward breakdown voltage is exceeded. When this occurs the voltage across the diode falls to a low level, about 1 to 2 V, and the current is then only limited by the external resistance in a circuit. Thus, for example, if the forward breakdown is at 300 V then when this voltage is reached the thyristor switches on and the voltage across it drops to 1 or 2 V. If the thyristor is in series with a resistance of, say, $20\ \Omega$ (Fig. 7.6) then before breakdown we have a very high resistance in series with the $20\ \Omega$ and so virtually all the 300 V is across the thyristor and there is negligible current. When forward breakdown occurs, the voltage across the thyristor drops to, say, 2 V and so there is now $300 - 2 = 298$ V across the $20\ \Omega$ resistor, hence the current rises to $298/20 = 14.9$ A. Once switched on the thyristor remains on until the forward current is reduced to below a level of a few milliamps. The voltage at which forward breakdown occurs is determined by the current entering the gate, the higher the current the lower the breakdown voltage. The power-handling capability of a thyristor is high and thus it is widely used for switching high power applications. As an example, the Texas Instruments CF106D has a maximum off-state voltage of 400 V and a maximum gate trigger current of 0.2 mA.

The *triac* is similar to the thyristor and is equivalent to a pair of thyristors connected in reverse parallel on the same chip. The triac can be turned on in either the forward or reverse direction. Figure 7.7 shows the characteristic. As an example, the Motorola MAC212-4 triac has a maximum off-state voltage of 200 V and a maximum on-state current of 12 A r.m.s. Triacs are simple, relatively inexpensive, methods of controlling a.c. power.

Figure 7.8 shows the type of effect that occurs when a sinusoidal alternating voltage is applied across (a) a thyristor and (b) a triac. Forward breakdown occurs when the voltage reaches the breakdown value and then the voltage across the device remains low.

As an example of how such devices can be used for control purposes, Figure 7.9 illustrates how a thyristor could be used to control a steady d.c. voltage V . In this the thyristor is operated as a switch by using the gate to switch the device on or off. By using an alternating signal to the gate, the supply voltage can be chopped and an intermittent voltage produced. The average value of the output d.c. voltage is thus varied and hence controlled by the alternating signal to the gate.

Another example of control is that of alternating current for electric heaters, electric motors or lamp dimmers. Figure 7.10 shows a half-wave, variable resistance, phase-control circuit. The alternating current is applied across the load, e.g. the lamp for the lamp dimming circuit, in series with a thyristor. R_1 is a current-limiting resistor and R_2 is a potentiometer which sets the level at which the thyristor is triggered. The diode is to prevent the

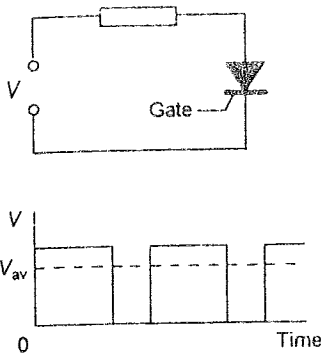


Fig. 7.9 Thyristor d.c. control

negative part of the alternating voltage cycle being applied to the gate. By adjusting R_2 the thyristor can be made to trigger at any point between 0° and 90° in the positive half-cycle of the applied alternating voltage. When the thyristor is triggered near the beginning of the cycle, i.e. 0° , it conducts for the entire positive half-cycle and the maximum power is delivered to the load. As the triggering of the thyristor is delayed to later in the cycle so the power delivered to the load is reduced.

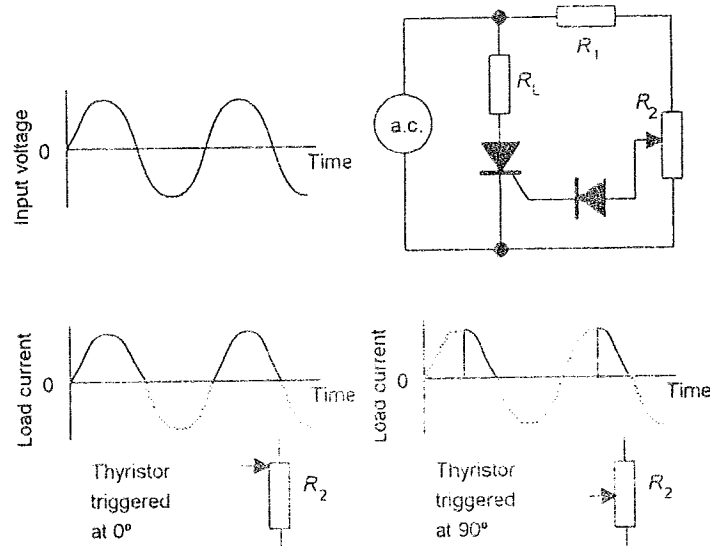


Fig. 7.10 Phase-control circuit




Fig. 7.11 Snubber circuit

When a source voltage is suddenly applied to a thyristor, or a triac, with the gate off, the thyristor may switch from off to on. A typical rate of voltage change that would produce this effect is of the order of $50 \text{ V}/\mu\text{s}$. If the source is a d.c. voltage the thyristor can remain in this conducting state until there is a circuit interruption. In order to prevent this sudden change in source voltage producing this effect, the rate at which the voltage changes with time, i.e. dV/dt , is controlled by using a *snubber circuit*. This is a resistor in series with a capacitor and is placed in parallel with the thyristor (Fig. 7.11). The snubber capacitance C is given by:

$$C = \frac{(V_A)_{\max}^2}{L_L (dV/dt)_{\max}^2}$$

and its resistance R by:

$$R + R_L = 2 \sqrt{\frac{L_L}{C}}$$

where R_L is the load resistance and L_L its inductance.

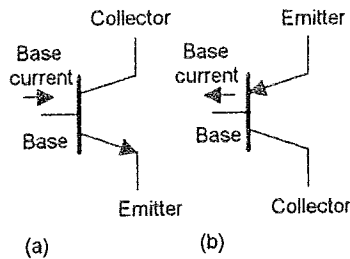


Fig. 7.12 Transistor symbols:
(a) npn, (b) pnp

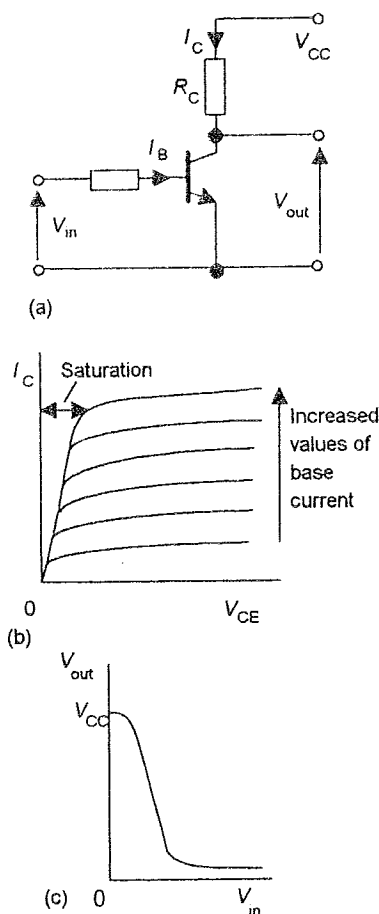


Fig. 7.13 Transistor switch

7.3.3 Bipolar transistors

Bipolar transistors come in two forms, the npn and the pnp. Figure 7.12 shows the symbol for each. For the npn transistor, the main current flows in at the collector and out at the emitter, a controlling signal being applied to the base. The pnp transistor has the main current flowing in at the emitter and out at the collector, a controlling signal being applied to the base.

For a npn transistor connected as shown in Figure 7.13(a), the so-termed common-emitter circuit, the relationship between the collector current I_C and the potential difference between the collector and emitter V_{CE} is described by the series of graphs shown in Figure 7.13(b). When the base current I_B is zero the transistor is cut off, in this state both the base-emitter and the base-collector junctions are reverse biased. When the base current is increased, the collector current increases and V_{CE} decreases as a result of more of the voltage being dropped across R_C . When V_{CE} reaches a value $V_{CE(sat)}$, the base-collector junction becomes forward biased and the collector current can increase no further, even if the base current is further increased. This is termed saturation. By switching the base current between 0 and a value that drives the transistor into saturation, bipolar transistors can be used as switches. When there is no input voltage V_{in} then virtually the entire V_{CC} voltage appears at the output. When the input voltage is made sufficiently high the transistor switches so that very little of the V_{CC} voltage appears at the output (Fig. 7.13(c)).

The relationship between collector current and the base current I_B at values below that which drive the transistor into saturation is

$$I_C = h_{FE} I_B$$

where h_{FE} is the *current gain*. At saturation the collector current $I_{C(sat)}$ is

$$I_{C(sat)} = \frac{V_{CC} - V_{CE(sat)}}{R_C}$$

To ensure that the transistor is driven into saturation the base current must thus rise to at least

$$I_{B(sat)} = \frac{I_{C(sat)}}{h_{FE}}$$

Thus for a transistor with h_{FE} of 50 and $V_{CE(sat)}$ of 1 V, then for a circuit with $R_C = 10 \Omega$ and $V_{CC} = 5$ V, the base current must rise to at least about 8 mA.

Because the base current needed to drive a bipolar power transistor is fairly large, a second transistor is often needed to enable switching to be obtained with relatively small currents, e.g. that supplied by a microprocessor. Thus the switching circuit

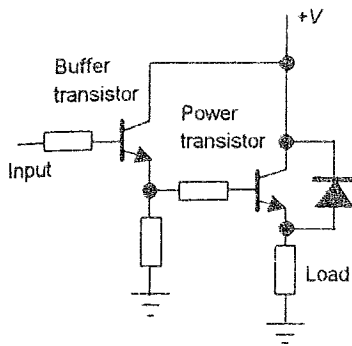


Fig. 7.14 Switching a load

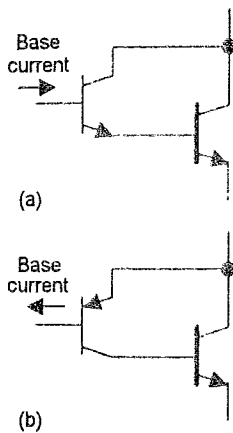


Fig. 7.15 Darlington pairs

can be of the form shown in Figure 7.14. Such a combination of a pair of transistors to enable a high current to be switched with a small input current is termed a *Darlington pair* and they are available as single-chip devices. A *protection diode* is generally connected in parallel with the power transistor to prevent damage to it when the transistor is switched off since it is generally used with inductive loads and large transient voltages can occur. The integrated circuit ULN2001N from SGS-Thompson contains seven separate Darlington pairs, each pair being provided with a protection diode. Each pair is rated as 500 mA continuous and can withstand surges up to 600 mA.

Figure 7.15(a) shows the Darlington connections when a small npn transistor is combined with a large npn transistor, the result being equivalent to a large npn transistor with a large amplification factor. Figure 7.15(b) shows the Darlington connections for a small pnp transistor with a large npn transistor, the result being equivalent to a single large pnp transistor.

In using transistor switched actuators with a microprocessor, attention has to be given to the size of the base current required and its direction. The base current required can be too high and so a buffer might be used. The buffer increases the drive current to the required value. It might also be used to invert. Figure 7.16 illustrates how a buffer might be used when transistor switching is used to control a d.c. motor by on-off switching. Type 240 buffer is inverting while types 241 and 244 are non-inverting. Buffer 74LS240 has a high-level maximum output current of 15 mA and a low-level maximum output current of 24 mA.

Bipolar transistor switching is implemented by base currents and higher frequencies of switching are possible than with thyristors. The power handling capability is less than that of thyristors.

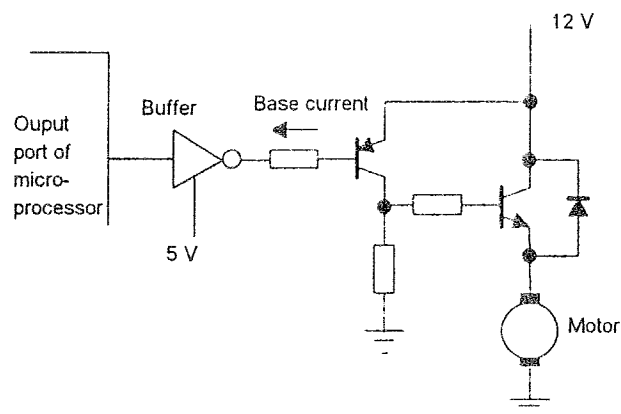


Fig. 7.16 Control of d.c. motor

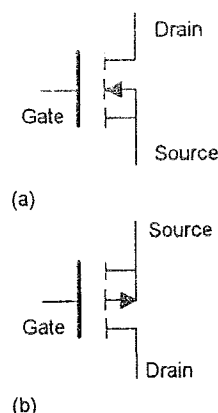


Fig. 7.17 MOSFETs:
(a) n-channel, (b) p-channel

7.3.4 MOSFETs

MOSFETs (metal-oxide field-effect transistors) come in two types, the n-channel and the p-channel. Figure 7.17 shows the symbols. The main difference between the use of a MOSFET for switching and a bipolar transistor is that no current flows into the gate to exercise the control. The gate voltage is the controlling signal. Thus drive circuitry can be simplified in that there is no need to be concerned about the size of the current.

Figure 7.18 illustrates the use of a MOSFET as an on-off switch for a motor; compare the circuit with that in Figure 7.16 where bipolar transistors are used. A level shifter buffer is indicated, this being to raise the voltage level to that required for the MOSFET.

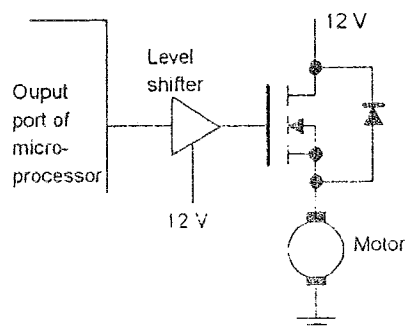


Fig. 7.18 Control of d.c. motor

With MOSFETs, very high frequency switching is possible, up to 1 MHz, and interfacing with a microprocessor is simpler than with bipolar transistors.

For more information on solid-state switches, the reader is referred to specialist texts such *Advanced Industrial Electronics* by N. Morris (McGraw-Hill 1974), *Electronics* by D.I. Crecraft, D.A. Gorham and J.J. Sparkes (Chapman and Hall 1993) or *Power Electronics for the Microprocessor Age* by T. Kenjo (Oxford University Press 1990).

7.4 Solenoids

Solenoids can be used to provide electrically operated actuators. *Solenoid valves* are an example of such devices, being used to control fluid flow in hydraulic or pneumatic systems (see Fig. 5.9). When a current passes through a coil a soft iron core is pulled into the coil and, in doing so, can open or close ports to allow the flow of a fluid.

7.5 D.C. motors

Electric motors are frequently used as the final control element in positional or speed-control systems. Motors can be classified into two main categories: d.c. motors and a.c. motors, most motors




Fig. 7.19 Force on a current carrying conductor

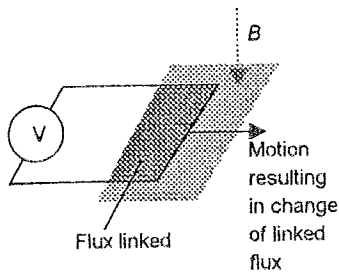


Fig. 7.20 Induced e.m.f.

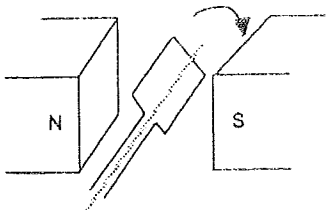


Fig. 7.21 D.C. motor basics

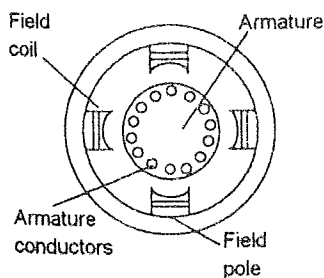


Fig. 7.22 D.C. motor

used in modern control systems being d.c. motors. The basic principles involved in the action of a motor are:

- 1 A force is exerted on a conductor in a magnetic field when a current passes through it (Fig. 7.19). For a conductor of length L carrying a current I in a magnetic field of flux density B at right angles to the conductor, the force F equals BIL .
- 2 When a conductor moves in a magnetic field then an e.m.f. is induced across it (Fig. 7.20). The induced e.m.f. e is equal to the rate at which the magnetic flux Φ (flux equals the product of the flux density and the area) swept through by the conductor changes (Faraday's law), i.e. $e = -d\Phi/dt$. The minus sign is because the e.m.f. is in such a direction as to oppose the change producing it (Lenz's law), i.e. the direction of the induced e.m.f. is in such a direction as to produce a current which sets up magnetic fields which tend to neutralise the change in magnetic flux linked by the coil and which was responsible for the e.m.f. For this reason it is often referred to as a back e.m.f.

7.5.1 Basic principles

Figure 7.21 shows the basic principle of the d.c. motor, a loop of wire which is free to rotate in the field of a permanent magnet. When a current is passed through the coil, the resulting forces acting on its sides at right angles to the field cause forces to act on those sides to give rotation. However, for the rotation to continue, when the coil passes through the vertical position the current direction through the coil has to be reversed.

In the conventional d.c. motor, coils of wire are mounted in slots on a cylinder of magnetic material called the *armature*. The armature is mounted on bearings and is free to rotate. It is mounted in the magnetic field produced by *field poles*. These may be, for small motors, permanent magnets or electromagnets with their magnetism produced by a current through the *field coils*. Figure 7.22 shows the basic principle of a four-pole d.c. motor with the magnetic field produced by current carrying coils. The ends of each armature coil are connected to adjacent segments of a segmented ring called the commutator with electrical contacts made to the segments through carbon contacts called brushes. As the armature rotates, the commutator reverses the current in each coil as it moves between the field poles. This is necessary if the forces acting on the coil are to remain acting in the same direction and so the rotation continue. The direction of rotation of the d.c. motor can be reversed by reversing either the armature current or the field current.




Fig. 7.23 Armature

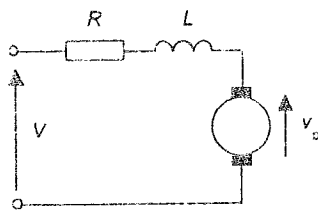


Fig. 7.24 Equivalent circuit




Fig. 7.25 Torque-speed characteristic

7.5.2 Permanent magnet d.c. motor

Consider a permanent magnet d.c. motor, the permanent magnet giving a constant value of flux density. For an armature conductor of length L and carrying a current i the force resulting from a magnetic flux density B at right angles to the conductor is BiL (Fig. 7.23). With N such conductors the force is $NBiL$. The forces result in a torque T about the coil axis of Fb , with b being the breadth of the coil. Thus:

$$\text{torque } T = NBbLi = k_t i$$

where k_t is the torque constant. Since an armature coil is rotating in a magnetic field, electromagnetic induction will occur and a back e.m.f. will be induced. The back e.m.f. v_b is proportional to the rate at which the flux linked by the coil changes and hence, for a constant magnetic field, is proportional to the angular velocity ω of the rotation. Thus:

$$\text{back e.m.f. } v_b = k_v \omega$$

where k_v is the back e.m.f. constant.

We can consider a d.c. motor to have the equivalent circuit shown in Figure 7.24, i.e. the armature coil being represented by a resistor R in series with an inductance L in series with a source of back e.m.f. If we neglect the inductance of the armature coil then the voltage providing the current i through the resistance is the applied voltage V minus the back e.m.f., i.e. $V - v_b$. Hence:

$$i = \frac{V - v_b}{R} = \frac{V - k_v \omega}{R}$$

The torque T is thus:

$$T = k_t i = \frac{k_t}{R} (V - k_v \omega)$$

Graphs of the torque against the rotational speed ω are a series of straight lines for different voltage values (Fig. 7.25). The starting torque, i.e. the torque when $\omega = 0$, is thus proportional to the applied voltage, the no-load speed is proportional to the applied voltage and the torque decreases with increasing speed.

As an example, a small permanent magnet motor S6M41 by PMI Motors has $k_t = 3.01 \text{ N cm/A}$, $k_v = 3.15 \text{ V/krpm}$, a terminal resistance of 1.207Ω and an armature resistance of 0.940Ω .

7.5.3 D.C. motors with field coils

D.C. motors with field coils are classified as series, shunt, compound and separately excited according to how the field windings and armature windings are connected (Fig. 7.26).

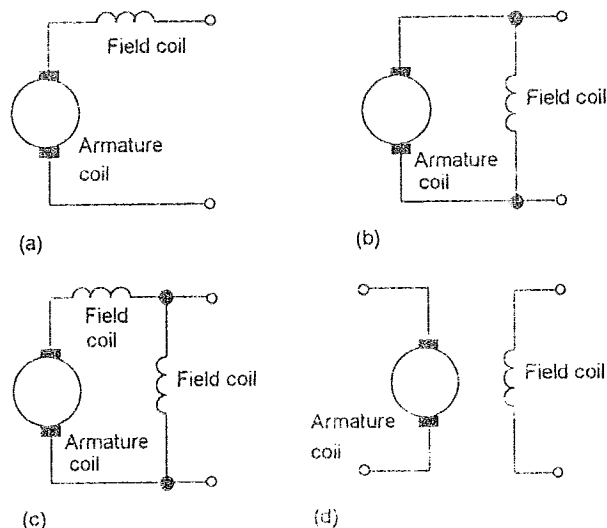


Fig. 7.26 D.C. motors: (a) series, (b) shunt, (c) compound, (d) separately wound

1 *Series wound motor*

With the series wound motor the armature and fields coils are in series. Such a motor exerts the highest starting torque and has the greatest no-load speed. With light loads there is a danger that a series wound motor might run at too high a speed. Reversing the polarity of the supply to the coils has no effect on the direction of rotation of the motor; it will continue rotating in the same direction since both the field and armature currents have been reversed.

2 *Shunt wound motor*

With the shunt wound motor the armature and field coils are in parallel. It provides the lowest starting torque, a much lower no-load speed and has good speed regulation. Because of this almost constant speed regardless of load, shunt wound motors are very widely used. To reverse the direction of rotation, either the armature or field supplied must be reversed. For this reason, the separately excited windings are preferable for such a situation.

3 *Compound motor*

The compound motor has two field windings, one in series with the armature and one in parallel. Compound wound motors aim to get the best features of the series and shunt wound motors, namely a high starting torque and good speed regulation.

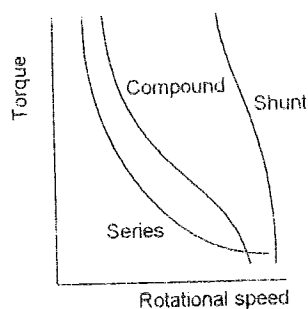


Fig. 7.27 Torque-speed characteristics

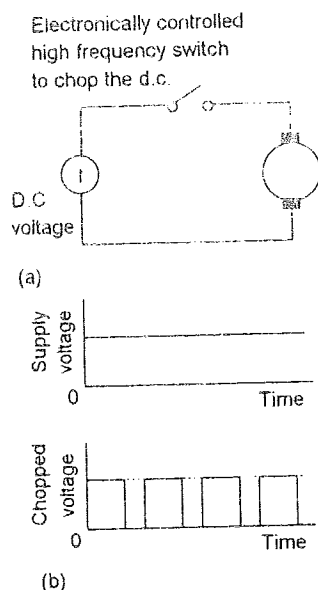


Fig. 7.28 PWM: (a) principle of PWM circuit, (b) varying the average armature voltage by chopping the d.c. voltage

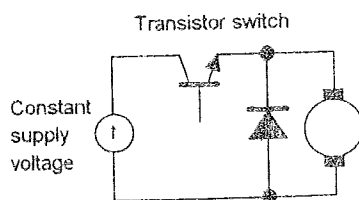


Fig. 7.29 PWM

4 Separately excited motor

The separately excited motor has separate control of the armature and field currents and can be considered to be a special case of the shunt wound motor.

Figure 7.27 indicates the torque-speed characteristics of the above motors. The speed of such d.c. motors can be changed by either changing the armature current or the field current. Generally it is the armature current that is varied. The choice of motor will depend on its application. For example, with a robot manipulator, the robot wrist might use a series wound motor because the speed decreases as the load increases. A shunt wound motor would be used where a constant speed was required, regardless of the load. For more details of d.c. motors, the reader is referred to texts such as *Electric Machines and Drives* by J.D. Edwards (Macmillan 1991), *Electrical Machines and Drive Systems* by C.B. Gray (Longman 1989) or *Electric Motors and Control Techniques* by I.M. Gottlieb (TAB Books, McGraw-Hill 1994).

7.5.4 Control of d.c. motors

The speed of a permanent magnet motor depends on the current through the armature coil. With a field coil motor the speed can be changed by either varying the armature current or the field current; generally it is the armature current that is varied. Thus speed control can be obtained by controlling the voltage applied to the armature. However, because fixed voltage supplies are often used, a variable voltage is obtained by an electronic circuit.

With an alternating current supply, the thyristor circuit of Figure 7.10 can be used to control the average voltage applied to the armature. However, we are often concerned with the control of d.c. motors by means of control signals emanating from microprocessors. In such cases the technique known as *pulse width modulation* (PWM) is generally used. This basically involves taking a constant d.c. supply voltage and chopping it so that the average value is varied (Fig. 7.28). Figure 7.29 shows how PWM can be obtained by means of a basic transistor circuit. The transistor is switched on or off by means of a signal applied to its base. The diode is to provide a path for current which arises when the transistor is off as a result of the motor acting as a generator. Such a circuit can only be used to drive the motor in one direction; a circuit (Fig. 7.30) involving four transistors, termed an H circuit, can be used to enable the motor to be operated in forward and reverse directions. This circuit can be modified by the use of logic gates so that one input controls the switching and one the direction of rotation (Fig. 7.31).

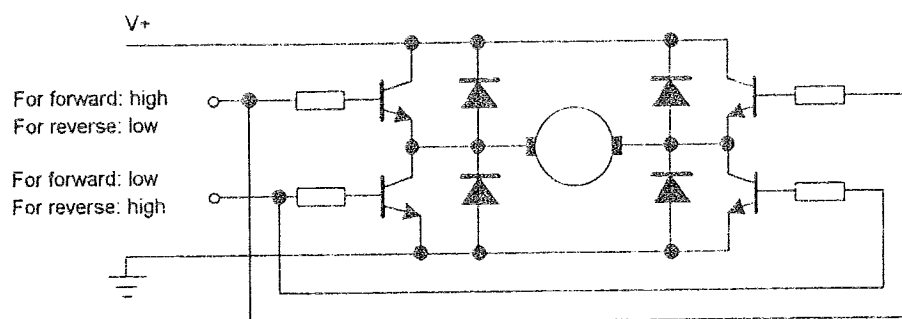


Fig. 7.30 H circuit

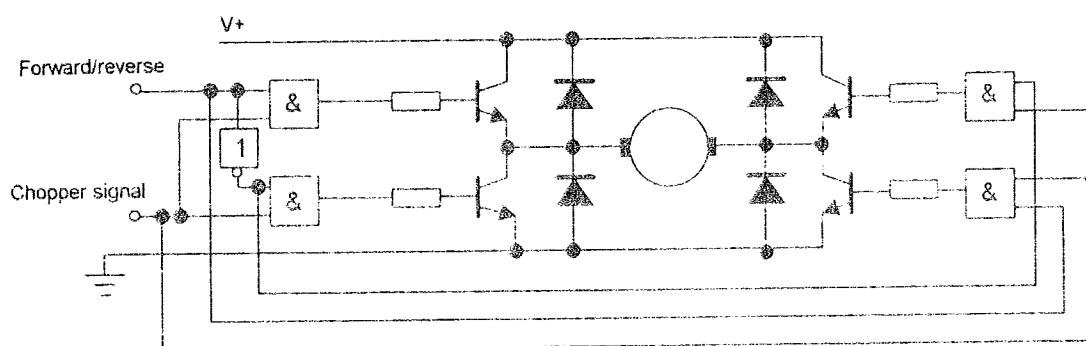


Fig. 7.31 H circuit

The above are examples of open-loop control; this assumes that conditions will remain constant, e.g. the supply voltage and the load driven by the motor. Closed-loop control systems use feedback to modify the motor speed if conditions change. Figure 7.32 shows some of the methods that might be employed.

In Figure 7.32(a) the feedback signal is provided by a tachogenerator, this giving an analogue signal which has to be converted to a digital signal by an ADC for input to the microprocessor. The output from the microprocessor is converted to an analogue signal by an DAC and used to vary the voltage applied to the armature of the d.c. motor. In Figure 7.32(b) the feedback signal is provided by an encoder, this giving a digital signal which after code conversion can be directly inputted to the microprocessor. As in (a) the system shows an analogue voltage being varied to control the motor speed. In Figure 7.32(c) the system is completely digital and PWM is used to control the average voltage applied to the armature.

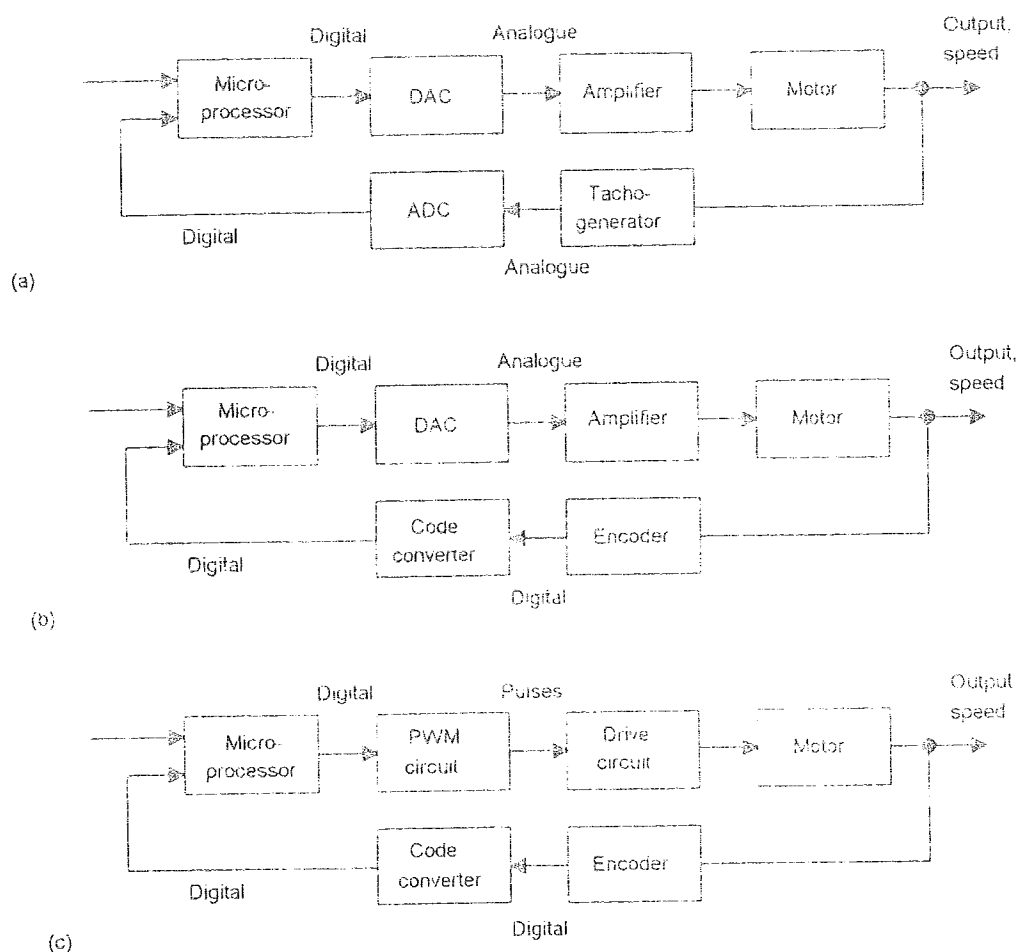


Fig. 7.32 Speed control with feedback

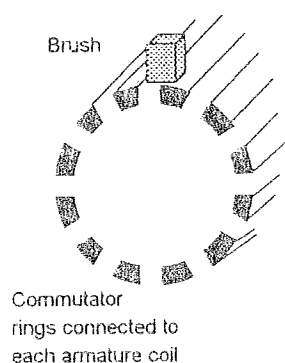


Fig. 7.33 Commutator

7.5.5 Brushless permanent magnet d.c. motors

A problem with d.c. motors is that they require a commutator and brushes (Fig. 7.33) in order to periodically reverse the current through each armature coil. The brushes make sliding contacts with the commutator and as a consequence sparks jump between the two and they suffer wear. Brushes thus have to be periodically changed and the commutator resurfaced. To avoid such problems brushless motors have been designed.

Essentially they consist of a sequence of stator coils and a permanent magnet rotor. A current-carrying conductor in a magnetic field experiences a force, likewise, as a consequence of Newton's third law of motion, the magnet will also experience an opposite and equal force. With the conventional d.c. motor the

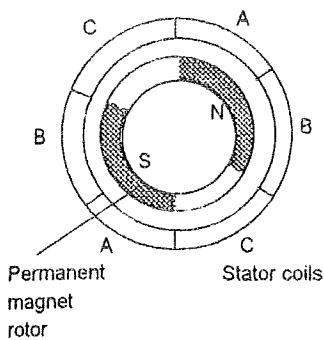


Fig. 7.34 Brushless permanent magnet d.c. motor

magnet is fixed and the current-carrying conductors made to move. With the brushless permanent magnet d.c. motor the reverse is the case, the current carrying conductors are fixed and the magnet moves. The rotor is a ferrite or ceramic permanent magnet. Figure 7.34 shows the basic form of such a motor. The current to the stator coils is electronically switched by transistors in sequence round the coils, the switching being controlled by the position of the rotor so that there are always forces acting on the magnet causing it to rotate in the same direction. Hall sensors are generally used to sense the position of the rotor and initiate the switching by the transistors, the sensors being positioned around the stator.

Figure 7.35 shows the transistor switching circuits that might be used with the motor shown in Figure 7.34. To switch the coils in sequence we need to supply signals to switch the transistors on in the right sequence. This is provided by the outputs from the three sensors operating through a decoder circuit to give the appropriate base currents. Thus when the rotor is in the vertical position, i.e. 0° , there is an output from sensor c but none from a and b. This is used to switch on transistors A+ and B-. For the rotor in the 60° position there are signals from the sensors b and c and transistors A+ and C- are switched on. Table 7.1 shows the entire switching sequence. The entire circuit for controlling such a motor is available on a single integrated circuit.

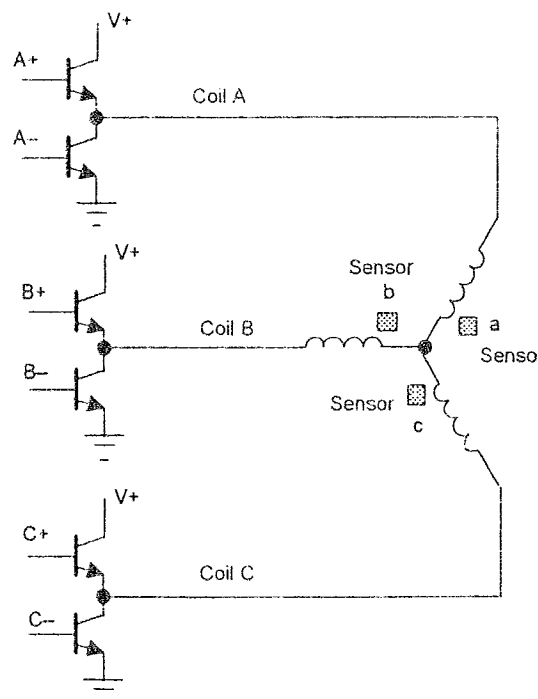


Fig. 7.35 Transistor switching


Table 7.1 Switching sequence

Rotor position	Sensor signals			Transistors on	
	a	b	c		
0°	0	0	1	A+	B-
60°	0	1	1	A+	C-
120°	0	1	0	B+	C-
180°	1	1	0	B+	A-
240°	1	0	0	C+	A-
360°	1	0	1	C+	B-

Brushless permanent magnet d.c. motors are becoming increasingly used in situations where high performance coupled with reliability and low maintenance are essential. Because of their lack of brushes, they are quiet and capable of high speeds. For more details of brushless d.c. motors, the reader is referred to specialist texts such as *Electric Machines and Drives* by J.D. Edwards (Macmillan 1991) or *Brushless Permanent-magnet and Reluctance Motor Drives* by T.J.E. Miller (Oxford University Press 1989).

7.6 A.C. motors

Rotor conductors giving the squirrel cage

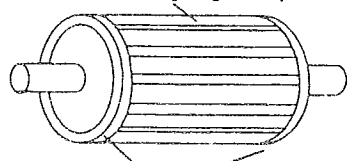

End rings connecting the ends of all the conductors to give the circuits in which currents are induced

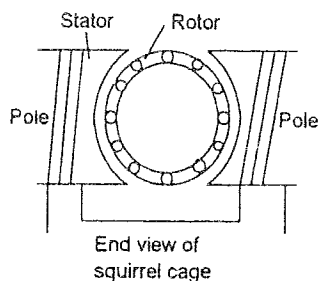


Fig. 7.36 Single-phase induction motor

Alternating current motors can be classified into two groups, single phase and polyphase with each group being further subdivided into induction and synchronous motors. Single-phase motors tend to be used for low power requirements while polyphase motors are used for higher powers. Induction motors tend to be cheaper than synchronous motors and are thus very widely used.

The *single-phase squirrel-cage induction motor* consists of a squirrel-cage rotor, this being copper or aluminium bars that fit into slots in end rings to form complete electrical circuits (Fig. 7.36). There are no external electrical connections to the rotor. The basic motor consists of this rotor with a stator having a set of windings. When an alternating current passes through the stator windings an alternating magnetic field is produced. As a result of electromagnetic induction, e.m.f.s are induced in the conductors of the rotor and currents flow in the rotor. Initially, when the rotor is stationary, the forces on the current carrying conductors of the rotor in the magnetic field of the stator are such as to result in no net torque. The motor is not self-starting. A number of methods are used to make the motor self-starting and give this initial impetus to start it; one is to use an auxiliary starting winding to give the rotor an initial push. The rotor rotates at a speed determined by the frequency of the alternating current applied to the stator. For a constant frequency supply to a two-pole single-phase motor the magnetic field will alternate at




Fig. 7.37 Three-phase induction motor




Fig. 7.38 Three-phase synchronous motor


this frequency. This speed of rotation of the magnetic field is termed the *synchronous speed*. The rotor will never quite match this frequency of rotation, typically differing from it by about 1 to 3%. This difference is termed *slip*. Thus for a 50 Hz supply the speed of rotation of the rotor will be almost 50 revolutions per second.

The *three-phase induction motor* (Fig. 7.37) is similar to the single-phase induction motor but has a stator with three windings located 120° apart, each winding being connected to one of the three lines of the supply. Because the three phases reach their maximum currents at different times, the magnetic field can be considered to rotate round the stator poles, completing one rotation in one full cycle of the current. The rotation of the field is much smoother than with the single-phase motor. The three-phase motor has a great advantage over the single-phase motor of being self-starting. The direction of rotation is reversed by interchanging any two of the line connections, this changing the direction of rotation of the magnetic field.

Synchronous motors have stators similar to those described above for induction motors but a rotor which is a permanent magnet (Fig. 7.38). The magnetic field produced by the stator rotates and so the magnet rotates with it. With one pair of poles per phase of the supply, the magnetic field rotates through 360° in one cycle of the supply and so the frequency of rotation with this arrangement is the same as the frequency of the supply. Synchronous motors are used when a precise speed is required. They are not self-starting and some system has to be employed to start them.


A.C. motors have the great advantage over d.c. motors of being cheaper, more rugged, reliable and maintenance free. However speed control is generally more complex than with d.c. motors and as a consequence a speed-controlled d.c. drive generally works out cheaper than a speed-controlled a.c. drive, though the price difference is steadily dropping as a result of technological developments and the reduction in price of solid-state devices. Speed control of a.c. motors is based around the provision of a variable frequency supply, since the speed of such motors is determined by the frequency of the supply. The torque developed by an a.c. motor is constant when the ratio of the applied stator voltage to frequency is constant. Thus to maintain a constant torque at the different speeds when the frequency is varied the voltage applied to the stator has also to be varied. With one method, the a.c. is first rectified to d.c. by a *converter* and then *inverted* back to a.c. again but at a frequency that can be selected (Fig. 7.39). Another method that is often used for operating slow-speed motors is the *cycloconverter*. This converts a.c. at one frequency directly to a.c. at another frequency without the intermediate d.c. conversion.

Fig. 7.39 Variable speed
a.c. motor

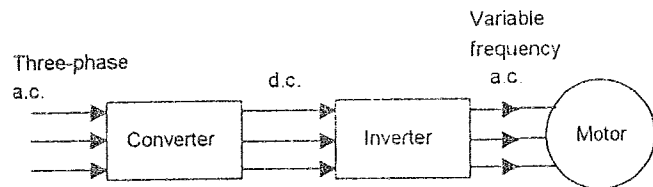


For more details of a.c. motors, the reader is referred to texts such as *Electric Machines and Drives* by J.D. Edwards (Macmillan 1991) or *Electrical Machines and Drive Systems* by C.B. Gray (Longman 1989).

7.7 Stepper motors

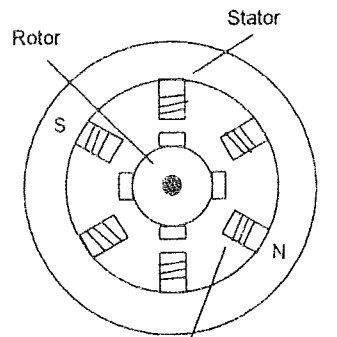

This pair of poles energised by current being switched to them and rotor rotates to position shown below



This pair of poles energised by current being switched to them to give next step

Fig. 7.40 Variable reluctance
stepper motor

The *stepper motor* is a device that produces rotation through equal angles, the so-called *steps*, for each digital pulse supplied to its input. Thus, for example, if with such a motor 1 pulse produces a rotation of 6° then 60 pulses will produce a rotation through 360° . There are a number of forms of stepper motor:

1 Variable reluctance stepper

Figure 7.40 shows the basic form of the variable reluctance stepper motor. With this form the rotor is made of soft steel and is cylindrical with four poles, i.e. fewer poles than on the stator. When an opposite pair of windings has current switched to them, a magnetic field is produced with lines of force which pass from the stator poles through the nearest set of poles on the rotor. Since lines of force can be considered to be rather like elastic thread and always trying to shorten themselves, the rotor will move until the rotor and stator poles line up. This is termed the position of minimum reluctance. This form of stepper generally gives step angles of 7.5° or 15° .

2 Permanent magnet stepper

Figure 7.41 shows the basic form of the *permanent magnet* stepper motor. The motor shown has a stator with four poles. Each pole is wound with a field winding, the coils on opposite pairs of poles being in series. Current is supplied from a d.c. source to the windings through switches. The rotor is a permanent magnet and thus when a pair of stator poles has a current switched to it, the rotor will move to line up with it. Thus for the currents giving the situation shown in the figure the rotor moves to the 45° position. If the current is then switched so that the polarities are reversed, the rotor will move a further 45° in order to line up again. Thus by switching the currents through the coils the rotor rotates in 45° steps. With this type of motor, step angles are commonly 1.8° , 7.5° , 15° , 30° , 34° or 90° .

Fig. 7.41 Permanent magnet stepper motor


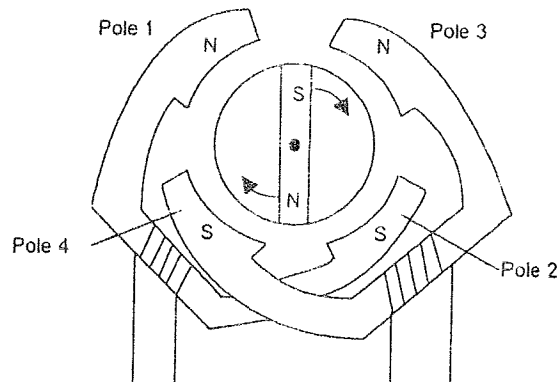


Fig. 7.42 Hybrid motor rotor

3 Hybrid stepper

Hybrid stepper motors combine the features of both the variable reluctance and permanent magnet motors, having a permanent magnet encased in iron caps which are cut to have teeth (Fig. 7.42). The rotor sets itself in the minimum reluctance position in response to a pair of stator coils being energised. Typical step angles are 0.9° and 1.8° . Such stepper motors are extensively used in high-accuracy positioning applications, e.g. in computer hard disc drives.

7.7.1 Stepper motor specifications

The following are some of the terms commonly used in specifying stepper motors:

1 Phase

This term refers to the number of independent windings on the stator, e.g. a four-phase motor. The current required per phase and its resistance and inductance will be specified so that the controller switching output is specified. Two-phase motors, e.g. Figure 7.41, tend to be used in light-duty applications, three-phase motors tend to be variable reluctance steppers, e.g. Figure 7.40, and four-phase motors tend to be used for higher power applications.

2 Step angle

This is the angle through which the rotor rotates for one switching change for the stator coils.

3 Holding torque

This is the maximum torque that can be applied to a powered motor without moving it from its rest position and causing spindle rotation.

- 4 *Pull-in torque*
This is the maximum torque against which a motor will start, for a given pulse rate, and reach synchronism without losing a step.
- 5 *Pull-out torque*
This is the maximum torque that can be applied to a motor, running at a given stepping rate, without losing synchronism.
- 6 *Pull-in rate*
This is the maximum switching rate at which a loaded motor can start without losing a step.
- 7 *Pull-out rate*
This is the switching rate at which a loaded motor will remain in synchronism as the switching rate is reduced.
- 8 *Slew range*
This is the range of switching rates between pull-in and pull-out within which the motor runs in synchronism but cannot start up or reverse.

Figure 7.43 shows the general characteristics of a stepper motor.

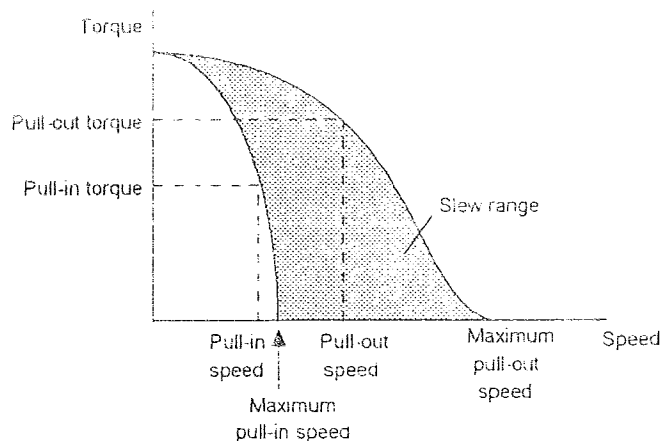


Fig. 7.43 Stepper motor characteristics

7.7.2 Stepper motor control

Solid-state electronics is used to switch the d.c. supply between the pairs of stator windings. Two-phase motors, e.g. Figure 7.41, are termed *bipolar motors* when they have four connecting wires for signals to generate the switching sequence (Fig. 7.44). Such a motor can be driven by H circuits (see Fig. 7.30 and the associated discussion). Figure 7.45 shows the circuit and Table




Fig. 7.44 Bipolar motor

7.2 shows the switching sequence required for the transistors to carry out the four steps, the sequence then being repeated for further steps. The sequence gives a clockwise rotation; for an anti-clockwise rotation the sequence is reversed.

Table 7.2 Switching sequence for full-stepping bipolar stepper

Step	Transistors			
	1 and 4	2 and 3	5 and 8	6 and 7
1	On	Off	On	Off
2	On	Off	Off	On
3	Off	On	Off	On
4	Off	On	On	Off

Half-steps, and hence finer resolution, are obtainable if instead of the full-stepping sequence needed to implement a pole reversal to get from one step to the next, the coils are switched so that the rotor stops at a position halfway to the next full step. Table 7.3 shows the sequence for half-stepping with the bipolar stepper.

Table 7.3 Half-steps for bipolar stepper

Step	Transistors			
	1 and 4	2 and 3	5 and 8	6 and 7
1	On	Off	On	Off
2	On	Off	Off	Off
3	On	Off	Off	On
4	Off	Off	Off	On
5	Off	On	Off	On
6	Off	On	Off	Off
7	Off	On	On	Off
8	Off	Off	On	Off

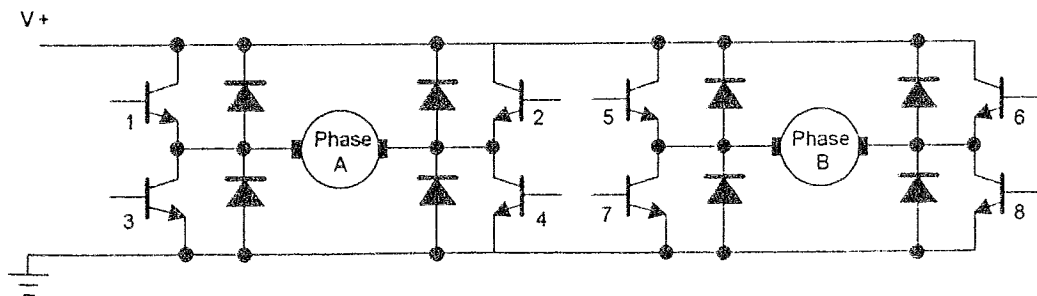


Fig. 7.45 H circuit

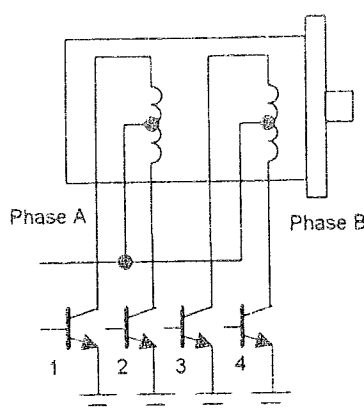


Fig. 7.46 Unipolar motor

Two-phase motors are termed *unipolar* when they have six connecting wires for the generation of the switching sequence (Fig. 7.46). Each of the coils has a centre-tap. With the centre-taps of the phase coils connected together, such a form of stepper motor can be switched with just four transistors. Table 7.4 gives the switching sequence for the transistors in order to produce the steps for clockwise rotation, the sequence then being repeated for further steps. For anti-clockwise rotation the sequence is reversed. Table 7.5 shows the sequence when the unipolar is half-stepping.

Integrated circuits are available to provide the drive circuitry. Figure 7.47 shows the connections with the integrated circuit SAA 1027 for a four-phase stepper. The three inputs are controlled by applying high or low signals to them. When the set terminal is held high, the output from the integrated circuit changes state each time the trigger terminal goes from low to high. The sequence repeats itself at four-step intervals but can be reset to the zero condition at any time by applying a low signal to the trigger terminal. When the rotation input is held low there is clockwise rotation, when high it is anti-clockwise.


Table 7.4 Switching sequence for full-stepping unipolar stepper

Step	Transistors			
	1	2	3	4
1	On	Off	On	Off
2	On	Off	Off	On
3	Off	On	Off	On
4	Off	On	On	Off

Table 7.5 Half-steps for unipolar stepper

Step	Transistors			
	1	2	3	4
1	On	Off	On	Off
2	On	Off	Off	Off
3	On	Off	Off	On
4	Off	Off	Off	On
5	Off	On	Off	On
6	Off	On	Off	Off
7	Off	On	On	Off
8	Off	Off	On	Off

Internal block diagram of SAA 1027

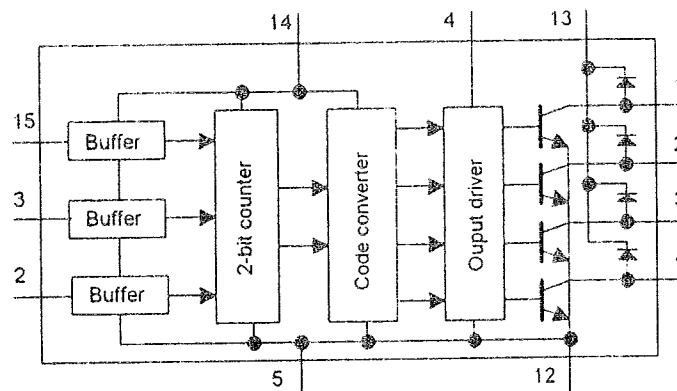

Typical connections for SAA 1027 to a four-phase stepper

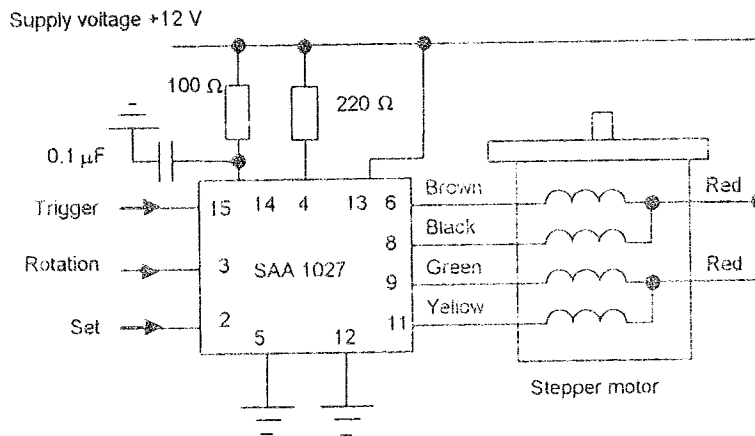


Fig. 7.47 Integrated circuit SAA 1027 for stepper motor

Some applications require very small step angles. While the step angle can be made small by increasing the number of rotor teeth and/or the number of phases, generally more than four phases and 50 to 100 teeth are not used. Instead a technique known as *mini-stepping* is used. This involves dividing each step into a number of equal size sub-steps. This is done by using different currents to the coils so that the rotor moves to intermediate positions between normal step positions. Thus, for example, a step of 1.8° might be subdivided into 10 equal steps.

Stepper motors can be used to give controlled rotational steps but also can give continuous rotation with their rotational speed controlled by controlling the rate at which pulses are applied to it to cause stepping. This gives a very useful controlled variable speed motor which finds many applications.

Because stepper coils have inductance and switched inductive loads can generate large back e.m.f.s when switched, when steppers are connected to microprocessor output ports it is

necessary to include protection to avoid damage to the microprocessor. This may take the form of resistors in the lines to limit the current, though these must have values carefully chosen to both provide the protection but also not to limit the value of the current needed to switch the transistors. Diodes across the coils prevent current in the reverse direction and so give protection. An alternative is to use optoisolators (see Section 3.3).

For more details of stepping motors and their drive circuits, the reader is referred to texts such as *Stepping Motors and their Microprocessor Controls* by T. Kenjo (Oxford University Press 1984), *Power Electronics for the Microprocessor Age* by T. Kenjo (Oxford University Press 1990) or *Electrical Machines and Drive Systems* by C.B. Gray (Longman 1989).

Problems

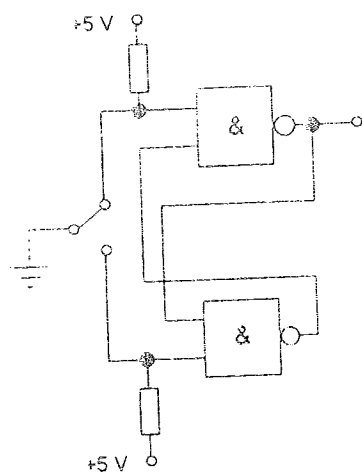


Fig. 7.48 Problem 1

- 1 Explain how the circuit shown in Figure 7.48 can be used to debounce a switch.
- 2 Explain how a thyristor can be used to control the level of a d.c. voltage by chopping the output from a constant voltage supply
- 3 A d.c. motor is required to have (a) a high torque at low speeds for the movement of large loads, (b) a torque which is almost constant regardless of speed. Suggest suitable forms of motor.
- 4 Suggest possible motors, d.c. or a.c., which can be considered for applications where (a) cheap, constant torque operation is required, (b) high controlled speeds are required, (c) low speeds are required, (d) maintenance requirements have to be minimised
- 5 Explain the principle of the brushless d.c. permanent magnet motor.
- 6 Explain the principles of operation of the variable reluctance stepper motor
- 7 If a stepper motor has a step angle of 7.5° , what digital input rate is required to produce a rotation of 10 rev/s?

8 Basic system models

8.1 Mathematical models

Consider the following situation. A microprocessor switches on a motor. How will the rotation of the motor shaft vary with time? The speed will not immediately assume the full-speed value but will only attain that speed after some time. Consider another situation. A hydraulic system is used to open a valve which allows water into a tank to restore the water level to that required. How will the water level vary with time? The water level will not immediately assume the required level but will only attain that level after some time. This chapter, and Chapters 9, 10 and 11, are about determining how systems behave with time when subject to some disturbance.

In order to understand the behaviour of systems, *mathematical models* are needed. These mathematical models are equations which describe the relationship between the input and output of a system. They can be used to enable forecasts to be made of the behaviour of a system under specific conditions. The basis for any mathematical model is provided by the fundamental physical laws that govern the behaviour of the system. In this chapter a range of systems will be considered, including mechanical, electrical, thermal and fluid examples.

Like a child building houses, cars, cranes, etc., from a number of basic building blocks, systems can be made up from a range of building blocks. Each building block is considered to have a single property or function. Thus to take a simple example, an electrical circuit system may be made up from building blocks which represent the behaviour of resistors, capacitors and inductors. The resistor building block is assumed to have purely the property of resistance, the capacitor purely that of capacitance and the inductor purely that of inductance. By combining these building blocks in different ways a variety of electrical circuit systems can be built up and the overall input-output relationships obtained for the system by combining in an appropriate way the relationships for the building blocks. Thus a mathematical model

for the system can be obtained. A system built up in this way is called a *lumped parameter* system. This is because each parameter, i.e. property or function, is considered independently.

There are similarities in the behaviour of building blocks used in mechanical, electrical, thermal and fluid systems. This chapter is about the basic building blocks and their combination to produce mathematical models for physical, real, systems. Chapter 9 looks at more complex models.

A more detailed discussion will be found in texts such as *Dynamic Modelling and Control of Engineering Systems* by J. Lowen Shearer and Bohdan T. Kulakowski (Prentice-Hall 1997) or *Modelling and Analysis of Dynamic Systems* by C. Frederick (Houghton Mifflin 1993).

8.2 Mechanical system building blocks

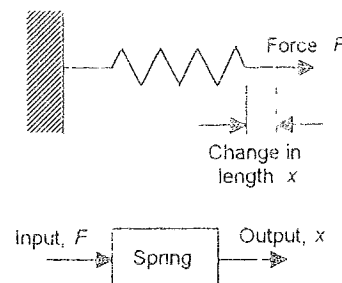


Fig. 8.1 Spring

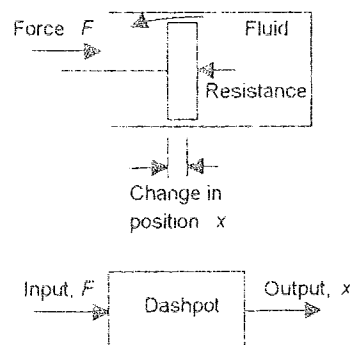


Fig. 8.2 Dashpot

The models used to represent mechanical systems have the basic building blocks of springs, dashpots and masses. *Springs* represent the stiffness of a system, *dashpots* the forces opposing motion, i.e. frictional or damping effects, and *masses* the inertia or resistance to acceleration. The mechanical system does not have to be really made up of springs, dashpots and masses but have the properties of stiffness, damping and inertia. All these building blocks can be considered to have a force as an input and a displacement as an output.

The stiffness of a *spring* is described by the relationship between the forces F used to extend or compress a spring and the resulting extension or compression x (Fig. 8.1). In the case of a spring where the extension or compression is proportional to the applied forces, i.e. a linear spring,

$$F = kx$$

where k is a constant. The bigger the value of k the greater the forces have to be to stretch or compress the spring and so the greater the stiffness. The object applying the force to stretch the spring is also acted on by a force, the force being that exerted by the stretched spring (Newton's third law). This force will be in the opposite direction and equal in size to the force used to stretch the spring, i.e. kx .

The *dashpot* building block represents the types of forces experienced when we endeavour to push an object through a fluid or move an object against frictional forces. The faster the object is pushed the greater becomes the opposing forces. The dashpot which is used pictorially to represent these damping forces which slow down moving objects consists of a piston moving in a closed cylinder (Fig. 8.2). Movement of the piston requires the fluid on one side of the piston to flow through or past the piston. This flow produces a resistive force. In the ideal case, the damping or resistive force F is proportional to the velocity v of the piston.

Thus

$$F = cv$$

where c is a constant. The larger the value of c the greater the damping force at a particular velocity. Since velocity is the rate of change of displacement x of the piston, i.e. $v = dx/dt$, then

$$F = c \frac{dx}{dt}$$

Thus the relationship between the displacement x of the piston, i.e. the output, and the force as the input is a relationship depending on the rate of change of the output.

The mass building block (Fig. 8.3) exhibits the property that the bigger the mass the greater the force required to give it a specific acceleration. The relationship between the force F and the acceleration a is (Newton's second law) $F = ma$, where the constant of proportionality between the force and the acceleration is the constant called the mass m . Acceleration is the rate of change of velocity, i.e. dv/dt , and velocity v is the rate of change of displacement x , i.e. $v = dx/dt$. Thus

$$F = ma = m \frac{dv}{dt} = m \frac{d(dx/dt)}{dt} = m \frac{d^2x}{dt^2}$$

Energy is needed to stretch the spring, accelerate the mass and move the piston in the dashpot. However, in the case of the spring and the mass we can get the energy back but with the dashpot we cannot. The spring when stretched stores energy, the energy being released when the spring springs back to its original length. The energy stored when there is an extension x is $\frac{1}{2}kx^2$. Since $F = kx$ this can be written as

$$E = \frac{1}{2} \frac{F^2}{k}$$

There is also energy stored in the mass when it is moving with a velocity v , the energy being referred to as kinetic energy, and released when it stops moving.

$$E = \frac{1}{2}mv^2$$

However, there is no energy stored in the dashpot. It does not return to its original position when there is no force input. The dashpot dissipates energy rather than storing it, the power P dissipated depending on the velocity v and being given by

$$P = cv^2$$

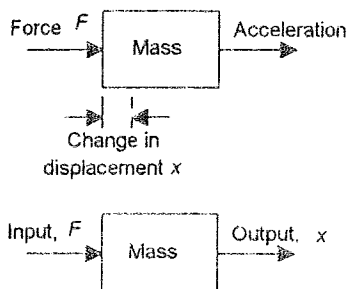


Fig. 8.3 Mass

8.2.1 Rotational systems

The spring, dashpot and mass are the basic building blocks for mechanical systems where forces and straight line displacements are involved without any rotation. If there is rotation then the equivalent three building blocks are a torsional spring, a rotary damper and the moment of inertia, i.e. the inertia of a rotating mass. With such building blocks the inputs are torque and the outputs angle rotated. With a *torsional spring* the angle θ rotated is proportional to the torque T . Hence

$$T = k\theta$$

With the *rotary damper* a disc is rotated in a fluid and the resistive torque T is proportional to the angular velocity ω , and since angular velocity is the rate at which angle changes, i.e. $d\theta/dt$,

$$T = c\omega = c \frac{d\theta}{dt}$$

The *moment of inertia* building block exhibits the property that the greater the moment of inertia I the greater the torque needed to produce an angular acceleration a .

$$T = Ia$$

Thus, since angular acceleration is the rate of change of angular velocity, i.e. $d\omega/dt$, and angular velocity is the rate of change of angular displacement, then

$$T = I \frac{d\omega}{dt} = I \frac{d(d\theta/dt)}{dt} = I \frac{d^2\theta}{dt^2}$$

The torsional spring and the rotating mass store energy; the rotary damper just dissipates energy. The energy stored by a torsional spring when twisted through an angle θ is $\frac{1}{2}k\theta^2$ and since $T = k\theta$ this can be written as

$$E = \frac{1}{2} \frac{T^2}{k}$$

The energy stored by a mass rotating with an angular velocity ω is the kinetic energy E , where

$$E = \frac{1}{2} I \omega^2$$

The power P dissipated by the rotatory damper when rotating with an angular velocity ω is

$$P = c\omega^2$$

Table 8.1 summarises the equations defining the characteristics of the mechanical building blocks when there is, in the case of straight line displacements (termed translational), a force input F and a displacement x output and, in the case of rotation, a torque T and angular displacement θ .

Table 8.1 Mechanical building blocks

Building block	Describing equation	Energy stored or power dissipated
<i>Translational</i>		
Spring	$F = kx$	$E = \frac{1}{2} \frac{F^2}{k}$
Dashpot	$F = c \frac{dx}{dt}$	$P = cv^2$
Mass	$F = m \frac{d^2x}{dt^2}$	$E = \frac{1}{2} mv^2$
<i>Rotational</i>		
Spring	$T = k\theta$	$E = \frac{1}{2} \frac{T^2}{k}$
Rotational damper	$T = c \frac{d\theta}{dt}$	$P = c\omega^2$
Moment of inertia	$T = I \frac{d^2\theta}{dt^2}$	$E = \frac{1}{2} I\omega^2$


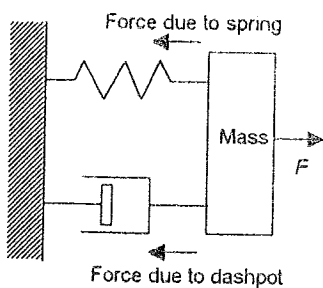


Fig. 8.4 Spring-dashpot-mass system




Fig. 8.5 Free-body diagram

8.2.2 Building up a mechanical system

Many systems can be considered to be essentially a mass, a spring and dashpot combined in the way shown in Figure 8.4. To evaluate the relationship between the force and displacement for the system the procedure to be adopted is to consider just one mass, and just the forces acting on that body. A diagram of the mass and just the forces acting on it is called a *free-body diagram* (Fig. 8.5). When several forces act concurrently on a body, their single equivalent resultant can be found by vector addition. If the forces are all acting along the same line or parallel lines, this means that the resultant or net force acting on the block is the algebraic sum. Thus for the mass in Figure 8.4, if we consider just the forces acting on that block then the net force applied to the mass is the applied force F minus the force resulting from the stretching or compressing of the spring and minus the force from the damper. Thus

$$\text{Net force applied to mass } m = F - kx - cv$$

where v is the velocity with which the piston in the dashpot, and hence the mass, is moving. This net force is the force applied to the mass to cause it to accelerate. Thus

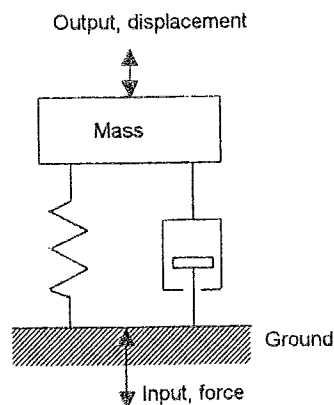


Fig. 8.6 Mathematical model for a machine mounted on the ground

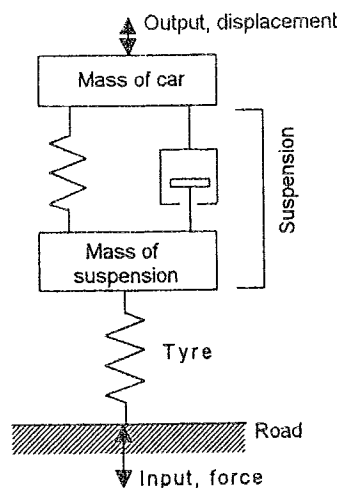


Fig. 8.7 Mathematical model of a wheel of a car moving along a road

Net force applied to mass = ma

Hence

$$F - kx - c \frac{dx}{dt} = m \frac{d^2x}{dt^2}$$

or, when rearranged,

$$m \frac{d^2x}{dt^2} + c \frac{dx}{dt} + kx = F$$

This equation, called a *differential equation*, describes the relationship between the input of force F to the system and the output of displacement x . Because of the d^2x/dt^2 term, it is a *second-order* differential equation; a first-order differential equation would only have dx/dt .

There are many systems which can be built up from suitable combinations of the spring, dashpot and mass building blocks. Figure 8.6 shows the model for a machine mounted on the ground and could be used as a basis for studying the effects of ground disturbances on the displacements of a machine bed. Figure 8.7 shows a model for the wheel and its suspension for a car or truck and can be used for the study of the behaviour that could be expected of the vehicle when driven over a rough road and hence as a basis for the design of the vehicle suspension. The procedure to be adopted for the analysis of such models is just the same as outlined above for the simple spring-dashpot-mass model. A free-body diagram is drawn for each mass in the system, such diagrams showing each mass independently and just the forces acting on it. Then for each mass the resultant of the forces acting on it is then equated to the product of the mass and the acceleration of the mass.

Similar models can be constructed for rotating systems. To evaluate the relationship between the torque and angular displacement for the system the procedure to be adopted is to consider just one rotational mass block, and just the torques acting on that body. When several torques act on a body simultaneously, their single equivalent resultant can be found by addition in which the direction of the torques is taken into account. Thus a system involving a torque being used to rotate a mass on the end of a shaft (Fig. 8.8(a)) can be considered to be represented by the rotational building blocks shown in Figure 8.8(b). This is a comparable situation to that analysed above (Fig. 8.4) for linear displacements and yields a similar equation

$$I \frac{d^2\theta}{dt^2} + c \frac{d\theta}{dt} + k\theta = T$$

Fig. 8.8 Rotating a mass on the end of a shaft: (a) physical situation, (b) building block model

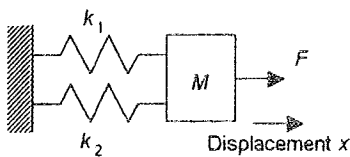
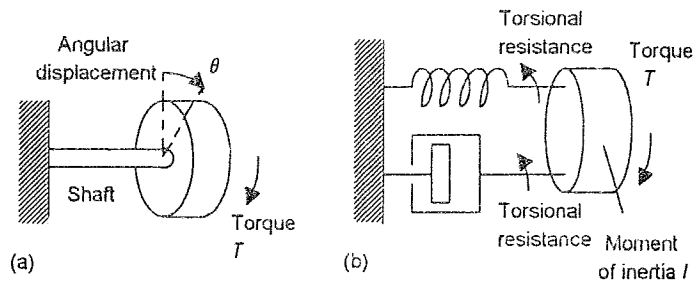


Fig. 8.9 Example 1

To illustrate the above, consider the development of the equations in the following examples.

- 1 Derive the differential equation describing the relationship between the input of the force F and the output of displacement x for the system shown in Figure 8.9.

The net force applied to the mass is F minus the resisting forces exerted by each of the springs. Since these are k_1x and k_2x , then

$$\text{Net force} = F - k_1x - k_2x$$

Since the net force causes the mass to accelerate, then

$$\text{Net force} = m \frac{d^2x}{dt^2}$$

Hence

$$m \frac{d^2x}{dt^2} + (k_1 + k_2)x = F$$

- 2 Derive the differential equation describing the motion of the mass m_1 in Figure 8.10 when a force F is applied.

Consider the free-body diagrams (Fig. 8.11). For mass m_2 these are the force F and the force exerted by the upper spring. The force exerted by the upper spring is due to it being stretched by $(x_2 - x_3)$ and so is $k_2(x_3 - x_2)$. Thus the net force acting on the mass is:

$$\text{Net force} = F - k_2(x_3 - x_2)$$

This force will cause the mass to accelerate and so:

$$F - k_2(x_3 - x_2) = m_2 \frac{d^2x_3}{dt^2}$$

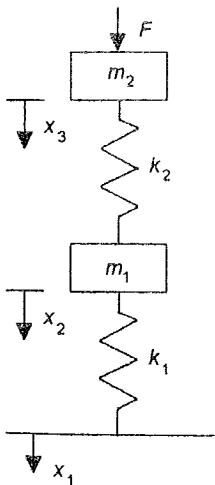


Fig. 8.10 Mass-spring system

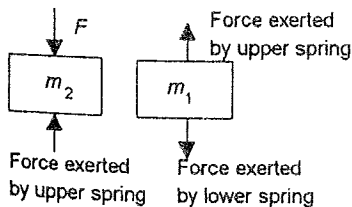


Fig. 8.11 Free-body diagrams

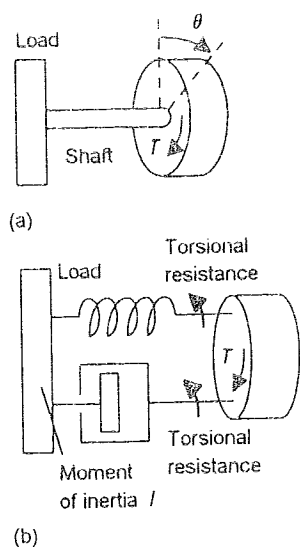


Fig. 8.12 Torsional spring-mass system

8.3 Electrical system building blocks

For the free-body diagram for mass m_1 , the force exerted by the upper spring is $k_2(x_3 - x_2)$ and that by the lower spring is $k_1(x_1 - x_2)$. Thus the net force acting on the mass is:

$$\text{Net force} = k_1(x_2 - x_1) - k_2(x_3 - x_2)$$

This force will cause the mass to accelerate and so:

$$k_1(x_2 - x_1) - k_2(x_3 - x_2) = m_1 \frac{d^2 x_2}{dt^2}$$

We thus have two simultaneous second-order differential equations to describe the behaviours of the system.

- 3 A motor is used to rotate a load. Devise a model and obtain the differential equation for it.

The model used can be that described by Figure 8.12, essentially being the same as that in Figure 8.8. The differential equation is thus, as then:

$$I \frac{d^2 \theta}{dt^2} + c \frac{d\theta}{dt} + k\theta = T$$

The basic building blocks of electrical systems are inductors, capacitors and resistors. For an *inductor* the potential difference v across it at any instant depends on the rate of change of current (di/dt) through it:

$$v = L \frac{di}{dt}$$

where L is the inductance. The direction of the potential difference is in the opposite direction to the potential difference used to drive the current through the inductor, hence the term back e.m.f. The equation can be rearranged to give

$$i = \frac{1}{L} \int v dt$$

For a *capacitor*, the potential difference across it depends on the charge q on the capacitor plates at the instant concerned.

$$v = \frac{q}{C}$$

where C is the capacitance. Since the current i to or from the capacitor is the rate at which charge moves to or from the capacitor plates, i.e. $i = dq/dt$, then the total charge q on the plates is given by

$$q = \int i dt$$

and so

$$v = \frac{1}{C} \int i \, dt$$

Alternatively, since $v = q/C$ then

$$\frac{dv}{dt} = \frac{1}{C} \frac{dq}{dt} = \frac{1}{C} i$$

and so

$$i = C \frac{dv}{dt}$$

For a *resistor*, the potential difference v across it at any instant depends on the current i through it.

$$v = Ri$$

where R is the resistance

Both the inductor and capacitor store energy which can then be released at a later time. A resistor does not store energy but just dissipates it. The energy stored by an inductor when there is a current i is

$$E = \frac{1}{2} Li^2$$

The energy stored by a capacitor when there is a potential difference v across it is

$$E = \frac{1}{2} Cv^2$$

The power P dissipated by a resistor when there is a potential difference v across it is

$$P = iv = \frac{v^2}{R}$$

Table 8.2 summarises the equations defining the characteristics of the electrical building blocks when the input is current and the output is potential difference. Compare them with the equations given in Table 8.1 for the mechanical system building blocks.

8.3.1 Building up a model for an electrical system

The equations describing how the electrical building blocks can be combined are *Kirchhoff's laws*. These can be expressed as:

Table 8.2 Electrical building blocks

Building block	Describing equation	Energy stored or power dissipated
Inductor	$i = \frac{1}{L} \int v \, dt$	$E = \frac{1}{2} Li^2$
Capacitor	$v = C \frac{di}{dt}$	$E = \frac{1}{2} Cv^2$
Resistor	$i = \frac{v}{R}$	$P = \frac{v^2}{R}$

Law 1: the total current flowing towards a junction is equal to the total current flowing from that junction, i.e. the algebraic sum of the currents at the junction is zero.

Law 2: in a closed circuit or loop, the algebraic sum of the potential differences across each part of the circuit is equal to the applied e.m.f.

A convenient way of using law 1 is called *node analysis* since the law is applied to each principal node of a circuit, a node being a point of connection or junction between building blocks or circuit elements and a principal node being one where three or more branches of the circuit meet. A convenient way of using law 2 is called *mesh analysis* since the law is applied to each mesh, a mesh being a closed path or loop which contains no other loop.

To illustrate the use of these two methods of analysis to generate relationships, consider the circuit shown in Figure 8.13. All the components are resistors for this illustrative example. With node analysis a principal node, point A on the figure, is picked and the voltage at the node given a value v_A with reference to some other principal node that has been picked as the reference. In this case it is convenient to pick node B as the reference. We then consider all the currents entering and leaving node A and thus, according to Kirchhoff's first law,

$$i_1 = i_2 + i_3$$

The current entering through R_1 is i_1 and since the potential difference across R_1 is $(v_A - v)$ then $i_1 R_1 = v_A - v$. The current through R_2 is i_2 and since the potential difference across R_2 is v_A then $i_2 R_2 = v_A$. The current i_3 passes through R_3 in series with R_4 and there is a potential difference of v_A across the combination. Hence $i_3(R_3 + R_4) = v_A$. Thus equating the currents gives

$$\frac{v - v_A}{R_1} = \frac{v_A}{R_2} + \frac{v_A}{R_3 + R_4}$$

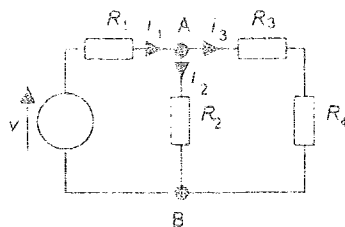


Fig. 8.13 Node analysis

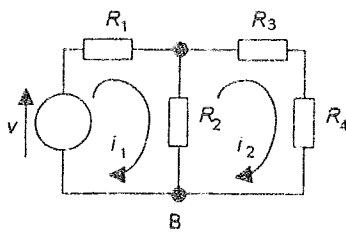


Fig. 8.14 Mesh analysis

To illustrate the use of mesh analysis for the circuit in Figure 8.13 we assume there are currents circulating in each mesh in the way shown in Figure 8.14. Then Kirchhoff's second law is applied to each mesh. Thus for the mesh with current i_1 circulating, since the current through R_1 is i_1 and that through R_2 is $(i_1 - i_2)$, then

$$v = i_1 R_1 + (i_1 - i_2) R_2$$

Similarly for the mesh with current i_2 circulating, since there is no source of e.m.f., then

$$0 = i_2 R_3 + i_2 R_4 + (i_2 - i_1) R_2$$

We thus have two simultaneous equations which can be solved to obtain the two mesh currents and hence the currents through each branch of the circuit. In general, when the number of nodes in a circuit is less than the number of meshes it is easier to employ nodal analysis.

Now consider a simple electrical system consisting of a resistor and capacitor in series, as shown in Figure 8.15. Applying Kirchhoff's second law to the circuit loop gives

$$v = v_R + v_C$$

where v_R is the potential difference across the resistor and v_C that across the capacitor. Since it is just a single loop the current i through all the circuit elements will be the same. If the output from the circuit is the potential difference across the capacitor, v_C , then since $v_R = iR$ and $i = C(dv_C/dt)$,

$$v = RC \frac{dv_C}{dt} + v_C$$

This gives the relationship between the output v_C and the input v and is a first-order differential equation.

Figure 8.16 shows a resistor-inductor-capacitor system. If Kirchhoff's second law is applied to this circuit loop,

$$v = v_R + v_L + v_C$$

where v_R is the potential difference across the resistor, v_L that across the inductor and v_C that across the capacitor. Since there is just a single loop the current i will be the same through all circuit elements. If the output from the circuit is the potential difference across the capacitor, v_C , then since $v_R = iR$ and $v_L = L(di/dt)$

$$v = iR + L \frac{di}{dt} + v_C$$

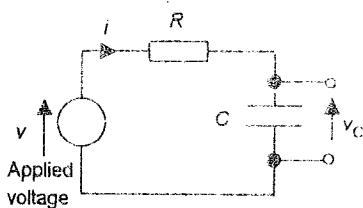


Fig. 8.15 Resistor-capacitor system

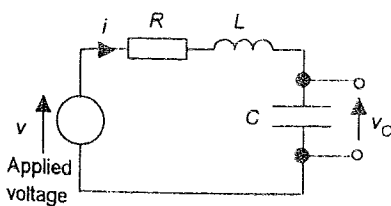


Fig. 8.16 Resistor-inductor-capacitor system

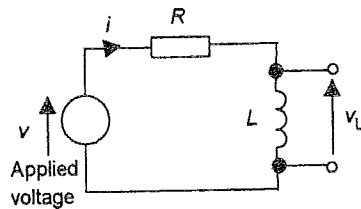


Fig. 8.17 Resistor-inductor system

But $i = C(dv_C/dt)$ and so

$$\frac{di}{dt} = C \frac{d(dv_C/dt)}{dt} = C \frac{d^2v_C}{dt^2}$$

Hence

$$v = RC \frac{dv_C}{dt} + LC \frac{d^2v_C}{dt^2} + v_C$$

This is a second-order differential equation.

To illustrate the above, consider the relationship between the output, the potential difference across the inductor of v_L , and the input v for the circuit shown in Figure 8.17. Applying Kirchhoff's second law to the circuit loop gives

$$v = v_R + v_L$$

where v_R is the potential difference across the resistor R and v_L that across the inductor. Since $v_R = iR$,

$$v = iR + v_L$$

Since

$$i = \frac{1}{L} \int v_L dt$$

then the relationship between the input and output is:

$$v = \frac{R}{L} \int v_L dt + v_L$$

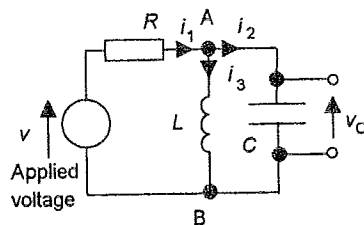


Fig. 8.18 Resistor-capacitor-inductor system

As another example, consider the relationship between the output, the potential difference v_C across the capacitor, and the input v for the circuit shown in Figure 8.18. Using nodal analysis, node B is taken as the reference node and node A taken to be at a potential of v_A relative to B. Applying Kirchhoff's law 1 to node A gives

$$i_1 = i_2 + i_3$$

But

$$i_1 = \frac{v - v_A}{R}$$

$$i_2 = \frac{1}{L} \int v_A dt$$

$$i_3 = C \frac{dv_A}{dt}$$

Hence

$$\frac{v - v_A}{R} = \frac{1}{L} \int v_A dt + C \frac{dv_A}{dt}$$

But $v_C = v_A$. Hence, with some rearrangement,

$$v = RC \frac{dv_C}{dt} + v_C + \frac{R}{L} \int v_C dt$$

The same answer could have been obtained by mesh analysis.

8.3.2 Electrical and mechanical analogies

The building blocks for electrical and mechanical systems have many similarities. For example, the electrical resistor does not store energy but dissipates it with the current i through the resistor being given by $i = v/R$, where R is a constant, and the power P dissipated by $P = v^2/R$. The mechanical analogue of the resistor is the dashpot. It also does not store energy but dissipates it with the force F being related to the velocity v by $F = cv$, where c is a constant, and the power P dissipated by $P = cv^2$. Both these sets of equations have similar forms. Comparing them, and taking the current as being analogous to the force, then the potential difference is analogous to the velocity and the dashpot constant c to the reciprocal of the resistance, i.e. $(1/R)$. These analogies between current and force, potential difference and velocity, hold for the other building blocks with the spring being analogous to inductance and mass to capacitance.

The analogy between current and force is the one most often used. However, another set of analogies can be drawn between potential difference and force.

8.4 Fluid system building blocks




Fig. 8.19 Fluid system block

In fluid flow systems there are three basic building blocks which can be considered to be the equivalent of electrical resistance, capacitance and inductance. For such systems (Fig. 8.19) the input, the equivalent of the electrical current, is the volumetric rate of flow q , and the output, the equivalent of electrical potential difference, is pressure difference $(p_1 - p_2)$. Fluid systems can be considered to fall into two categories: *hydraulic*, where the fluid is a liquid and is deemed to be incompressible; and *pneumatic*, where it is a gas which can be compressed and consequently shows a density change.

Hydraulic resistance is the resistance to flow which occurs as a result of a liquid flowing through valves or changes in a pipe diameter (Fig. 8.20). The relationship between the volume rate of flow of liquid q through the resistance element and the resulting pressure difference $(p_1 - p_2)$ is

$$p_1 - p_2 = Rq$$

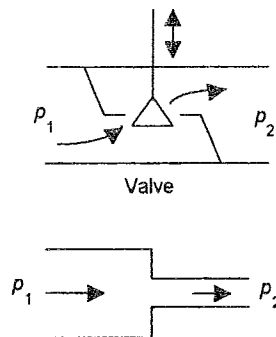


Fig. 8.20 Hydraulic resistance examples

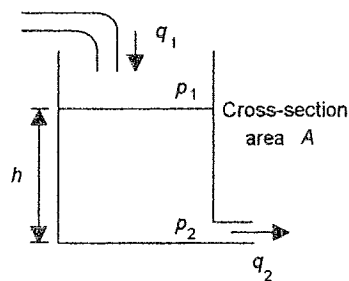


Fig. 8.21 Hydraulic capacitance

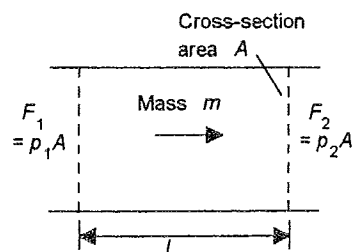


Fig. 8.22 Hydraulic inductance

where R is a constant called the hydraulic resistance. The bigger the resistance the bigger the pressure difference for a given rate of flow. This equation, like that for the electrical resistance and Ohm's law, assumes a linear relationship. Such hydraulic linear resistances occur with orderly flow through capillary tubes and porous plugs but non-linear resistances occur with flow through sharp-edged orifices or if flow is turbulent.

Hydraulic capacitance is the term used to describe energy storage with a liquid where it is stored in the form of potential energy. A height of liquid in a container (Fig. 8.21), i.e. a so-called pressure head, is one form of such a storage. For such a capacitance, the rate of change of volume V in the container, i.e. dV/dt , is equal to the difference between the volumetric rate at which liquid enters the container q_1 and the rate at which it leaves q_2 ,

$$q_1 - q_2 = \frac{dV}{dt}$$

But $V = Ah$, where A is the cross-sectional area of the container and h the height of liquid in it. Hence

$$q_1 - q_2 = \frac{d(Ah)}{dt} = A \frac{dh}{dt}$$

But the pressure difference between the input and output is p , where $p = h\rho g$ with ρ being the liquid density and g the acceleration due to gravity. Thus, if the liquid is assumed to be incompressible, i.e. its density does not change with pressure,

$$q_1 - q_2 = A \frac{d(\rho h)}{dt} = \frac{A}{\rho g} \frac{dp}{dt}$$

The hydraulic capacitance C is defined as being

$$C = \frac{A}{\rho g}$$

Thus

$$q_1 - q_2 = C \frac{dp}{dt}$$

Integration of this equation gives

$$p = \frac{1}{C} \int (q_1 - q_2) dt$$

Hydraulic inductance is the equivalent of inductance in electrical systems or a spring in mechanical systems. To accelerate a fluid and so increase its velocity a force is required. Consider a block of liquid of mass m (Fig. 8.22). The net force acting on the liquid is

$$F_1 - F_2 = p_1 A - p_2 A = (p_1 - p_2)A$$

where $(p_1 - p_2)$ is the pressure difference and A the cross-sectional area. This net force causes the mass to accelerate with an acceleration a , and so

$$(p_1 - p_2)A = ma$$

But a is the rate of change of velocity dv/dt , hence

$$(p_1 - p_2)A = m \frac{dv}{dt}$$

But the mass of liquid concerned has a volume of AL , where L is the length of the block of liquid or the distance between the points in the liquid where the pressures p_1 and p_2 are measured. If the liquid has a density ρ then $m = AL\rho$ and so

$$(p_1 - p_2)A = AL\rho \frac{dv}{dt}$$

But the volume rate of flow $q = Av$, hence

$$(p_1 - p_2)A = L\rho \frac{dq}{dt}$$

$$p_1 - p_2 = I \frac{dq}{dt}$$

where the hydraulic inertance I is defined as

$$I = \frac{L\rho}{A}$$

With *pneumatic systems* the three basic building blocks are, as with hydraulic systems, resistance, capacitance and inertance. However, gases differ from liquids in being compressible, i.e. a change in pressure causes a change in volume and hence density. *Pneumatic resistance* R is defined in terms of the mass rate of flow dm/dt (note that this is often written as an \dot{m} with a dot above it to indicate that the symbol refers to the mass rate of flow and not just the mass) and the pressure difference $(p_1 - p_2)$ as

$$p_1 - p_2 = R \frac{dm}{dt} = R\dot{m}$$

Pneumatic capacitance C is due to the compressibility of the gas, and is comparable to the way in which the compression of a spring stores energy. If there is a mass rate of flow dm_1/dt entering a container of volume V and a mass rate of flow of dm_2/dt leaving it, then the rate at which the mass in the container is changing is $(dm_1/dt - dm_2/dt)$. If the gas in the container has a density ρ then the rate of change of mass in the container is

$$\text{Rate of change of mass in container} = \frac{d(\rho V)}{dt}$$

But, because a gas can be compressed, both ρ and V can vary with time. Hence

$$\text{Rate of change of mass in container} = \rho \frac{dV}{dt} + V \frac{d\rho}{dt}$$

Since $(dV/dt) = (dV/dp)(dp/dt)$ and, for an ideal gas, $pV = mRT$ with consequently $p = (m/V)RT = \rho RT$ and $d\rho/dt = (1/RT)(dp/dt)$, then

$$\text{Rate of change of mass in container} = \rho \frac{dV}{dp} \frac{dp}{dt} + \frac{V}{RT} \frac{dp}{dt}$$

where R is the gas constant and T the temperature, assumed to be constant, on the Kelvin scale. Thus

$$\frac{dm_1}{dt} - \frac{dm_2}{dt} = \left(\rho \frac{dV}{dp} + \frac{V}{RT} \right) \frac{dp}{dt}$$

The pneumatic capacitance due to the change in volume of the container C_1 is defined as

$$C_1 = \rho \frac{dV}{dp}$$

and the pneumatic capacitance due to the compressibility of the gas C_2 as

$$C_2 = \frac{V}{RT}$$

Hence

$$\frac{dm_1}{dt} - \frac{dm_2}{dt} = (C_1 + C_2) \frac{dp}{dt}$$

or

$$p_1 - p_2 = \frac{1}{C_1 + C_2} \int (\dot{m}_1 - \dot{m}_2) dt$$

Pneumatic inertance is due to the pressure drop necessary to accelerate a block of gas. According to Newton's second law the net force is $ma = d(mv)/dt$. Since the force is provided by the pressure difference $(p_1 - p_2)$, then if A is the cross-sectional area of the block of gas being accelerated

$$(p_1 - p_2)A = \frac{d(mv)}{dt}$$

But m , the mass of the gas being accelerated, is ρLA with ρ being the gas density and L the length of the block of gas being accelerated. But the volume rate of flow $q = Av$, where v is the velocity. Thus

$$mv = \rho LA \frac{q}{A} = \rho Lq$$

and so

$$(p_1 - p_2)A = L \frac{d(\rho q)}{dt}$$

But $\dot{m} = \rho q$ and so

$$p_1 - p_2 = \frac{L}{A} \frac{d\dot{m}}{dt}$$

$$p_1 - p_2 = I \frac{d\dot{m}}{dt}$$

with the pneumatic inertance I being

$$I = \frac{L}{A}$$

Table 8.3 shows the basic characteristics of the fluid building blocks, both hydraulic and pneumatic.

Table 8.3 Hydraulic and pneumatic building blocks

Building block	Describing equation	Energy stored or power dissipated
<i>Hydraulic</i>		
Inertance	$q = \frac{1}{L} \int (p_1 - p_2) dt$	$E = \frac{1}{2} I q^2$
Capacitance	$q = C \frac{d(p_1 - p_2)}{dt}$	$E = \frac{1}{2} C (p_1 - p_2)^2$
Resistance	$q = \frac{p_1 - p_2}{R}$	$P = \frac{1}{R} (p_1 - p_2)^2$
<i>Pneumatic</i>		
Inertance	$\dot{m} = \frac{1}{L} \int (p_1 - p_2) dt$	$E = \frac{1}{2} I \dot{m}^2$
Capacitance	$\dot{m} = C \frac{d(p_1 - p_2)}{dt}$	$E = \frac{1}{2} C (p_1 - p_2)^2$
Resistance	$\dot{m} = \frac{p_1 - p_2}{R}$	$P = \frac{1}{R} (p_1 - p_2)^2$

For hydraulics the volumetric rate of flow and for pneumatics the mass rate of flow are analogous to the electrical current in an electric system. For both hydraulics and pneumatics the pressure difference is analogous to the potential difference in electrical

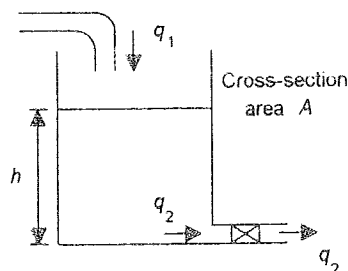


Fig. 8.23 A fluid system

systems. Compare Table 8.3 with Table 8.2. Hydraulic and pneumatic inertia and capacitance are both energy storage elements; hydraulic and pneumatic resistance are both energy dissipaters.

8.4.1 Building up a model for a fluid system

Figure 8.23 shows a simple hydraulic system, a liquid entering and leaving a container. Such a system can be considered to consist of a capacitor, the liquid in the container, with a resistor, the valve. Inertia can be neglected since flow rates change only very slowly. For the capacitor we can write

$$q_1 - q_2 = C \frac{dp}{dt}$$

The rate at which liquid leaves the container q_2 equals the rate at which it leaves the valve. Thus for the resistor

$$p_1 - p_2 = Rq_2$$

The pressure difference ($p_1 - p_2$) is the pressure due to the height of liquid in the container and is thus $h\rho g$. Thus $q_2 = h\rho g/R$ and so substituting for q_2 in the first equation gives

$$q_1 - \frac{h\rho g}{R} = C \frac{d(h\rho g)}{dt}$$

and, since $C = A/\rho g$,

$$q_1 = A \frac{dh}{dt} + \frac{\rho gh}{R}$$

This equation describes how the height of liquid in the container depends on the rate of input of liquid into the container.

A bellows is an example of a simple pneumatic system (Fig. 8.24). Resistance is provided by a constriction which restricts the rate of flow of gas into the bellows and capacitance is provided by the bellows itself. Inertia can be neglected since the flow rate changes only slowly.

The mass flow rate into the bellows is given by

$$p_1 - p_2 = R\dot{m}$$

where p_1 is the pressure prior to the constriction and p_2 the pressure after the constriction, i.e. the pressure in the bellows. All the gas that flows into the bellows remains in the bellows, there being no exit from the bellows. The capacitance of the bellows is given by

$$\dot{m}_1 - \dot{m}_2 = (C_1 + C_2) \frac{dp_2}{dt}$$

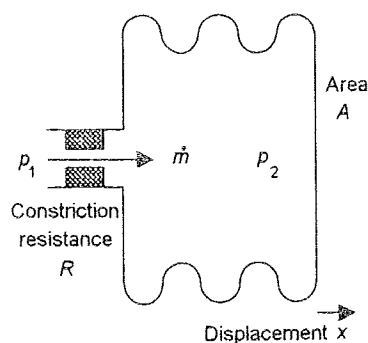


Fig. 8.24 A pneumatic system

The mass flow rate entering the bellows is given by the equation for the resistance and the mass leaving the bellows is zero. Thus

$$\frac{p_1 - p_2}{R} = (C_1 + C_2) \frac{dp_2}{dt}$$

Hence

$$p_1 = R(C_1 + C_2) \frac{dp_2}{dt} + p_2$$

This equation describes how the pressure in the bellows p_2 varies with time when there is an input of a pressure p_1 .

The bellows expands or contracts as a result of pressure changes inside it. Bellows are just a form of spring and so we can write $F = kx$ for the relationship between the force F causing an expansion or contraction and the resulting displacement x , where k is the spring constant for the bellows. But the force F depends on the pressure p_2 , with $p_2 = F/A$ where A is the cross-sectional area of the bellows. Thus $p_2 A = F = kx$. Hence substituting for p_2 in the above equation gives

$$p_1 = R(C_1 + C_2) \frac{k}{A} \frac{dx}{dt} + \frac{k}{A} x$$

This equation, a first-order differential equation, describes how the extension or contraction x of the bellows changes with time when there is an input of a pressure p_1 . The pneumatic capacitance due to the change in volume of the container C_1 is $\rho dV/dp_2$ and since $V = Ax$, C_1 is $\rho A dx/dp_2$. But for the bellows $p_2 A = kx$, thus

$$C_1 = \rho A \frac{dx}{d(kx/A)} = \frac{\rho A^2}{k}$$

C_2 , the pneumatic capacitance due to the compressibility of the air, is $V/RT = Ax/RT$.

The following illustrates how, for the hydraulic system shown in Figure 8.25, relationships can be derived which describe how the heights of the liquids in the two containers will change with time. With this model inertance is neglected.

Container 1 is a capacitor and thus

$$q_1 - q_2 = C_1 \frac{dp}{dt}$$

where $p = h_1 \rho g$ and $C_1 = A_1 / \rho g$ and so

$$q_1 - q_2 = A_1 \frac{dh_1}{dt}$$

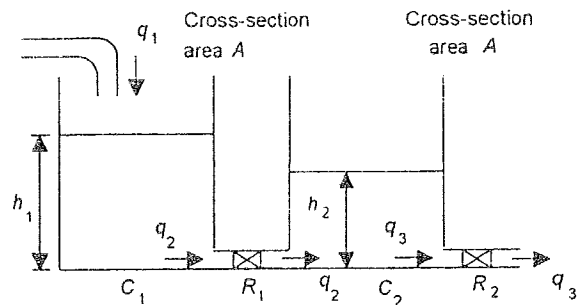


Fig. 8.25 A fluid system

The rate at which liquid leaves the container q_2 equals the rate at which it leaves the valve R_1 . Thus for the resistor,

$$p_1 - p_2 = R_1 q_2$$

The pressures are $h_1 \rho g$ and $h_2 \rho g$. Thus

$$(h_1 - h_2) \rho g = R_1 q_2$$

Using the value of q_2 given by this equation and substituting it into the earlier equation gives

$$q_1 - \frac{(h_1 - h_2) \rho g}{R_1} = A_1 \frac{dh_1}{dt}$$

This equation describes how the height of the liquid in container 1 depends on the input rate of flow.

For container 2 a similar set of equations can be derived. Thus for the capacitor C_2

$$q_2 - q_3 = C_2 \frac{dp}{dt}$$

where $p = h_2 \rho g$ and $C_2 = A_2 / \rho g$ and so

$$q_2 - q_3 = A_2 \frac{dh_2}{dt}$$

The rate at which liquid leaves the container q_3 equals the rate at which it leaves the valve R_2 . Thus for the resistor,

$$p_2 - 0 = R_2 q_3$$

This assumes that the liquid exits into the atmosphere. Thus, using the value of q_3 given by this equation and substituting it into the earlier equation gives

$$q_2 - \frac{h_2 \rho g}{R_2} = A_2 \frac{dh_2}{dt}$$

Substituting for q_2 in this equation using the value given by the equation derived for the first container gives

$$\frac{(h_1 - h_2) \rho g}{R_1} - \frac{h_2 \rho g}{R_2} = A_2 \frac{dh_2}{dt}$$

This equation describes how the height of liquid in container 2 changes.

8.5 Thermal system building blocks

There are only two basic building blocks for thermal systems: resistance and capacitance. There is a net flow of heat between two points if there is a temperature difference between them. The electrical equivalent of this is that there is only a net current i between two points if there is a potential difference v between them, the relationship between the current and potential difference being $i = v/R$, where R is the electrical resistance between the points. A similar relationship can be used to define *thermal resistance* R . If q is the rate of flow of heat and $(T_1 - T_2)$ the temperature difference, then

$$q = \frac{T_2 - T_1}{R}$$

The value of the resistance depends on the mode of heat transfer. In the case of conduction through a solid, for unidirectional conduction

$$q = Ak \frac{T_1 - T_2}{L}$$

where A is the cross-sectional area of the material through which the heat is being conducted and L the length of material between the points at which the temperatures are T_1 and T_2 . k is the thermal conductivity. Hence, with this mode of heat transfer,

$$R = \frac{L}{Ak}$$

When the mode of heat transfer is convection, as with liquids and gases, then

$$q = Ah(T_2 - T_1)$$

where A is the surface area across which there is the temperature difference and h is the coefficient of heat transfer. Thus, with this mode of heat transfer,

$$R = \frac{1}{Ah}$$

Thermal capacitance is a measure of the store of internal energy in a system. Thus, if the rate of flow of heat into a system is q_1 and the rate of flow out is q_2 , then

$$\text{Rate of change of internal energy} = q_1 - q_2$$

An increase in internal energy means an increase in temperature. Since

$$\text{Internal energy change} = mc \times \text{change in temperature}$$

where m is the mass and c the specific heat capacity, then

$$\text{Rate of change of internal energy} = mc \times \text{rate of change of temperature}$$

Thus

$$q_1 - q_2 = mc \frac{dT}{dt}$$

where dT/dt is the rate of change of temperature. This equation can be written as

$$q_1 - q_2 = C \frac{dT}{dt}$$

where C is the thermal capacitance and so $C = mc$. Table 8.4 gives a summary of the thermal building blocks

Table 8.4 Thermal building blocks

Building block	Describing equation	Energy stored
Capacitance	$q_1 - q_2 = C \frac{dT}{dt}$	$E = CT$
Resistance	$q = \frac{T_1 - T_2}{R}$	




Fig. 8.26 A thermal system

8.5.1 Building up a model for a thermal system

Consider a thermometer at temperature T which has just been inserted into a liquid at temperature T_L (Fig. 8.26). If the thermal resistance to heat flow from the liquid to the thermometer is R then,

$$q = \frac{T_L - T}{R}$$

where q is the net rate of heat flow from liquid to thermometer. The thermal capacitance C of the thermometer is given by the equation

$$q_1 - q_2 = C \frac{dT}{dt}$$

Since there is only a net flow of heat from the liquid to the thermometer, $q_1 = q$ and $q_2 = 0$. Thus

$$q = C \frac{dT}{dt}$$

Substituting this value of q in the earlier equation gives

$$C \frac{dT}{dt} = \frac{T_L - T}{R}$$

Rearranging this equation gives

$$RC \frac{dT}{dt} + T = T_L$$

This equation, a first-order differential equation, describes how the temperature indicated by the thermometer T will vary with time when the thermometer is inserted into a hot liquid.

In the above thermal system the parameters have been considered to be lumped. This means, for example, that there has been assumed to be just one temperature for the thermometer and just one for the liquid, i.e. the temperatures are only functions of time and not position within a body.

To illustrate the above consider Figure 8.27 which shows a thermal system consisting of an electric fire in a room. The fire emits heat at the rate q_1 and the room loses heat at the rate q_2 . Assuming that the air in the room is at a uniform temperature T and that there is no heat storage in the walls of the room, derive an equation describing how the room temperature will change with time.

If the air in the room has a thermal capacity C then

$$q_1 - q_2 = C \frac{dT}{dt}$$

If the temperature inside the room is T and that outside the room T_0 then

$$q_2 = \frac{T - T_0}{R}$$

where R is the resistivity of the walls. Substituting for q_2 gives

$$q_1 - \frac{T - T_0}{R} = C \frac{dT}{dt}$$

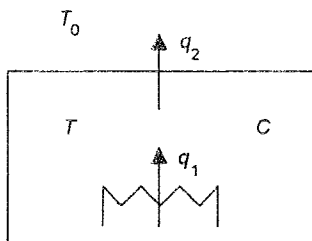


Fig. 8.27 Thermal system

Hence

$$RC \frac{dT}{dt} + T = Rq_1 + T_0$$

Problems

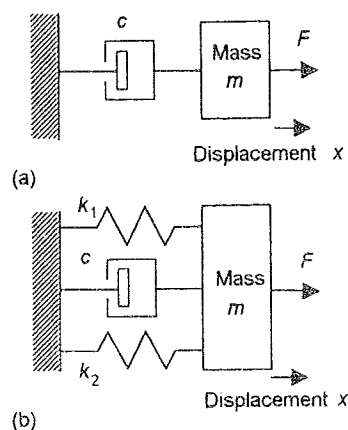


Fig. 8.28 Problem 1

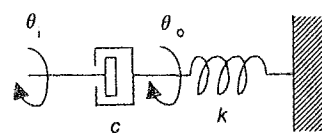


Fig. 8.29 Problem 3

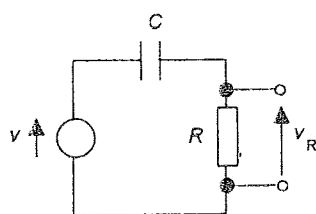


Fig. 8.30 Problem 5

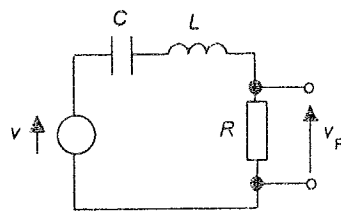


Fig. 8.31 Problem 6

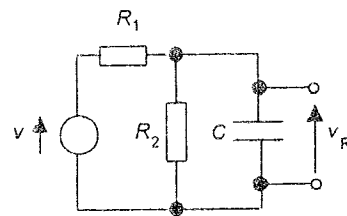


Fig. 8.32 Problem 7

- 1 Derive an equation relating the input, force F , with the output, displacement x , for the systems described by Figure 8.28.
- 2 Propose a model for the metal wheel of a railway carriage running on a metal track.
- 3 Derive an equation relating the input angular displacement θ_i with the output angular displacement θ_o for the rotational system shown in Figure 8.29.
- 4 Propose a model for a stepped shaft (i.e. a shaft where there is a step change in diameter) used to rotate a mass and derive an equation relating the input torque and the angular rotation. You may neglect damping.
- 5 Derive the relationship between the output, the potential difference across the resistor R of v_R , and the input v for the circuit shown in Figure 8.30 which has a resistor in series with a capacitor.
- 6 Derive the relationship between the output, the potential difference across the resistor R of v_R , and the input v for the series LCR circuit shown in Figure 8.31.
- 7 Derive the relationship between the output, the potential difference across the capacitor C of v_C , and the input v for the circuit shown in Figure 8.32.
- 8 Derive the relationship between the height h_2 and time for the hydraulic system shown in Figure 8.33. Neglect inertia.
- 9 A hot object, capacitance C and temperature T , cools in a large room at temperature T_r . If the thermal system has a resistance R derive an equation describing how the temperature of the hot object changes with time and give an electrical analogue of the system.

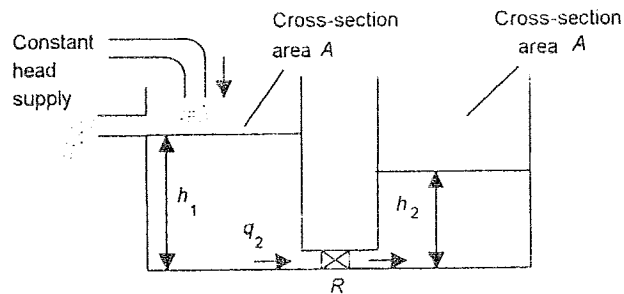


Fig. 8.33 Problem 8

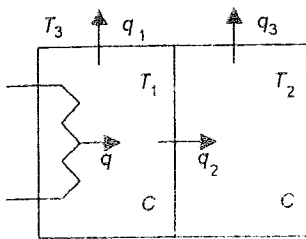


Fig. 8.34 Problem 10

- 10 Figure 8.34 shows a thermal system involving two compartments, with one containing a heater. If the temperature of the compartment containing the heater is T_1 , the temperature of the other compartment T_2 and the temperature surrounding the compartments T_3 , develop equations describing how the temperatures T_1 and T_2 will vary with time. All the walls of the containers have the same resistance and negligible capacity. The two containers have the same capacity C .
- 11 Derive the differential equation relating the pressure input p to a diaphragm actuator (as in Fig. 5.22) to the displacement x of the stem.
- 12 Derive the differential equation for a motor driving a load through a gear system (Fig. 8.35) which relates the angular displacement of the load with time.

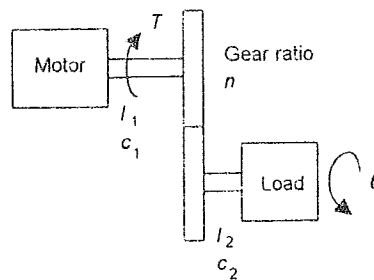


Fig. 8.35 Problem 12

9 System models

9.1 Engineering systems

In Chapter 8 the basic building blocks of translational mechanical, rotational mechanical, electrical, fluid and thermal systems were separately considered. However, many systems encountered in engineering involve aspects of more than one of these disciplines. For example, an electric motor involves both electrical and mechanical elements. This chapter looks at how single-discipline building blocks can be combined to give models for such multi-discipline systems.

In combining blocks we are assuming that the relationship for each block is linear. The following is a discussion of linearity and how, because many real engineering items are non-linear, we can make a linear approximation for a non-linear item.

9.1.1 Linearity

The relationship between the force F and the extension x produced for an ideal spring is linear, being given by $F = kx$. This means that if force F_1 produces an extension x_1 and force F_2 produces an extension x_2 , a force equal to $(F_1 + F_2)$ will produce an extension $(x_1 + x_2)$. This is called the *principle of superposition* and is a necessary condition for a system that can be termed a *linear system*. Another condition for a linear system is that if an input F_1 produces an extension x_1 , then an input cF_1 will produce an output cx_1 , where c is a constant multiplier. A graph of the force F plotted against the extension x is a straight line passing through the origin when the relationship is linear (Fig. 9.1(a)).

Real springs, like any other real components, are not perfectly linear (Fig. 9.1(b)). However, there is often a range of operation for which linearity can be assumed. Thus for the spring giving the graph in Fig. 9.1(b), linearity can be assumed provided the spring is only used over the central part of its graph. For many system components, linearity can be assumed for operations within a range of values of the variable about some operating point.

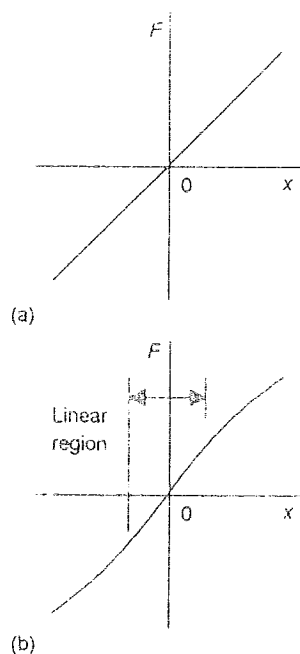


Fig. 9.1 Springs (a) ideal.
(b) real

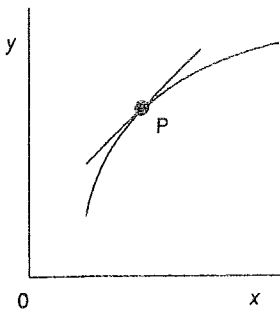


Fig. 9.2 A non-linear relationship

For some system components (Fig. 9.2) the relationship is non-linear. For such components the best that can be done to obtain a linear relationship is to just work with the straight line which is the slope of the graph at the operating point. Thus for the relationship between y and x in Figure 9.2, at the operating point P where the slope has the value m

$$\Delta y = m \Delta x$$

where Δy and Δx are small changes in input and output signals at the operating point.

Thus, for example, the rate of flow of liquid q through an orifice is given by

$$q = c_d A \sqrt{\frac{2(p_1 - p_2)}{\rho}}$$

where c_d is a constant called the discharge coefficient, A the cross-sectional area of the orifice, ρ the fluid density and $(p_1 - p_2)$ the pressure difference. For a constant cross-sectional area and density the equation can be written as

$$q = C \sqrt{p_1 - p_2}$$

where C is a constant. This is a non-linear relationship between the rate of flow and the pressure difference. We can obtain a linear relationship by considering the straight line representing the slope of the rate of flow/pressure difference graph (Fig. 9.3) at the operating point. The slope m is $dq/d(p_1 - p_2)$ and has the value

$$m = \frac{dq}{d(p_1 - p_2)} = \frac{C}{2\sqrt{p_{o1} - p_{o2}}}$$

where $(p_{o1} - p_{o2})$ is the value at the operating point. For small changes about the operating point we will assume that we can replace the non-linear graph by the straight line of slope m and therefore can write $m = \Delta q / \Delta(p_1 - p_2)$ and hence

$$\Delta q = m \Delta(p_1 - p_2)$$

Hence, if we had $C = 2 \text{ m}^3/\text{s per kPa}$, i.e. $q = 2(p_1 - p_2)$, then for an operating point of $(p_1 - p_2) = 4 \text{ kPa}$ with $m = 2/(2\sqrt{4}) = 0.5$, the linearised version of the equation would be

$$\Delta q = 0.5 \Delta(p_1 - p_2)$$

In the above discussion it was assumed that the flow was through an orifice of constant cross-sectional area. If the orifice is

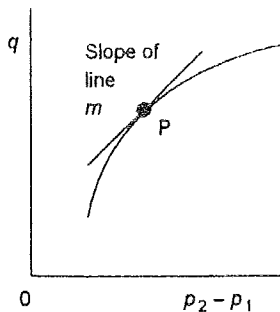


Fig. 9.3 Flow through an orifice

a flow control valve then this is not the case, the cross-sectional area being adjusted to vary the flow rate. In such a situation,

$$q = CA \sqrt{p_1 - p_2}$$

Since both A and $(p_1 - p_2)$ can change, then we have to obtain the linearised equation when either or both these variables can change. Because of the principle of superposition we can consider each of these variables changing independently and then add the two results to obtain the equation for when both change. Thus for changes about the operating point the slopes of a graph of q against A would be

$$m_1 = \frac{dq}{dA} = C \sqrt{p_{o1} - p_{o2}}$$

and thus $\Delta q = m_1 \Delta A$. The subscript o is used to indicate values at the operating point. For a graph of q against $(p_1 - p_2)$

$$m_2 = \frac{dq}{d(p_1 - p_2)} = \frac{CA_o}{2 \sqrt{p_{o1} - p_{o2}}}$$

and thus $\Delta q = m_2 \Delta(p_1 - p_2)$. The linearised version when both variables can change is thus

$$\Delta q = m_1 \Delta A + m_2 \Delta(p_1 - p_2)$$

with m_1 and m_2 having the values indicated above.

Linearised mathematical models are used because most of the techniques of control systems are based on there being linear relationships for the elements of such systems. Also, because most control systems are maintaining an output equal to some reference value, the variations from this value tend to be rather small and so the linearised model is perfectly appropriate.

To illustrate the above, consider a thermistor being used for temperature measurement in a control system. The relationship between the resistance R of the thermistor and its temperature T is given by

$$R = k e^{-cT}$$

We can linearise this equation about an operating point of T_o . The slope m of a graph of R against T at the operating point T_o is given by dR/dT . Thus

$$m = \frac{dR}{dT} = -kc e^{-cT_o}$$

Hence

9.2 Rotational-translational systems

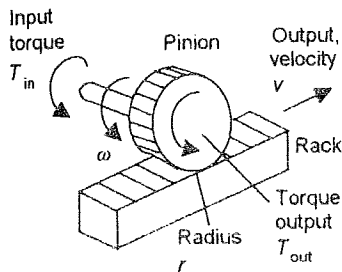


Fig. 9.4 Rack-and-pinion

There are many mechanisms which involve the conversion of rotational motion to translational motion or vice versa. For example, there are rack-and-pinion, shafts with lead screws, pulley and cable systems, etc.

To illustrate how such systems can be analysed, consider a rack-and-pinion system (Fig. 9.4). The rotational motion of the pinion is transformed into translational motion of the rack. Consider first the pinion element. The net torque acting on it is $(T_{in} - T_{out})$. Thus, considering the moment of inertia element, and assuming negligible damping,

$$T_{in} - T_{out} = I \frac{d\omega}{dt}$$

where I is the moment of inertia of the pinion and ω its angular velocity. The rotation of the pinion will result in a translational velocity v of the rack. If the pinion has a radius r , then $v = r\omega$. Hence we can write

$$T_{in} - T_{out} = \frac{I}{r} \frac{dv}{dt}$$

Now consider the rack element. There will be a force of T/r acting on it due to the movement of the pinion. If there is a frictional force of cv then the net force is

$$\frac{T_{out}}{r} - cv = m \frac{dv}{dt}$$

Eliminating T_{out} from the two equations gives

$$T_{in} - rcv = \left(\frac{I}{r} + mr \right) \frac{dv}{dt}$$

and so

$$\frac{dv}{dt} = \left(\frac{r}{I + mr^2} \right) (T_{in} - rcv)$$

The result is a first-order differential equation describing how the output is related to the input.

9.3 Electromechanical systems

Electromechanical devices, such as potentiometers, motors and generators, transform electrical signals to rotational motion or vice versa. This section is a discussion of how we can derive models for such systems. A potentiometer has an input of a rotation and an output of a potential difference. An electric motor has an input of a potential difference and an output of rotation of

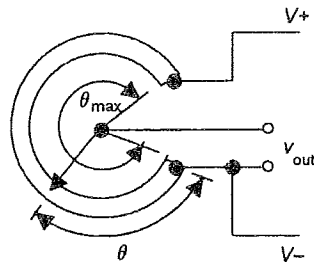


Fig. 9.5 Rotary potentiometer

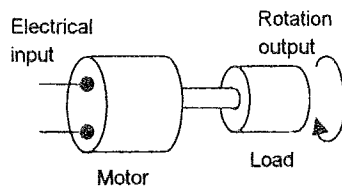


Fig. 9.6 Motor driving a load

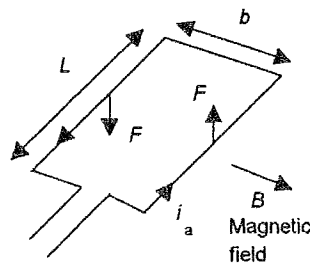


Fig. 9.7 One wire of armature coil

a shaft. A generator has an input of rotation of a shaft and an output of a potential difference.

9.3.1 Potentiometer

The *rotary potentiometer* (Fig. 9.5) is a potential divider and thus:

$$\frac{v_o}{V} = \frac{\theta}{\theta_{\max}}$$

where V is the potential difference across the full length of the potentiometer track and θ_{\max} is the total angle swept out by the slider in being rotated from one end of the track to the other. The output is v_o for the input θ .

9.3.2 D.C. motor

The d.c. motor is used to convert an electrical input signal into a mechanical output signal, a current through the armature coil of the motor resulting in a shaft being rotated and hence the load rotated (Fig. 9.6). The motor basically consists of a coil, the armature coil, which is free to rotate. This coil is located in the magnetic field provided by a current through field coils or a permanent magnet. When a current i_a flows through the armature coil then, because it is in a magnetic field, forces act on the coil and cause it to rotate (Fig. 9.7). The force F acting on a wire carrying a current i_a and of length L in a magnetic field of flux density B at right angles to the wire is given by $F = Bi_aL$ and with N wires is $F = Nbi_aL$. The forces on the armature coil wires result in a torque T , where $T = Fb$, with b being the breadth of the coil. Thus

$$T = NBi_aLb$$

The resulting torque is thus proportional to (Bi_a) , the other factors all being constants. Hence we can write

$$T = k_1 Bi_a$$

Since the armature is a coil rotating in a magnetic field, a voltage will be induced in it as a consequence of electromagnetic induction. This voltage will be in such a direction as to oppose the change producing it and is called the back e.m.f. This back e.m.f. v_b is proportional to the rate or rotation of the armature and the flux linked by the coil, hence the flux density B . Thus

$$v_b = k_2 B\omega$$

where ω is the shaft angular velocity and k_2 a constant.

Consider a d.c. motor which has the armature and field coils separately excited (see Fig. 7.22(d) and associated discussion). With a so-called *armature-controlled motor* the field current i_f is held constant and the motor controlled by adjusting the armature voltage v_a . A constant field current means a constant magnetic flux density B for the armature coil. Thus

$$v_b = k_2 B \omega = k_3 \omega$$

where k_3 is a constant. The armature circuit can be considered to be a resistance R_a in series with an inductance L_a (Fig. 9.8). If v_a is the voltage applied to the armature circuit then, since there is a back e.m.f. of v_b , we have

$$v_a - v_b = L_a \frac{di_a}{dt} + R_a i_a$$

We can think of this equation in terms of the block diagram shown in Fig. 9.9(a).

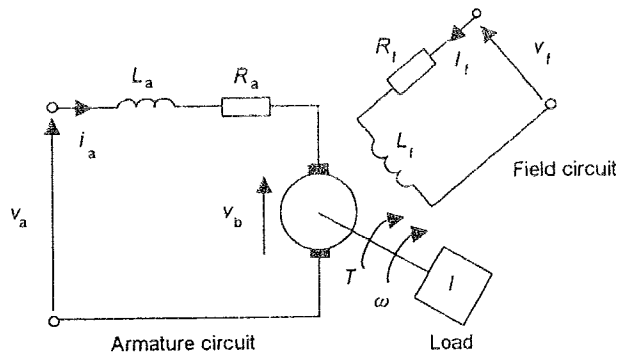


Fig. 9.8 D.C. motor circuits

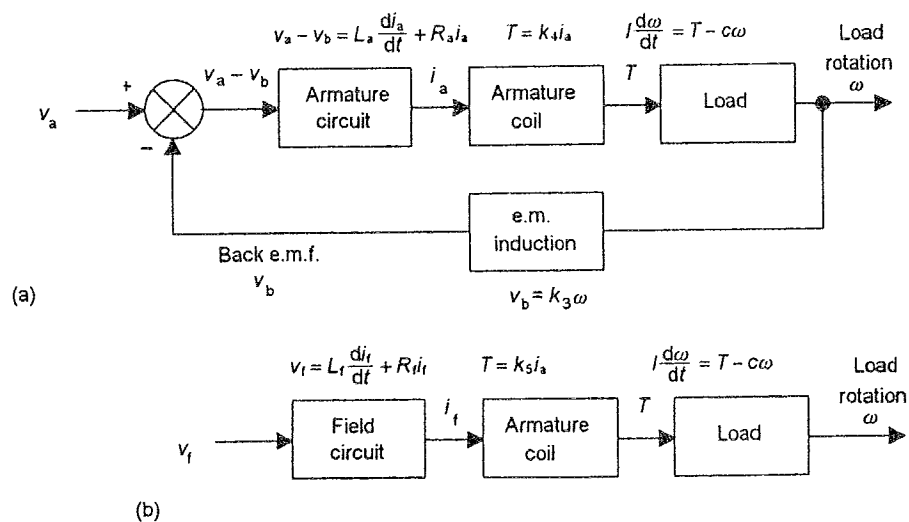


Fig. 9.9 D.C. motors:
(a) armature-controlled,
(b) field-controlled

The input to the motor part of the system is v_a and this is summed with the feedback signal of the back e.m.f. v_b to give an error signal which is the input to the armature circuit. The above equation thus describes the relationship between the input of the error signal to the armature coil and the output of the armature current i_a . Substituting for v_b :

$$v_a - k_3\omega = L_a \frac{di_a}{dt} + R_a i_a$$

The current i_a in the armature generates a torque T . Since, for the armature-controlled motor, B is constant we have

$$T = k_1 B i_a = k_4 i_a$$

where k_4 is a constant. This torque then becomes the input to the load system. The net torque acting on the load will be

$$\text{Net torque} = T - \text{damping torque}$$

The damping torque is $c\omega$, where c is a constant. Hence, if any effects due to the torsional springiness of the shaft are neglected,

$$\text{Net torque} = k_4 i_a - c\omega$$

This will cause an angular acceleration of $d\omega/dt$, hence

$$I \frac{d\omega}{dt} = k_4 i_a - c\omega$$

We thus have two equations that describe the conditions occurring for an armature-controlled motor, namely

$$v_a - k_3\omega = L_a \frac{di_a}{dt} + R_a i_a \quad \text{and} \quad I \frac{d\omega}{dt} = k_4 i_a - c\omega$$

We can thus obtain the equation relating the output ω with the input v_a to the system by eliminating i_a . See the brief discussion of the Laplace transform in Chapter 10, or that in Appendix A, for details of how this might be done.

With a so-called *field-controlled motor* the armature current is held constant and the motor controlled by varying the field voltage. For the field circuit (Fig. 9.8) there is essentially just inductance L_f in series with a resistance R_f . Thus for that circuit

$$v_f = R_f i_f + L_f \frac{di_f}{dt}$$

We can think of the field-controlled motor in terms of the block diagram shown in Fig. 9.9(b). The input to the system is v_f . The field circuit converts this into a current i_f , the relationship between v_f and i_f being the above equation. This current leads to

the production of a magnetic field and hence a torque acting on the armature coil, as given by $T = k_1 B i_a$. But the flux density B is proportional to the field current i_f and i_a is constant, hence

$$T = k_1 B i_a = k_s i_f$$

where k_s is a constant. This torque output is then converted by the load system into an angular velocity ω . As earlier, the net torque acting on the load will be

$$\text{Net torque} = T - \text{damping torque}$$

The damping torque is $c\omega$, where c is a constant. Hence, if any effects due to the torsional springiness of the shaft are neglected,

$$\text{Net torque} = k_s i_f - c\omega$$

This will cause an angular acceleration of $d\omega/dt$, hence

$$I \frac{d\omega}{dt} = k_s i_f - c\omega$$

The conditions occurring for a field-controlled motor are thus described by the equations

$$v_f = R_f i_f + L_f \frac{di_f}{dt} \quad \text{and} \quad I \frac{d\omega}{dt} = k_s i_f - c\omega$$

We can thus obtain the equation relating the output ω with the input v_f to the system by eliminating i_f . See the brief discussion of the Laplace transform in Chapter 10, or that in the Appendix, for details of how this might be done.

9.4 Hydraulic-- mechanical systems

Hydraulic-mechanical converters involve the transformation of hydraulic signals to translational or rotational motion, or vice versa. Thus, for example, the movement of a piston in a cylinder as a result of hydraulic pressure involves the transformation of a hydraulic pressure input to the system to a translational motion output.

Figure 9.10 shows a hydraulic system in which an input of displacement x_i is, after passing through the system, transformed into a displacement x_o of a load. The system consists of a *spool valve* and a *cylinder*. The input displacement x_i to the left results in the hydraulic fluid supply pressure p_s causing fluid to flow into the left-hand side of the cylinder. This pushes the piston in the cylinder to the right and expels the fluid in the right-hand side of the chamber through the exit port at the right-hand end of the spool valve.

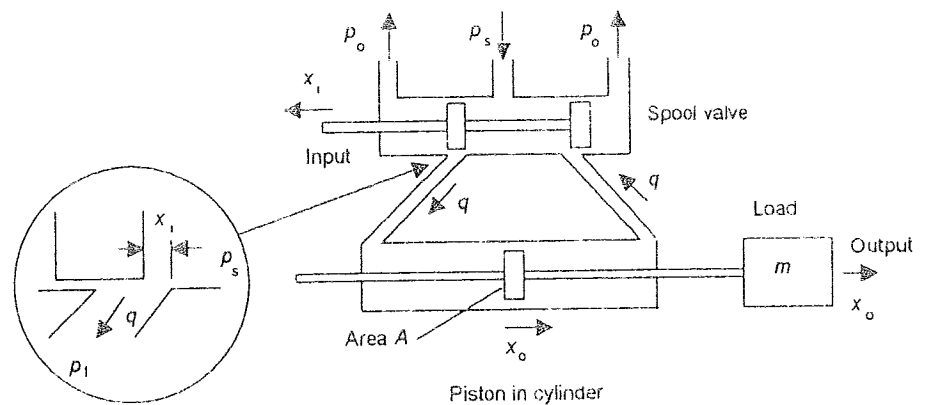


Fig. 9.10 Hydraulic system and load

The rate of flow of fluid to and from the chamber depends on the extent to which the input motion has uncovered the ports allowing the fluid to enter or leave the spool valve. When the input displacement x_i is to the right the spool valve allows fluid to move to the right-hand end of the cylinder and so results in a movement of the piston in the cylinder to the left.

The rate of flow of fluid q through an orifice, which is what the ports in the spool valve are, is a non-linear relationship (see Section 9.1.1) depending on the pressure difference between the two sides of the orifice and its cross-sectional area A . However, a linearised version of the equation can be used (see Section 9.1.1 for its derivation)

$$\Delta q = m_1 \Delta A + m_2 \Delta(\text{pressure difference})$$

where m_1 and m_2 are constants at the operating point. For the fluid entering the chamber the pressure difference is $(p_s - p_1)$ and for the exit $(p_2 - p_o)$. If the operating point about which the equation is linearised is taken to be the point at which the spool valve is central and the ports connecting it to the cylinder are both closed, then for this condition q is zero, and so $\Delta q = q$, A is proportional to x_i if x_i is measured from this central position, and the change in pressure on the inlet side of the piston is $-\Delta p_1$ relative to p_s and on the exit side Δp_2 relative to p_o . Thus, for the inlet port the equation can be written as

$$q = m_1 x_i + m_2 (-\Delta p_1)$$

and for the exit port

$$q = m_1 x_i + m_2 \Delta p_2$$

Adding the two equations gives

$$2q = 2m_1x_1 - m_2(\Delta p_1 - \Delta p_2)$$

$$q = m_1x_1 - m_3(\Delta p_1 - \Delta p_2)$$

where $m_3 = m_2/2$.

For the cylinder the change in the volume of fluid entering the left-hand side of the chamber, or leaving the right-hand side, when the piston moves a distance x_0 is Ax_0 , where A is the cross-sectional area of the piston. Thus the rate at which the volume is changing is $A(dx_0/dt)$. The rate at which fluid is entering the left-hand side of the cylinder is q . However, since there is some leakage flow of fluid from one side of the piston to the other

$$q = A \frac{dx_0}{dt} + q_L$$

where q_L is the rate of leakage. Substituting for q , gives

$$m_1x_1 - m_3(\Delta p_1 - \Delta p_2) = A \frac{dx_0}{dt} + q_L$$

The rate of leakage flow q_L is a flow through an orifice, the gap between the piston and the cylinder. This is of constant cross-section and has a pressure difference $(\Delta p_1 - \Delta p_2)$. Hence, using the linearised equation for such a flow,

$$q_L = m_4(\Delta p_1 - \Delta p_2)$$

Thus, using this equation to substitute for q_L

$$m_1x_1 - m_3(\Delta p_1 - \Delta p_2) = A \frac{dx_0}{dt} + m_4(\Delta p_1 - \Delta p_2)$$

$$m_1x_1 - (m_3 + m_4)(\Delta p_1 - \Delta p_2) = A \frac{dx_0}{dt}$$

The pressure difference across the piston results in a force being exerted on the load, the force exerted being $(\Delta p_1 - \Delta p_2)A$. There is, however, some damping of motion, i.e. friction, of the mass. This is proportional to the velocity of the mass, i.e. (dx_0/dt) . Hence the net force acting on the load is

$$\text{net force} = (\Delta p_1 - \Delta p_2)A - c \frac{dx_0}{dt}$$

This net force causes the mass to accelerate, the acceleration being (d^2x_0/dt^2) . Hence

$$m \frac{d^2x_0}{dt^2} = (\Delta p_1 - \Delta p_2)A - c \frac{dx_0}{dt}$$

Rearranging this equation gives

$$\Delta p_1 - \Delta p_2 = \frac{m}{A} \frac{d^2 x_o}{dt^2} + \frac{c}{A} \frac{dx_o}{dt}$$

Using this equation to substitute for the pressure difference in the earlier equation,

$$m_3 \ddot{x}_1 - (m_3 + m_4) \left(\frac{m}{A} \frac{d^2 x_o}{dt^2} + \frac{c}{A} \frac{dx_o}{dt} \right) = A \frac{dx_o}{dt}$$

Rearranging gives

$$\frac{(m_3 + m_4)m}{A} \frac{d^2 x_o}{dt^2} + \left(A + \frac{c(m_3 + m_4)}{A} \right) \frac{dx_o}{dt} = m_3 \ddot{x}_1$$

and rearranging this equation leads to

$$\frac{(m_3 + m_4)m}{A^2 + c(m_3 + m_4)} \frac{d^2 x_o}{dt^2} + \frac{dx_o}{dt} = \frac{Am_3}{A^2 + c(m_3 + m_4)} \ddot{x}_1$$

This equation can be simplified by introducing two constants k and τ , the latter constant being called the time constant (see Chapter 10). Hence

$$\tau \frac{d^2 x_o}{dt^2} + \frac{dx_o}{dt} = k \ddot{x}_1$$

Thus the relationship between input and output is described by a second-order differential equation

Problems

- 1 The relationship between the force F used to stretch a spring and its extension x is given by

$$F = kx^2$$

where k is a constant. Linearise this equation for an operating point of x_0 .

- 2 The relationship between the e.m.f. E generated by a thermocouple and the temperature T is given by

$$E = aT + bT^2$$

where a and b are constants. Linearise this equation for an operating point of temperature T_0 .

- 3 The relationship between the torque T applied to a simple pendulum and the angular deflection (Fig. 9.11) is given by

$$T = mgL \sin \theta$$




Fig. 9.11 Problem 3

where m is the mass of the pendulum bob, L the length of the pendulum and g the acceleration due to gravity. Linearise this equation for the equilibrium angle θ of 0° .

- 4 Derive a differential equation relating the input voltage to a d.c. servo motor and the output angular velocity, assuming that the motor is armature controlled and the equivalent circuit for the motor has an armature with just resistance, its inductance being neglected.
- 5 Derive differential equations for a d.c. generator. The generator may be assumed to have a constant magnetic field. The armature circuit has the armature coil, having both resistance and inductance, in series with the load. Assume that the load has both resistance and inductance.
- 6 Derive differential equations for a permanent magnet d.c. motor.
- 7 Consider a solenoid actuator in which a current passing through the solenoid results in movement of a rod actuator into or out of the solenoid. Propose models for the arrangement which could then be used to develop a differential equation relating the input of current to the output of displacement.

10

Dynamic responses of systems

10.1 Modelling dynamic systems

The most important function of a model devised for measurement or control systems is to be able to predict what the output will be for a particular input. We are not just concerned with a static situation, i.e. that after some time when the steady state has been reached an output of x corresponds to an input of y . We have to consider how the output will change with time when there is a change of input or when the input changes with time. For example, how will the temperature of a temperature-controlled system change with time when the thermostat is set to a new temperature? For a control system, how will the output of the system change with time when the set value is set to a new value or perhaps increased at a steady rate?

Chapters 8 and 9 were concerned with models of systems when the inputs varied with time, with the results being expressed in terms of differential equations. This chapter is about how we can use such models to make predictions about how outputs will change with time when the input changes with time.

10.1.1 Differential equations

To describe the relationship between the input to a system and its output we must describe the relationship between inputs and outputs which are both possible functions of time. We thus need a form of equation which will indicate how the system output will vary with time when the input is varying with time. This can be done by the use of a *differential equation*. Such an equation includes derivatives with respect to time and so gives information about how the response of a system varies with time. A derivative dx/dt describes the rate at which x varies with time, the derivative d^2x/dt^2 states how dx/dt varies with time. Differential equations can be classed as *first-order*, *second-order*, *third-order*, etc. according to the highest order of the derivative in the equation.

For a first-order equation the highest order will be dx/dt , with a second-order d^2x/dt^2 , with a third-order d^3x/dt^3 , with n th-order $d^n x/dt^n$.

This chapter is about the types of responses we can expect from first-order and second-order systems and the solution of such differential equations in order that the response of the system to different types of input can be obtained. This chapter uses the 'try a solution' approach in order to find a solution; the Laplace transformation method is introduced in Chapter 11. A more detailed discussion of the transform is given in Appendix A. For a more detailed consideration of differential equations, the reader is referred to *Mathematics for Engineers and Technologists* by H. Fox and W. Bolton (Butterworth-Heinemann 2002) and of the Laplace transform to *Laplace and z-Transforms* by W. Bolton (Longman 1994).

10.1.2 Natural and forced responses

An example of a first-order system is water flowing out of a tank (Fig. 10.1). For such a system we have

$$p_1 - p_2 = Rq$$

where R is the hydraulic resistance. But $p_1 - p_2 = h\rho g$, where ρ is the density of the water, and q is the rate at which water leaves the tank and so is $-dV/dt$, with V being the volume of water in the tank and so being Ah . Thus $q = -d(Ah)/dt = -Adh/dt$. Thus the above equation can be written as:

$$h\rho g = -RA \frac{dh}{dt}$$

The range of change of the variable h is proportional to the variable. This might be termed a *natural response* in that there is no input to the system forcing the variable to change. We can draw attention to this by writing the differential equation with all the output terms, i.e. h , on the same side of the equals sign, i.e.

$$RA \frac{dh}{dt} + (\rho g)h = 0$$

In Section 8.4.1 the differential equation was derived for a water tank from which water was flowing but also into which there was a flow of water (Fig. 10.2). This equation has a forcing function of q_1 and can be written as:

$$RA \frac{dh}{dt} + (\rho g)h = q_1$$

As another example, consider a thermometer being placed in a hot liquid at some temperature T_L . The rate at which the reading

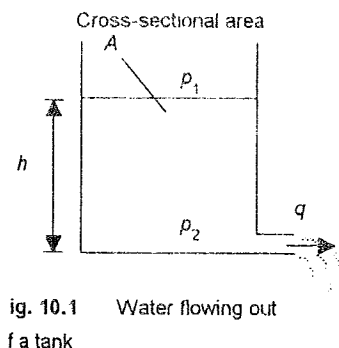


fig. 10.1 Water flowing out of a tank

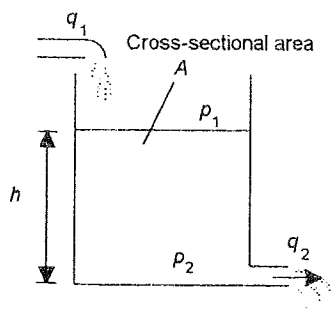


Fig. 10.2 Water flowing out of a tank with forcing input

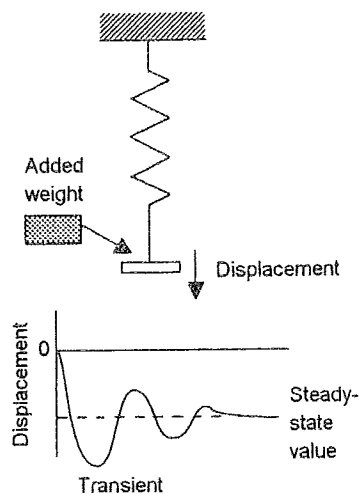


Fig. 10.3 Transient and steady-state responses of a spring system




Fig. 10.4 Step input at time 0




Fig. 10.5 Impulse




Fig. 10.6 Ramp input at time 0

10.2 First-order systems

of the thermometer T changes with time and was derived in Section 8.5.1 as being given by the differential equation:

$$RC \frac{dT}{dt} + T = T_L$$

Such a differential equation has a forcing input of T_L .

10.1.3 Transient and steady-state responses

The total response of a control system, or element of a system, can be considered to be made up of two aspects, the steady-state response and the transient response. The *transient response* is that part of a system response which occurs when there is a change in input and which dies away after a short interval of time. The *steady-state response* is the response that remains after all transient responses have died down.

To give a simple illustration of this, consider a vertically suspended spring (Fig. 10.3) and what happens when a weight is suddenly suspended from it. The deflection of the spring abruptly increases and then may well oscillate until after some time it settles down to a steady value. The steady value is the steady-state response of the spring system, the oscillation that occurs prior to this steady state is the transient response.

The input to the spring system, the weight, is a quantity which varies with time. Up to some particular time there is no added weight, i.e. no input, then after that time there is an input which remains constant for the rest of the time. This type of input is known as a *step input* and has a graph of the form shown in Figure 10.4.

The input signal to systems can take other forms, e.g. impulse, ramp, and sinusoidal signals. An impulse is a very short duration input (Fig. 10.5); a ramp is a steadily increasing input (Fig. 10.6) and can be described by an equation of the form $y = kt$, where k is a constant and a sinusoidal input can be described by an equation of the form $y = k \sin \omega t$, with ω being the so-called angular frequency and equal to $2\pi f$ where f is the frequency.

Both the input and the output are functions of time. One way of indicating this is to write them in the form $f(t)$, where f is the function and (t) indicates that its value depends on time t . Thus for the weight W input to the spring system we could write $W(t)$ and for the deflection d output $d(t)$. $y(t)$ is commonly used for an input and $x(t)$ for an output.

Consider a first-order system (Fig. 10.7) with $y(t)$ as the input to the system and $x(t)$ the output and which has a forcing input $b_0 y$ and can be described by a differential equation of the form

$$a_1 \frac{dx}{dt} + a_0 x = b_0 y$$




Fig. 10.7 System

where a_1 , a_0 and b_0 are constants.

A method that we can use to solve a first-order equation and give an equation which directly indicates how the output varies with time involves the recognition of the type of solution that would fit the differential equation and then establishing that such a solution is valid.

The input $y(t)$ can take many forms. Consider first the situation when the input is 0. Because there is no input to the system we have no signal forcing the system to respond in any way other than its natural response with no input. The differential equation is then

$$a_1 \frac{dx}{dt} + a_0 x = 0$$

Let us try a solution of the form $x = A e^{st}$, where A and s are constants. We then have $dx/dt = sA e^{st}$ and so when these values are substituted in the differential equation we obtain

$$a_1 s A e^{st} + a_0 A e^{st} = 0$$

and so $a_1 s + a_0 = 0$ and $s = -a_0/a_1$. Thus the solution is

$$x = A e^{-a_0 t / a_1}$$

This is termed the *natural response* since there is no forcing function. We can determine the value of the constant A given some initial (boundary) condition. Thus if $x = 1$ when $t = 0$ then $A = 1$. Figure 10.8 shows the natural response, i.e. an exponential decay.

Now consider the differential equation when there is a *forcing function*, i.e.

$$a_1 \frac{dx}{dt} + a_0 x = b_0 y$$

Consider the solution to this equation to be made up of two parts, i.e. $x = u + v$. One part represents the transient part of the solution and the other the steady-state part. Substituting this into the differential equation gives

$$a_1 \frac{d(u+v)}{dt} + a_0(u+v) = b_0 y$$

Rearranging this gives

$$\left(a_1 \frac{du}{dt} + a_0 u \right) + \left(a_1 \frac{dv}{dt} + a_0 v \right) = b_0 y$$

If we let




Fig. 10.8 Natural response

$$a_1 \frac{dy}{dt} + a_0 y = b_0 y$$

then we must have

$$a_1 \frac{du}{dt} + a_0 u = 0$$

and so two differential equations, one of which contains a forcing function and one which is just the natural response equation. This last equation is just the natural equation which we solved earlier in this section and so will have a solution of the form

$$u = A e^{-a_0/a_1 t}$$

The other differential equation contains the forcing function y . For this differential equation the form of solution we try depends on the form of the input signal y . For a step input when y is constant for all times greater than 0, i.e. $y = k$, we can try a solution $v = A$, where A is a constant. If we have an input signal of the form $y = a + bt + ct^2 + \dots$, where a , b and c are constants which can be zero, then we can try a solution which is of the form $v = A + Bt + Ct^2 + \dots$. For a sinusoidal signal we can try a solution of the form $v = A \cos \omega t + B \sin \omega t$.

To illustrate this, assume there is a step input at a time of $t = 0$ with the size of the step being k . Then we try a solution of the form $v = A$. Differentiating a constant gives 0; thus when this solution is substituted into the differential equation we obtain $a_0 A = b_0 k$ and so $v = (b_0/a_0)k$.

The full solution will be given by $y = u + v$ and so will be

$$y = A e^{-a_0/a_1 t} + \frac{b_0}{a_0} k$$

We can determine the value of the constant A given some initial (boundary) conditions. Thus if the output $y = 0$ when $t = 0$ then

$$0 = A + \frac{b_0}{a_0} k$$

Thus $A = -(b_0/a_0)k$. The solution then becomes

$$x = \frac{b_0}{a_0} k (1 - e^{-a_0/a_1 t})$$

When $t \rightarrow \infty$ the exponential term tends to 0. The exponential term thus gives that part of the response which is the transient solution. The steady-state response is the value of x when $t \rightarrow \infty$ and so is $(b_0/a_0)k$. Thus the equation can be written as

$$x = \text{steady-state value} \times (1 - e^{-a_0/a_1 t})$$

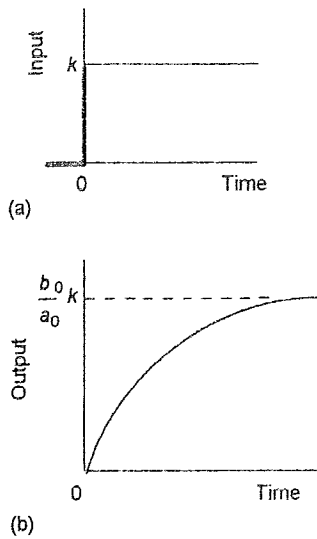


Fig. 10.9 (a) Step input,
(b) resulting output

Figure 10.9 shows a graph of how the output x varies with time for the step input.

As a further illustration of the above, consider the following examples.

- 1 An electrical transducer system which consists of a resistance in series with a capacitor. When subject to a step input of size V it is found to give an output of a potential difference across the capacitor v which is given by the differential equation

$$RC \frac{dv}{dt} + v = V$$

What is the solution of the differential equation, i.e. what is the response of the system and how does v vary with time?

Comparing the differential equation with the equation solved earlier: $a_1 = RC$, $a_0 = 1$, and $b_0 = 1$. Then the solution is of the form

$$v = V(1 - e^{-t/RC})$$

- 2 Consider an electrical circuit consisting of a $1 \text{ M}\Omega$ resistance in series with a $2 \mu\text{F}$ capacitance. At a time $t = 0$ the circuit is subject to a ramp voltage of $4t \text{ V}$, i.e. the voltage increases at the rate of 4 V every 1 s . Determine how the voltage across the capacitor will vary with time.

The differential equation will be of a similar form to that given in the previous example but with the step voltage V of that example replaced by the ramp voltage $4t$, i.e.

$$RC \frac{dv}{dt} + v = 4t$$

Thus, using the values given in the question,

$$2 \frac{dv}{dt} + v = 4t$$

Taking $v = v_n + v_f$, i.e. the sum of the natural and forced responses, we have for the natural response

$$2 \frac{dv_n}{dt} + v_n = 0$$

and for the forced response

$$2 \frac{dv_f}{dt} + v_f = 4t$$

For the natural response differential equation we can try a solution of the form $v_n = A e^{st}$. Hence, using this value

$$2As e^{st} + A e^{st} = 0$$

Thus $s = -1/2$ and so $v_n = A e^{-t/2}$.

For the forced response differential equation, since the right-hand side of the equation is $4t$ we can try a solution of the form $v_f = A + Bt$. Using this value gives $2B + A + Bt = 4t$. Thus we must have $B = 4$ and $A = -2B = -8$. Hence the solution is $v_f = -8 + 4t$. Thus the full solution is

$$v = v_n + v_f = A e^{-t/2} - 8 + 4t$$

Since $v = 0$ when $t = 0$ we must have $A = 8$. Hence

$$v = 8 e^{-t/2} - 8 + 4t$$

- 3 Consider a motor when the relationship between the output angular velocity ω and the input voltage v for a motor is given by

$$\frac{IR}{k_1 k_2} \frac{d\omega}{dt} + \omega = \frac{1}{k_1} v$$

What will be the steady-state value of the angular velocity when the input is a step of size 1 V?

Comparing the differential equation with the equation solved earlier, then $a_1 = IR/k_1 k_2$, $a_0 = 1$ and $b_1 = 1/k_1$. The steady-state value for a step input is thus $(b_0/a_0) = 1/k_1$.

10.2.1 The time constant

For a first-order system subject to a step input of size k we have an output y which varies with time t according to

$$x = \frac{b_0}{a_0} k (1 - e^{-a_0 t/a_1})$$

or

$$x = \text{steady-state value} \times (1 - e^{-a_0 t/a_1})$$

When the time $t = (a_1/a_0)$ then the exponential term has the value $e^{-1} = 0.37$ and

$$x = \text{steady-state value} \times (1 - 0.37)$$

In this time the output has risen to 0.63 of its steady-state value. This time is called the *time constant* τ .

$$\tau = \frac{a_1}{a_0}$$

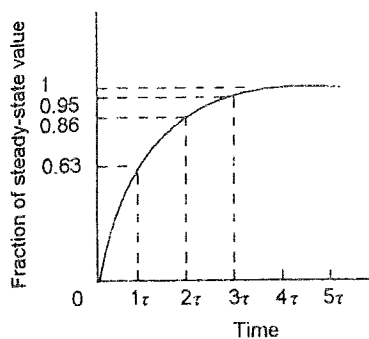


Fig. 10.10 Response of a first-order system to a step input

In a time of $2(a_1/a_0) = 2\tau$, the exponential term becomes $e^{-2} = 0.14$ and so

$$x = \text{steady-state value} \times (1 - 0.14)$$

In this time the output has risen to 0.86 of its steady-state value. In a similar way, values can be calculated for the output after 3τ , 4τ , 5τ , etc. Table 10.1 shows the results of such calculations and Figure 10.10 the graph of how the output varies with time for a unit step input.

Table 10.1 Response of a first-order system to a step input

Time t	Fraction of steady-state output
0	0
1τ	0.63
2τ	0.86
3τ	0.95
4τ	0.98
5τ	0.99
∞	1

In terms of the time constant τ , we can write the equation describing the response of a first-order system as

$$x = \text{steady-state value} \times (1 - e^{-t/\tau})$$

The time constant τ is (a_1/a_0) , thus we can write our general form of the first-order differential equation

$$a_1 \frac{dx}{dt} + a_0 x = b_0 y$$

as

$$\tau \frac{dx}{dt} + x = \frac{b_0}{a_0} y$$

But b_0/a_0 is the factor by which the input y is multiplied to give the steady-state value. We can term it the *steady-state gain* since it is the factor stating by how much bigger the output is than the input under steady-state conditions. Thus if we denote this by G_{ss} then the differential equation can be written in the form

$$\tau \frac{dx}{dt} + x = G_{ss} y$$

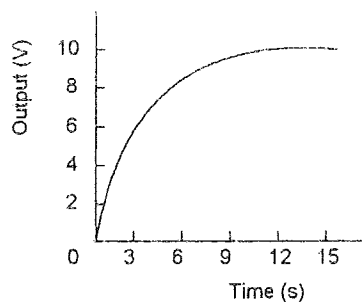


Fig. 10.11 Example

To illustrate this consider Figure 10.11 which shows how the output v_o of a first-order system varies with time when subject to a step input of 5 V. The time constant is the time taken for a first-order system output to change from 0 to 0.63 of its final steady-state value. In this case this time is about 3 s. We can check this value, and that the system is first order, by finding the value at 2, i.e. 6 s. With a first-order system it should be 0.86 of the steady-state value. In this case it is. The steady-state output is 10 V. Thus the steady-state gain G_{ss} is (steady-state output/input) = $10/5 = 2$. The differential equation for a first-order system can be written as

$$\tau \frac{dx}{dt} + x = G_{ss}y$$

Thus, for this system, we have

$$3 \frac{dv_o}{dt} + v_o = 2v_i$$

10.3 Second-order systems

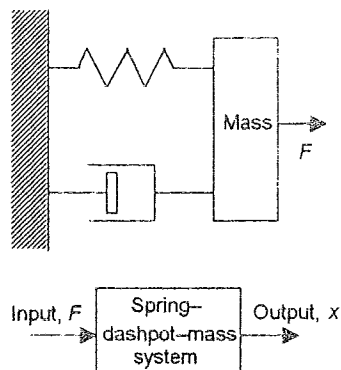


Fig. 10.12 Spring-dashpot-mass system

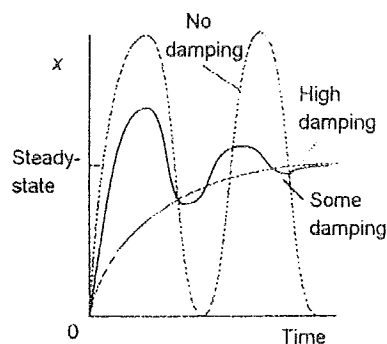


Fig. 10.13 Effect of damping

Many second-order systems can be considered to be essentially just a stretched spring with a mass and some means of providing damping. Figure 10.12 shows the basis of such a system. Such a system was analysed in Section 8.2.2. The equation describing the relationship between the input of force F and the output of a displacement x is

$$m \frac{d^2x}{dt^2} + c \frac{dx}{dt} + kx = F$$

where m is the mass, c the damping constant and k the spring constant.

The way in which the resulting displacement x will vary with time will depend on the amount of damping in the system. Thus if the force was applied as a step input and there was no damping at all then the mass would freely oscillate on the spring and the oscillations would continue indefinitely. No damping means $c = 0$ and so the dx/dt term is 0. However, damping will cause the oscillations to die away until a steady displacement of the mass is obtained. If the damping is high enough there will be no oscillations and the displacement of the mass will just slowly increase with time and gradually the mass will move towards its steady displacement position. Figure 10.13 shows the general way the displacements, for a step input, vary with time with different degrees of damping.

10.3.1 The second-order differential equation

Consider a mass on the end of a spring. In the absence of any damping and left to freely oscillate without being forced the output of the second-order system is a continuous oscillation

(simple harmonic motion). Thus, suppose we describe this oscillation by the equation

$$x = A \sin \omega_n t$$

where x is the displacement at a time t , A the amplitude of the oscillation and ω_n the angular frequency of the free undamped oscillations. Differentiating this gives

$$\frac{dx}{dt} = \omega_n A \cos \omega_n t$$

Differentiating a second time gives

$$\frac{d^2x}{dt^2} = -\omega_n^2 A \sin \omega_n t = -\omega_n^2 x$$

This can be reorganised to give the differential equation

$$\frac{d^2x}{dt^2} + \omega_n^2 x = 0$$

But for a mass m on a spring of stiffness k we have a restoring force of kx and thus

$$m \frac{d^2x}{dt^2} = -kx$$

This can be written as

$$\frac{d^2x}{dt^2} + \frac{k}{m} x = 0$$

Thus, comparing the two differential equations, we must have

$$\omega_n^2 = \frac{k}{m}$$

and $x = A \sin \omega_n t$ is the solution to the differential equation.

Now consider when we have damping. The motion of the mass is then described by

$$m \frac{d^2x}{dt^2} + c \frac{dx}{dt} + kx = F$$

We can solve this second-order differential equation by the same method used earlier for the first-order differential equation and consider the solution to be made up of two elements, a transient response and a forced response, i.e. $x = x_n + x_f$. Substituting for x in the above equation then gives

$$m \frac{d^2(x_n + x_f)}{dt^2} + c \frac{d(x_n + x_f)}{dt} + k(x_n + x_f) = F$$

If we let

$$m \frac{d^2 x_n}{dt^2} + c \frac{dx_n}{dt} + kx_n = 0$$

then we must have

$$m \frac{d^2 x_f}{dt^2} + c \frac{dx_f}{dt} + kx_f = F$$

To solve the transient equation we can try a solution of the form $x_n = A e^{st}$. This gives $dx_n/dt = As e^{st}$ and $d^2x_n/dt^2 = As^2 e^{st}$. Thus, substituting these values in the differential equation gives

$$mAs^2 e^{st} + cAs e^{st} + kA e^{st} = 0$$

$$ms^2 + cs + k = 0$$

Thus $x_n = A e^{st}$ can only be a solution provided the above equation equals 0. This equation is called the *auxiliary equation*. The roots of the equation can be obtained by factoring or using the formula for the roots of a quadratic equation. Thus

$$\begin{aligned} s &= \frac{-c \pm \sqrt{c^2 - 4mk}}{2m} = -\frac{c}{2m} \pm \sqrt{\left(\frac{c}{2m}\right)^2 - \frac{k}{m}} \\ &= -\frac{c}{2m} \pm \sqrt{\frac{k}{m} \left(\frac{c^2}{4mk}\right) - \frac{k}{m}} \end{aligned}$$

But $\omega_n^2 = k/m$ and so, if we let $\zeta^2 = c^2/4mk$ we can write the above equation as

$$s = -\zeta\omega_n \pm \omega_n \sqrt{\zeta^2 - 1}$$

ζ is termed the *damping factor*.

The value of s obtained from the above equation depends very much on the value of the square root term. Thus when ζ^2 is greater than 1 the square root term gives a square root of a positive number, and when ζ^2 is less than 1 we have the square root of a negative number. The damping factor determines whether the square root term is that of a positive or negative number and so the form of the output from the system.

With $\zeta > 1$ there are two different real roots s_1 and s_2 :

$$s_1 = -\zeta\omega_n + \omega_n \sqrt{\zeta^2 - 1}$$

$$s_2 = -\zeta\omega_n - \omega_n \sqrt{\zeta^2 - 1}$$

and so the general solution for x_n is

$$x_n = A e^{s_1 t} + B e^{s_2 t}$$

For such conditions the system is said to be *over-damped*.

When $\zeta = 1$ there are two equal roots with $s_1 = s_2 = -\omega_n$. For this condition, which is called *critically damped*,

$$x_n = (At + B) e^{-\omega_n t}$$

It may seem that the solution for this case should be $x_n = A e^{s_1 t}$, but two constants are required and so the solution is of this form (see *Ordinary Differential Equations* by W. Bolton (Longman 1994) for a discussion of this).

With $\zeta < 1$ there are two complex roots since the roots both involve the square root of (-1) .

$$s = -\zeta\omega_n \pm \omega_n \sqrt{\zeta^2 - 1} = -\zeta\omega_n \pm \omega_n \sqrt{-1} \sqrt{1 - \zeta^2}$$

and so writing j for $\sqrt{-1}$,

$$s = -\zeta\omega_n \pm j\omega_n \sqrt{1 - \zeta^2}$$

If we let

$$\omega = \omega_n \sqrt{1 - \zeta^2}$$

then we can write $s = -\zeta\omega_d \pm j\omega$ and so the two roots are

$$s_1 = -\zeta\omega_d + j\omega \quad \text{and} \quad s_2 = -\zeta\omega_d - j\omega$$

The term ω is the angular frequency of the motion when it is in the damped condition specified by ζ . The solution under these conditions is thus

$$x_n = A e^{(-\zeta\omega_n + j\omega)t} + B e^{(-\zeta\omega_n - j\omega)t} = e^{-\zeta\omega_n t} (A e^{j\omega t} + B e^{-j\omega t})$$

But $e^{j\omega t} = \cos \omega t + j \sin \omega t$ and $e^{-j\omega t} = \cos \omega t - j \sin \omega t$. Hence

$$\begin{aligned} x_n &= e^{-\zeta\omega_n t} (A \cos \omega t + jA \sin \omega t + B \cos \omega t - jB \sin \omega t) \\ &= e^{-\zeta\omega_n t} [(A + B) \cos \omega t + j(A - B) \sin \omega t] \end{aligned}$$

If we substitute constants P and Q for $(A + B)$ and $j(A - B)$, then

$$x_n = e^{-\zeta\omega_n t} (P \cos \omega t + Q \sin \omega t)$$

For such conditions the system is said to be *under-damped*.

The above has thus given the solutions for the natural part of the solution. To solve the forcing equation,

$$m \frac{d^2 x_f}{dt^2} + c \frac{dx_f}{dt} + kx_f = F$$

we need to consider a particular form of input signal and then try a solution. Thus for a step input of size F at time $t = 0$ we can try a solution $x_f = A$, where A is a constant (see the discussion of the solution of first-order differential equations for a discussion of the choice of solutions). Then $dx_f/dt = 0$ and $d^2x_f/dt^2 = 0$. Thus, when these are substituted in the differential equation $0 + 0 + kA = F$ and so $A = F/k$ and $x_f = F/k$. The complete solution, which is the sum of natural and forced solutions, is thus for the over-damped system

$$x = A e^{s_1 t} + B e^{s_2 t} + \frac{F}{k}$$

for the critically damped system

$$x = (At + B) e^{-\omega_n t} + \frac{F}{k}$$

and for the under-damped system

$$x = e^{-\zeta \omega_n t} (P \cos \omega_d t + Q \sin \omega_d t) + \frac{F}{k}$$

When $t \rightarrow \infty$ the above three equations all lead to the solution $x = F/k$. This is the steady-state condition.

Thus a second-order differential equation in the form

$$a_2 \frac{d^2 x}{dt^2} + a_1 \frac{dx}{dt} + a_0 x = b_0 y$$

has

$$\omega_n^2 = \frac{a_0}{a_2}$$

and

$$\zeta^2 = \frac{a_1^2}{4a_2 a_0}$$

The following examples are designed to illustrate the points made above.

- 1 Consider a series RLC circuit (Fig. 10.14) with $R = 100 \, \Omega$, $L = 2.0 \, \text{H}$ and $C = 20 \, \mu\text{F}$. The current i in the circuit is given by (see the text associated with Fig. 8.16):

$$\frac{d^2 i}{dt^2} + \frac{R}{L} \frac{di}{dt} + \frac{1}{LC} i = \frac{V}{LC}$$




Fig. 10.14 RLC system

when there is a step input V . If we compare the equation with the general second-order differential equation of:

$$a_2 \frac{d^2x}{dt^2} + a_1 \frac{dx}{dt} + a_0x = b_0y$$

then the natural angular frequency is given by

$$\omega_n^2 = \frac{1}{LC} = \frac{1}{2.0 \times 20 \times 10^{-6}}$$

and so $\omega_n = 158$ Hz. Comparison with the general second-order equation also gives

$$\zeta^2 = \frac{(R/L)^2}{4 \times (1/LC)} = \frac{R^2C}{4L} = \frac{100^2 \times 20 \times 10^{-6}}{4 \times 2.0}$$

Thus $\zeta = 0.16$. Since ζ is less than 1 the system is under-damped. The damped oscillation frequency ω is given by

$$\omega = \omega_n \sqrt{1 - \zeta^2} = 158 \sqrt{1 - 0.16^2} = 156 \text{ Hz}$$

Because the system is under-damped the solution will be of the same form as

$$x = e^{-\zeta\omega_n t} (P \cos \omega t + Q \sin \omega t) + \frac{F}{k}$$

and so

$$i = e^{-0.16 \times 158 t} (P \cos 156 t + Q \sin 156 t) + V$$

Since $i = 0$ when $t = 0$, then $0 = 1(P + 0) + V$. Thus $P = -V$. Since $di/dt = 0$ when $t = 0$ then differentiating the above equation and equating it to zero gives

$$\begin{aligned} \frac{di}{dt} &= e^{-\zeta\omega_n t} (\omega P \sin \omega t - \omega Q \cos \omega t) \\ &\quad - \zeta\omega_n e^{-\zeta\omega_n t} (P \cos \omega t + Q \sin \omega t) \end{aligned}$$

Thus $0 = 1(0 - \omega Q) - \zeta\omega_n(P + 0)$ and so

$$Q = \frac{\zeta\omega_n P}{\omega} = -\frac{\zeta\omega_n V}{\omega} = -\frac{0.16 \times 158 V}{156} \approx -0.16$$

Thus the solution of the differential equation is

$$i = V - V e^{-25.3 t} (\cos 156 t + 0.16 \sin 156 t)$$

- 2 Consider the system shown in Figure 10.15. The input, a torque T , is applied to a disc with a moment of inertia I about

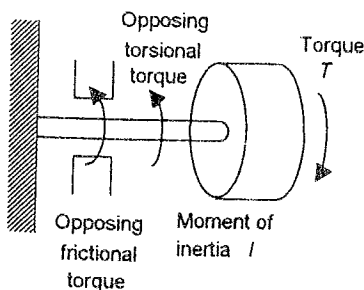


Fig. 10.15 Torsional system

the axis of the shaft. The shaft is free to rotate at the disc end but is fixed at its far end. The shaft rotation is opposed by the torsional stiffness of the shaft, an opposing torque of $k\theta_o$ occurring for an input rotation of θ_o . k is a constant. Frictional forces damp the rotation of the shaft and provide an opposing torque of $c \, d\theta_o/dt$, where c is a constant. What is the condition for this system to be critically damped?

We first need to obtain the differential equation for the system. The net torque is

$$\text{Net torque} = T - c \frac{d\theta_o}{dt} - k\theta_o$$

The net torque is $I \, d^2\theta_o/dt^2$, hence

$$I \frac{d^2\theta_o}{dt^2} = T - c \frac{d\theta_o}{dt} - k\theta_o$$

$$I \frac{d^2\theta_o}{dt^2} + c \frac{d\theta_o}{dt} + k\theta_o = T$$

The condition for critical damping is given when the damping ratio ζ equals 1. Comparing the above differential equation with the general form of the second-order differential equation, then

$$\zeta^2 = \frac{a_1^2}{4a_2a_0} = \frac{c^2}{4Ik}$$

Thus for critical damping we must have $c = \sqrt{4Ik}$.

10.4 Performance measures for second-order systems

Figure 10.16 shows the typical form of the response of an under-damped second-order system to a step input. Certain terms are used to specify such a performance.

The *rise time* t_r is the time taken for the response x to rise from 0 to the steady-state value x_{ss} and is a measure of how fast a system responds to the input. This is the time for the oscillating response to complete a quarter of a cycle, i.e. $\frac{1}{2}\pi$. Thus

$$\omega t_r = \frac{1}{2}\pi$$

The rise time is sometimes specified as the time taken for the response to rise from some specified percentage of the steady-state value, e.g. 10%, to another specified percentage, e.g. 90%.

The *peak time* t_p is the time taken for the response to rise from 0 to the first peak value. This is the time for the oscillating response to complete one half-cycle, i.e. π . Thus

$$\omega t_p = \pi$$

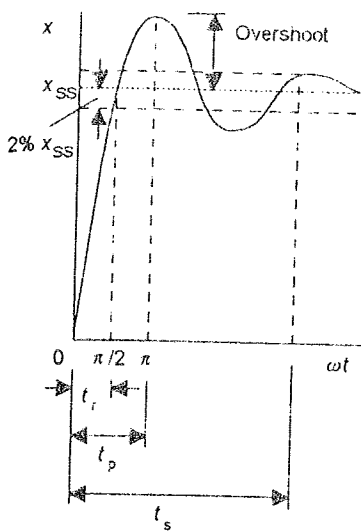


Fig. 10.16 Step response of an under-damped system

The *overshoot* is the maximum amount by which the response overshoots the steady-state value. It is thus the amplitude of the first peak. The overshoot is often written as a percentage of the steady-state value. For the under-damped oscillations of a system we can write

$$x = e^{-\zeta\omega_n t}(P \cos \omega t + Q \sin \omega t) + \text{steady-state value}$$

Since $x = 0$ when $t = 0$ then $0 = 1(P + 0) + x_{ss}$ and so $P = -x_{ss}$. The overshoot occurs at $\omega t = \pi$ and thus

$$x = e^{-\zeta\omega_n \pi} (P + 0) + x_{ss}$$

The overshoot is the difference between the output at that time and the steady-state value. Hence

$$\text{Overshoot} = x_{ss} e^{-\zeta\omega_n \pi}$$

Since $\omega = \omega_n \sqrt{1 - \zeta^2}$ then we can write

$$\begin{aligned} \text{Overshoot} &= x_{ss} \exp \left(\frac{-\zeta\omega_n \pi}{\omega_n \sqrt{1 - \zeta^2}} \right) \\ &= x_{ss} \exp \left(\frac{-\zeta \pi}{\sqrt{1 - \zeta^2}} \right) \end{aligned}$$

Expressed as a percentage of x_{ss} ,

$$\text{Percentage overshoot} = \exp \left(\frac{-\zeta \pi}{\sqrt{1 - \zeta^2}} \right) \times 100\%$$

Table 10.2 gives values of the percentage overshoot for particular damping ratios.

Table 10.2 Percentage peak overshoot

Damping ratio	Percentage overshoot
0.2	52.7
0.4	25.4
0.6	9.5
0.8	1.5

An indication of how fast oscillations decay is provided by the *subsidence ratio* or *decrement*. This is the amplitude of the second overshoot divided by that of the first overshoot. The first

overshoot occurs when we have $\omega t = \pi$, the second overshoot when $\omega t = 3\pi$. Thus,

$$\text{First overshoot} = x_{ss} \exp\left(\frac{-\zeta\pi}{\sqrt{1-\zeta^2}}\right)$$

$$\text{Second overshoot} = x_{ss} \exp\left(\frac{-3\zeta\pi}{\sqrt{1-\zeta^2}}\right)$$

and so

$$\text{Subsidence ratio} = \frac{\text{second overshoot}}{\text{first overshoot}} = \exp\left(\frac{-2\zeta\pi}{\sqrt{1-\zeta^2}}\right)$$

The *settling time* t_s is used as a measure of the time taken for the oscillations to die away. It is the time taken for the response to fall within and remain within some specified percentage, e.g. 2%, of the steady-state value (see Fig. 10.15). This means that the amplitude of the oscillation should be less than 2% of x_{ss} . We have

$$x = e^{-\zeta\omega_n t}(P \cos \omega t + Q \sin \omega t) + \text{steady-state value}$$

and, as derived earlier, $P = -x_{ss}$. The amplitude of the oscillation is $(x - x_{ss})$ when x is a maximum value. The maximum values occur when ωt is some multiple of π and thus we have $\cos \omega t = 1$ and $\sin \omega t = 0$. For the 2% settling time, the settling time t_s is when the maximum amplitude is 2% of x_{ss} , i.e. $0.02x_{ss}$. Thus

$$0.02x_{ss} = e^{-\zeta\omega_n t_s}(x_{ss} \times 1 + 0)$$

Taking logarithms gives $\ln 0.02 = -\zeta\omega_n t_s$ and since $\ln 0.02 = -3.9$ or approximately 4 then

$$t_s = \frac{4}{\zeta\omega_n}$$

The above is the value of the settling time if the specified percentage is 2%. If the percentage is 5% the equation becomes

$$t_s = \frac{3}{\zeta\omega_n}$$

Since the time taken to complete one cycle, i.e. the periodic time, is $1/f$, where f is the frequency, and since $\omega = 2\pi f$ then the time to complete one cycle is $2\pi/\omega$. In a settling time of t_s the number of oscillations that occur is

$$\text{Number of oscillations} = \frac{\text{settling time}}{\text{periodic time}}$$

and thus for a settling time defined for 2% of the steady-state value,

$$\text{Number of oscillations} = \frac{4/\zeta\omega_n}{2\pi/\omega}$$

Since $\omega = \omega_n\sqrt{1-\zeta^2}$, then

$$\text{Number of oscillations} = \frac{2\omega_n\sqrt{1-\zeta^2}}{\pi\zeta\omega_n} = \frac{2}{\pi} \sqrt{\frac{1}{\zeta^2} - 1}$$

To illustrate the above, consider a second-order system which has a natural angular frequency of 2.0 Hz and a damped frequency of 1.8 Hz. Since $\omega = \omega_n\sqrt{1-\zeta^2}$, then the damping factor is given by

$$1.8 = 2.0\sqrt{1-\zeta^2}$$

and $\zeta = 0.44$. Since $\omega t_r = \frac{1}{2}\pi$, then the 100% rise time is given by

$$t_r = \frac{\pi}{2 \times 1.8} = 0.87 \text{ s}$$

The percentage overshoot is given by

$$\begin{aligned} \text{Percentage overshoot} &= \exp\left(\frac{-\zeta\pi}{\sqrt{1-\zeta^2}}\right) \times 100\% \\ &= \exp\left(\frac{-0.44\pi}{\sqrt{1-0.44^2}}\right) \times 100\% \end{aligned}$$

The percentage overshoot is thus 21%. The 2% settling time is given by

$$t_s = \frac{4}{\zeta\omega_n} = \frac{4}{0.44 \times 2.0} = 4.5 \text{ s}$$

The number of oscillations occurring within the 2% settling time is given by

$$\begin{aligned} \text{Number of oscillations} &= \frac{2}{\pi} \sqrt{\frac{1}{\zeta^2} - 1} \\ &= \frac{2}{\pi} \sqrt{\frac{1}{0.44^2} - 1} = 1.3 \end{aligned}$$

10.5 System identification

In Chapter 9 models were devised for systems by considering them to be made up of simple elements. An alternative way of developing a model for a real system is to use tests to determine its response to some input, e.g. a step input, and then find the model that fits the response. This process of determining a mathematical model is known as *system identification*. Thus if we obtain a response to a step input of the form shown in Figure 10.9 then we might assume that it is a first-order system and determine the time constant from the response curve. For example, suppose the response takes a time of 1.5 s to reach 0.63 of its final height and the final height of the signal is 5 times the size of the step input. Table 10.1 indicates a time constant of 1.5 s and so the differential equation describing the model is:

$$1.5 \frac{dx}{dt} + x = 5y$$

An underdamped second-order system will give a response to a step input of the form shown in Figure 10.16. The damping ratio can be determined from measurements of the first and second overshoots with the ratio of these overshoots, i.e. the subsidence ratio, giving the damping ratio. The natural frequency can be determined from the time between successive overshoots. We can then use these values to determine the constants in the second-order differential equation.

Problems

- 1 A first-order system has a time constant of 4 s and a steady-state transfer function of 6. What is the form of the differential equation for this system?
- 2 A mercury-in-glass thermometer has a time constant of 10 s. If it is suddenly taken from being at 20°C and plunged into hot water at 80°C, what will be the temperature indicated by the thermometer after (a) 10 s, (b) 20 s?
- 3 A circuit consists of a resistor R in series with an inductor L . When subject to a step input voltage V at time $t = 0$ the differential equation for the system is

$$\frac{di}{dt} + \frac{R}{L}i = \frac{V}{L}$$

What is (a) the solution for this differential equation, (b) the time constant, (c) the steady-state current i ?

- 4 Describe the form of the output variation with time for a step input to a second-order system with a damping factor of (a) 0, (b) 0.5, (c) 1.0, (d) 1.5.
- 5 A RLC circuit has a current i which varies with time t when subject to a step input of V and is described by

$$\frac{d^2i}{dt^2} + 10 \frac{di}{dt} + 16i = 16V$$

What is (a) the undamped frequency, (b) the damping ratio, (c) the solution to the equation if $i = 0$ when $t = 0$ and $di/dt = 0$ when $t = 0$?

- 6 A system has an output x which varies with time t when subject to a step input of y and is described by

$$\frac{d^2x}{dt^2} + 10\frac{dx}{dt} + 25x = 50y$$

What is (a) the undamped frequency, (b) the damping ratio, (c) the solution to the equation if $x = 0$ when $t = 0$ and $dx/dt = -2$ when $t = 0$ and there is a step input of size 3 units?

- 7 An accelerometer (an instrument for measuring acceleration) has an undamped angular frequency of 100 Hz and a damping factor of 0.6. What will be (a) the maximum percentage overshoot and (b) the rise time when there is a sudden change in acceleration?
- 8 What will be (a) the undamped angular frequency, (b) the damping factor, (c) the damped angular frequency, (d) the rise time, (e) the percentage maximum overshoot and (f) the 0.2% settling time for a system which gave the following differential equation for a step input y ?

$$\frac{d^2x}{dt^2} + 5\frac{dx}{dt} + 16x = 16y$$

- 9 When a voltage of 10 V is suddenly applied to a moving coil voltmeter it is observed that the pointer of the instrument rises to 11 V before eventually settling down to read 10 V. What is (a) the damping factor and (b) the number of oscillations the pointer will make before it is within 0.2% of its steady-state value?
- 10 A second order system is described by the differential equation:

$$\frac{d^2x}{dt^2} + c\frac{dx}{dt} + 4x = F$$

What value of damping constant c will be needed if the percentage overshoot is to be less than 9.5%?

- 11 Observation of the oscillations of a damped system when responding to an input indicates that the maximum displacement during the second cycle is 75% of the first displacement. What is the damping factor of the system?
- 12 A second order system is found to have a time of 1.6 s between the first overshoot and the second overshoot. What is the natural frequency of the system?

11 System transfer functions

11.1 The transfer function

For an amplifier system it is customary to talk of the *gain* of the amplifier. This states how much bigger the output signal will be when compared with the input signal. It enables the output to be determined for specific inputs. Thus, for example, an amplifier with a voltage gain of 10 will give, for an input voltage of 2 mV, an output of 20 mV, or if the input is 1 V an output of 10 V. The gain states the mathematical relationship between the output and the input for the block

$$\text{Gain} = \frac{\text{output}}{\text{input}}$$

However, for many systems the relationship between the output and the input is in the form of a differential equation and so a statement of the function as just a simple number like the gain of 10 is not possible. We cannot just divide the output by the input because the relationship is a differential equation and not a simple algebraic equation. We can, however, transform a differential equation into an algebraic equation by using what is termed the *Laplace transform*. Differential equations describe how systems behave with time and are transformed by means of the Laplace transform into simple algebraic equations, not involving time, where we can carry out normal algebraic manipulations of the quantities. We talk of behaviour in the *time domain* being transformed to the *s-domain*. Then we can define the relationship between output and input in terms of a *transfer function*. The transfer function states the relationship between the Laplace transform of the output and the Laplace transform of the input, i.e.

$$\text{Transfer function} = \frac{\text{Laplace transform of output}}{\text{Laplace transform of input}}$$







Fig. 11.1 Block diagram




Unit impulse at zero time has the transform of 1




Unit step at zero time has the transform of $1/s$



Unit ramp at zero time has the transform of $1/s^2$

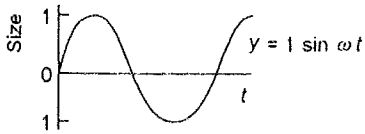

Unit amplitude sine wave has the transform of $\omega/(s^2 + \omega^2)$

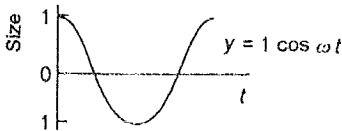

Unit amplitude cosine wave has the transform of $s/(s^2 + \omega^2)$

Fig. 11.2 Laplace transforms for common inputs

We can indicate when a signal is in the time domain, i.e. is a function of time, by writing it as $f(t)$. When in the s -domain a function is written, since it is a function of s , as $F(s)$. It is usual to use a capital letter F for the Laplace transform and a lower-case letter f for the time-varying function $f(t)$.

Suppose that the input to a linear system has a Laplace transform of $Y(s)$ and the Laplace transform of the output is $X(s)$. The *transfer function* $G(s)$ of the system is then defined as

$$G(s) = \frac{X(s)}{Y(s)}$$

with all the initial conditions being zero, i.e. we assume zero output when zero input, zero rate of change of output with time when zero rate of change of input with time. Thus the output transform is $X(s) = G(s)Y(s)$, i.e. the product of the input transform and the transfer function. If we represent a system by a block diagram (Fig. 11.1) then $G(s)$ is the function in the box which takes an input of $Y(s)$ and converts it to an output of $X(s)$.

This chapter gives an indication of how Laplace transforms can be used in relation to the transfer functions of systems. For more details the reader is referred to Appendix A or *Laplace and z-Transforms* by W. Bolton (Longman 1994), part of the Mathematics for Engineers series.

11.1.1 Laplace transforms

To obtain the Laplace transform of a differential equation which includes quantities which are functions of time we can use tables coupled with a few basic rules (Appendix A includes such a table and gives details of the rules). Figure 11.2 shows basic transforms for common forms of inputs.

The following are some of the basic rules involved in working with Laplace transforms:

- 1 If a function of time is multiplied by a constant then the Laplace transform is multiplied by the same constant, i.e.

$$af(t) \text{ has the transform of } aF(s)$$

For example, the Laplace transform of a step input of 6 V to an electrical system is just 6 times the transform for a unit step and thus $6/s$.

- 2 If an equation includes the sum of, say, two separate quantities which are functions of time, then the transform of the equation is the sum of the two separate Laplace transforms, i.e.

$$f(t) + g(t) \text{ has the transform } F(s) + G(s)$$

- 3 The Laplace transform of a first derivative of a function is

$$\text{Transform of } \left\{ \frac{d}{dt} f(t) \right\} = sF(s) - f(0)$$

where $f(0)$ is the initial value of $f(t)$ when $t = 0$. However, when we are dealing with a transfer function we have all initial conditions zero.

- 4 The Laplace transform for the second derivative of a function is

$$\text{Transform of } \left\{ \frac{d^2}{dt^2} f(t) \right\} = s^2 F(s) - sf(0) - \frac{d}{dt} f(0)$$

where $df(0)/dt$ is the initial value of the first derivative of $f(t)$ when we have $t = 0$. However, when we are dealing with a transfer function we have all initial conditions zero.

- 5 The Laplace transform of an integral of a function is

$$\text{Transform of } \left\{ \int_0^t f(t) dt \right\} = \frac{1}{s} F(s)$$

Thus, in obtaining the transforms of differential or integral equations when all the initial conditions are zero we:

*Replace a function of time $f(t)$ by $F(s)$,
replace a first derivative $df(t)/dt$ by $sF(s)$,
replace a second derivative $d^2f(t)/dt^2$ by $s^2F(s)$,
replace an integral $\int f(t) dt$ by $F(s)/s$.*

When algebraic manipulations have occurred in the s -domain, then the outcome can be transformed back to the time domain by using the table of transforms in the inverse manner, i.e. finding the time domain function which fits the s -domain result. Often the transform has to be rearranged to be put into a form given in the table. The following are some useful such inversions; for more inversions see the table given in Appendix A.

	Laplace transform	Function of time
1	$\frac{1}{s+a}$	e^{-at}
2	$\frac{a}{s(s+a)}$	$(1 - e^{-at})$
3	$\frac{b-a}{(s+a)(s+b)}$	$e^{-at} - e^{-bt}$
4	$\frac{s}{(s+a)^2}$	$(1 - at) e^{-at}$
5	$\frac{a}{s^2(s+a)}$	$t - \frac{1 - e^{-at}}{a}$

The following sections illustrate the application of the above to first-order and second-order systems.

11.2 First-order systems

Consider a system where the relationship between the input and the output is in the form of a first-order differential equation. The differential equation of a first-order system is of the form

$$a_1 \frac{dx}{dt} + a_0 x = b_0 y$$

where a_1 , a_0 , b_0 are constants, y is the input and x the output, both being functions of time. The Laplace transform of this, with all initial conditions zero, is

$$a_1 s X(s) + a_0 X(s) = b_0 Y(s)$$

and so we can write the transfer function $G(s)$ as

$$G(s) = \frac{X(s)}{Y(s)} = \frac{b_0}{a_1 s + a_0}$$

This can be rearranged to give

$$G(s) = \frac{b_0/a_0}{(a_1/a_0)s + 1} = \frac{G}{\tau s + 1}$$

where G is the *gain* of the system when there are steady-state conditions, i.e. there is no dx/dt term. (a_1/a_0) is the time constant τ of the system (see Section 10.2.3).

When a first-order system is subject to a unit step input then $Y(s) = 1/s$ and the output transform $X(s)$ is

$$X(s) = G(s)Y(s) = \frac{G}{s(\tau s + 1)} = G \frac{(1/\tau)}{s(s + 1/\tau)}$$

Hence, since we have the transform in the form $a/s(s + a)$, using the inverse transformation listed as item 2 in the previous section gives

$$x = G(1 - e^{-t/\tau})$$

The following examples illustrate the above points in the consideration of the transfer function of a first-order system and its behaviour when subject to a step input.

- 1 Consider a circuit which has a resistance R in series with a capacitance C . The input to the circuit is v and the output is the potential difference v_C across the capacitor. The differential equation relating the input and output is

$$v = RC \frac{dv_C}{dt} + v_C$$

Determine the transfer function

Taking the Laplace transform, with all initial conditions zero, then

$$V(s) = RCsV_C(s) + V_C(s)$$

Hence the transfer function is

$$G(s) = \frac{V_C(s)}{V(s)} = \frac{1}{RCs + 1}$$

- 2 Consider a thermocouple which has a transfer function linking its voltage output V and temperature input of

$$G(s) = \frac{30 \times 10^{-6}}{10s + 1} \text{ V/}^\circ\text{C}$$

Determine the response of the system when subject to a step input of size 100°C and hence the time taken to reach 95% of the steady-state value

Since the transform of the output is equal to the product of the transfer function and the transform of the input, then

$$V(s) = G(s) \times \text{input}(s)$$

A step input of size 100°C , i.e. the temperature of the thermocouple is abruptly increased by 100°C , is $100/s$. Thus

$$\begin{aligned} V(s) &= \frac{30 \times 10^{-6}}{10s + 1} \times \frac{100}{s} = \frac{30 \times 10^{-4}}{10s(s + 0.1)} \\ &= 30 \times 10^{-4} \frac{0.1}{s(s + 0.1)} \end{aligned}$$

The fraction element is of the form $a/s(s + a)$ and so the inverse transform is

$$V = 30 \times 10^{-4} (1 - e^{-0.1t}) \text{ V}$$

The final value, i.e. the steady-state value, is when $t \rightarrow \infty$ and so is when the exponential term is zero. The final value is therefore $30 \times 10^{-4} \text{ V}$. Thus the time taken to reach, say, 95% of this is given by

$$0.95 \times 30 \times 10^{-4} = 30 \times 10^{-4} (1 - e^{-0.1t})$$

Thus $0.05 = e^{-0.1t}$ and $\ln 0.05 = -0.1t$. The time is thus 30 s.

- 3 Consider a ramp input to the above thermocouple system of $5t$ °C/s, i.e. the temperature is raised by 5°C every second. Determine how the voltage of the thermocouple varies with time and hence the voltage after 12 s.

The transform of the ramp signal is $5/s^2$. Thus

$$V(s) = \frac{30 \times 10^{-6}}{10s + 1} \times \frac{5}{s^2} = 150 \times 10^{-6} \frac{0.1}{s^2(s + 0.1)}$$

The inverse transform can be obtained using item 5 in the list given in the previous section. Thus

$$V = 150 \times 10^{-6} \left(t - \frac{1 - e^{-0.1t}}{0.1} \right)$$

After a time of 12 s we would have $V = 7.5 \times 10^{-4}$ V.

- 4 Consider an impulse input of size 100°C , i.e. the thermocouple is subject to a momentary temperature increase of 100°C . Determine how the voltage of the thermocouple varies with time and hence the voltage after 2 s.

The impulse has a transform of 100. Hence

$$V(s) = \frac{30 \times 10^{-6}}{10s + 1} \times 100 = 3 \times 10^{-4} \frac{1}{s + 0.1}$$

Hence $V = 3 \times 10^{-4} e^{-0.1t}$ V. After 2 s, the thermocouple voltage $V = 1.8 \times 10^{-4}$ V.

11.3 Second-order systems

For a second-order system, the relationship between the input y and the output x is described by a differential equation of the form

$$a_2 \frac{d^2x}{dt^2} + a_1 \frac{dx}{dt} + a_0x = b_0y$$

where a_2 , a_1 , a_0 and b_0 are constants. The Laplace transform of this equation, with all initial conditions zero, is

$$a_2s^2X(s) + a_1sX(s) + a_0X(s) = b_0Y(s)$$

Hence

$$G(s) = \frac{X(s)}{Y(s)} = \frac{b_0}{a_2s^2 + a_1s + a_0}$$

An alternative way of writing the differential equation for a second-order system is

$$\frac{d^2x}{dt^2} + 2\zeta\omega_n \frac{dx}{dt} + \omega_n^2x = b_0\omega_n^2y$$

where ω_n is the natural angular frequency with which the system oscillates and ζ is the damping ratio. The Laplace transform of this equation gives

$$G(s) = \frac{X(s)}{Y(s)} = \frac{b_0 \omega_n^2}{s^2 + 2\zeta \omega_n s + \omega_n^2}$$

The above are the general forms taken by the transfer function for a second-order system.

When a second-order system is subject to a unit step input, i.e. $Y(s) = 1/s$, then the output transform is

$$X(s) = G(s)Y(s) = \frac{b_0 \omega_n^2}{s(s^2 + 2\zeta \omega_n s + \omega_n^2)}$$

This can be rearranged as

$$X(s) = \frac{b_0 \omega_n^2}{s(s + p_1)(s + p_2)}$$

where p_1 and p_2 are the roots of the equation

$$s^2 + 2\zeta \omega_n s + \omega_n^2 = 0$$

Hence, using the equation for the roots of a quadratic equation,

$$p = \frac{-2\zeta \omega_n \pm \sqrt{4\zeta^2 \omega_n^2 - 4\omega_n^2}}{2}$$

and so the two roots p_1 and p_2 are:

$$p_1 = -\zeta \omega_n + \omega_n \sqrt{\zeta^2 - 1}$$

$$p_2 = -\zeta \omega_n - \omega_n \sqrt{\zeta^2 - 1}$$

With $\zeta > 1$ the square root term is real and the system is over-damped. To find the inverse transform we can either use partial fractions (see Appendix A) to break the expression down into a number of simple fractions or use item 14 in the table of transforms in Appendix A; the result in either case is:

$$x = \frac{b_0 \omega_n^2}{p_1 p_2} \left[1 - \frac{p_2}{p_2 - p_1} e^{-p_2 t} + \frac{p_1}{p_2 - p_1} e^{-p_1 t} \right]$$

With $\zeta = 1$ the square root term is zero and so $p_1 = p_2 = -\omega_n$. The system is critically damped. The equation then becomes

$$X(s) = \frac{b_0 \omega_n^2}{s(s + \omega_n)^2}$$

This equation can be expanded by means of partial fractions (see Appendix A) to give

$$Y(s) = b_0 \left[\frac{1}{s} - \frac{1}{s + \omega_n} - \frac{\omega_n}{(s + \omega_n)^2} \right]$$

Hence

$$x = b_0 [1 - e^{-\omega_n t} - \omega_n t e^{-\omega_n t}]$$

With $\zeta < 1$, using item 28 in the table in Appendix A, gives

$$x = b_0 \left[1 - \frac{e^{-\zeta \omega_n t}}{\sqrt{1 - \zeta^2}} \sin(\omega_n \sqrt{1 - \zeta^2} t + \phi) \right]$$

where $\cos \phi = \zeta$. This is an under-damped oscillation.

The following examples illustrate the above:

- 1 What will be the state of damping of a system having the following transfer function and subject to a unit step input?

$$G(s) = \frac{1}{s^2 + 8s + 16}$$

For a unit step input $Y(s) = 1/s$ and so the output transform is

$$\begin{aligned} X(s) &= G(s)Y(s) = \frac{1}{s(s^2 + 8s + 16)} \\ &= \frac{1}{s(s+4)(s+4)} \end{aligned}$$

The roots of $s^2 + 8s + 16$ are thus $p_1 = p_2 = -4$. Both the roots are real and the same and so the system is critically damped.

- 2 A robot arm having the following transfer function is subject to a unit ramp input. What will be the output?

$$G(s) = \frac{K}{(s+3)^2}$$

The output transform $X(s)$ is:

$$X(s) = G(s)Y(s) = \frac{K}{(s+3)^2} \times \frac{1}{s^2}$$

Using partial fractions (see Appendix A) this becomes

$$X(s) = \frac{K}{9s^2} - \frac{2K}{9(s+3)} + \frac{K}{9(s+3)^2}$$

Hence the inverse transform is

$$x = \frac{1}{9}Kt - \frac{2}{9}Ke^{-3t} + \frac{1}{9}Kte^{-3t}$$

11.4 Systems in series

If a system consists of a number of subsystems in series, as in Figure 11.3, then the transfer function $G(s)$ of the system is given by

$$\begin{aligned} G(s) &= \frac{X(s)}{Y(s)} = \frac{X_1(s)}{Y(s)} \times \frac{X_2(s)}{X_1(s)} \times \frac{X(s)}{X_2(s)} \\ &= G_1(s) \times G_2(s) \times G_3(s) \end{aligned}$$

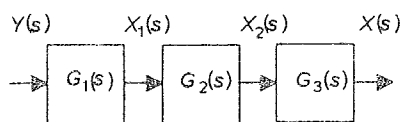


Fig. 11.3 Systems in series

The transfer function of the system as a whole is the product of the transfer functions of the series elements. The following examples illustrate this. It has been assumed that when subsystems are linked together that no interaction occurs between the blocks which would result in changes in their transfer functions, e.g. with electrical circuits there can be problems when subsystem circuits interact and load each other.

- 1 What will be the transfer function for a system consisting of three elements in series, the transfer functions of the elements being 10 , $2/s$, and $4/(s+3)$?

Using the equation developed above

$$G(s) = 10 \times \frac{2}{s} \times \frac{4}{s+3} = \frac{80}{s(s+3)}$$

- 2 A field-controlled d.c. motor consists of three subsystems in series, the field circuit, the armature coil and the load. Figure 11.4 illustrates the arrangement and the transfer functions of the subsystems. Determine the overall transfer function.




Fig. 11.4 Field-controlled d.c. motor

The overall transfer function is the product of the transfer functions of the series elements. Thus

$$G(s) = \frac{1}{Ls+R} \times k \times \frac{1}{Is+c} = \frac{k}{(Ls+R)(Is+c)}$$

11.5 Systems with feedback loops

Figure 11.5 shows a simple system having negative feedback. With *negative feedback* the system input and the feedback signals are subtracted at the summing point. The term *forward path* is

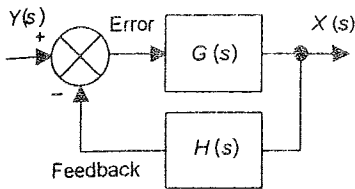


Fig. 11.5 Negative feedback system

used for the path having the transfer function $G(s)$ in the figure and *feedback path* for the one having $H(s)$. The entire system is referred to as a *closed-loop system*.

For the negative feedback system, the input to the subsystem having the forward-path transfer function $G(s)$ is $Y(s)$ minus the feedback signal. The feedback loop has a transfer function of $H(s)$ and has as its input $X(s)$, thus the feedback signal is $H(s)X(s)$. Thus the $G(s)$ element has an input of $Y(s) - H(s)X(s)$ and an output of $X(s)$ and so

$$G(s) = \frac{X(s)}{Y(s) - H(s)X(s)}$$

This can be rearranged to give

$$\frac{X(s)}{Y(s)} = \frac{G(s)}{1 + G(s)H(s)}$$

Hence the overall transfer function for the negative feedback system $T(s)$ is

$$T(s) = \frac{X(s)}{Y(s)} = \frac{G(s)}{1 + G(s)H(s)}$$

The following examples illustrate the above:

- 1 What will be the overall transfer function for a closed-loop system having a forward-path transfer function of $2/(s + 1)$ and a negative feedback-path transfer function of $5s$?

Using the equation developed above


$$\begin{aligned} T(s) &= \frac{G(s)}{1 + G(s)H(s)} \\ &= \frac{2/(s + 1)}{1 + [2/(s + 1)]5s} = \frac{2}{11s + 1} \end{aligned}$$

- 2 Consider an armature-controlled d.c. motor (Fig. 11.6). This has a forward path consisting of three elements: the armature circuit with a transfer function $1/(Ls + R)$, the armature coil with a transfer function k and the load with a transfer function $1/(Js + c)$. There is a negative feedback path with a transfer function K . Determine the overall transfer function for the system.

The forward-path transfer function for the series elements is the product of the transfer functions of the series elements, i.e.

$$G(s) = \frac{1}{Ls + R} \times k \times \frac{1}{Js + c} = \frac{k}{(Ls + R)(Js + c)}$$

Fig. 11.6 Armature-controlled d.c. motor

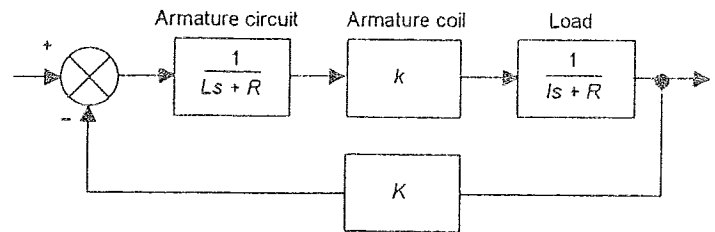


The feedback path has a transfer function of K . Thus the overall transfer function is

$$T(s) = \frac{G(s)}{1 + G(s)H(s)} = \frac{\frac{k}{(Ls+R)(Js+c)}}{1 + \frac{kK}{(Ls+R)(Js+c)}}$$

$$= \frac{k}{(Ls+R)(Js+c) + kK}$$

11.6 Effect of pole location on transient response

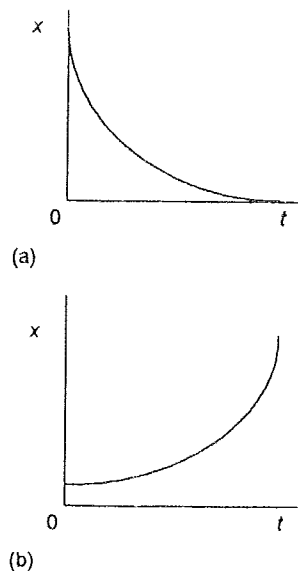Fig. 11.7 First-order systems:
(a) root is negative, (b) root is positive

Consider a first-order system with a transfer function of $1/(s+1)$ and subject to an input of a unit impulse. The system output $X(s) = [1/(s+1)] \times 1$ and thus $x = e^{-t}$. As the time t increases so the output dies away to eventually become zero. Now consider the unit impulse input to a system with the transfer function $1/(s-1)$. The output is then $x = e^t$. As t increases so the output increases with time. Thus a momentary impulse to the system has resulted in an ever increasing output; the system with this pole value is unstable. Thus, in general, for a first-order system with transfer function $1/(s+p)$, the system is *stable* if we have $(s+p)$, i.e. the pole is negative, and *unstable* if we have $(s-p)$, i.e. the pole is positive (Fig. 11.7).

A system is stable if the real part of all its poles is negative.

A system is unstable if the real part of any of its poles is positive.

For a second-order system with transfer function

$$G(s) = \frac{b_0 \omega_n^2}{s^2 + 2\zeta \omega_n s + \omega_n^2}$$

when subject to a unit impulse input:

$$X(s) = \frac{b_0 \omega_n^2}{(s+p_1)(s+p_2)}$$

where p_1 and p_2 are the roots of the equation

$$s^2 + 2\zeta\omega_n s + \omega_n^2 = 0$$

Using the equation for the roots of a quadratic equation,

$$p = \frac{-2\zeta\omega_n \pm \sqrt{4\zeta^2\omega_n^2 - 4\omega_n^2}}{2} = -\zeta\omega_n \pm \omega_n\sqrt{\zeta^2 - 1}$$

Depending on the value of the damping factor so the term under the square root sign can be real or imaginary. When there is an imaginary term the output involves an oscillation. For example, suppose we have a second-order system with transfer function

$$G(s) = \frac{1}{[s - (-2 + j1)][s - (-2 - j1)]}$$

i.e. $p = -2 \pm j1$. When subject to a unit impulse input the output is $e^{-2t} \sin t$. The amplitude of the oscillation, i.e. e^{-2t} , dies away as the time increases and so the effect of the impulse is a gradually decaying oscillation (Fig. 11.8(a)). The system is stable.

Suppose, however, we have a system with transfer function

$$G(s) = \frac{1}{[s - (2 + j1)][s - (2 - j1)]}$$

i.e. $p = +2 \pm j1$. When subject to a unit impulse input the output is $e^{2t} \sin t$. The amplitude of the oscillation, i.e. e^{2t} , increases as the time increases (Fig. 11.8(b)). The system is unstable.

In general, when an impulse is applied to a system, the output is in the form of the sum of a number of exponential terms. If just one of these terms is of exponential growth then the output continues to grow and the system is unstable. When there are pairs of poles involving \pm imaginary terms then the output is an oscillation.

11.6.1 Compensation

The output from a system might be unstable or perhaps the response is too slow or there is too much overshoot. Systems can have their responses to inputs altered by including *compensators*. A compensator is a block which is incorporated in the system so that it alters the overall transfer function of the system in such a way as to obtain the required characteristics.

As an illustration of the use of a compensator, consider a position control system which has a negative feedback path with a transfer function of 1 and two subsystems in its forward path: a compensator with a transfer function of K and a motor/drive system with a transfer function of $1/s(s+1)$. What value of K is necessary for the system to be critically damped? The forward path has a transfer function of $K/s(s+1)$ and the feedback path a transfer function of 1. Thus the overall transfer function of the system is

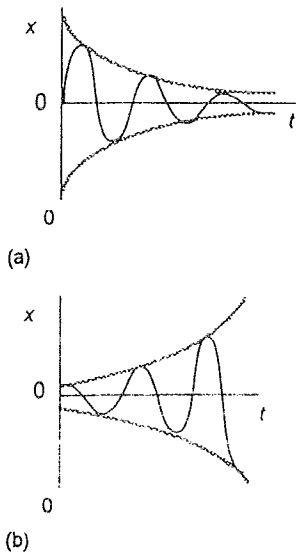


Fig. 11.8 Second-order systems

$$T(s) = \frac{G(s)}{1 + G(s)H(s)} = \frac{\frac{K}{s(s+1)}}{1 + \frac{K}{s(s+1)}} = \frac{K}{s(s+1) + K}$$

The denominator is thus $s^2 + s + K$. This will have the roots

$$s = \frac{-1 \pm \sqrt{1 - 4K}}{2}$$

To be critically damped we must have $1 - 4K = 0$ and hence the compensator must have the proportional gain of $K = 1/4$.

11.7 MATLAB and SIMULINK

Computer software can be used to aid computation and modelling of systems; a program that is often used is MATLAB. The following is a brief introduction to MATLAB (registered trademark of the Mathworks Inc.) version 4.0 or later. For additional information you are referred to the user guide or textbooks such as *The MATLAB Handbook* by Eva Pärt-Enander, Anders Sjöberg, Bo Melin and Pernilla Isaksson (Addison-Wesley 1996) and *Using MATLAB to Analyze and Design Control Systems*, 2nd edition, by Naomi Ehrlich Leonard and William S. Levine (Addison-Wesley 1995).

Commands are entered by typing them in after the prompt and then pressing the enter or return key in order that the command can be executed. In the discussion of the commands that follow, this pressing of the enter or return key will not be repeated but should be assumed in all cases. To start MATLAB, in Windows or the Macintosh systems, click on the MATLAB icon, otherwise type matlab. The screen will then produce the MATLAB prompt `>>`. To quit MATLAB type quit or exit after the prompt. Because MATLAB is case sensitive, lower-case letters should be used throughout for commands.

Typing help after the prompt, or selecting help from the menu bar at the top of the MATLAB window, displays a list of MATLAB broad help topics. To get help on a particular topic in the list, e.g. exponentials, type help exp. Typing lookfor plus some topic will instruct MATLAB to search for information on that topic, e.g. lookfor integ will display a number of commands which could be considered for integration.

In general, mathematical operations are entered into MATLAB in the same way as they would be written on paper. For example:

```
>> a = 4/2
```

yields the response:

```
a =
    2
```


and:

```
>> a = 3*2
```

yields the response:

```
a =
    6
```

Operations are carried in the following order: ^ power operation, * multiplication, / division, + addition, - subtraction. Precedence of operators is from left to right but parentheses () can be used to affect the order. For example:

```
>> a = 1+2^3/4*5
```

yields the response:

```
a =
    11
```

because we have $2^3/4$ which is multiplied by 5 and then added to 1, whereas:

```
>> a = 1+2^3/(4*5)
```

yields the response:

```
a =
    1.4
```

because we have 2^3 divided by the product of 4 and 5, and then added to 1.

The following are some of the mathematical functions available with MATLAB:

abs(x)	Gives the absolute value of x, i.e. $ x $
exp(x)	Gives the exponential of x, i.e. e^x
log(x)	Gives the natural logarithm of x, i.e. $\ln x$
log10(x)	Gives the base 10 logarithm of x, i.e. $\log_{10} x$
sqrt(x)	Gives the square root of x, i.e. \sqrt{x}
sin(x)	Gives $\sin x$ where x is in radians
cos(x)	Gives $\cos x$ where x is in radians
tan(x)	Gives $\tan x$ where x is in radians
asin(x)	Gives $\arcsin x$, i.e. $\sin^{-1} x$
acos(x)	Gives $\arccos x$, i.e. $\cos^{-1} x$
atan(x)	Gives $\arctan x$, i.e. $\tan^{-1} x$
csc(x)	Gives $1/\sin x$

<code>sec(x)</code>	Gives $1/\cos x$
<code>cot(x)</code>	Gives $1/\tan x$

π is entered by typing `pi`.

Instead of writing a series of commands at the prompt, a text file can be written and then the commands executed by referring MATLAB to that file. The term M-file is used since these text files, containing a number of consecutive MATLAB commands, have the suffix `.m`. In writing such a file, the first line must begin with the word `function` followed by a statement identifying the name of the function and the input and output in the form:

`function [output] = function name [input]`

e.g. `function y=cotan(x)` which is the file used to determine the value of y given by $\cotan x$. Such a file can be called up in some MATLAB sequence of commands by writing the name followed by the input, e.g. `cotan(x)`. It is in fact already included in MATLAB and is used when the cotangent of x is required. However, the file could have been user written. A function that has multiple inputs should list all of them in the function statement. Likewise, a function that is to return more than one value should list all the outputs.

Lines that start with `%` are comment lines; they are not interpreted by MATLAB as commands. For example, suppose we write a program to determine the root-mean-square values of a single column of data points, the program might look like:

```
function y=rms(x)
% rms Root mean square
% rms(x) gives the root mean square value of the
% elements of column vector x.
xs=x^2;
s=size(x);
y=sqrt(sum(xs)/s);
```

We have let `xs` be the square values of each x value. The command `s=size(x)` obtains the size, i.e. number of entries, in the column of data. The command `y=sqrt(sum(xs)/s(1))` obtains the square root of the sum of all the `xs` values divided by `s`. The `;` command is used at the end of each program line.

MATLAB supplies a number of toolboxes containing collections of M-files. Of particular relevance to this book is the Control System toolbox. It can be used to carry out time responses of systems to impulses, steps, ramps, etc., along with Bode and Nyquist analysis, root locus, etc.

11.7.1 Plotting

Two-dimensional linear plots can be produced by using the `plot(x,y)` command; this plots the values of x and y . For example, we might have:

```
x=[0 1 2 3 4 5];
y=[0 1 4 9 16 25];
plot(x,y)
```

To plot a function, whether standard or user defined, we use the command `fplot(function name,lim)`, where `lim` determines the plotting interval, i.e. the minimum and maximum values of x .

The command `semilogx(x,y)` generates a plot of the values of x and y using a logarithmic scale for x and a linear scale for y . The command `semilogy(x,y)` generates a plot of the values of x and y using a linear scale for x and a logarithmic scale for y . The command `loglog(x,y)` generates a plot of the values of x and y using logarithmic scales for both x and y . The command `polar(theta,r)` plots in polar coordinates with θ being the argument in radians and r the magnitude.

The subplot command enables the graph window to be split into subwindows and plots to be placed in each. For example, we might have:

```
x=(0 1 2 3 4 5 6 7);
y=exp(x);
subplot(2,1,1);plot(x,y);
subplot(2,1,2);semilogy(x,y);
```

Three integers m, n, p are given with the subplot command; the digits m and n indicate the graph window is to be split into an $m \times n$ grid of smaller windows, where m is the number of rows and n is the number of columns, and the digit p specifies the window to be used for the plot. The subwindows are numbered by row from left to right and top to bottom. Thus the above sequence of commands divides the window into two, with one plot above the other; the top plot is a linear plot and the lower plot is a semilogarithmic plot.

The number and style of grid lines, the plot colour and the adding of text to a plot can all be selected. The command `print` is used to print a hard copy of a plot, either to a file or a printer. This can be done by selecting the file menu-bar item in the figure window and then selecting the print option.

11.7.2 Transfer functions

The following lines in a MATLAB program illustrate how a transfer function can be entered and displayed on screen:

```
% G(s)=4(s+10)/(s+5)(s+15)
num=4*[1 10];
den=conv([1 5],[1 15]);
printsys(num,den,'s')
```

The command num is used to indicate the numerator of the transfer function, in descending powers of s . The command den is used to indicate the denominator in descending powers of s for each of the two polynomials in the denominator. The command conv multiplies two polynomials, in this case they are $(s + 5)$ and $(s + 15)$. The printsys command displays the transfer function with the numerator and denominator specified and written in the s -domain.

Sometimes we may be presented with a transfer function as the ratio of two polynomials and need to find the poles and zeros. For this we can use

```
% Finding poles and zeros for the transfer function
% G(s)=(5s^2 + 3s - 4)/(s^3 - 2s^2 + 4s - 7)
num=[5 3 -4];
den=[1 2 4 -7];
[z,p,k]=tf2zp(num,den)
```

[z,p,k]=tf2zp(num,den) is the command to determine and display the zeros (z), poles (p) and gain (k) of the zero-pole-gain transfer function entered.

MATLAB can be used to give graphs showing the response of a system to different inputs. For example, the following program will give the response of the system to a unit step input $u(t)$ with a specified transfer function:

```
% Display of response to a step input for a system with
% transfer function G(s) = 5 (s^2 - 3s - 12)
num=5;
den=[1 3 12];
step(num,den)
```

11.7.3 Block diagrams

Control systems are often represented as a series of interconnected blocks, each block having specific characteristics. MATLAB allows systems to be built up from interconnected blocks. The commands used are cloop when a block with a given open-loop transfer function has unity feedback. If the feedback is not unity the command feedback is used, e.g. with Figure 11.9 we have the program.

```
% System with feedback loop
ngo=[1 1];
dgo=conv([1 3],[1 4]);
```

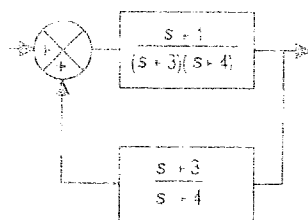


Fig. 11.9 Block diagram

```

nh=[1 3];
dh=[1 4];
[ngc2,dgc2]=feedback(ngo,dgo,nh,dh)
printsys(ngc2,dgc2,'s')

```

ngo and dgo indicate the numerator and denominator of open-loop transfer function $G_o(s)$, nh and dh the numerator and denominator of the feedback loop transfer function $H(s)$. The program results in the display of the transfer function for the system as a whole.

The command series is used to indicate that two blocks are in series in a particular path; the command parallel indicates that they are in parallel.

11.7.4 SIMULINK

SIMULINK is used in conjunction with MATLAB to specify systems by 'connecting' boxes on the screen rather than, as above, writing a series of commands to generate the description of the block diagram. Once MATLAB has been started, SIMULINK is selected using the command `>>simulink`. This opens the SIMULINK control window with its icons and pull-down menus in its header bar. Click on file, then click on new from the drop-down menu. This opens a window in which a system can be assembled.

To start assembling the blocks required, go back to the control window and double-click on the linear icon. Click and then drag the transfer Fcn icon into the untitled window. If you require a gain block, click and drag the gain icon into the untitled window. Do the same for a sum icon and perhaps an integrator icon. In this way, drag all the required icons into the untitled window. Then double-click on the Sources icon and select the appropriate source from its drop-down menu, e.g. step input, and drag it into the untitled window. Now double-click on the sinks icon and drag the graph icon into the untitled window. To connect the icons, depress the mouse button while the mouse arrow is on the output symbol of an icon and drag to it the input symbol of the icon to which it is to be connected. Repeat this for all the icons until the complete block diagram is assembled.

To give the transfer Fcn box a transfer function, double-click in the box. This will give a dialogue box in which you can use MATLAB commands for numerator and denominator. Click on the numerator and type in `[1 1]` if $(s + 1)$ is required. Click on the denominator and type in `[1 2 3]` if $(s^2 + 2s + 3)$ is required. Then click the done icon. Double-click on the gain icon and type in the gain value. Double-click on the sum icon and set the signs to + or - according to whether positive or negative feedback is required. Double-click on the graph icon and set the parameters for the graph. You then have the complete simulation diagram on screen. Figure 11.10 shows the form it might take. To delete any block or

connection, select them by clicking and then press the key.

To simulate the behaviour of the system, click on Simulation to pull down its menu. Select Parameters and set the start and stop times for the simulation. From the Simulation menu, select Start. SIMULINK will then create a graph window and display the output of the system. The file can be saved by selecting File and clicking on SAVE AS in the drop-down menu. Insert a file name in the dialogue box then click on Done.

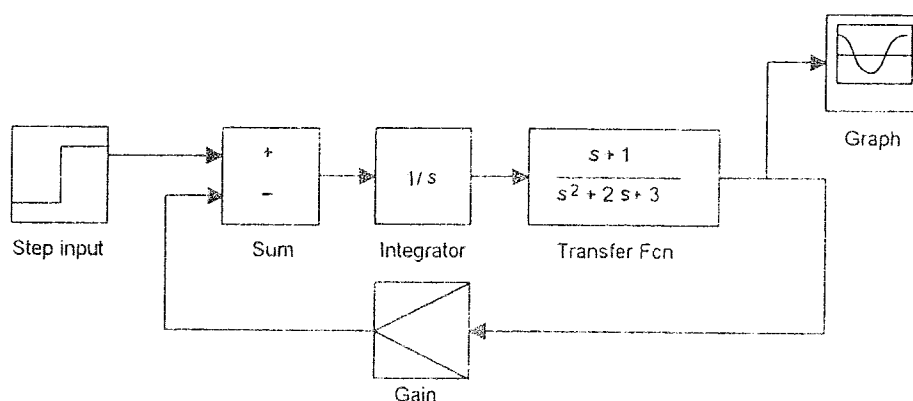


Fig. 11.10 Example of use of SIMULINK

Problems

- 1 What are the transfer functions for systems giving the following input/output relationships?

(a) A hydraulic system has an input q and an output h where

$$q = A \frac{dh}{dt} + \frac{\rho gh}{R}$$

(b) A spring-dashpot-mass system with an input F and an output x , where

$$m \frac{d^2x}{dt^2} + c \frac{dx}{dt} + kx = F$$

(c) An RLC circuit with an input v and output v_C , where

$$v = RC \frac{dv_C}{dt} + LC \frac{d^2v_C}{dt^2} + v_C$$

- 2 What are the time constants of the systems giving the transfer functions (a) $G(s) = 5/(3s + 1)$, (b) $G(s) = 2/(2s + 3)$?
- 3 Determine how the outputs of the following systems vary with time when subject to a unit step input at time $t = 0$: (a) $G(s) = 2/(s + 2)$, (b) $G(s) = 10/(s + 5)$.

- 4 What is the state of the damping for the systems having the following transfer functions?

$$(a) G(s) = \frac{5}{s^2 - 6s + 16}, \quad (b) G(s) = \frac{10}{s^2 + s + 100}.$$

$$(c) G(s) = \frac{2s + 1}{s^2 + 2s + 1}, \quad (d) G(s) = \frac{3s + 20}{s^2 + 2s + 20}$$

- 5 What is the output of a system with the transfer function $s/(s + 3)^2$ and subject to a unit step input at time $t = 0$?
 6 What is the output of a system having the transfer function $G = 2/[(s + 3)(s + 4)]$ and subject to a unit impulse?
 7 What are the overall transfer functions of the following negative feedback systems?

Forward path

Feedback path

$$(a) G(s) = \frac{4}{s(s + 1)},$$

$$H(s) = \frac{1}{s}.$$

$$(b) G(s) = \frac{2}{s + 1},$$

$$H(s) = \frac{1}{s + 2}.$$

$$(c) G(s) = \frac{4}{(s + 2)(s + 3)},$$

$$H(s) = 5$$

$$(d) \text{ two series elements}$$

$$H(s) = 10$$

$$G_1(s) = 2/(s + 2)$$

$$\text{and } G_2(s) = 1/s,$$

- 8 What is the overall transfer function for a closed-loop system having a forward-path transfer function of $5/(s + 3)$ and a negative feedback-path transfer function of 10?
 9 A closed-loop system has a forward path having two series elements with transfer functions 5 and $1/(s + 1)$. If the feedback path has a transfer function $2/s$, what is the overall transfer function of the system?
 10 A closed-loop system has a forward path having two series elements with transfer functions of 2 and $1/(s + 1)$. If the feedback path has a transfer function of s , what is the overall transfer function of the system?

12 Frequency response

12.1 Sinusoidal input

In the previous two chapters, the response of systems to step, impulse and ramp inputs has been considered. This chapter extends this to when there is a sinusoidal input. While for many control systems a sinusoidal input might not be encountered normally, it is a useful testing input since the way the system responds to such an input is a very useful source of information to aid the design and analysis of systems.

Consider a first-order system which is described by the differential equation

$$a_1 \frac{dx}{dt} + a_0 x = b_0 y$$

where y is the input and x the output. Suppose we have the unit amplitude sinusoidal input of $y = \sin \omega t$. What will the output be? Well we must end up with the sinusoid $b_0 \sin \omega t$ when we add $a_1 dx/dt$ and $a_0 x$. But sinusoids have the property that when differentiated the result is also a sinusoid and with the same frequency (a cosine is a sinusoid, being just $\sin(\omega t + 90^\circ)$). This applies no matter how many times we carry out the differentiation. Thus we should expect that the steady-state response x will also be sinusoidal and with the same frequency. The output may, however, differ in amplitude and phase from the input.

12.2 Phasors

In discussing sinusoidal signals it is convenient to use *phasors*. Consider a sinusoid described by the equation $v = V \sin(\omega t + \phi)$, where V is the amplitude, ω the angular frequency and ϕ the phase angle. The phasor can be represented by a line of length $|V|$, making an angle of ϕ with the phase reference axis. The $||$ lines are used to indicate that we are only concerned with the magnitude or size of the quantity when specifying its length. A phasor quantity in order to be specified always requires a

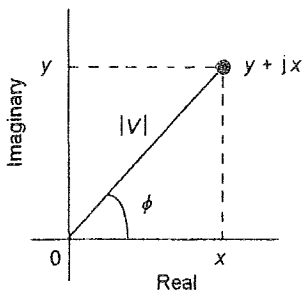


Fig. 12.1 Complex representation of a phasor

magnitude and angle to be specified. The convention generally adopted is to write a phasor in bold, non-italic, print, e.g. **V**. When such a symbol is seen it implies a quantity having both a magnitude and an angle.

Such a phasor can be described by means of complex number notation. A complex quantity can be represented by $(x + jy)$, where x is the real part and y the imaginary part of the complex number. On a graph with the imaginary component as the y -axis and the real part as the x -axis, x and y are Cartesian coordinates of the point representing the complex number (Fig. 12.1). If we take the line joining this point to the graph origin to represent a phasor, then we have the phase angle ϕ of the phasor represented by

$$\tan \phi = \frac{y}{x}$$

and its length by the use of Pythagoras' theorem as

$$\text{Length of phasor } |V| = \sqrt{x^2 + y^2}$$

Since $x = |V| \cos \phi$ and $y = |V| \sin \phi$, then we can write

$$V = x + jy = |V| (\cos \theta + j \sin \theta)$$

Thus a specification of the real and imaginary parts of a complex number enables a phasor to be specified.

Consider a phasor of length 1 and phase angle 0° (Fig. 12.2(a)). It will have a complex representation of $1 + j0$. Now consider the same length phasor but with a phase angle of 90° (Fig. 12.2(b)). It will have a complex representation of $0 + j1$. Thus rotation of a phasor anti-clockwise by 90° corresponds to multiplication of the phasor by j . If we now rotate this phasor by a further 90° (Fig. 12.2(c)), then following the same multiplication rule we have the original phasor multiplied by j^2 . But the phasor is just the original phasor in the opposite direction, i.e. just multiplied by -1 . Hence $j^2 = -1$ and so $j = \sqrt{-1}$. Rotation of the original phasor through a total of 270° , i.e. $3 \times 90^\circ$, is equivalent to multiplying the original phasor by $j^3 = j(j^2) = -j$.

For further discussion of complex numbers and their application in engineering, the reader is referred to *Complex Numbers* by W. Bolton (Longman 1994), part of their Mathematics for Engineers series.

To illustrate the above, consider a voltage v which varies sinusoidally with time according to the equation

$$v = 10 \sin(\omega t + 30^\circ) \text{ V}$$

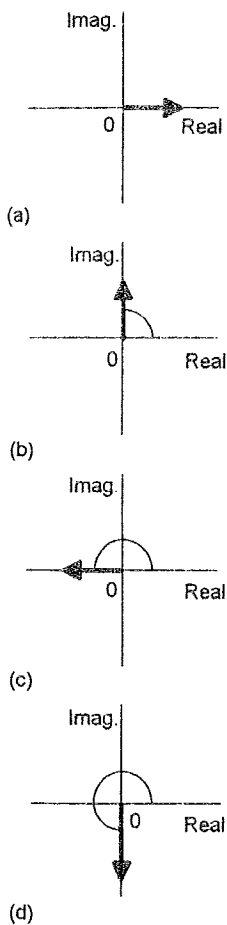


Fig. 12.2 Phasor rotation:
(a) 0° , (b) 90° , (c) 180° , (d) 270°

When represented by a phasor, what are (a) its length, (b) its angle relative to the reference axis, (c) its real and imaginary parts when represented by a complex number?

- (a) The phasor will have a length scaled to represent the amplitude of the sinusoid and so is 10 V.
- (b) The angle of the phasor relative to the reference axis is equal to the phase angle and so is 30° .
- (c) The real part is given by the equation $x = 10 \cos 30^\circ = 8.7$ V and the imaginary part by $y = 10 \sin 30^\circ = 5.0$ V. Thus the phasor is specified by $8.7 + j5.0$ V.

12.2.1 Phasor equations

Consider a phasor to represent the unit amplitude sinusoid of $x = \sin \omega t$. Differentiation of the sinusoid gives $dx/dt = \omega \cos \omega t$. But we can also write this as $dx/dt = \omega \sin(\omega t + 90^\circ)$. In other words, differentiation just results in a phasor with a length increased by a factor of ω and which is rotated round by 90° from the original phasor. Thus, in complex notation, we have multiplied the original phasor by $j\omega$, since multiplication by j is equivalent to a rotation through 90° .

Thus the differential equation

$$a_1 \frac{dx}{dt} + a_0 x = b_0 y$$

can be written, in complex notation, as a *phasor equation*

$$j\omega a_1 \mathbf{X} + a_0 \mathbf{X} = b_0 \mathbf{Y}$$

where the bold, non-italic, letters indicate that the data refers to phasors. We can say that the differential equation, which was an equation in the time domain, has been transformed into an equation in the *frequency domain*. The frequency domain equation can be rewritten as

$$(j\omega a_1 + a_0) \mathbf{X} = b_0 \mathbf{Y}$$

$$\frac{\mathbf{X}}{\mathbf{Y}} = \frac{b_0}{j\omega a_1 + a_0}$$

But, in Section 11.2, when the same differential equation was written in the s -domain, we had

$$G(s) = \frac{X(s)}{Y(s)} = \frac{b_0}{a_1 s + a_0}$$

If we replace s by $j\omega$ we have the same equation. It turns out that we can always do this to convert from the s -domain to the frequency domain. This thus leads to a definition of a *frequency-*

response function or frequency transfer function $G(j\omega)$, for the steady state, as

$$G(j\omega) = \frac{\text{output phasor}}{\text{input phasor}}$$

To illustrate the above consider the determination of the frequency-response function for a system having a transfer function of

$$G(s) = \frac{1}{s+1}$$

The frequency-response function is obtained by replacing s by $j\omega$. Thus

$$G(j\omega) = \frac{1}{j\omega + 1}$$

12.3 Frequency response

A first-order system has a transfer function which can be written as

$$G(s) = \frac{1}{1 + \tau s}$$

where τ is the time constant of the system (see Section 11.2). The frequency-response function $G(j\omega)$ can be obtained by replacing s by $j\omega$. Hence

$$G(j\omega) = \frac{1}{1 + j\omega\tau}$$

We can put this into a more convenient form by multiplying the top and bottom of the expression by $(1 - j\omega\tau)$ to give

$$G(j\omega) = \frac{1}{1 + j\omega\tau} \times \frac{1 - j\omega\tau}{1 - j\omega\tau} = \frac{1 - j\omega\tau}{1 + j^2\omega^2\tau^2}$$

But $j^2 = -1$, thus

$$G(j\omega) = \frac{1}{1 + \omega^2\tau^2} - j \frac{\omega\tau}{1 + \omega^2\tau^2}$$

This is of the form $x + jy$ and so, since $G(j\omega)$ is the output phasor divided by the input phasor, we have the size of the output phasor bigger than that of the input phasor by a factor which can be written as $|G(j\omega)|$, with

$$|G(j\omega)| = \sqrt{x^2 + y^2} = \sqrt{\left(\frac{1}{1 + \omega^2\tau^2}\right)^2 + \left(\frac{\omega\tau}{1 + \omega^2\tau^2}\right)^2}$$

$$= \frac{1}{\sqrt{1 + \omega^2 \tau^2}}$$

$|G(j\omega)|$ tells us how much bigger the amplitude of the output is than the amplitude of the input. It is generally referred to as the *magnitude* or *gain*. The phase difference ϕ between the output phasor and the input phasor is given by

$$\tan \phi = \frac{y}{x} = -\omega\tau$$

The negative sign indicates that the output phasor lags behind the input phasor by this angle.

The following examples illustrate the above:

- 1 Determine the frequency-response function, the magnitude and phase of a system (an electrical circuit with a resistor in series with a capacitor across which the output is taken) that has a transfer function of

$$G(s) = \frac{1}{RCs + 1}$$

The frequency-response function can be obtained by substituting $j\omega$ for s and so give

$$G(j\omega) = \frac{1}{j\omega RC + 1}$$

We can multiply the top and bottom of the above equation by $1 - j\omega RC$ and then rearrange the result to give

$$G(j\omega) = \frac{1}{1 + \omega^2(RC)^2} - j \frac{\omega(RC)}{1 + \omega^2(RC)^2}$$

Hence

$$|G(j\omega)| = \frac{1}{\sqrt{1 + \omega^2(RC)^2}}$$

and $\tan \phi = -\omega RC$.

- 2 Determine the magnitude and phase of the output from a system when subject to a sinusoidal input of $2 \sin(3t + 60^\circ)$ if it has a transfer function of

$$G(s) = \frac{4}{s + 1}$$

The frequency-response function is obtained by replacing s by $j\omega$. Thus

$$G(j\omega) = \frac{4}{j\omega + 1}$$

Multiplying the top and bottom of the equation by $(-j\omega + 1)$:

$$G(j\omega) = \frac{-j4\omega + 4}{\omega^2 + 1} = \frac{4}{\omega^2 + 1} - j \frac{4\omega}{\omega^2 + 1}$$

The magnitude is thus

$$\begin{aligned} |G(j\omega)| &= \sqrt{x^2 + y^2} = \sqrt{\frac{4^2}{(\omega^2 + 1)^2} + \frac{4^2\omega^2}{(\omega^2 + 1)^2}} \\ &= \frac{4}{\sqrt{\omega^2 + 1}} \end{aligned}$$

and the phase angle is given by $\tan \phi = y/x$ and so

$$\tan \phi = -\omega$$

For the specified input we have $\omega = 3$ rad/s. The magnitude is thus

$$|G(j\omega)| = \frac{4}{\sqrt{3^2 + 1}} = 1.3$$

and the phase is given by $\tan \phi = -3$. Thus $\phi = -72^\circ$. This is the phase angle between the input and the output. Thus the output is $2.6 \sin(3t - 12^\circ)$.

12.3.1 Frequency response for a second-order system

Consider a second-order system with the transfer function (see Section 11.3)

$$G(s) = \frac{\omega_n^2}{s^2 + 2\zeta\omega_n s + \omega_n^2}$$

where ω_n is the natural angular frequency and ζ the damping ratio. The frequency-response function is obtained by replacing s by $j\omega$. Thus

$$\begin{aligned} G(j\omega) &= \frac{\omega_n^2}{-\omega^2 + j2\zeta\omega\omega_n + \omega_n^2} = \frac{\omega_n^2}{(\omega_n^2 - \omega^2) + j2\zeta\omega\omega_n} \\ &= \frac{1}{\left[1 - \left(\frac{\omega}{\omega_n}\right)^2\right] + j2\zeta\left(\frac{\omega}{\omega_n}\right)} \end{aligned}$$

Multiplying the top and bottom of the expression by

$$\left[1 - \left(\frac{\omega}{\omega_n} \right)^2 \right] - j2\zeta \left(\frac{\omega}{\omega_n} \right)$$

gives

$$G(j\omega) = \frac{\left[1 - \left(\frac{\omega}{\omega_n} \right)^2 \right] - j2\zeta \left(\frac{\omega}{\omega_n} \right)}{\left[1 - \left(\frac{\omega}{\omega_n} \right)^2 \right]^2 + \left[2\zeta \left(\frac{\omega}{\omega_n} \right) \right]^2}$$

This is of the form $x + jy$ and so, since $G(j\omega)$ is the output phasor divided by the input phasor, we have the size or magnitude of the output phasor bigger than that of the input phasor by a factor which is given by $\sqrt{(x^2 + y^2)}$ as

$$|G(j\omega)| = \frac{1}{\sqrt{\left[1 - \left(\frac{\omega}{\omega_n} \right)^2 \right]^2 + \left[2\zeta \left(\frac{\omega}{\omega_n} \right) \right]^2}}$$

The phase ϕ difference between the input and output is given by $\tan \phi = x/y$ and so

$$\tan \phi = - \frac{2\zeta \left(\frac{\omega}{\omega_n} \right)}{1 - \left(\frac{\omega}{\omega_n} \right)^2}$$

The minus sign is because the output phase lags behind the input.

12.4 Bode plots

The frequency response of a system is the set of values of the magnitude $|G(j\omega)|$ and phase angle ϕ that occur when a sinusoidal input signal is varied over a range of frequencies. This can be expressed as two graphs, one of the magnitude $|G(j\omega)|$ plotted against the angular frequency ω and the other of the phase ϕ plotted against ω . The magnitude and angular frequency are plotted using logarithmic scales. Such a pair of graphs is referred to as a *Bode plot*.

The magnitude is expressed in decibel units (dB).

$$|G(j\omega)| \text{ in dB} = 20 \lg_{10} |G(j\omega)|$$

Thus, for example, a magnitude of 20 dB means that

$$20 = 20 \lg_{10} |G(j\omega)|$$

so $1 = \lg_{10} |G(j\omega)|$ and $10^1 = |G(j\omega)|$. Thus a magnitude of 20 dB means the magnitude is 10, therefore the amplitude of the output is 10 times that of the input. A magnitude of 40 dB would mean a magnitude of 100 and so the amplitude of the output is 100 times that of the input.

12.4.1 Examples of Bode plots

Consider the Bode plot for a system having the transfer function $G(s) = K$, where K is a constant. The frequency-response function is thus $G(j\omega) = K$. The magnitude $|G(j\omega)| = K$ and so, in decibels, $|G(j\omega)| = 20 \lg K$. The magnitude plot is thus a line of constant magnitude, changing K merely shifts the magnitude line up or down by a certain number of decibels. The phase is zero. Figure 12.3 shows the Bode plot.

Consider the Bode plot for a system having a transfer function $G(s) = 1/s$. The frequency-response function $G(j\omega)$ is thus $1/j\omega$. Multiplying this by j/j gives $G(j\omega) = -j/\omega$. The magnitude $|G(j\omega)|$ is thus $1/\omega$. In decibels this is $20 \lg (1/\omega) = -20 \lg \omega$. When $\omega = 1$ rad/s the magnitude is 0. When $\omega = 10$ rad/s it is -20 dB. When $\omega = 100$ rad/s it is -40 dB. For each tenfold increase in angular frequency the magnitude drops by -20 dB. The magnitude plot is thus a straight line of slope -20 dB per decade of frequency which passes through 0 dB at $\omega = 1$ rad/s. The phase of such a system is given by

$$\tan \phi = \frac{-\frac{1}{\omega}}{0} = -\infty$$

Hence $\phi = -90^\circ$ for all frequencies. Figure 12.4 shows the Bode plot.

Consider the Bode plot for a first-order system for which the transfer function is given by

$$G(s) = \frac{1}{\tau s + 1}$$

The frequency-response function is then

$$G(j\omega) = \frac{1}{j\omega\tau + 1}$$

The magnitude (see Section 12.2.1) is then

$$|G(j\omega)| = \frac{1}{\sqrt{1 + \omega^2\tau^2}}$$

In decibels this is

$$20 \lg \left(\frac{1}{\sqrt{1 + \omega^2\tau^2}} \right)$$

When $\omega \ll 1/\tau$ then $\omega^2\tau^2$ is negligible compared with 1 and so the magnitude is $20 \lg 1 = 0$ dB. Hence at low frequencies there is a straight line magnitude plot at a constant value of 0 dB. For higher frequencies, when $\omega \gg 1/\tau$, $\omega^2\tau^2$ is much greater than 1 and so the 1 can be neglected. The magnitude is then $20 \lg$

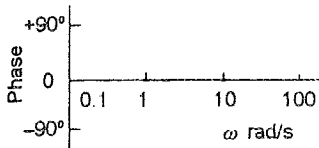
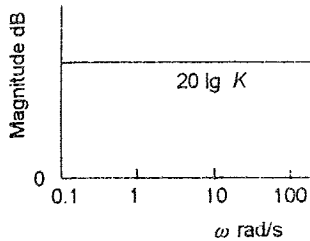


Fig. 12.3 Bode plot for $G(s) = K$

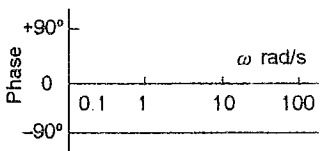
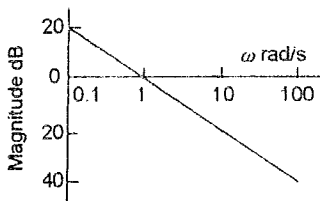


Fig. 12.4 Bode plot for $G(s) = 1/s$

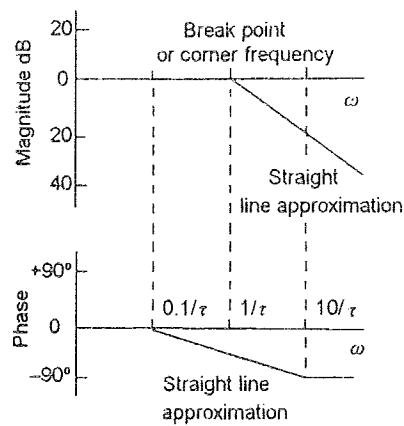


Fig. 12.5 Bode plot for first-order system

$(1/\omega\tau)$, i.e. $-20 \lg \omega\tau$. This is a straight line of slope -20 dB per decade of frequency which intersects the 0 dB line when $\omega\tau = 1$, i.e. when $\omega = 1/\tau$. Figure 12.5 shows these lines for low and high frequencies with their intersection, or so-called *break point* or *corner frequency*, at $\omega = 1/\tau$. The two straight lines are called the asymptotic approximation to the true plot. The true plot rounds off the intersection of the two lines. The difference between the true plot and the approximation is a maximum of 3 dB at the break point.

The phase for the first-order system (see Section 12.2.1) is given by $\tan \phi = -\omega\tau$. At low frequencies, when ω is less than about $0.1/\tau$, the phase is virtually 0° . At high frequencies, when ω is more than about $10/\tau$, the phase is virtually -90° . Between these two extremes the phase angle can be considered to give a reasonable straight line on the Bode plot (Fig. 12.5). The maximum error in assuming a straight line is 5.5° .

Consider a second-order system with a transfer function of

$$G(s) = \frac{\omega_n^2}{s^2 + 2\zeta\omega_n s + \omega_n^2}$$

The frequency-response function is obtained by replacing s by $j\omega$.

$$G(j\omega) = \frac{\omega_n^2}{-\omega^2 + j2\zeta\omega_n\omega + \omega_n^2}$$

The magnitude is then (see Section 12.2.2)

$$|G(j\omega)| = \frac{1}{\sqrt{\left[1 - \left(\frac{\omega}{\omega_n}\right)^2\right]^2 + \left[2\zeta\left(\frac{\omega}{\omega_n}\right)\right]^2}}$$

Thus, in decibels, the magnitude is

$$\begin{aligned} 20 \lg \frac{1}{\sqrt{\left[1 - \left(\frac{\omega}{\omega_n}\right)^2\right]^2 + \left[2\zeta\left(\frac{\omega}{\omega_n}\right)\right]^2}} \\ = -20 \lg \sqrt{\left[1 - \left(\frac{\omega}{\omega_n}\right)^2\right]^2 + \left[2\zeta\left(\frac{\omega}{\omega_n}\right)\right]^2} \end{aligned}$$

For $(\omega/\omega_n) \ll 1$ the magnitude approximates to $-20 \lg 1$ or 0 dB and for $(\omega/\omega_n) \gg 1$ the magnitude approximates to $-20 \lg (\omega/\omega_n)^2$. Thus when ω increases by a factor of 10 the magnitude increases by a factor of $-20 \lg 100$ or -40 dB. Thus at low frequencies the magnitude plot is a straight line at 0 dB, while at high frequencies it is a straight line of -40 dB per decade of frequency. The intersection of these two lines, i.e. the break point, is at $\omega = \omega_n$. The magnitude plot is thus approximately given by

these two asymptotic lines. The true value, however, depends on the damping ratio ζ . Figure 12.6 shows the two asymptotic lines and the true plots for a number of damping ratios.

The phase is given by (see Section 12.2.2)

$$\tan \phi = -\frac{2\zeta\left(\frac{\omega}{\omega_n}\right)}{1 - \left(\frac{\omega}{\omega_n}\right)^2}$$

For $(\omega/\omega_n) \ll 1$, e.g. $(\omega/\omega_n) = 0.2$, then $\tan \phi$ is approximately 0 and so $\phi = 0^\circ$. For $(\omega/\omega_n) \gg 1$, e.g. $(\omega/\omega_n) = 5$, $\tan \phi$ is approximately $-\infty$ and so $\phi = -180^\circ$. When $\omega = \omega_n$ then we have $\tan \phi = -\infty$ and so $\phi = -90^\circ$. A reasonable approximation is given by a straight line drawn through -90° at $\omega = \omega_n$ and the points 0° at $(\omega/\omega_n) = 0.2$ and -180° at $(\omega/\omega_n) = 5$. Figure 12.6 shows the graph.

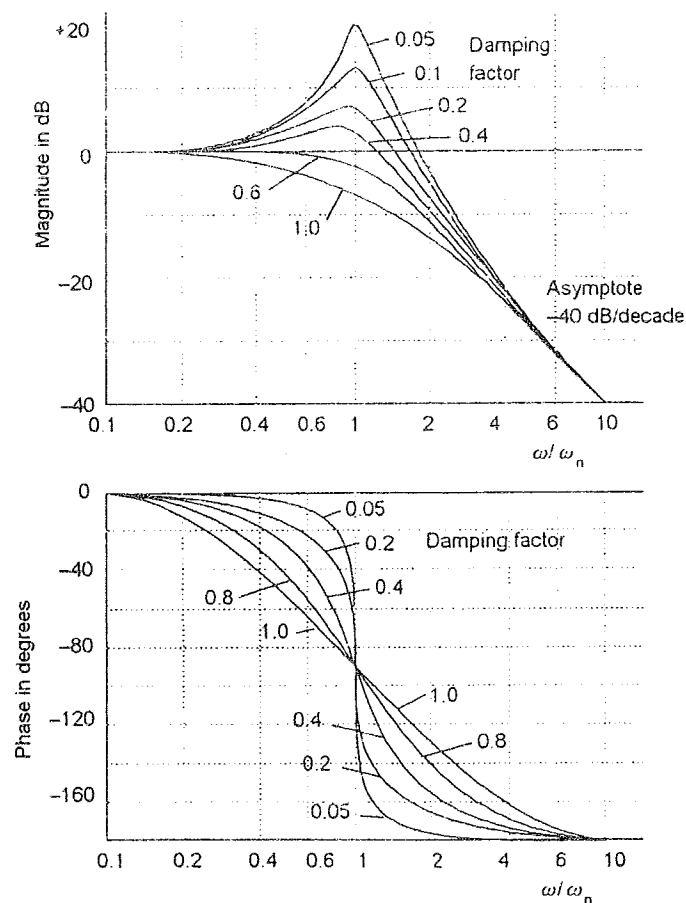


Fig. 12.6 Bode plot for a second-order system

12.4.2 Building up Bode plots

Consider a system involving a number of elements in series. The transfer function of the system as a whole is given by (see Section 11.4)

$$G(s) = G_1(s)G_2(s)G_3(s) \dots \text{etc.}$$

Hence the frequency-response function for a two-element system, when s is replaced by $j\omega$, is

$$G(j\omega) = G_1(j\omega)G_2(j\omega)$$

We can write the transfer function $G_i(j\omega)$ as a complex number (see Section 12.2), i.e.

$$x + jy = |G_1(j\omega)| (\cos \phi_1 + j \sin \phi_1)$$

where $|G(j\omega)|$ is the magnitude and ϕ , the phase of the frequency-response function. Similarly we can write $G_2(j\omega)$ as

$$|G_2(j\omega)| (\cos \phi_2 + j \sin \phi_2)$$

Thus

$$\begin{aligned} G(j\omega) &= |G_1(j\omega)| (\cos \phi_1 + j \sin \phi_1) \\ &\quad \times |G_2(j\omega)| (\cos \phi_2 + j \sin \phi_2) \\ &= |G_1(j\omega)| |G_2(j\omega)| [\cos \phi_1 \cos \phi_2 \\ &\quad + j(\sin \phi_1 \cos \phi_2 + \cos \phi_1 \sin \phi_2) + j^2 \sin \phi_1 \sin \phi_2] \end{aligned}$$

But $j^2 = -1$ and, since $\cos \phi_1 \cos \phi_2 - \sin \phi_1 \sin \phi_2 = \cos (\phi_1 + \phi_2)$ and $\sin \phi_1 \cos \phi_2 + \cos \phi_1 \sin \phi_2 = \sin (\phi_1 + \phi_2)$, thus

$$G(j\omega) = |G_1(j\omega)| |G_2(j\omega)| [\cos (\phi_1 + \phi_2) + j \sin (\phi_1 + \phi_2)]$$

The frequency-response function of the system has a magnitude which is the product of the magnitudes of the separate elements and a phase which is the sum of the phases of the separate elements, i.e.

$$|G(j\omega)| = |G_1(j\omega)| |G_2(j\omega)| |G_3(j\omega)| \dots \text{etc.}$$

$$\phi = \phi_1 + \phi_2 + \phi_3 + \dots \text{etc.}$$

Now, considering the Bode plot where the logarithms of the magnitudes are plotted,

$$\lg |G(j\omega)| = \lg |G_1(j\omega)| + \lg |G_2(j\omega)| + \lg |G_3(j\omega)| + \dots \text{etc.}$$

Thus we can obtain the Bode plot of a system by adding together the Bode plots of the magnitudes of the constituent elements. Likewise the phase plot is obtained by adding together the phases of the constituent elements.

By using a number of basic elements, the Bode plots for a wide range of systems can be readily obtained. The basic elements used are:

- 1 $G(s) = K$
This gives the Bode plot shown in Figure 12.3.
- 2 $G(s) = 1/s$
This gives the Bode plot shown in Figure 12.4.
- 3 $G(s) = s$
This gives a Bode plot which is a mirror image of that in Figure 12.4. $|G(j\omega)| = 20$ dB per decade of frequency, passing through 0 dB at $\omega = 1$ rad/s. ϕ is constant at 90° .
- 4 $G(s) = 1/(\tau s + 1)$
This gives the Bode plot shown in Figure 12.5.
- 5 $G(s) = \tau s + 1$
This gives a Bode plot which is a mirror image of that in Figure 12.5. For the magnitude plot, the break point is at $1/\tau$ with the line prior to it being at 0 dB and after it at a slope of 20 dB per decade of frequency. The phase is zero at $0.1/\tau$ and rises to $+90^\circ$ at $10/\tau$.
- 6 $G(s) = \omega_n^2/(s^2 + 2\zeta\omega_n s + \omega_n^2)$
This gives the Bode plot shown in Figure 12.6.
- 7 $G(s) = (s^2 + 2\zeta\omega_n s + \omega_n^2)/\omega_n^2$
This gives a Bode plot which is a mirror image of that in Figure 12.6.

To illustrate the above, consider the drawing of the asymptotes of the Bode plot for a system having a transfer function of

$$G(s) = \frac{10}{2s + 1}$$

The transfer function is made up of two elements, one with a transfer function of 10 and one with transfer function $1/(2s + 1)$. The Bode plots can be drawn for each of these and then added together to give the required plot. The Bode plot for transfer function 10 will be of the form given in Figure 12.3 with $K = 10$ and that for $1/(2s + 1)$ like that given in Figure 12.5 with $\tau = 2$. The result is shown in Figure 12.7.

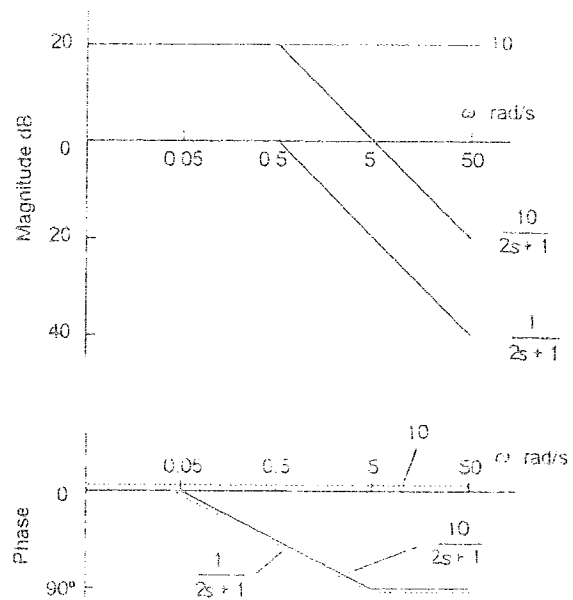


Fig. 12.7 Building up a Bode diagram

As another example consider the drawing of the asymptotes of the Bode plot for a system having a transfer function of

$$G(s) = \frac{2.5}{s(s^2 + 3s + 25)}$$

The transfer function is made up of three components, one with a transfer function of 0.1, one with transfer function $1/s$ and one with transfer function $25/(s^2 + 3s + 25)$. The transfer function of 0.1 will give a Bode plot like that of Figure 12.3 with $K = 0.1$. The transfer function of $1/s$ will give a Bode plot like that of Figure 12.4. The transfer function of $25/(s^2 + 3s + 25)$ can be represented as $\omega_n^2/(s^2 + 2\zeta\omega_n s + \omega_n^2)$ with $\omega_n = 5$ rad/s and $\zeta = 0.3$. The break point will be when $\omega = \omega_n = 5$ rad/s. The asymptote for the phase passes through -90° at the break point, and is 0° when we have $(\omega/\omega_n) = 0.2$ and -180° when $(\omega/\omega_n) = 5$. Figure 12.8 shows the resulting Bode plot.

12.4.3 Bode plots with MATLAB

MATLAB can be used to produce Bode plots (see Section 11.7 for a preliminary discussion of MATLAB). To carry out a Bode plot of a system described by a transfer function $4/(s^2 + 2s + 3)$ the program is:

```
% Generate Bode plot for G(s)=4/(s^2 + 2s + 3)
num=4;
```

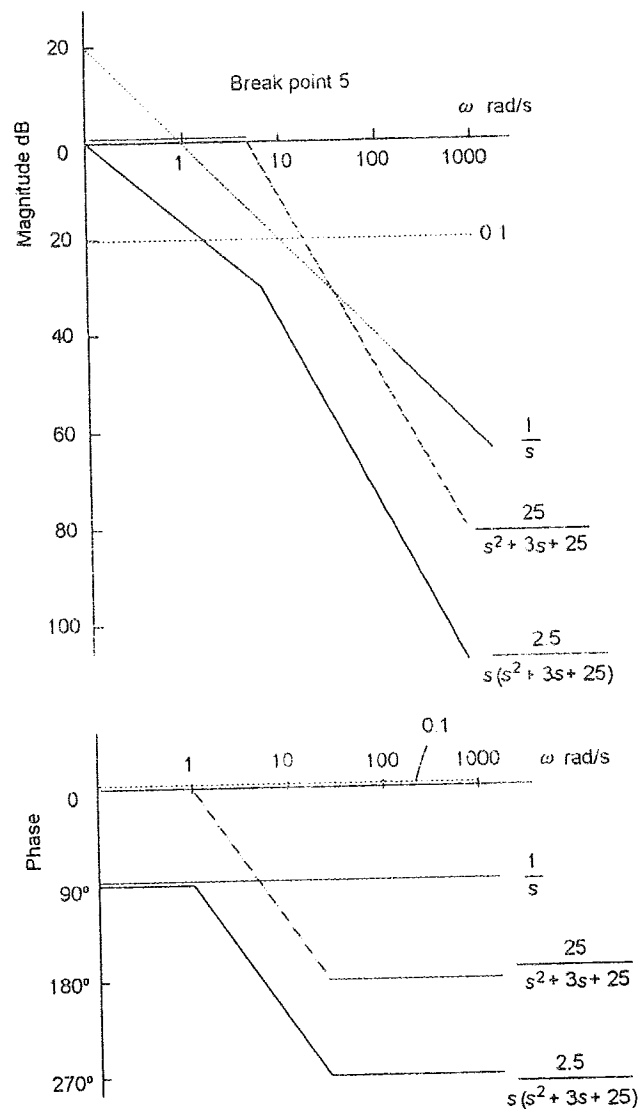


Fig. 12.8 Building up a Bode diagram

```
den=[1 2 3];
bode(num,den)
```

The command `bode(num,den)` produces the Bode plot of gain in dB against frequency in rad/s on a log scale, and phase in degrees against frequency in rad/s on a log scale.

12.4.4 System identification

If we experimentally determine the Bode diagram for a system by considering its response to a sinusoidal input, then we can obtain

the transfer function for the system. Basically we draw the asymptotes on the magnitude Bode plot and consider their gradients. The phase angle curve is used to check the results obtained from the magnitude analysis.

- 1 If the gradient at low frequencies prior to the first corner frequency is zero then there is no s or $1/s$ element in the transfer function. The K element in the numerator of the transfer function can be obtained from the value of the low frequency magnitude; the magnitude in dB = $20 \lg K$.
- 2 If the initial gradient at low frequencies is -20 dB/decade then the transfer function has a $1/s$ element.
- 3 If the gradient becomes more negative at a corner frequency by 20 dB/decade, there is a $(1 + s/\omega_c)$ term in the denominator of the transfer function, with ω_c being the corner frequency at which the change occurs. Such terms can occur for more than one corner frequency.
- 4 If the gradient becomes more positive at a corner frequency by 20 dB/decade, there is a $(1 + s/\omega_c)$ term in the numerator of the transfer function, with ω_c being the frequency at which the change occurs. Such terms can occur for more than one corner frequency.
- 5 If the gradient at a corner frequency becomes more negative by 40 dB/decade, there is a $(s^2/\omega_c^2 + 2\zeta s/\omega_c + 1)$ term in the denominator of the transfer function. The damping ratio ζ can be found by considering the detail of the Bode plot at a corner frequency, as in Figure 12.6.
- 6 If the gradient at a corner frequency becomes more positive by 40 dB/decade, there is a $(s^2/\omega_c^2 + 2\zeta s/\omega_c + 1)$ term in the numerator of the transfer function. The damping ratio ζ can be found by considering the detail of the Bode plot at a corner frequency, as in Figure 12.6.
- 7 If the low-frequency gradient is not zero, the K term in the numerator of the transfer function can be determined by considering the value of the low-frequency asymptote. At low frequencies, many terms in transfer functions can be neglected and the gain in dB approximates to $20 \lg (K/\omega^2)$. Thus, at $\omega = 1$ the gain in dB approximates to $20 \lg K$.

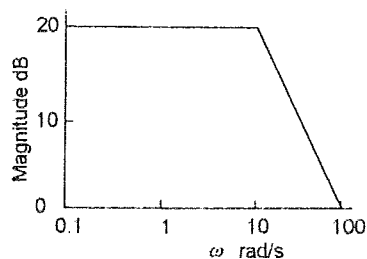


Fig. 12.9 Bode plot

As an illustration of the above, consider the Bode magnitude plot shown in Figure 12.9. The initial gradient is 0 and so there is no $1/s$ or s term in the transfer function. The initial gain is 20 and so $20 = 20 \lg K$ and $K = 10$. The gradient changes by -20 dB/decade at a frequency of 10 rad/s. Hence there is a $(1 + s/10)$

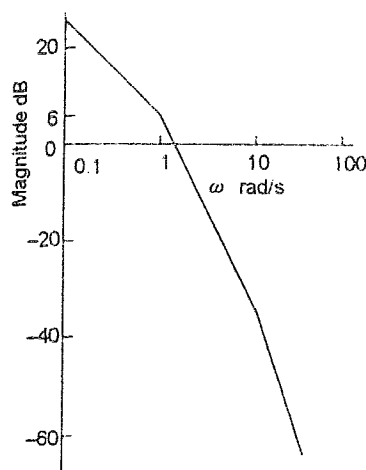


Fig. 12.10 Bode plot

term in the denominator. The transfer function is thus $10/(1 + 0.1s)$.

As a further illustration, consider Figure 12.10. There is an initial slope of -20 dB/decade and so a $1/s$ term. At the corner frequency 1.0 rad/s there is a -20 dB/decade change in gradient and so a $1/(1 + s/1)$ term. At the corner frequency 10 rad/s there is a further -20 dB/decade change in gradient and so a $1/(1 + s/10)$ term. At $\omega = 1$ the magnitude is 6 dB and so $6 = 20 \lg K$ and $K = 10^{6/20} = 2.0$. The transfer function is thus $2.0/s(1 + s)(1 + 0.1s)$.

As a further illustration, Figure 12.11 shows a Bode plot which has an initial zero gradient which changes by -40 dB/decade at 10 rad/s. The initial magnitude is 10 dB and so $10 = 20 \lg K$ and $K = 10^{10/20} = 3.2$. The change of -40 dB/decade at 10 rad/s means there is $(s^2/10^2 + 2\zeta s/10 + 1)$ term in the denominator. The transfer function is thus $3.2/(0.01s^2 + 0.2\zeta s + 1)$. The damping factor can be obtained by comparison of the Bode plot at the corner frequencies with Figure 12.6. It rises by about 6 dB above the corner and this corresponds to a damping factor of about 0.2 . The transfer function is thus $3.2/(0.01s^2 + 0.04s + 1)$.

12.5 Performance specifications

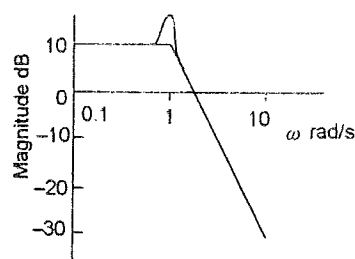


Fig. 12.11 Bode plot

The terms used to describe the performance of a system when subject to a sinusoidal input are peak resonance and bandwidth. The *peak resonance* M_p is defined as being the maximum value of the magnitude (Fig. 12.12). A large value of the peak resonance corresponds to a large value of the maximum overshoot of a system. For a second-order system it can be directly related to the damping ratio by comparison of the response with the Bode plot of Figure 12.6, a low damping ratio corresponding to a high peak resonance.

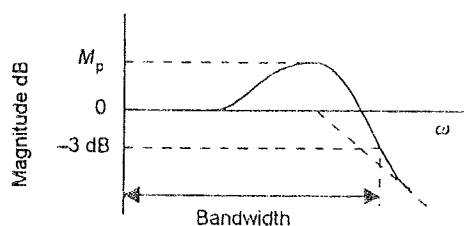


Fig. 12.12 Performance specifications

The *bandwidth* is defined as the frequency band between which the magnitude does not fall below -3 dB. For the system giving the Bode plot in Figure 12.12, the bandwidth is the spread between zero frequency and the frequency at which the magnitude drops below -3 dB.

12.6 Stability

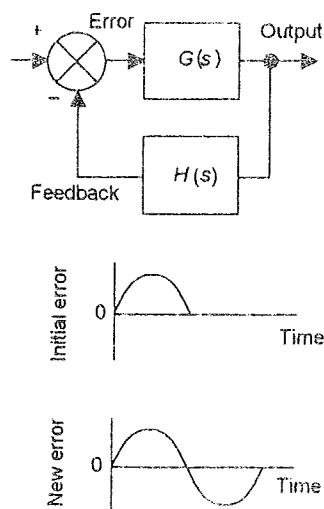


Fig. 12.13 Self-sustaining oscillations

When there is a sinusoidal input to a system, the output from that system is sinusoidal with the same angular frequency but can have an output with an amplitude and phase which differ from that of the input. Consider a closed-loop system with negative feedback (Fig. 12.13) and no input to the system. Suppose, somehow, we have a half-rectified sinusoidal pulse as the error signal in the system and that it passes through to the output and is fed back to arrive at the comparator element with amplitude unchanged but delayed by just half a cycle, i.e. a phase change of 180° as shown in the figure. When this signal is subtracted from the input signal we have a resulting error signal which just continues the initial half-rectified pulse. This pulse then goes back round the feedback loop and once again arrives just in time to continue the signal. Thus we have a self-sustaining oscillation.

For self-sustained oscillations to occur we must have a system which has a frequency-response function with a magnitude of 1 and a phase of -180° . The system through which the signal passes is $G(s)$ in series with $H(s)$. If the magnitude is less than 1 then each succeeding half-wave pulse is smaller in size and so the oscillation dies away. If the magnitude is greater than 1 then each succeeding pulse is larger than the previous one and so the wave builds up and the system is unstable.

- 1 A control system will oscillate with a constant amplitude if the magnitude resulting from the system $G(s)$ in series with $H(s)$ is 1 and the phase is -180° .
- 2 A control system will oscillate with a diminishing amplitude if the magnitude resulting from the system $G(s)$ in series with $H(s)$ is less than 1 and the phase is -180° .
- 3 A control system will oscillate with an increasing amplitude, and so is unstable, if the magnitude resulting from the system $G(s)$ in series with $H(s)$ is greater than 1 and the phase is -180° .

A good, stable control system usually requires that the magnitude of $G(s)H(s)$ should be significantly less than 1. Typically a value between 0.4 and 0.5 is used. In addition, the phase angle should be between about -115° and -125° . Such values produce a slightly under-damped control system which gives, with a step input, about a 20 to 30% overshoot with a subsidence ratio of about 3 to 1 (see Section 10.4 for an explanation of these terms).

A concern with a control system is how stable it is and thus not likely to oscillate as a result of some small disturbance. The term *gain margin* is used for the factor by which the magnitude ratio must be multiplied when the phase is -180° to make it have the value 1 and so give instability. The term *phase margin* is used for

the number of degrees by which the phase angle is numerically smaller than -180° when the magnitude is 1. These rules mean a gain margin of between 2 and 2.5 and a phase margin between 45° and 65° for a good, stable control system.

Problems

- 1 What are the magnitudes and phases of the systems having the following transfer functions?

(a) $\frac{5}{s+2}$, (b) $\frac{2}{s(s+1)}$, (c) $\frac{1}{(2s+1)(s^2+s+1)}$

- 2 What will be the steady-state response of a system with a transfer function $1/(s+2)$ when subject to the sinusoidal input $3 \sin(5t + 30^\circ)$?
- 3 What will be the steady-state response of a system with a transfer function $5/(s^2 + 3s + 10)$ when subject to the input $2 \sin(2t + 70^\circ)$?
- 4 Determine the values of the magnitudes and phase at angular frequencies of (i) 0 rad/s, (ii) 1 rad/s, (iii) 2 rad/s, (iv) ∞ rad/s for systems with the transfer functions (a) $1/[s(2s+1)]$, (b) $1/(3s+1)$.
- 5 Draw Bode plot asymptotes for systems having the transfer functions (a) $10/[s(0.1s+1)]$, (b) $1/[(2s+1)(0.5s+1)]$.
- 6 Obtain the transfer functions of the systems giving the Bode plots in Figure 12.14.

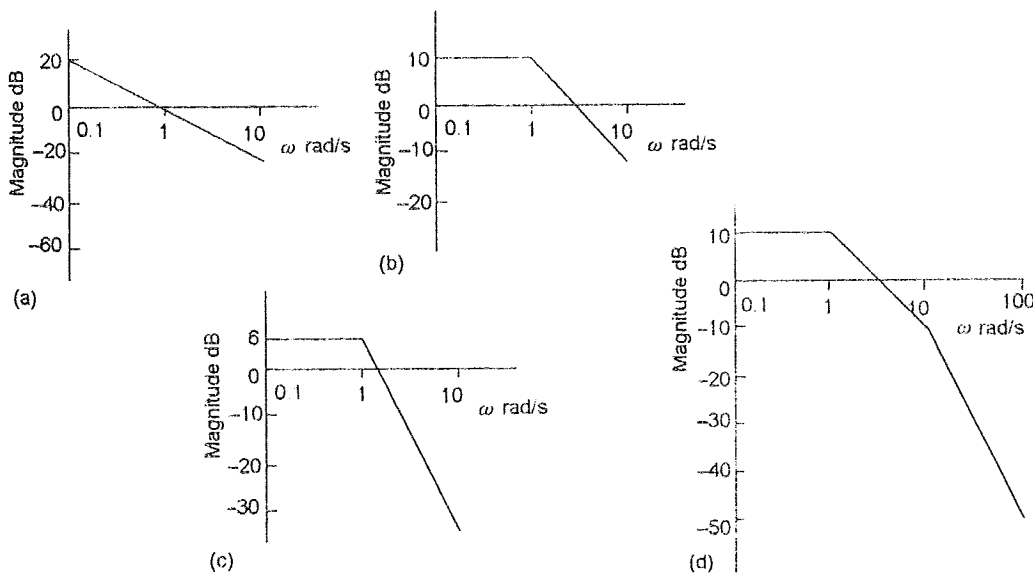


Fig. 12.14 Problem 6

13 Closed-loop controllers

13.1 Continuous and discrete processes

Open-loop control is essentially just a switch on-switch off form of control, e.g. an electric fire is either switched on or off in order to heat a room. With closed-loop control systems, a controller is used to compare the output of a system with the required condition and convert the error into a control action designed to reduce the error. The error might arise as a result of some change in the conditions being controlled or because the set value is changed, e.g. there is a step input to the system to change the set value to a new value. In this chapter we are concerned with the ways in which controllers can react to error signals, i.e. the *control modes* as they are termed, which occur with continuous processes. Such controllers might, for example, be pneumatic systems or operational amplifier systems. However, computer systems are rapidly replacing many of these. The term *direct digital control* is used when the computer is in the feedback loop and exercising control in this way. This chapter is about closed-loop control.

Many processes not only involve controlling some variable, e.g. temperature, to a required value but also involve the sequencing of operations. A domestic washing machine (see Section 1.4.3) where a number of actions have to be carried out in a predetermined sequence is an example. Another example is the manufacture of a product which involves the assembly of a number of discrete parts in a specific sequence by some controlled system. The sequence of operations might be *clock-based* or *event-based* or a combination of the two. With a clock-based system the actions are carried out at specific times; with an event-based system the actions are carried out when there is feedback to indicate that a particular event has occurred.

The term *programmable logic controller* (PLC) is used for a simple controller based on a microprocessor and operates by examining the input signals from sensors and carrying out logic instructions which have been programmed into its memory. The

output after such processing is signals which feed into correcting/actuator units. Thus it can carry out sequences of operations. The main difference between a PLC and a computer is that programming is predominantly concerned with logic and switching operations, and the interfacing for input and output devices is inside the controller. Such controllers are discussed in more detail in Chapter 18.

In many processes there can be a mixture of continuous and discrete control. For example, in the domestic washing machine there will be sequence control for the various parts of the washing cycle with feedback loop control of the temperature of the hot water and the level of the water.

13.1.1 Lag

In any control system there are lags. Thus, for example, a change in the condition being controlled does not immediately produce a correcting response from the control system. This is because time is required for the system to make the necessary responses. For example, in the control of the temperature in a room by means of a central heating system, a lag will occur between the room temperature falling below the required temperature and the control system responding and switching on the heater. This is not the only lag. Even when the control system has responded there is a lag in the room temperature responding as time is taken for the heat to transfer from the heater to the air in the room.

13.1.2 Steady-state error

We might get an error signal to the controller occurring as a result of the controlled variable changing or a change in the set value input. For example, we might have a ramp input to the system with the aim that the controlled variable increases steadily with time. The term *steady-state error* is used for the difference between the set value input and the output after all transients have died away. It is thus a measure of the accuracy of the control system in tracking the set value input.

Consider a control system which has unity feedback (Fig. 13.1). When there is a reference input of $R(s)$ there is an output of $X(s)$. The feedback signal is $X(s)$ and so the error signal is $E(s) = R(s) - X(s)$. If $G(s)$ is the forward-path transfer function, then for the unity feedback system as a whole:

$$\frac{X(s)}{R(s)} = \frac{G(s)}{1 + G(s)H(s)} = \frac{G(s)}{1 + G(s)}$$

Hence

$$E(s) = R(s) - X(s) = R(s) - \frac{G(s)R(s)}{1 + G(s)} = \frac{1}{1 + G(s)}R(s)$$

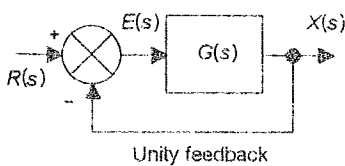


Fig. 13.1 Unity feedback system

The error thus depends on $G(s)$.

In order to determine the steady-state error we can determine the error e as a function of time and then determine the value of the error when all transients have died down and so the error as the time t tends to an infinite value. While we could determine the inverse of $E(s)$ and then determine its value when $t \rightarrow \infty$, there is a simpler method using the *final-value theorem* (see Appendix A); this involves finding the value of $sE(s)$ as s tends to a zero value.

$$e_{ss} = \lim_{t \rightarrow \infty} e(t) = \lim_{s \rightarrow 0} sE(s)$$

To illustrate the above, consider a unity feedback system with a forward-path transfer function of $k/(cs + 1)$ and subject to a unit step input of $1/s$

$$e_{ss} = \lim_{s \rightarrow 0} sE(s) = \lim_{s \rightarrow 0} \left[s \frac{1}{1 + k/(cs + 1)} \frac{1}{s} \right] = \frac{1}{1 + k}$$

There is thus a steady-state error, the output from the system will never attain the set value. By increasing the gain k of the system then the steady-state error can be reduced.

However, if the unity-feedback system had a forward-path transfer function of $k/s(cs + 1)$ and was subject to a step input, then the steady-state error would be

$$e_{ss} = \lim_{s \rightarrow 0} sE(s) = \lim_{s \rightarrow 0} \left[s \frac{1}{1 + k/s(cs + 1)} \frac{1}{s} \right] = 0$$

There is no steady-state error with this system.

13.2 Control modes

There are a number of ways by which a control unit can react to an error signal and supply an output for correcting elements.

- 1 The *two-step mode* in which the controller is essentially just a switch which is activated by the error signal and supplies just an on-off correcting signal.
- 2 The *proportional mode* (P) which produces a control action that is proportional to the error. The correcting signal thus becomes bigger the bigger the error. Thus as the error is reduced the amount of correction is reduced and the correcting process slows down.
- 3 The *derivative mode* (D) which produces a control action that is proportional to the rate at which the error is changing. When there is a sudden change in the error signal the controller gives a large correcting signal, when there is a gradual change only a small correcting signal is produced.

Derivative control can be considered to be a form of anticipatory control in that the existing rate of change of error is measured, a coming larger error is anticipated and correction applied before the larger error has arrived. Derivative control is not used alone but always in conjunction with proportional control and, often, integral control.

- 4 The *integral mode* (I) which produces a control action that is proportional to the integral of the error with time. Thus a constant error signal will produce an increasing correcting signal. The correction continues to increase as long the error persists. The integral controller can be considered to be 'looking-back', summing all the errors and thus responding to changes that have occurred.
- 5 Combinations of modes: proportional plus derivative modes (PD), proportional plus integral modes (PI), proportional plus integral plus derivative modes (PID). The term *three-term controller* is used for PID control.

These five modes of control are discussed in the following sections of the chapter. The controller can achieve these modes by means of pneumatic circuits, analogue electronic circuits involving operational amplifiers or by the programming of a microprocessor or computer.

13.3 Two-step mode

An example of the *two-step mode* of control is the bimetallic thermostat (see Fig. 2.49) that might be used with a simple temperature control system. This is just a switch which is switched on or off according to the temperature. If the room temperature is above the required temperature then the bimetallic strip is in an off position and the heater is off. If the room temperature falls below the required temperature then the bimetallic strip moves into an on position and the heater is switched fully on. The controller in this case can be in only two positions, on or off, as indicated by Figure 13.2.

With the two-step mode the control action is discontinuous. A consequence of this is that oscillations of the controlled variable occur about the required condition. This is because of lags in the time the control system and the process take to respond. For example, in the case of the temperature control for a domestic central heating system, when the room temperature drops below the required level the time that elapses before the control system responds and switches the heater on might be very small in comparison with the time that elapses before the heater begins to have an effect on the room temperature. In the meantime the temperature has fallen even more. The reverse situation occurs when the temperature has risen to the required temperature. Since time elapses before the control system reacts and switches the

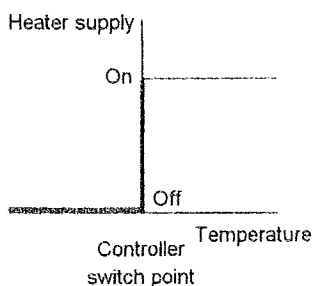


Fig. 13.2 Two-step control

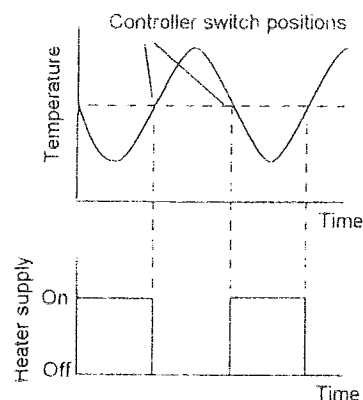


Fig. 13.3 Oscillations with two-step control

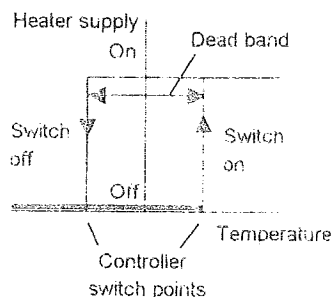


Fig. 13.4 Two-step control with two controller switch points

13.4 Proportional mode

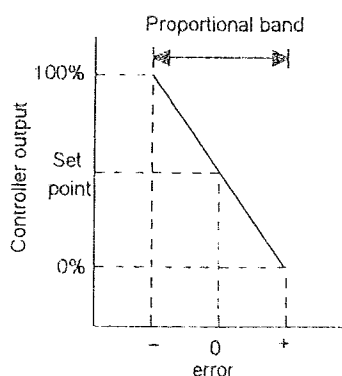


Fig. 13.5 Proportional band

heater off, and yet more time while the heater cools and stops heating the room, the room temperature goes beyond the required value. The result is that the room temperature oscillates above and below the required temperature (Fig. 13.3).

With the simple two-step system described above there is the problem that when the room temperature is hovering about the set value the thermostat might be almost continually switching on or off, reacting to very slight changes in temperature. This can be avoided if, instead of just a single temperature value at which the controller switches the heater on or off, two values are used and the heater is switched on at a lower temperature than the one at which it is switched off (Fig. 13.4). The term *dead band* is used for the values between the on and off values. A large dead band results in large fluctuations of the temperature about the set temperature, a small dead band will result in an increased frequency of switching. The bimetallic element shown in Figure 2.49 has a permanent magnet for a switch contact, this has the effect of producing a dead band.

Two-step control action tends to be used where changes are taking place very slowly, i.e. with a process with a large capacitance. Thus, in the case of heating a room, the effect of switching the heater on or off on the room temperature is only a slow change. The result of this is an oscillation with a long periodic time. Two-step control is thus not very precise, but it does involve simple devices and is thus fairly cheap. On-off control is not restricted to mechanical switches such as bimetallic strips or relays; rapid switching can be achieved with the use of thyristor circuits (see Section 7.2.2), such a circuit might be used for controlling the speed of a motor, and operational amplifiers.

With the two-step method of control, the controller output is either an on or an off signal, regardless of the magnitude of the error. With the *proportional mode*, the size of the controller output is proportional to the size of the error. This means the correction element of the control system, e.g. a valve, will receive a signal which is proportional to the size of the correction required.

Figure 13.5 shows how the output of such a controller varies with the size and sign of the error. The linear relationship between controller output and error tends to exist only over a certain range of errors, this range being called the *proportional band*. Within the proportional band the equation of the straight line can be represented by

$$\text{Change in controller output from set point} = K_P e$$

where e is the error and K_P a constant. K_P is thus the gradient of the straight line in Figure 13.5.

The controller output is generally expressed as a percentage of the full range of possible outputs within the proportional band. This output can then correspond to, say, a correction valve changing from fully closed to fully open. Similarly, the error is expressed as a percentage of the full-range value, i.e. the error range corresponding to the 0 to 100% controller output. Thus

$$\begin{aligned} &\% \text{ change in controller output from set point} \\ &= K_P \times \% \text{ change in error} \end{aligned}$$

Hence, since 100% controller output corresponds to an error percentage equal to the proportional band

$$K_P = \frac{100}{\text{proportional band}}$$

We can rewrite the equation as

$$\text{change in output} = I_{\text{out}} - I_0 = K_P e$$

where I_0 is the controller output percentage at zero error, I_{out} the output percentage at percentage error e . Thus taking Laplace transforms:

$$\text{Change in output } (s) = K_P E(s)$$

and so, since

$$\text{Transfer function} = \frac{\text{change in output } (s)}{E(s)}$$

K_P is, within the proportional band, the transfer function of the controller.

Generally a 50% controller output is chosen to be the output when the error is zero. Thus, in the case of the controller being used to control a valve which allows water into a tank, when the error is zero the valve will be half (50%) open. This will give the normal flow rate. Any error will then increase or reduce the flow rate at a value which depends on the size of the error. The result will be to return the error to its zero value and the controller to a 50% output. Suppose the process has the flow of liquid into a tank being controlled and for some reason a new set point is required for the flow rate. We can talk of this change in terms of there being a step input to the control system. This new set value could require the correcting valve to be kept open at a higher percentage, say 60%. This cannot be achieved by the zero error setting but requires a permanent error setting called an *offset* (Fig. 13.6). The size of this offset is directly proportional to the size of the load changes and inversely proportional to the K_P , a

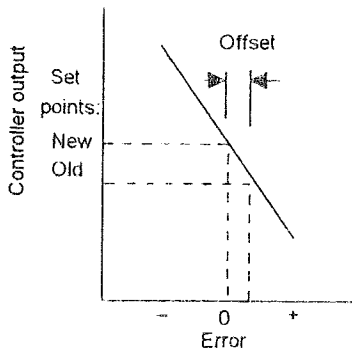


Fig. 13.6 Offset

higher value of K_p giving a steeper gradient in Figure 13.6 and so a smaller error change needed to accommodate a load change.

The proportional mode of control tends to be used in processes where the transfer function K_p can be made large enough to reduce the offset to an acceptable level. However, the larger the transfer function the greater the chance of the system oscillating and becoming unstable.

To illustrate the above discussion of proportional control, consider a proportional controller which is to be used to control the height of water in a tank where the water level can vary from zero to 9.0 m. What proportional band and transfer function will be required if the required height of water is 5.0 m and the controller is to fully close a valve when the water rises to 5.5 m and fully open it when the water falls to 4.5 m? When the error is -0.5 m the controller output must be 100% open and when $+0.5$ m it must be 0% open. The proportional band must therefore extend from a height error of -0.5 m to one of $+0.5$ m. Expressed as a percentage, the proportional band extends from

$$-(0.5/9.0) \times 100 = -5.6\% \text{ to } +(0.5/9.0) \times 100 = +5.6\%$$

The proportional band is thus 11.2%. Note that if we work in percentages for the controller, we must work in percentages for the error. This value of proportional band will thus mean a transfer function K_p of $(100\%)/(11.2\%) = 8.9$.

As an illustration of offset error, consider a proportional controller which has a transfer function of 15 and a set point of 50% output. It outputs to a valve which at the set point allows a flow of 200 m³/s. The valve changes its output by 4 m³/s for each per cent change in controller output. What will be the controller output and the offset error when the flow has to be changed to 240 m³/s? The new controller setting, as a percentage, for a flow change from 200 to 240 m³/s is $40/4 = 10\%$ change from 50 to 60%. Hence

$$K_p = 15 = \frac{60 - 50}{e}$$

Thus the offset is $e = 0.67\%$.

13.4.1 Electronic proportional controller

A summing operational amplifier with an inverter can be used as a proportional controller (Fig. 13.7). For a summing amplifier we have (see Section 3.2.3)

$$V_{\text{out}} = -R_f \left(\frac{V_0}{R_2} + \frac{V_e}{R_1} \right)$$

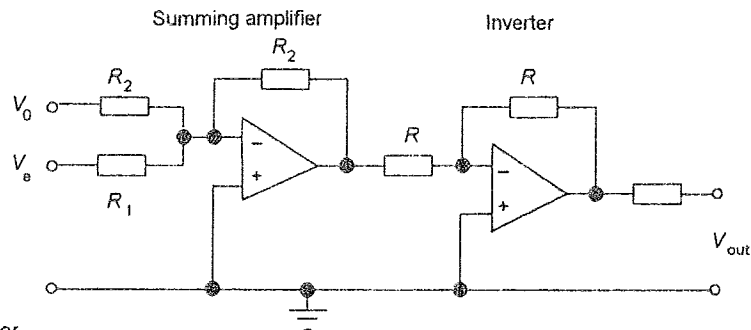


Fig. 13.7 Proportional controller

The input to the summing amplifier through R_2 is the zero error voltage value V_0 , i.e. the set value, and the input through R_1 is the error signal V_e . But when the feedback resistor $R_f = R_2$, then the equation becomes

$$V_{out} = -\frac{R_2}{R_1}V_e - V_0$$

If the output from the summing amplifier is then passed through an inverter, i.e. an operational amplifier with a feedback resistance equal to the input resistance, then

$$V_{out} = \frac{R_2}{R_1}V_e + V_0$$

$$V_{out} = K_p V_e + V_0$$

where K_p is the proportionality constant. The result is a proportional controller.

As an illustration, Figure 13.8 shows an example of a proportional control system for the control of the temperature of the liquid in a container as liquid is pumped through it.

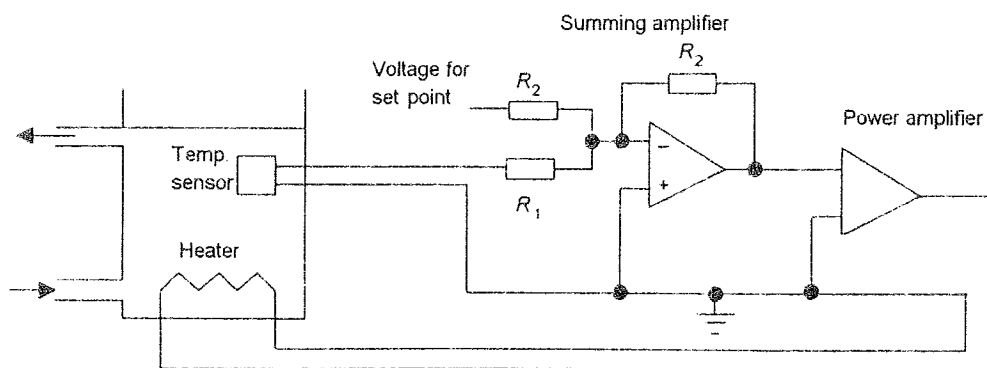


Fig. 13.8 Proportional controller for temperature control

13.4.2 System response

With proportional control we have a gain element with transfer function K_p in series with the forward-path element $G(s)$ (Fig 13.9). The error is thus:

$$E(s) = \frac{K_p G(s)}{1 + K_p G(s)} R(s)$$

and so, for a step input, the steady-state error is:

$$e_{ss} = \lim_{s \rightarrow 0} sE(s) = \lim_{s \rightarrow 0} \left[s \frac{1}{1 + 1/K_p G(s)} \frac{1}{s} \right]$$

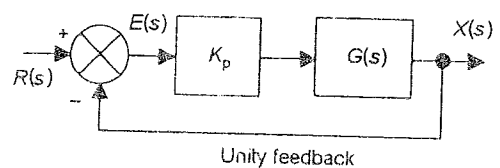


Fig. 13.9 System with proportional control

This will have a finite value and so there is always a steady-state error. Low values of K_p give large steady-state errors but stable responses. High values of K_p give smaller steady-state errors but a greater tendency to instability.

13.5 Derivative control

With the *derivative mode* of control the change in controller output from the set point value is proportional to the rate of change with time of the error signal. This can be represented by the equation

$$I_{out} - I_0 = K_D \frac{de}{dt}$$

where I_0 is the set point output value, I_{out} the output value that will occur when the error e is changing at the rate de/dt . It is usual to express these controller outputs as a percentage of the full range of output and the error as a percentage of full range. K_D is the constant of proportionality.

The transfer function is obtained by taking Laplace transforms, thus

$$(I_{out} - I_0)(s) = K_D s E(s)$$

Hence the transfer function is $K_D s$.

With derivative control, as soon as the error signal begins to change there can be quite a large controller output since it is proportional to the rate of change of the error signal and not its value. Rapid initial responses to error signals thus occur. Figure

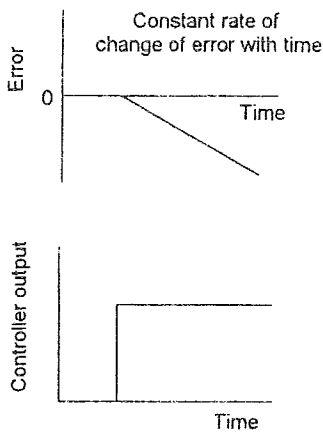


Fig. 13.10 Derivative control

13.10 shows the controller output that results when there is a constant rate of change of error signal with time. The controller output is constant because the rate of change is constant and occurs immediately the deviation occurs. Derivative controllers do not, however, respond to steady-state error signals, since with a steady error the rate of change of error with time is zero. Because of this derivative control is always combined with proportional control; the proportional part gives a response to all error signals, including steady signals, while the derivative part responds to the rate of change.

To illustrate the above, consider a derivative controller which has a set point of 50% and derivative constant K_D of 0.4 s. What will be the controller output when the error (a) changes at 1%/s, (b) is constant at 4%? Using the equation given above

$$I_{out} = K_D \frac{de}{dt} + I_0 = 0.4 \times 1 + 50 = 50.4\%$$

With de/dt zero, then I_{out} equals I_0 , i.e. 50%. The output only differs from the set point value when the error is changing.

Figure 13.11 shows the form of an electronic derivative controller circuit, the circuit involving an operational amplifier connected as a differentiator circuit followed by another operational amplifier connected as an inverter. The derivative time K_D is R_2C .

13.5.1 Proportional plus derivative control

Derivative control is never used alone because it is not capable of giving an output when there is a steady error signal and so no correction is possible. It is thus invariably used in conjunction with proportional control so that this problem can be resolved.

With proportional plus derivative control the change in controller output from the set point value is given by

$$\text{Change in output from set point} = K_P e + K_D \frac{de}{dt}$$

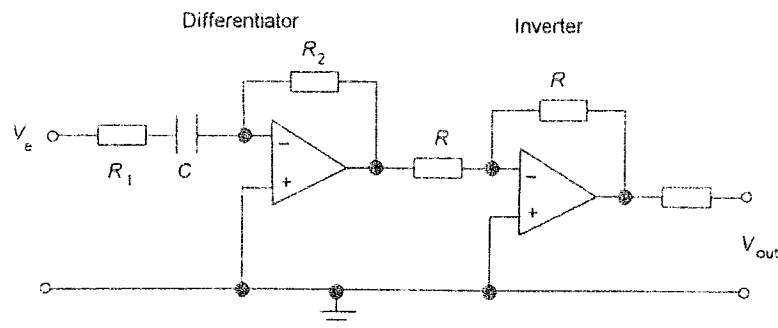


Fig. 13.11 Derivative controller

Hence

$$I_{\text{out}} = K_P e + K_D \frac{de}{dt} + I_0$$

where I_0 is the output at the set point, I_{out} the output when the error is e , K_P is the proportionality constant and K_D the derivative constant, de/dt is the rate of change of error. The system has a transfer function given by

$$(I_{\text{out}} - I_0)(s) = K_P E(s) + K_D s E(s)$$

Hence the transfer function is $K_P + K_D s$. This is often written as:

$$\text{transfer function} = K_D \left(s + \frac{1}{T_D} \right)$$

where $T_D = K_D/K_P$ and is the *derivative time constant*.

Figure 13.12 shows how the controller output can vary when there is a constantly changing error. There is an initial quick change in controller output because of the derivative action followed by the gradual change due to proportional action. This form of control can thus deal with fast process changes; however, a change in set value will require an offset error (see earlier discussion of proportional control).

To illustrate the above, consider what the controller output will be for a proportional plus derivative controller (a) initially and (b) 2 s after the error begins to change from the zero error at the rate of 1.2%/s. The controller has a set point of 50%, $K_P = 4$ and $K_D = 0.4$ s. Using the equation given above

$$I_{\text{out}} = K_P e + K_D \frac{de}{dt} + I_0$$

Initially the error e is zero. Hence, initially when the error begins to change

$$I_{\text{out}} = 0 + 0.4 \times 1.2 + 50 = 50.48\%$$

Because the rate of change is constant, after 2 s the error will have become 2.4%. Hence, then

$$I_{\text{out}} = 4 \times 2.4 + 0.4 \times 1.2 + 50 = 59.08\%$$

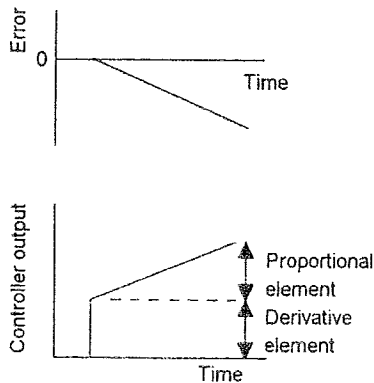


Fig. 13.12 PD control

13.6 Integral control

The *integral mode* of control is one where the rate of change of the control output I is proportional to the input error signal e .

$$\frac{dI}{dt} = K_I e$$

K_I is the constant of proportionality and, when the controller output is expressed as a percentage and the error as a percentage, has units of s^{-1} . Integrating the above equation gives

$$\int_{I_0}^{I_{out}} dI = \int_0^t K_I e \, dt$$

$$I_{out} - I_0 = \int_0^t K_I e \, dt$$

I_0 is the controller output at zero time, I_{out} is the output at time t .

The transfer function is obtained by taking the Laplace transform. Thus

$$(I_{out} - I_0)(s) = \frac{1}{s} K_I E(s)$$

and so

$$\text{Transfer function} = \frac{1}{s} K_I$$

Figure 13.13 illustrates the action of an integral controller when there is a constant error input to the controller. We can consider the graphs in two ways. When the controller output is constant the error is zero; when the controller output varies at a constant rate the error has a constant value. The alternative way of considering the graphs is in terms of the area under the error graph.

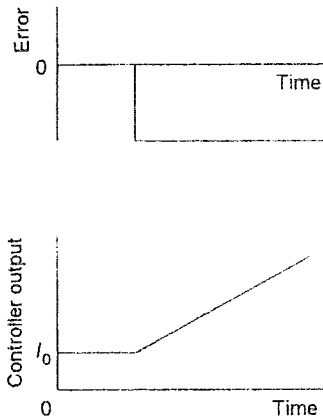


Fig. 13.13 Integral control

$$\text{Area under the error graph between } t = 0 \text{ and } t = \int_0^t e \, dt$$

Thus up to the time when the error occurs the value of the integral is zero. Hence $I_{out} = I_0$. When the error occurs it maintains a constant value. Thus the area under the graph is increasing as the time increases. Since the area increases at a constant rate the controller output increases at a constant rate.

To illustrate the above, consider an integral controller with a value of K_I of $0.10/s$ and an output of 40% at the set point. What will be the output after times of (a) $1s$, (b) $2s$, if there is a sudden change to a constant error of 20% ? Using the equation developed above

$$I_{out} - I_0 = \int_0^t K_I e \, dt$$

When the error does not vary with time the equation becomes

$$I_{out} = K_I e t + I_0$$

Thus for (a) when $t = 1s$,

$$I_{out} = 0.10 \times 20 \times 1 + 40 = 42\%$$

For (b) when $t = 2$ s,

$$I_{out} = 0.10 \times 20 \times 2 + 40 = 44\%$$

Figure 13.14 shows the form of the circuit used for an electronic integral controller. It consists of an operational amplifier connected as an integrator and followed by another operational amplifier connected as a summer to add the integrator output to that of the controller output at zero time. K_I is $1/R_1C$.

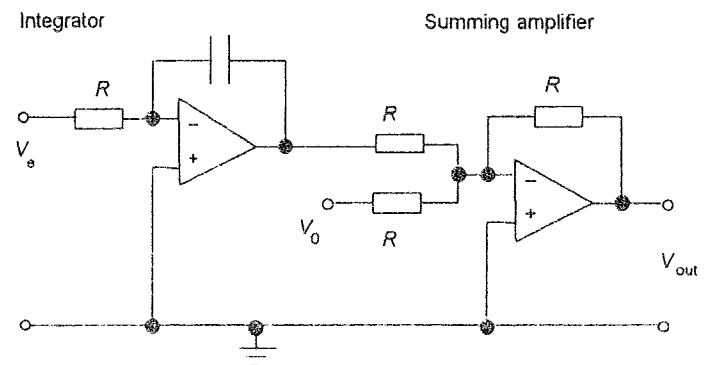


Fig. 13.14 Integral controller

13.6.1 Proportional plus integral control

The integral mode of control is not usually used alone but is frequently used in conjunction with the proportional mode. When integral action is added to a proportional control system the controller output I_{out} is given by

$$I_{out} = K_P e + K_I \int e \, dt + I_0$$

where K_P is the proportional control constant, K_I the integral control constant, I_{out} the output when there is an error e and I_0 the output at the set point when the error is zero. The transfer function is thus:

$$\text{transfer function} = K_P + \frac{K_I}{s} = \frac{K_P}{s} \left(s + \frac{1}{T_I} \right)$$

where $T_I = K_P/K_I$ and is the *integral time constant*.

Figure 13.15 shows how the system reacts when there is an abrupt change to a constant error. The error gives rise to a proportional controller output which remains constant since the error does not change. There is then superimposed on this a steadily increasing controller output due to the integral action.

Suppose there is a change in the controller set point from, say, 50 to 60%. With just a proportional controller this can only be done by having an offset error, i.e. an error value other than zero for the set point value. However, with the combination of integral

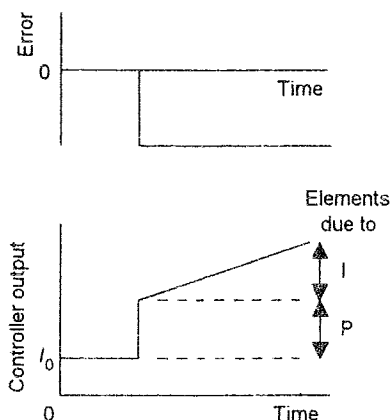


Fig. 13.15 PI control

and proportional control this is not the case. The integral part of the control can provide a change in controller output without any offset error. The controller can be said to reset its set point. Figure 13.16 shows the effects of the proportional action and the integral action if we create an error signal which is increased from the zero value and then decreased back to it again. With proportional action alone the controller mirrors the change and ends up back at its original set point value. With the integral action the controller output increases in proportion to the way the area under the error-time graph increases and since, even when the error has reverted back to zero, there is still a value for the area there is a change in controller output which continues after the error has ceased. The result of combining the proportional and integral actions, i.e. adding the two separate graphs, is thus a change in controller output without an offset error. A step input to the control system can thus give a steady-state value with no error.

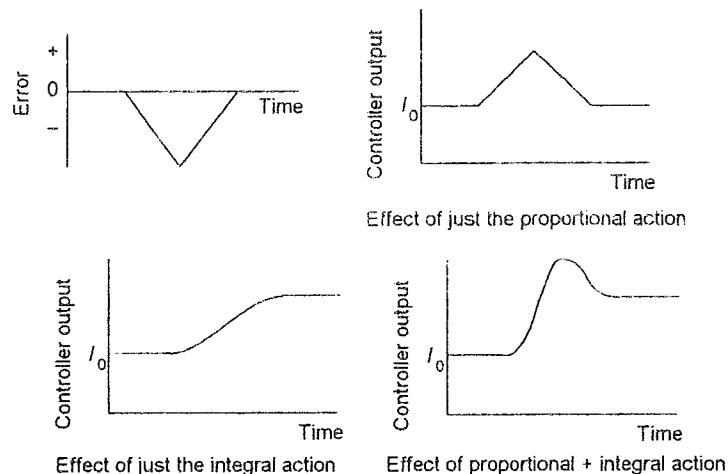


Fig. 13.16 PI control

Because of the lack of an offset error, this type of controller can be used where there are large changes in the process variable. However, because the integration part of the control takes time the changes must be relatively slow to prevent oscillations. Another disadvantage of this form of control is that when the process is started up with controller output at 100%, e.g. with a liquid level control the initial condition may be an empty tank and so the error is so large that the controller has to give a 100% output to fully open a valve, the integral action causes a considerable overshoot of the error before finally settling down.

13.7 PID controller

Combining all three modes of control (proportional, integral and derivative) enables a controller to be produced which has no offset error and reduces the tendency for oscillations. Such a controller

is known as a *three-mode controller* or *PID controller*. The equation describing its action can be written as

$$I_{\text{out}} = K_p e + K_i \int e \, dt + K_D \frac{de}{dt} + I_0$$

where I_{out} is the output from the controller when there is an error e which is changing with time t , I_0 is the set point output when there is no error, K_p is the proportionality constant, K_i the integral constant and K_D the derivative constant. One way of considering a three-mode controller is as a proportional controller which has integral control to eliminate the offset error and derivative control to reduce time lags. Taking the Laplace transform gives:

$$(I_{\text{out}} - I_0)(s) = K_p E(s) + \frac{1}{s} K_i E(s) + s K_D E(s)$$

and so:

$$\text{Transfer function} = K_p e + \frac{1}{s} K_i + s K_D = K_p \left(1 + \frac{1}{T_i s} + T_D s \right)$$

To illustrate the above, consider what will be the controller output of a three-mode controller having K_p as 4, K_i as 0.6 /s, K_D as 0.5 s, a set point output of 50% and, subject to the error change shown in Figure 13.17, (a) immediately the change starts to occur and (b) 2 s after it starts. Using the equation given above for I_{out}

$$I_{\text{out}} = K_p e + K_i \int e \, dt + K_D \frac{de}{dt} + I_0$$

we have for (a) $e = 0$, $de/dt = 1/s$, and $\int e \, dt = 0$. Thus

$$I_{\text{out}} = 0 + 0 + 0.5 \times 1 + 50 = 50.5\%$$

For (b) we have, at 2 s, $e = 1\%$, $\int e \, dt = 1.5$ s since the integral is the area under the error-time graph up to 2 s, and $de/dt = 0$. Thus

$$I_{\text{out}} = 4 \times 1 + 0.6 \times 1.5 + 0 + 50 = 54.9\%$$




Fig. 13.17 Error signal

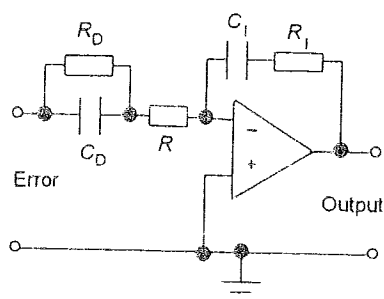


Fig. 13.18 PID circuit

13.7.1 Operational amplifier PID circuits

A three-mode controller can be produced by combining the various circuits described earlier in this chapter for the separate proportional, derivative and integral modes. A more practical controller can, however, be produced with a single operational amplifier. Figure 13.18 shows one such circuit. The proportional constant K_p is $R/(R + R_D)$, the derivative constant K_D is $R_D C_D$ and the integral constant K_i is $1/R_i C_i$.

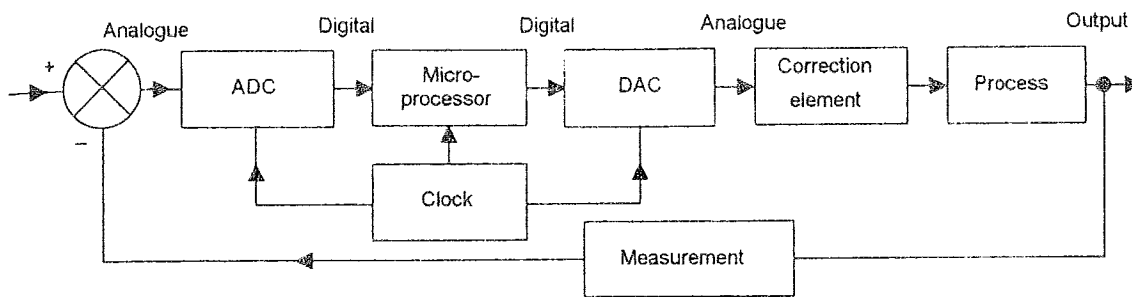


Fig. 13.19 Digital closed-loop control system

13.8 Digital controllers

Figure 13.19 shows the basis of a direct digital control system that can be used with a continuous process; the term *direct digital control* is used when the digital controller, basically a microprocessor, is in control of the closed-loop control system. The controller receives inputs from sensors, executes control programs and provides the output to the correction elements. Such controllers require inputs which are digital, process the information in digital form and give an output in digital form. Since many control systems have analogue measurements an analogue-to-digital converter (ADC) is used for the inputs. A clock supplies a pulse at regular time intervals and dictates when samples of the controlled variable are taken by the ADC. These samples are then converted to digital signals which are compared by the microprocessor with the set point value to give the error signal. The microprocessor can then initiate a control mode to process the error signal and give a digital output. The control mode used by the microprocessor is determined by the program of instructions used by the microprocessor for processing the digital signals, i.e. the *software*. The digital output, generally after processing by a digital-to-analogue converter since correcting elements generally require analogue signals, can be used to initiate the correcting action.

A digital controller basically operates the following cycle of events:

- 1 Samples the measured value.
- 2 Compares it with the set value and establishes the error.
- 3 Carries out calculations based on the error value and stored values of previous inputs and outputs to obtain the output signal.
- 4 Sends the output signal to the DAC.
- 5 Waits until the next sample time before repeating the cycle.

Microprocessors as controllers have the advantage over analogue controllers that the form of the controlling action, e.g. proportional or three mode, can be altered by purely a change in the computer software. No change in hardware or electrical wiring is required. Indeed the control strategy can be altered by the computer program during the control action in response to the developing situation.

They also have other advantages. With analogue control, separate controllers are required for each process being controlled. With a microprocessor many separate processes can be controlled by sampling processes with a multiplexer (see Chapter 3). Digital control gives better accuracy than analogue control because the amplifiers and other components used with analogue systems change their characteristics with time and temperature and so show drift, while digital control, because it operates on signals in only the on-off mode, does not suffer from drift in the same way.

13.8.1 Implementing control modes

In order to produce a digital controller which will give a particular mode of control it is necessary to produce a suitable program for the controller. The program has to indicate how the digital error signal at a particular instant is to be processed in order to arrive at the required output for the following correction element. The processing can involve the present input together with previous inputs and previous outputs. The program is thus asking the controller to carry out a difference equation (see Section 3.10).

The transfer function for a PID analogue controller is

$$\text{Transfer function} = K_P + \frac{1}{s} K_I + s K_D$$

Multiplication by s is equivalent to differentiation. We can, however, consider the gradient of the time response for the error signal at the present instant of time as being (latest sample of the error e_n minus the last sample of the error e_{n-1})/(sampling interval T_s) (Fig. 13.20). Division by s is equivalent to integration. We can, however, consider the integral of the error at the end of a sampling period as being the area under the error-time graph during the last sampling interval plus the sum of the areas under the graph for all previous samples (Int_{prev}). If the sampling period is short relative to the times involved then the area during the last sampling interval is approximately $\frac{1}{2}(e_n + e_{n-1})/T_s$ (see Section 3.10 for another approximation known as Tustin's approximation). Thus we can write for the controller output x_n at a particular instant the equivalent of the transfer function as:

$$x_n = K_P e_n + K_I \left(\frac{(e_n + e_{n-1})T_s}{2} + \text{Int}_{\text{prev}} \right) + K_D \frac{e_n - e_{n-1}}{T_s}$$

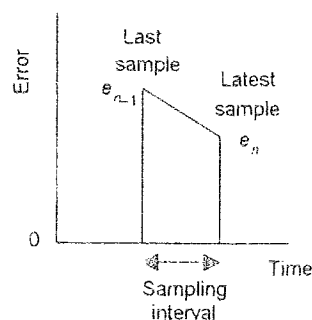


Fig. 13.20 Error signals

We can rearrange this equation to give:

$$x_n = Ae_n + Be_{n-1} + C(\text{Int}_{\text{prev}})$$

where $A = K_p + 0.5K_iT_s + K_D/T_s$, $B = 0.5K_iT_s - K_D/T_s$ and $C = K_i$.

The program for PID control thus becomes:

- 1 Set the values of K_p , K_i and K_D .
- 2 Set the initial values of e_{n-1} , Int_{prev} and the sample time T_s .
- 3 Reset the sample interval timer.
- 4 Input the error e_n .
- 5 Calculate y_n using the above equation.
- 6 Update, ready for the next calculation, the value of the previous area to $\text{Int}_{\text{prev}} + 0.5(e_n + e_{n-1})T_s$.
- 7 Update, ready for the next calculation, the value of the error by setting e_{n-1} equal to e_n .
- 8 Wait for the sampling interval to elapse.
- 9 Go to 3 and repeat the loop.

13.8.2 A computer control system

Typically a computer control system consists of the elements shown in Figure 13.19 with set points and control parameters being entered from a keyboard. The software for use with the system will provide the program of instructions needed, for example, for the computer to implement the PID control mode, provide the operator display, recognise and process the instructions inputted by the operator, provide information about the system, provide start-up and shut-down instructions, and supply clock/calendar information. An operator display is likely to show such information as the set point value, the actual measured value, the sampling interval, the error, the controller settings and the state of the correction element. The display is likely to be updated every few seconds.

For a more detailed discussion of computer control systems the reader is referred to specialist texts, e.g. *Real-time Computer Control* by S. Bennett (Prentice-Hall 1994).

13.9 Control system performance

The transfer function of a control system is affected by the mode chosen for the controller. Hence the response of the system to, say, a step input is affected. Consider the simple system shown in Figure 13.21. With proportional control the transfer function of the forward path is $K_pG(s)$ and so the transfer function of the feedback system $G(s)$ is

$$G(s) = \frac{K_p G_p(s)}{1 + K_p G_p(s)}$$

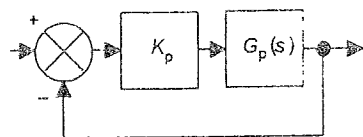


Fig. 13.21 System with proportional control

Suppose we have a process which is first order with a transfer function of $1/(\tau s + 1)$ where τ is the time constant. With proportional control, and unit feedback, the transfer function of the control system becomes

$$G(s) = \frac{K_p/(\tau s + 1)}{1 + K_p/(\tau s + 1)} = \frac{K_p}{\tau s + 1 + K_p}$$

The control system remains a first-order system. The proportional control has had the effect of just changing the form of the first-order response of the process. Without the controller the response to a unit step input was (see Section 11.2)

$$y = 1 - e^{-t/\tau}$$

Now it is

$$y = K_p(1 - e^{-t/(\tau/(1+K_p))})$$

The effect of the proportional control has been to reduce the time constant from τ to $\tau/(1 + K_p)$.

With integral control (Fig. 13.22) we have a forward-path transfer function of $K_I G_p(s)/s$ and so the system transfer function is

$$G(s) = \frac{K_I G_p(s)}{s + K_I G_p(s)}$$

Thus, now if we have a process which is first order with a transfer function of $1/(\tau s + 1)$, with proportional control and unit feedback the transfer function of the control system becomes

$$\begin{aligned} G(s) &= \frac{K_I/(\tau s + 1)}{s + K_I/(\tau s + 1)} \\ &= \frac{K_I}{s(\tau s + 1) + K_I} = \frac{K_I}{\tau s^2 + s + K_I} \end{aligned}$$

The control system is now a second-order system. Now, with a step input, the system will give a second-order response instead of a first-order response.

With a system having derivative control (Fig. 13.23) the forward path transfer function is $sK_D G(s)$ and so, with unity feedback, the system transfer function is

$$G(s) = \frac{sK_D G_p(s)}{1 + K_D G_p(s)}$$

With a process which is first order with a transfer function of $1/(\tau s + 1)$, derivative control gives an overall transfer function of

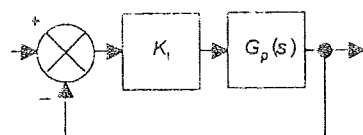


Fig. 13.22 System with integral control

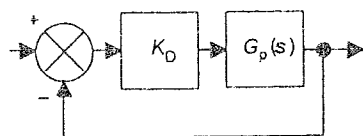


Fig. 13.23 System with derivative control

$$G(s) = \frac{sK_D/(\tau s + 1)}{1 + sK_D/(\tau s + 1)} = \frac{sK_D}{\tau s + 1 + sK_D}$$

13.10 Controller tuning

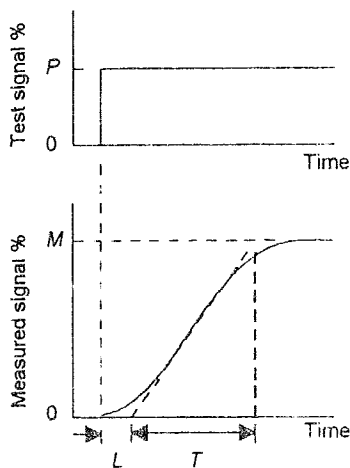


Fig. 13.24 Process reaction curve

The term *tuning* is used to describe the process of selecting the best controller settings. With a proportional controller this means selecting the value of K_P ; with a PID controller the three constants K_P , K_I and K_D have to be selected. There are a number of methods of doing this; here just two methods will be discussed, both by Ziegler and Nichols. They assumed that when the controlled system is open loop a reasonable approximation to its behaviour is a first-order system with a built-in time delay. Based on this, they then derived parameters for optimum performance.

13.10.1 Process reaction method

The process control loop is opened, generally between the controller and the correction unit, so that no control action occurs. A test input signal is then applied to the correction unit and the response of the controlled variable determined. The test signal should be as small as possible. Figure 13.24 shows the form of test signal and a typical response. The test signal is a step signal with a step size expressed as the percentage change P in the correction unit. The graph of the measured variable plotted against time is called the *process reaction curve*. The measured variable is expressed as the percentage of the full-scale range.

A tangent is drawn to give the maximum gradient of the graph. For Figure 13.24 the maximum gradient R is M/T . The time between the start of the test signal and the point at which this tangent intersects the graph time axis is termed the lag L . Table 13.1 gives the criteria recommended by Ziegler and Nichols for control settings based on the values of P , R and L .

Table 13.1 Process reaction curve criteria

Control mode	K_P	T_I	T_D
P	P/RL		
PI	$0.9P/RL$	$3.33L$	
PID	$1.2P/RL$	$2L$	$0.5L$

Consider the following example. Determine the settings required for a three-mode controller which gave the process reaction curve shown in Figure 13.25 when the test signal was a 6% change in the control valve position. Drawing a tangent to the maximum gradient part of the graph gives a lag L of 150 s and a gradient R of $5/300 = 0.017$ /s. Hence

$$K_P = \frac{1.2P}{RL} = \frac{1.2 \times 6}{0.017 \times 150} = 2.82$$

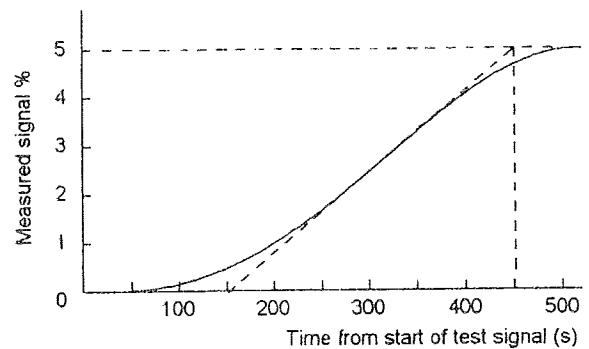


Fig. 13.25 Process curve example

$$T_I = 2L = 300 \text{ s}$$

$$T_D = 0.5L = 0.5 \times 150 = 75 \text{ s}$$

13.10.2 Ultimate cycle method

With this method, integral and derivative actions are first reduced to their minimum values. The proportional constant K_P is set low and then gradually increased. This is the same as saying that the proportional band is gradually made narrower. While doing this small disturbances are applied to the system. This is continued until continuous oscillations occur. The critical value of the proportional constant K_{Pc} at which this occurs is noted and the periodic time of the oscillations T_c measured. Table 13.2 shows how the Ziegler and Nichols recommended criteria for controller settings are related to this value of K_{Pc} . The critical proportional band is $100/K_{Pc}$.

Table 13.2 Ultimate cycle criteria

Control mode	K_P	T_I	T_D
P	$0.5K_{Pc}$		
PI	$0.45K_{Pc}$	$T_c/1.2$	
PID	$0.6K_{Pc}$	$T_c/2.0$	$T_c/8$

Consider the following example. When tuning a three-mode control system by the ultimate cycle method it was found that oscillations begin when the proportional band is decreased to 30%. The oscillations have a periodic time of 500 s. What are the suitable settings for the controller? The critical value of K_{Pc} is $100/\text{critical proportional band}$ and is therefore $100/30 = 3.33$. Then, using the criteria given in Table 13.2,

$$K_P = 0.6K_{Pc} = 0.6 \times 3.33 = 2.0$$

$$T_i = T/2.0 = 500/2 = 2.5 \text{ s}$$

$$T_D = T/8 = 500/8 = 62.5 \text{ s}$$

13.11 Velocity control

Consider the problem of controlling the movement of a load by means of a motor. Because the motor system is likely to be second-order, proportional control will lead to the system output taking time to reach the required displacement when there is, say, a step input to the system and may oscillate for a while about the required value. Time will thus be taken for the system to respond to an input signal. A higher speed of response, with fewer oscillations, can be obtained by using PD rather than just P control. There is, however, an alternative of achieving the same effect and this is by the use of a second feedback loop which gives a measurement related to the rate at which the displacement is changing. This is termed *velocity feedback*. Figure 13.26 shows such a system; the velocity feedback might involve the use of a tachogenerator giving a signal proportional to the rotational speed of the motor shaft and hence the rate at which the displacement is changing and the displacement might be monitored using a rotary potentiometer.

13.12 Adaptive control

There are many control situations where the parameters of the plant change with time or, perhaps, load, e.g. a robot manipulator being used to move loads when the load is changed. If the transfer function of the plant changes then retuning of the system is desirable for the optimum values to be determined for proportional, derivative and integral constants. For the control systems so far considered, it has been assumed that the system once tuned retains its values of proportional, derivative and integral constants until the operator decides to retune. The alternative to this is an *adaptive control system* which 'adapts' to changes and changes its parameters to fit the circumstances prevailing.

The adaptive control system is based on the use of a microprocessor as the controller. Such a device enables the control mode and the control parameters used to be adapted to fit the circumstances, modifying them as the circumstances change.

An adaptive control system can be considered to have three stages of operation:

- 1 Starts to operate with controller conditions set on the basis of an assumed condition.
- 2 The desired performance is continuously compared with the actual system performance.
- 3 The control system mode and parameters are automatically and continuously adjusted in order to minimise the difference between the desired and actual system performance.

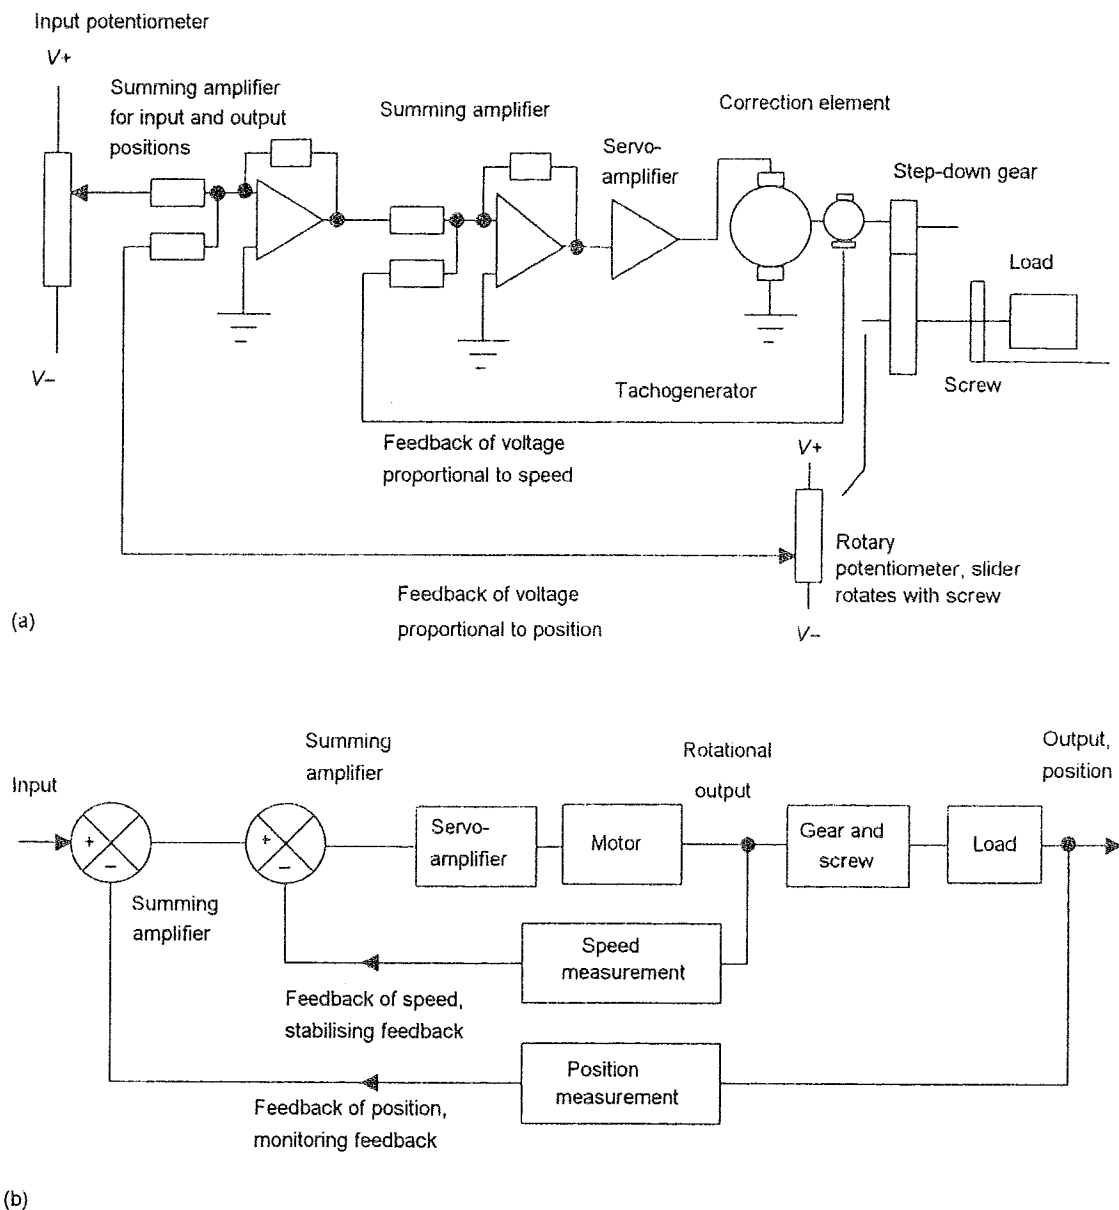


Fig. 13.26 System with velocity feedback: (a) descriptive diagram of the system, (b) block diagram of the system

For example, with a control system operating in the proportional mode, the proportional constant K_P may be automatically adjusted to fit the circumstances, changing as they do.

Adaptive control systems can take a number of forms. Three commonly used forms are:

- 1 Gain-scheduled control.
- 2 Self-tuning.
- 3 Model-reference adaptive systems.

13.12.1 Gain-scheduled control

With *gain-scheduled control* or, as it is sometimes referred to, *pre-programmed adaptive control*, preset changes in the parameters of the controller are made on the basis of some auxiliary measurement of some process variable. Figure 13.27 illustrates this method. The term *gain-scheduled control* was used because the only parameter originally adjusted was the gain, i.e. the proportionality constant K_p .

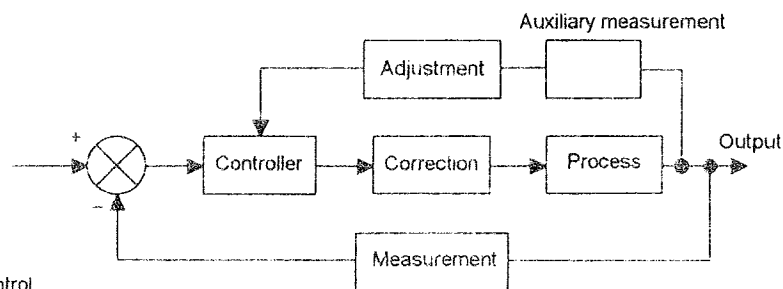


Fig. 13.27 Gain-scheduled control

For example, for a control system used to control the positioning of some load, the system parameters could be worked out for a number of different load values and a table of values loaded into the memory of the controller. A load cell might then be used to measure the actual load and give a signal to the controller indicating a mass value which is then used by the controller to select the appropriate parameters.

A disadvantage of this system is that the control parameters have to be determined for many operating conditions so that the controller can select the one to fit the prevailing conditions. An advantage, however, is that the changes in the parameters can be made quickly when the conditions change.

13.12.2 Self-tuning

With *self-tuning control* the system continuously tunes its own parameters based on monitoring the variable that the system is controlling and the output from the controller. Figure 13.28 illustrates the features of this system.

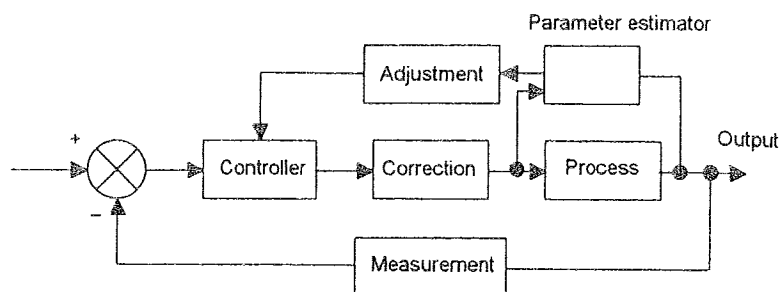


Fig. 13.28 Self-tuning

Self-tuning is often found in commercial PID controllers, it generally then being referred to as *auto-tuning*. When the operator presses a button, the controller injects a small disturbance into the system and measures the response. This response is compared to the desired response and the control parameters adjusted, by a modified Ziegler-Nichols rule, to bring the actual response closer to the desired response.

13.12.3 Model-reference adaptive systems

With the *model-reference* system an accurate model of the system is developed. The set value is then used as an input to both the actual and the model systems and the difference between the actual output and the output from the model compared. The difference in these signals is then used to adjust the parameters of the controller to minimise the difference. Figure 13.29 illustrates the features of the system.

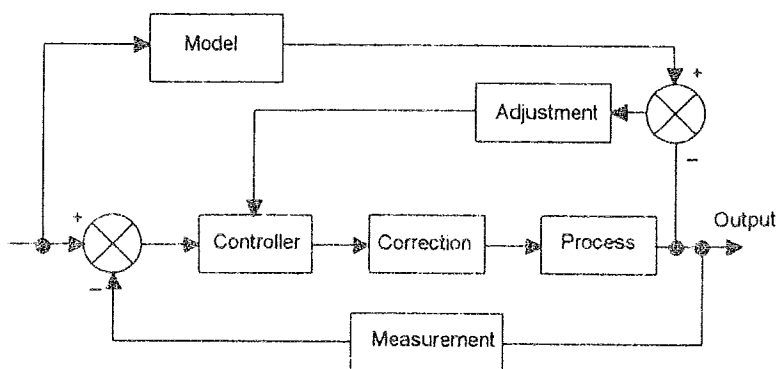


Fig. 13.29 Model-referenced control

For more details on adaptive control, the reader is referred to specialist texts such as *Adaptive Control* by K.J. Åström and B. Wittenmark (Addison-Wesley 1989, 1995).

Problems

- 1 What are the limitations of two-step (on-off) control and in what situation is such a control system commonly used?
- 2 A two-position mode controller switches on a room heater when the temperature falls to 20°C and off when it reaches 24°C . When the heater is on, the air in the room increases in temperature at the rate of 0.5°C per minute; when the heater is off it cools at 0.2°C per minute. If the time lags in the control system are negligible, what will be the times taken for (a) the heater switching on to off, (b) the heater switching off to on?
- 3 A two-position mode controller is used to control the water level in a tank by opening or closing a valve which in the open position allows water at the rate of $0.4\text{ m}^3/\text{s}$ to enter the tank. The tank has a cross-sectional area of 12 m^2 and water leaves it at the constant rate of $0.2\text{ m}^3/\text{s}$. The valve opens when the water level reaches 4.0 m and closes at 4.4 m . What will be the times taken for (a) the valve opening to closing, (b) the valve closing to opening?
- 4 A proportional controller is used to control the height of water in a tank where the water level can vary from zero to 4.0 m . The required height of water is 3.5 m and the controller is to fully close a valve when the water rises to 3.9 m and fully open it when the water falls to 3.1 m . What proportional band and transfer function will be required?
- 5 A proportional controller has K_P of 20 and a set point of 50% output. Its output is to have a valve which at the set point allows a flow of $2.0\text{ m}^3/\text{s}$. The valve changes its output in direct proportion to the controller output. What will be the controller output and the offset error when the flow has to be changed to $2.5\text{ m}^3/\text{s}$?
- 6 A derivative controller has a set point of 50% and derivative constant K_D of 0.5 s . The error starts at zero and then changes at $2\%/s$ for 3 s before becoming constant for 2 s , after which it decreases at $1\%/s$ to zero. What will be the controller output at (a) 0 s , (b) 1 s , (c) 4 s , (d) 6 s ?
- 7 An integral controller has a set point of 50% and a value of K_I of 0.10 /s . The error starts at zero and changes at $4\%/s$ for 2 s before becoming constant for 3 s . What will be the output after times of (a) 1 s , (b) 3 s ?
- 8 A three-mode controller has K_P as 2, K_I as 0.1 /s , K_D as 1.0 s , and a set point output of 50%. The error starts at zero and changes at $5\%/s$ for 2 s before becoming constant for 3 s . It then decreases at $2\%/s$ to zero and remains at zero. What will be the controller output at (a) 0 s , (b) 3 s , (c) 7 s ?
- 9 Describe and compare the characteristics of (a) proportional control, (b) proportional plus integral control, (c) proportional plus integral plus derivative control.
- 10 Determine the settings of K_P , T_I and T_D required for a three-mode controller which gave a process reaction curve with a

lag L of 200 s and a gradient R of 0.010%/s when the test signal was a 5% change in the control valve position.

- 11 When tuning a three-mode control system by the ultimate cycle method it was found that oscillations began when the proportional band was decreased to 20%. The oscillations had a periodic time of 200 s. What are the suitable values of K_p , T_i and T_d ?
- 12 Explain the basis on which the following forms of adaptive control systems function. (a) gain-scheduled, (b) self-tuning, (c) model-reference.
- 13 A d.c. motor behaves like a first-order system with a transfer function of relating output position to which it has rotated a load to input signal of $1/s(1 + s\tau)$. If the time constant τ is 1 s and the motor is to be used in a closed-loop control system with unity feedback and a proportional controller, determine the value of the proportionality constant which will give a closed-loop response with a 25% overshoot.
- 14 The small ultrasonic motor used to move the lens for automatic focusing with a camera (see Section 22.3.3) drives the ring with so little inertia that the transfer function relating angular position with input signal is represented by $1/s$, where c is the constant of proportionality relating the frictional torque to angular velocity. If the motor is to be controlled by a closed-loop system with unity feedback, what type of behaviour can be expected if proportional control is used?

14 Digital logic

14.1 Digital logic

Many control systems are concerned with setting events in motion or stopping them when certain conditions are met. For example, with the domestic washing machine, the heater is only switched on when there is water in the drum and it is to the prescribed level. Such control involves *digital* signals where there are only two possible signal levels. Digital circuitry is the basis of digital computers and microprocessor controlled systems.

This circuitry evolved from the transistor circuits being able to output at one of two voltage levels depending on the levels at its inputs. The two levels, usually 5 V and 0 V are the high and low signals and represented by 1 and 0. The *binary numbering system* involves just the numbers 0 and 1 and is thus widely used with such digital circuitry. These two levels of 0 and 1 may represent levels of on or off, open or closed, yes or no, true or false, +5 V or 0 V, etc.

With *digital control* we might, for example, have the water input to the domestic washing machine switched on if we have both the door to the machine closed and a particular time in the operating cycle has been reached. There are two input signals which are either yes or no signals and an output signal which is a yes or no signal. The controller is here programmed to only give a yes output if both the input signals are yes, i.e. if input *A* and input *B* are both 1 then there is an output of 1. Such an operation is said to be controlled by a *logic gate*, in this example an AND gate. There are many machines and processes which are controlled in this way.

The term *combinational logic* is used for the combining of two or more basic logic gates to form a required function. For example, a requirement might be that a buzzer sounds in a car if the key is in the ignition and a door is opened or if the headlights are on and the driver's door is opened.

In addition to a discussion of combinational logic, this chapter also includes a discussion of *sequential logic*. Such digital circuitry is used to exercise control in a specific sequence dictated

by a control clock or enable-disable control signals. These are combinational logic circuits with memory.

14.2 Number systems

The *decimal system* is based on the use of 10 symbols or digits: 0, 1, 2, 3, 4, 5, 6, 7, 8, 9. When a number is represented by this system, the digit position in the number indicates that the weight attached to each digit increases by a factor of 10 as we proceed from right to left.

...	10^3	10^2	10^1	10^0
	thousands	hundreds	tens	units

The *binary system* is based on just two symbols or states: 0 and 1. These are termed *binary digits* or *bits*. When a number is represented by this system, the digit position in the number indicates that the weight attached to each digit increases by a factor of 2 as we proceed from right to left.

...	2^3	2^2	2^1	2^0
	bit 3	bit 2	bit 1	bit 0

For example, the decimal number 15 in the binary system is 1111. In a binary number the bit 0 is termed the *least significant bit* (LSB) and the highest bit the *most significant bit* (MSB).

The *octal system* is based on eight digits: 0, 1, 2, 3, 4, 5, 6, 7. When a number is represented by this system, the digit position in the number indicates that the weight attached to each digit increases by a factor of 8 as we proceed from right to left.

...	8^3	8^2	8^1	8^0
-----	-------	-------	-------	-------

For example, the decimal number 15 in the octal system is 17.

The *hexadecimal system* is based on 16 digits/symbols: 0, 1, 2, 3, 4, 5, 6, 7, 8, 9, A, B, C, D, E, F. When a number is represented by this system, the digit position in the number indicates that the weight attached to each digit increases by a factor of 16 as we proceed from right to left.

...	16^3	16^2	16^1	16^0
-----	--------	--------	--------	--------

For example, the decimal number 15 is F in the hexadecimal system. This system is generally used in the writing of programs for microprocessor-based systems since it represents a very compact method of entering data.

The *binary coded decimal system* (BCD) is a widely used system with computers. Each decimal digit is coded separately in binary. For example, the decimal number 15 in BCD is 0001 0101. This

code is useful for outputs from microprocessor-based systems where the output has to drive decimal displays, each decimal digit in the display being supplied by the microprocessor with its own binary code.

Table 14.1 gives examples of numbers in the decimal, binary, BCD, octal and hexadecimal systems.

Table 14.1 Number systems

Decimal	Binary	BCD	Octal	Hexadecimal
0	0000	0000 0000	0	0
1	0001	0000 0001	1	1
2	0010	0000 0010	2	2
3	0011	0000 0011	3	3
4	0100	0000 0100	4	4
5	0101	0000 0101	5	5
6	0110	0000 0110	6	6
7	0111	0000 0111	7	7
8	1000	0000 1000	10	8
9	1001	0000 1001	11	9
10	1010	0001 0000	12	A
11	1011	0001 0001	13	B
12	1100	0001 0010	14	C
13	1101	0001 0011	15	D
14	1110	0001 0100	16	E
15	1111	0001 0101	17	F

14.2.1 Binary mathematics

Addition of binary numbers follows the following rules:

$$0 + 0 = 0$$

$$0 + 1 = 1 + 0 = 1$$

$$1 + 1 = 10 \quad \text{i.e. } 0 + \text{carry } 1$$

$$1 + 1 + 1 = 11 \quad \text{i.e. } 1 + \text{carry } 1$$

In decimal numbers the addition of 14 and 19 gives 33. In binary numbers this addition becomes

Augend	01110
Addend	10111
Sum	100001

For bit 0, $0 + 1 = 1$. For bit 1, $1 + 1 = 10$ and so we have 0 with 1 carried to the next column. For bit 3, $1 + 0 + \text{carried } 1 = 10$. For bit 4, $1 + 0 + \text{carried } 1 = 10$. We continue this through the various bits and end up with the sum plus a carry 1. The final number is thus 100001. When adding binary numbers A and B to give C , i.e. $A + B = C$, then A is termed the *augend*, B the *addend* and C the *sum*.

Subtraction of binary numbers follows the following rules:

$$0 - 0 = 0$$

$$1 - 0 = 1$$

$$1 - 1 = 0$$

$$0 - 1 = 10 - 1 + \text{borrow} = 1 + \text{borrow}$$

When evaluating $0 - 1$, a 1 is borrowed from the next column on the left containing a 1. The following example illustrates this. In decimal numbers the subtraction of 14 from 27 gives 13.

Minuend	11011
Subtrahend	01110
Difference	01101

For bit 0 we have $1 - 0 = 1$. For bit 1 we have $1 - 1 = 0$. For bit 2 we have $0 - 1$. We thus borrow 1 from the next column and so have $10 - 1 = 1$. For bit 3 we have $0 - 1$; remember we borrowed the 1. Again borrowing 1 from the next column, we then have $10 - 1 = 1$. For bit 4 we have $0 - 0 = 0$; remember we borrowed the 1. When subtracting binary numbers A and B to give C , i.e. we have $A - B = C$, then A is termed the *minuend*, B the *subtrahend* and C the *difference*.

The subtraction of binary numbers is more easily carried out electronically when an alternative method of subtraction is used. The subtraction example above can be considered to be the addition of a positive number and a negative number. The following techniques indicate how we can specify negative numbers and so turn subtraction into addition. It also enables us to deal with negative numbers in any circumstances.

The numbers used so far are referred to as *unsigned*. This is because the number itself contains no indication whether it is negative or positive. A number is said to be *signed* when the most significant bit is used to indicate the sign of the number, a 0 being used if the number is positive and a 1 if it is negative. When we have a positive number then we write it in the normal way with a 0 preceding it. Thus a positive binary number of 10010 would be written as 010010. A negative number of 10010 would be written as 110010. However, this is not the most useful way of

representing negative numbers for ease of manipulation by computers.

A more useful way of representing negative numbers is to use the two's complement method. A binary number has two complements, known as the *ones complement* and the *two's complement*. The ones complement of a binary number is obtained by changing all the 1s in the unsigned number into 0s and the 0s into 1s. The two's complement is then obtained by adding 1 to the ones complement. When we have a negative number then we obtain the two's complement and then sign it with a 1, the positive number being signed by a 0. Consider the representation of the decimal number -3 as a signed two's complement number. We first write the binary number for the unsigned 3 as 0011, then obtain the ones complement of 1100, add 1 to give the unsigned two's complement of 1101, and finally sign it with a 1 to indicate it is negative. The result is thus 11101. The following is another example, the signed two's complement being obtained as an 8-bit number for -6.

Table 14.2 Signed numbers

Denary number	Signed number	
+127	0111 1111	Just the binary number signed with a 0
etc.		
+6	0000 0110	
+5	0000 0101	
+4	0000 0101	
+3	0000 0011	The two's complement signed with a 1
+2	0000 0010	
+1	0000 0001	
+0	0000 0000	
-1	1111 1111	
-2	1111 1110	
-3	1111 1101	
-4	1111 1100	
-5	1111 1011	
-6	1111 1010	
etc.		
-127	1000 0000	

Unsigned binary number	000 0110
------------------------	----------

Ones complement	111 1001
-----------------	----------

Add 1	1
-------	---

Unsigned two's complement	111 1010
---------------------------	----------

Signed two's complement	1111 1010
-------------------------	-----------

When we have a positive number then we write it in the normal way with a 0 preceding it. Thus a positive binary number of 100 1001 would be written as 01001001. Table 14.2 shows some examples of numbers on this system.

Subtraction of a positive number from a positive number involves obtaining the signed two's complement of the subtrahend and then adding it to the signed minuend. Hence, for the subtraction of the decimal number 6 from the decimal number 4 we have

Signed minuend	0000 0100
Subtrahend, signed two's complement	1111 1010
Sum	1111 1110

The most significant bit of the outcome is 1 and so the result is negative. This is the signed two's complement for -2.

Consider another example, the subtraction of 43 from 57. The signed positive number of 57 is 0011 1001. The signed two's complement for -43 is given by:

Unsigned binary number for 43	010 1011
Ones complement	101 0100
Add 1	1
Unsigned two's complement	101 0101
Signed two's complement	1101 0101

Thus we obtain by the addition of the signed positive number and the signed two's complement number:

Signed minuend	0011 1001
Subtrahend, signed two's complement	1101 0101
Sum	0000 1110 + carry 1

The carry 1 is ignored. The result is thus 0000 1110 and since the most significant bit is 0 the result is positive. The result is the decimal number 14.

If we wanted to add two negative numbers then we would obtain the signed two's complement for each number and then add them. Whenever a number is negative we use the signed two's complement, when positive just the signed number.

14.2.2 Floating numbers

In the decimal number system, large numbers such as 120 000 are often written in *scientific notation* as 1.2×10^5 or perhaps 120×10^3 and small numbers such as 0.000 120 as 1.2×10^{-4} rather than as a number with a fixed location for the decimal point. Numbers in this form of notation are written in terms of 10 raised to some power. Likewise we can use such notation for binary numbers but with them written in terms of 2 raised to some power. For example, we might have 1010 written as 1.010×2^3 or perhaps 10.10×2^2 . Because the binary point can be moved to different locations by a choice of the power to which the 2 is raised, this notation is termed *floating point*.

A floating point number is in the form:

$$a \times r^e$$

where a is termed the *mantissa*, r the *radix* or *base* and e the *exponent* or *power*. With binary numbers the base is understood to be 2, i.e. we have $a \times 2^e$.

The advantage of using floating-point numbers is that, compared with fixed-point representation, a much wider range of numbers can be represented by a given number of digits.

Because with floating point numbers it is possible to store a number in a number of different ways, e.g. 0.1×10^2 and $0.01 \times$

10^3 , with computing systems such numbers are *normalised*, i.e. they are all put in the form $0.1 \times r^x$. Hence, with binary numbers we have 0.1×2^x and so if we had 0.00001001 it would become 0.1001×2^{-4} . In order to take account of the sign of a binary number we then add a sign bit of 0 for a positive number and 1 for a negative number. Thus the number 0.1001×2^{-4} becomes 1.1001×2^{-4} if negative and 0.1001×2^{-4} if positive.

If we want to add 2.01×10^3 and 10.2×10^2 we have to make the power (the term *exponent* is generally used) the same for each. Thus we can write $2.01 \times 10^3 + 1.02 \times 10^3$. We can then add them digit by digit, taking account of any carry, to give 2.03×10^3 . We adopt a similar procedure for binary floating-point numbers. Thus if we want to add 0.101100×2^4 and 0.111100×2^2 we first adjust them to have the same exponents, e.g. 0.101100×2^4 and 0.001111×2^4 , and then add them digit by digit to give 0.111011×2^4 .

Likewise for subtraction, digit-by-digit subtraction of floating-point numbers can only occur between two numbers when they have the same exponent. Thus 0.1101100×2^{-4} minus 0.1010100×2^{-5} can be written as $0.01010100 \times 2^{-4} - 0.101010 \times 2^{-4}$ and the result given as 0.1000010×2^{-4} .

14.2.3 Gray code

Consider two successive numbers in binary code 0001 and 0010 (denary 2 and 3); two bits have changed in the code group in going from one number to the next. Thus if we had, say, an absolute encoder (see Section 2.3.7) and assigned successive positions to successive binary numbers then two changes have to be made in this case. This can present problems in that both changes must be made at exactly the same instant; if one occurs fractionally before the other then there can momentarily be another number indicated. Thus in going from 0001 to 0010 we might momentarily have 0011 or 0000. Thus an alternative method of coding is likely to be used.

The *Gray code* is such a code, only one bit in the code group changes in going from one number to the next. The Gray code is unweighted in that the bit positions in the code group do not have any specific weight assigned to them. It is thus not suited to arithmetic operations but is widely used for input-output devices such as absolute encoders. Table 14.3 lists decimal numbers and their values in the binary code and in Gray code.

14.2.4 Parity method for error detection

The movement of digital data from one location to another can result in transmission errors, the receiver not receiving the same signal as transmitted by the transmitter as a result of electrical noise in the transmission process. Sometimes a noise pulse may be large enough at some point to alter the logic level of the signal.

Table 14.3 Gray code

Decimal number	Binary code	Gray code
0	0000	0000
1	0001	0001
2	0010	0011
3	0011	0010
4	0100	0110
5	0101	0111
6	0110	0101
7	0111	0100
8	1000	1100
9	1001	1101
10	1010	1111
11	1011	1110
12	1100	1010
13	1101	1011
14	1110	1001
15	1111	1000

For example, the sequence 1001 may be transmitted and be received as though 1101. In order to detect such errors a *parity bit* is often used. A parity bit is an extra 0 or 1 bit attached to a code group at transmission. In the *even-parity* method the value of the bit is chosen so that the total number of 1s in the code group, including the parity bit, is an even number. For example, in transmitting 1001 the parity bit used would be 0 to give 01001 and so an even number of 1s. In transmitting 1101 the parity bit used would be 1 to give 11101 and so an even number of 1s. With *odd parity* the parity bit is chosen so that the total number of 1s, including the parity bit, is odd. Thus if at the receiver the number of 1s in a code group does not give the required parity, the receiver will know that there is an error and can request the code group be retransmitted.

An extension of the parity check is the *sum check* in which blocks of code may be checked by sending a series of bits representing their binary sum. Parity and sum checks can only detect single errors in blocks of code, double errors go undetected. Also the error is not located so that correction by the receiver can be made. Multiple-error detection techniques and methods to pinpoint errors have been devised (see Section 21.3) and texts such as *Audio, Video and Data Telecommunications* by D. Peterson (McGraw-Hill 1992) explain these in more detail.

14.3 Logic gates

Logic gates are the basic building blocks for digital electronic circuits.

14.3.1 AND gate

Suppose we have a gate giving a high output only when both input *A* and input *B* are high, for all other conditions it gives a low output. This is an AND logic gate. We can visualise the AND gate as an electrical circuit involving two switches in series (Fig. 14.1). Only when switch *A* and switch *B* are closed is there a current.



Fig. 14.1 AND gate representation

An example of an AND gate is an interlock control system for a machine tool such that if the safety guard is in place and gives a 1 signal and the power is on, giving a 1 signal, then there can be an output, a 1 signal, and the machine operates. Another example is a burglar alarm in which it gives an output, the alarm sounding, when the alarm is switched on and when a door is opened to activate a sensor.

The relationships between inputs to a logic gate and the outputs can be tabulated in a form known as a *truth table*. This specifies the relationships between the inputs and outputs. Thus for an AND gate with inputs *A* and *B* and a single output *Q*, we will have a 1 output when, and only when, $A = 1$ and $B = 1$. All other combinations of *A* and *B* will generate a 0 output. We can thus write the truth table as:

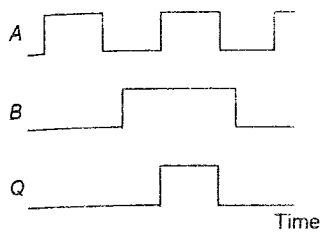


Fig. 14.2 AND gate

Inputs		Output
<i>A</i>	<i>B</i>	<i>Q</i>
0	0	0
0	1	0
1	0	0
1	1	1

Consider what happens when we have two digital inputs which are functions of time, as in Fig. 14.2. There will only be an output from the AND gate when each of the inputs is high and thus the output is as shown in the figure.

We can express the relationship between the inputs and the outputs of an AND gate in the form of an equation, termed a *Boolean equation*. The Boolean equation for the AND gate is written as:

$$A \cdot B = Q$$

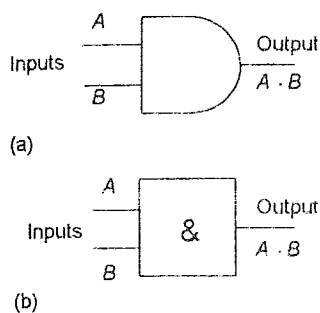


Fig. 14.3 Standard symbols for AND gates

Different sets of standard circuit symbols for logic gates have been used with the main form being that originated in the United States; an international standard form (IEEE/ANSI), however, has now been developed; this removes the distinctive shape and uses a rectangle with the logic function written inside it. Figure 14.3(a) shows the United States form of symbol used for an AND gate and (b) shows the new standardised form, the & symbol indicating AND. Both forms will be used in this book.




Fig. 14.4 OR gate representation

14.3.2 OR gate

An OR gate with inputs *A* and *B* gives an output of a 1 when *A* or *B* is 1. We can visualise such a gate as an electrical circuit involving two switches in parallel (Fig. 14.4). When switch *A* or *B* is closed then there is a current. OR gates can also have more than two inputs. The truth table for the gate is:

Inputs		Output
<i>A</i>	<i>B</i>	<i>Q</i>
0	0	0
0	1	1
1	0	1
1	1	1

We can write the Boolean equation for an OR gate as:

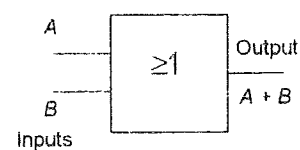




Fig. 14.5 Symbols for OR gate

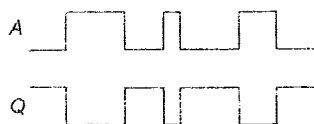


Fig. 14.6 NOT gate





Fig. 14.7 Symbols for NOT gate

$$A + B = Q$$

The symbols used for an OR gate are shown in Figure 14.5; the use of a greater than or equal to 1 sign to depict OR arises from the OR function being true if at least more than one input is true.

14.3.3 NOT gate

A NOT gate has just one input and one output, giving a 1 output when the input is 0 and a 0 output when the input is 1. The NOT gate gives an output which is the inversion of the input and is called an *inverter*. Thus if we have a digital input which varies with time, as in Figure 14.6, the out variation with time is the inverse.

The following is the truth table for the NOT gate:

Input	Output
A	Q
0	1
1	0

The Boolean equation describing the NOT gate is:

$$\overline{A} = Q$$

A bar over a symbol is used to indicate that the inverse, or complement, is being taken; thus the bar over the A indicates that the output Q is the inverse value of A . Figure 14.7 shows the symbols used for a NOT gate. The 1 representing NOT actually symbolises logic identity, i.e. no operation, and the inversion is depicted by the circle on the output.

14.3.4 NAND gate

The NAND gate can be considered as a combination of an AND gate followed by a NOT gate (Fig. 14.8(a)). Thus when input A is 1 and input B is 1 there is an output of 0, all other inputs giving an output of 1.

The NAND gate is just the AND gate truth table with the outputs inverted. An alternative way of considering the gate is as an AND gate with a NOT gate applied to invert both the inputs before they reach the AND gate. Figure 14.8(b) shows the symbols used for the NAND gate, being the AND symbol followed by the circle to indicate inversion. The following is the truth table:

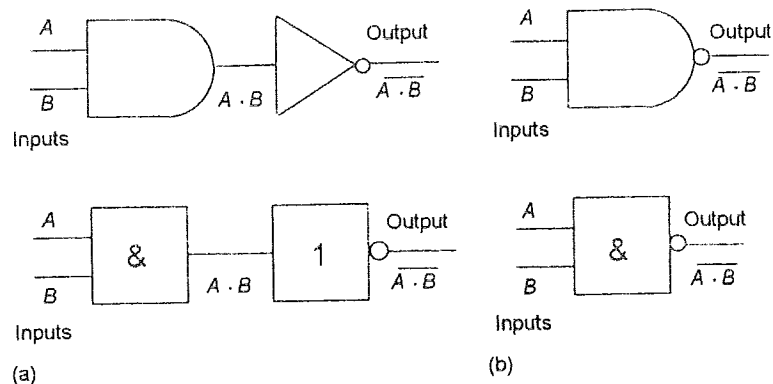


Fig. 14.8 NAND gate

Inputs		Output
A	B	Q
0	0	1
0	1	1
1	0	1
1	1	0

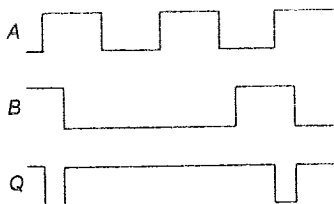


Fig. 14.9 NAND gate

The Boolean equation describing the NAND gate is:

$$\overline{A \cdot B} = Q$$

Figure 14.9 shows the output that occurs for a NAND gate when its two inputs are digital signals which vary with time. There is only a low output when both the inputs are high.

14.3.5 NOR gate

The NOR gate can be considered as a combination of an OR gate followed by a NOT gate (Fig. 14.7(a)). Thus when input A or input B is 1 there is an output of 0. It is just the OR gate with the outputs inverted. An alternative way of considering the gate is as an OR gate with a NOT gate applied to invert both the inputs before they reach the OR gate. Figure 14.10(b) shows the symbols used for the NOR gate; it is the OR symbol followed by the circle to indicate inversion. The Boolean equation for the NOR gate is:

$$\overline{A + B} = Q$$

The following is the truth table for the NOR gate:

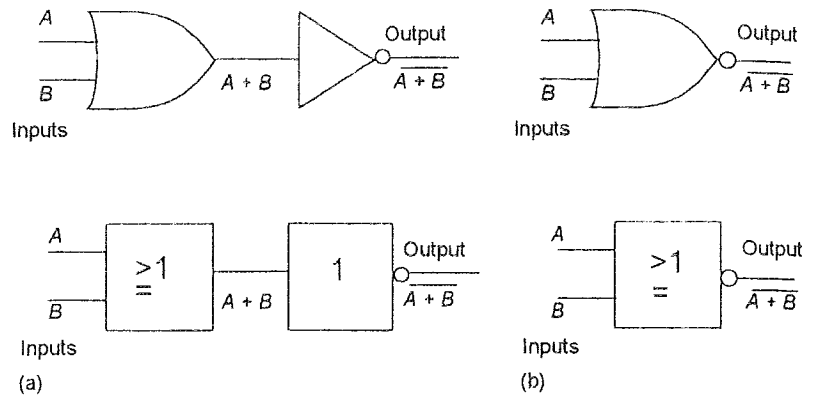


Fig. 14.10 NOR gate

Inputs		Output
A	B	Q
0	0	1
0	1	0
1	0	0
1	1	0

14.3.6 XOR gate

The EXCLUSIVE-OR gate (XOR) can be considered to be an OR gate with a NOT gate applied to one of the inputs to invert it before the inputs reach the OR gate (Fig. 14.11(a)). Alternatively it can be considered as an AND gate with a NOT gate applied to one of the inputs to invert it before the inputs reach the AND gate. The symbols are shown in Figure 14.11(b); the $=1$ depicts that the output is true if only one input is true. The following is the truth table:

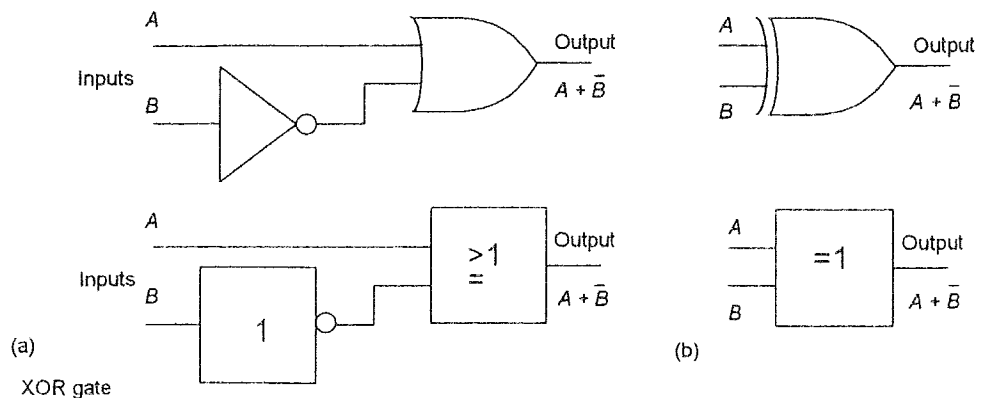


Fig. 14.11 XOR gate

Inputs		Output
<i>A</i>	<i>B</i>	<i>Q</i>
0	0	0
0	1	1
1	0	1
1	1	0

14.3.7 Combining gates

It might seem that to make logic systems we require a range of gates. However, as the following shows, we can make up all the gates from just one. Consider the combination of three NOR gates shown in Figure 14.12. The truth table, with the intermediate and final outputs, is as follows:

<i>A</i>	<i>B</i>	<i>C</i>	<i>D</i>	<i>Q</i>
0	0	1	1	0
0	1	1	0	0
1	0	0	1	0
1	1	0	0	1

The result is the same as an AND gate. If we followed this assembly of gates by a NOT gate then we would obtain a truth table the same as a NAND gate.

A combination of three NAND gates is shown in Figure 14.13. The truth table, with the intermediate and final outputs, is as follows:

<i>A</i>	<i>B</i>	<i>C</i>	<i>D</i>	<i>Q</i>
0	0	1	1	0
0	1	1	0	1
1	0	0	1	1
1	1	0	0	1

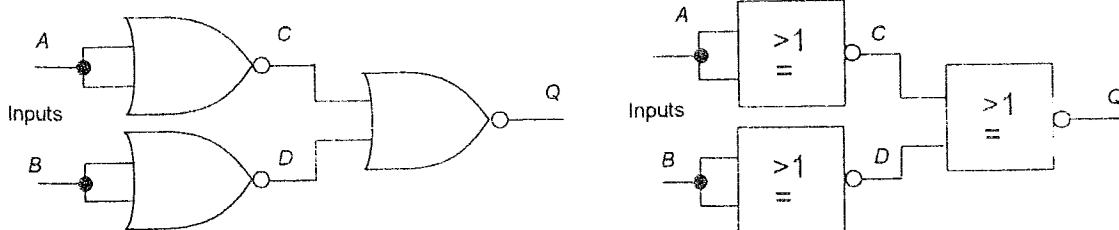


Fig. 14.12 Three NOR gates

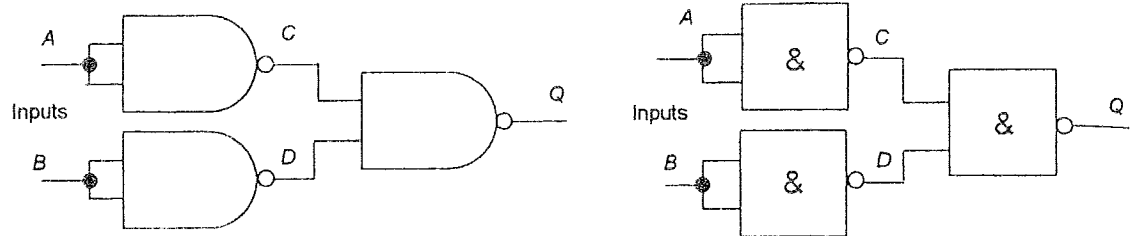
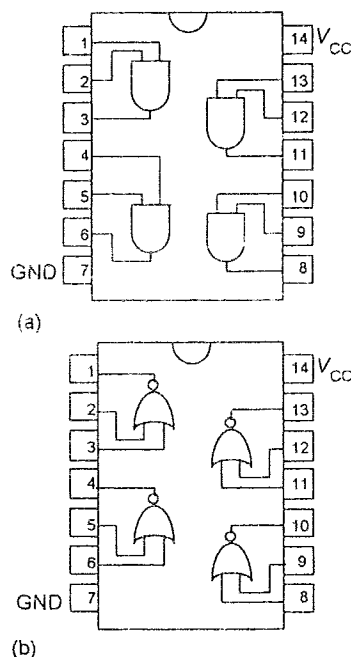


Fig. 14.13 Three NAND gates

Fig. 14.14 Integrated circuits:
(a) 7408, (b) 7402

The result is the same as an OR gate. If we followed this assembly of gates by a NOT gate then we would obtain a truth table the same as a NOR gate.

The above two illustrations of gate combinations show how one type of gate, a NOR or a NAND, can be used to substitute for other gates, provided we use more than one gate. Gates can also be combined to make complex gating circuits and sequential circuits.

Logic gates are available as integrated circuits. The different manufacturers have standardised their numbering schemes so that the basic part numbers are the same regardless of the manufacturer. For example, Figure 14.14(a) shows the gate systems available in integrated circuit 7408; it has four two-input AND gates and is supplied in a 14-pin package. Power supply connections are made to pins 7 and 14, these supplying the operating voltage for all the four AND gates. In order to indicate at which end of the package pin 1 starts, a notch is cut between pins 1 and 14. Integrated circuit 7411 has three AND gates with each having three inputs; integrated circuit 7421 has two AND gates with each having four inputs. Figure 14.14(b) shows the gate systems available in integrated circuit 7402. This has four two-input NOR gates in a 14-pin package, power connections being to pins 7 and 14. Integrated circuit 7427 has three gates with each having three inputs; integrated circuit 7425 has two gates with each having four inputs.

The above integrated circuits, with their 74xx numbers are *transistor-transistor logic (TTL) circuits* and are based on the use of transistors and basically operate between the 0 and 5 V levels. The standard CMOS family have the numbers 40xx and the high-speed CMOS family 74HCxx. Table 14.4 shows the general characteristics of the families; Figure 14.15 showing the input and output voltages.

14.4 Boolean algebra

Boolean algebra involves the binary digits 1 and 0 and the operations \cdot , $+$ and the inverse. The laws of this algebra are:

- 1 Anything ORed with itself is equal to itself: $A + A = A$.

Table 14.4 General characteristics of TTL and CMOS families

		TTL		CMOS	
Supply voltage		4.75–5.25 V		5–15 V	
Max. supply current		–100 mA		–0.02 mA	
		Input	Output	Input	Output
0 State	Voltage	0.8 V	0.5 V	1.5 V	0.05 V
	Current	–0.4 mA	8 mA	–0.0001 mA	0.5 mA
1 State	Voltage	2.0 V	2.7 V	3.5 V	4.95 V
	Current	0.02 mA	–0.4 mA	0.0001 mA	–0.2 mA
Max. operating frequency		33 MHz		10 MHz	
Active power consumption		8 mW		0.1 mW	

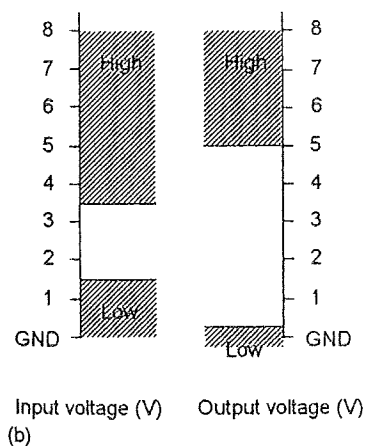
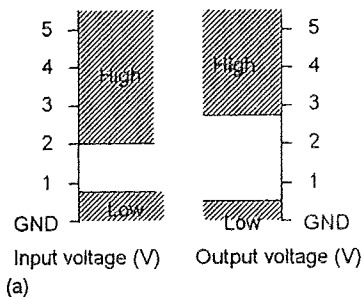


Fig. 14.15 Defining high and low: (a) TTL, (b) CMOS

- 2 Anything ANDed with itself is equal to itself: $A \cdot A = A$.
- 3 It does not matter in which order we consider inputs for OR and AND gates, e.g.

$$A + B = B + A \quad \text{and} \quad A \cdot B = B \cdot A$$

- 4 As the following truth table indicates:

$$A + (B \cdot C) = (A + B) \cdot (A + C)$$

A	B	C	$B \cdot C$	$A + B \cdot C$	$A + B$	$A + C$	$(A + B) \cdot (A + C)$
0	0	0	0	0	0	0	0
0	0	1	0	0	0	1	0
0	1	0	0	0	1	0	0
0	1	1	1	1	1	1	1
1	0	0	0	1	1	1	1
1	0	1	0	1	1	1	1
1	1	0	0	1	1	1	1
1	1	1	1	1	1	1	1

- 5 Likewise we can use a truth table to show that we can treat bracketed terms in the same way as in ordinary algebra, e.g.

$$A \cdot (B + C) = A \cdot B + A \cdot C$$

- 6 Anything ORed with its own inverse equals 1:

$$A + \overline{A} = 1$$

- 7 Anything ANDed with its own inverse equals 0:

$$A \cdot \overline{A} = 0$$

- 8 Anything ORed with a 0 is equal to itself; anything ORed with a 1 is equal to 1. Thus $A + 0 = A$ and $A + 1 = 1$.
- 9 Anything ANDed with a 0 is equal to 0; anything ANDed with a 1 is equal to itself. Thus $A \cdot 0 = 0$ and $A \cdot 1 = A$.

As an illustration of the use of the above to simplify Boolean expressions, consider simplifying:

$$(A + B) \cdot \overline{C} + A \cdot C$$

Using item 5 for the first term gives:

$$A \cdot \overline{C} + B \cdot \overline{C} + A \cdot C$$

We can regroup this and use item 6 to give:

$$A \cdot (\overline{C} + C) + B \cdot \overline{C} = A \cdot 1 + B \cdot \overline{C}$$

Hence, using item 9 the simplified expression becomes:

$$A + B \cdot \overline{C}$$

14.4.1 De Morgan laws

As illustrated above, the laws of Boolean algebra can be used to simplify Boolean expressions. In addition we have what are known as the *De Morgan* laws:

- 1 The inverse of the outcome of ORing A and B , is the same as when the inverses of A and B are separately ANDed. The following truth table shows the validity of this:

$$\overline{A + B} = \overline{A} \cdot \overline{B}$$

A	B	$A + B$	$\overline{A + B}$	\overline{A}	\overline{B}	$\overline{A} \cdot \overline{B}$
0	0	0	1	1	1	1
0	1	1	0	1	0	0
1	0	1	0	0	1	0
1	1	1	0	0	0	0

- 2 The inverse of the outcome of ANDing A and B is the same as when the inverses of A and B are separately ORed. The following truth table shows the validity of this:

$$\overline{A \cdot B} = \overline{A} + \overline{B}$$

A	B	$A \cdot B$	$\overline{A \cdot B}$	\overline{A}	\overline{B}	$\overline{A} + \overline{B}$
0	0	0	1	1	1	1
0	1	0	1	1	0	1
1	0	0	1	0	1	1
1	1	1	0	0	0	0

As an illustration of the use of a De Morgan law, consider the simplification of the logic circuit shown in Figure 14.16.

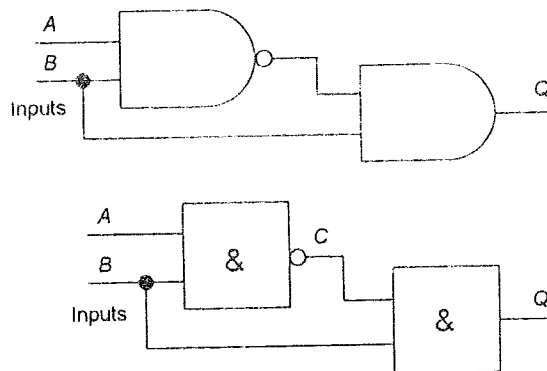


Fig. 14.16 Circuit simplification

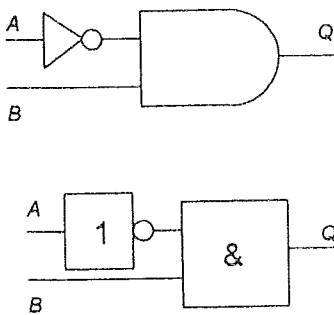


Fig. 14.17 Circuit simplification

The Boolean equation for the output in terms of the input is:

$$Q = \overline{A \cdot B} \cdot B$$



Applying the second law from above gives:

$$Q = (\overline{A} + \overline{B}) \cdot B$$



We can write this as:

$$Q = \overline{A} \cdot B + \overline{B} \cdot B = \overline{A} \cdot B + 0 = \overline{A} \cdot B$$

Hence the simplified circuit is as shown in Figure 14.17.

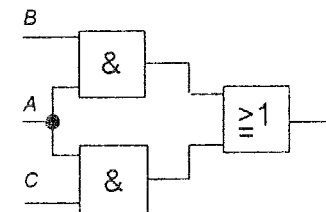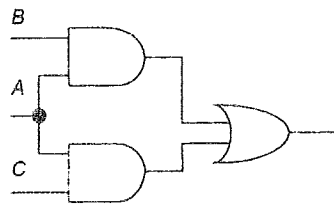

(a)

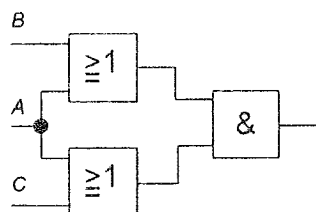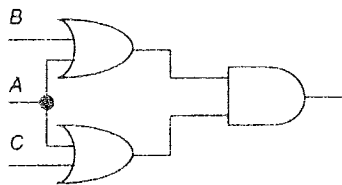

(b)

Fig. 14.18 (a) Sum of products,
(b) product of sums

14.4.2 Boolean function generation from truth tables

Given a situation where the requirements of a system can be specified in terms of a truth table, how can a logic gate system using the minimum number of gates be devised to give that truth table?

Boolean algebra can be used to manipulate switching functions into many equivalent forms, some of which take many more logic gates than others; the form, however, to which most are minimised is AND gates driving a single OR gate or vice versa. Two AND gates driving a single OR gate (Fig. 14.18(a)) give:

$$A \cdot B + A \cdot C$$

This is termed the *sum of products* form. For two OR gates driving a single AND gate (Fig. 14.18(b)), we have:

$$(A + B) \cdot (A + C)$$

This is known as the *product of sums* form.

Thus in considering what minimum form might fit a given truth table, the usual procedure is to find the sum of products or the product of sums form that fits the data. Generally the sum of products form is used. The procedure used is to consider each row of the truth table in turn and find the product that would fit a row. The overall result is then the sum of all these products.

Suppose we have a row in a truth table of:



$$A = 1, B = 0 \text{ and output } Q = 1$$

When A is 1 and B is not 1 then the output is 1, thus the product which fits this is:

$$Q = A \cdot \overline{B}$$

We can repeat this operation for each row of a truth table, as the following table indicates.

A	B	Output	Products
0	0	0	$\overline{A} \cdot \overline{B}$
0	1	0	$\overline{A} \cdot B$
1	0	1	$A \cdot \overline{B}$
1	1	0	$A \cdot B$

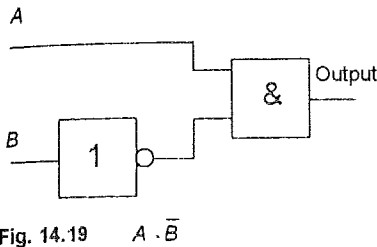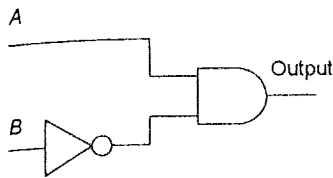Fig. 14.19 $A \cdot \bar{B}$

However, only the row of the truth table that has an output of 1 need be considered, since the rows with 0 output do not contribute to the final expression; the result is thus:

$$Q = A \cdot \bar{B}$$

The logic gate system that will give this truth table is thus that shown in Figure 4.19.

As a further example, consider the following truth table, only the products terms giving a 1 output being included:

A	B	C	Output	Products
0	0	0	1	$\bar{A} \cdot \bar{B} \cdot \bar{C}$
0	0	1	0	
0	1	0	1	$\bar{A} \cdot B \cdot \bar{C}$
0	1	1	0	
1	0	0	0	
1	0	1	0	
1	1	0	0	
1	1	1	0	

Thus the sum of products which fits this table is:

$$Q = \bar{A} \cdot \bar{B} \cdot \bar{C} + \bar{A} \cdot B \cdot \bar{C}$$

This can be simplified to give:

$$Q = \bar{A} \cdot \bar{C} \cdot (\bar{B} + B) = \bar{A} \cdot \bar{C}$$

The truth table can thus be generated by just a NAND gate.

14.5 Karnaugh maps

The *Karnaugh map* is a graphical method that can be used to produce simplified Boolean expressions from sums of products obtained from truth tables. The truth table has a row for the value of the output for each combination of input values. With two input variables there are four lines in the truth table, with three input variables six lines and with four input variables 16 lines. Thus with two input variables there are four product terms, with three input variables there are six and with four input variables 16. The Karnaugh map is drawn as a rectangular array of cells, with each cell corresponding to a particular product value. Thus with two input variables there are four cells, with three input variables six cells and with four input variables 16 cells. The output values for the rows are placed in their cells in the




Fig. 14.20 Two input variable map




Fig. 14.21 Two input variable map

Karnaugh map, though it is usual to only indicate the 1 output values and leave the cells having 0 output as empty.

Figure 14.20 shows the map for two input variables. The cells are given the output values for the following products:

the upper left cell $\bar{A} \cdot \bar{B}$,

the lower left cell $A \cdot \bar{B}$,

the upper right cell $\bar{A} \cdot B$,

the lower right cell $A \cdot B$

The arrangement of the map squares is such that horizontally adjacent squares differ only in one variable and, likewise, vertically adjacent squares differ in only one variable. Thus horizontally with our two-variable map the variables differ only in A and vertically they differ only in B .

For the following truth table, if we put the values given for the products in the Karnaugh map, only indicating where a cell has a 1 value and leaving blank those with a 0 value, then the map shown in Figure 14.21 is obtained.

A	B	Output	Products
0	0	0	$\bar{A} \cdot \bar{B}$
0	1	0	$\bar{A} \cdot B$
1	0	1	$A \cdot \bar{B}$
1	1	0	$A \cdot B$

Because the only 1 entry is in the lower right square, the truth table can be represented by the Boolean expression:

$$\text{output} = A \cdot \bar{B}$$

As a further example, consider the following truth table:

A	B	Output	Products
0	0	0	$\bar{A} \cdot \bar{B}$
0	1	0	$\bar{A} \cdot B$
1	0	1	$A \cdot \bar{B}$
1	1	1	$A \cdot B$




Fig. 14.22 Two input variable map

It gives the Karnaugh map shown in Figure 14.22. This has an output given by:

$$\text{output} = A \cdot \overline{B} + A \cdot B$$

We can simplify this to:

$$A \cdot \overline{B} + A \cdot B = A \cdot (\overline{B} + B) = A$$

When two cells containing a 1 have a common vertical edge we can simplify the Boolean expression to just the common variable. We can do this by inspection of a map, indicating which cell entries can be simplified by drawing loops round them, as in Figure 14.22.

Figure 14.23 shows the Karnaugh map for the following truth table, it having three input variables. As before we can use looping to simplify the resulting Boolean expression to just the common variable. The result is:

$$\text{output} = \overline{A} \cdot \overline{C}$$

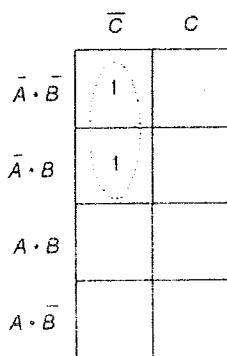


Fig. 14.23 Three input variable map

A	B	C	Output	Products
0	0	0	1	$\overline{A} \cdot \overline{B} \cdot \overline{C}$
0	0	1	0	$\overline{A} \cdot \overline{B} \cdot C$
0	1	0	1	$\overline{A} \cdot B \cdot \overline{C}$
0	1	1	0	$\overline{A} \cdot B \cdot C$
1	0	0	0	$A \cdot \overline{B} \cdot \overline{C}$
1	0	1	0	$A \cdot \overline{B} \cdot C$
1	1	0	0	$A \cdot B \cdot \overline{C}$
1	1	1	0	$A \cdot B \cdot C$

Figure 14.24 shows the Karnaugh map for the following truth table, it having four input variables. Looping simplifies the resulting Boolean expression to give:

$$\text{output} = \overline{A} \cdot \overline{C} \cdot D + A \cdot B \cdot C$$




Fig. 14.24 Four-variable map

The above represents just some simple examples of Karnaugh maps and the use of looping. Note that in looping, adjacent cells can be considered to be those in the top and bottom rows of the left- and right-hand columns. Think of opposite edges of the map being joined together. Looping a pair of adjacent 1s in a map eliminates the variable that appears in complemented and uncomplemented form. Looping a quad of adjacent 1s eliminates

the two variables that appear in both complemented and uncomplemented form. Looping an octet of adjacent 1s eliminates the three variables that appear in both complemented and uncomplemented form.

<i>A</i>	<i>B</i>	<i>C</i>	<i>D</i>	Output	Products
0	0	0	0	0	
0	0	0	1	1	$\overline{A} \cdot \overline{B} \cdot \overline{C} \cdot D$
0	0	1	0	0	
0	0	1	1	0	
0	1	0	0	0	
0	1	0	1	1	$\overline{A} \cdot B \cdot \overline{C} \cdot D$
0	1	1	0	0	
0	1	1	1	0	
1	0	0	0	0	
1	0	0	1	0	
1	0	1	0	0	
1	0	1	1	0	
1	1	0	0	0	
1	1	0	1	0	
1	1	1	0	1	$A \cdot B \cdot C \cdot \overline{D}$
1	1	1	1	1	$A \cdot B \cdot C \cdot D$

As a further illustration, consider an automated machine that will only start when two of three sensors *A*, *B* and *C* give signals. The following truth table fits this requirement and Figure 14.25 shows the resulting three-variable Karnaugh diagram.

	\overline{C}	<i>C</i>
$\overline{A} \cdot \overline{B}$		
$\overline{A} \cdot B$		1
$A \cdot B$	1	1
$A \cdot \overline{B}$		1

Fig. 14.25 Map for machine

<i>A</i>	<i>B</i>	<i>C</i>	Output	Products
0	0	0	0	
0	0	1	0	
0	1	0	0	
0	1	1	1	$\overline{A} \cdot B \cdot C$
1	0	0	0	
1	0	1	1	$A \cdot \overline{B} \cdot C$
1	1	0	1	$A \cdot B \cdot \overline{C}$
1	1	1	1	$A \cdot B \cdot C$

The Boolean expression which fits the map and thus describes the outcome from the machine is:

$$\text{Outcome} = A \cdot B + B \cdot C + A \cdot C$$

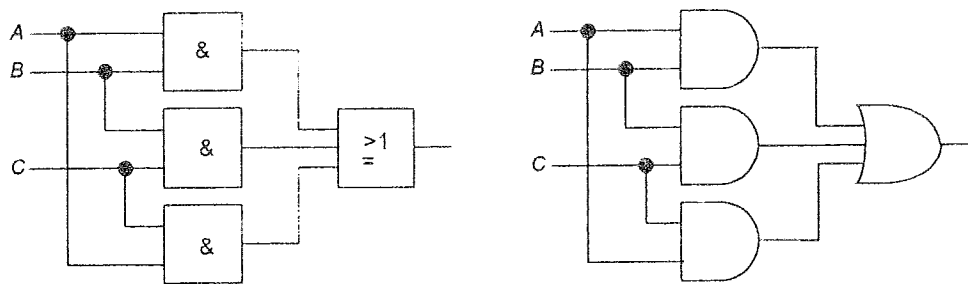


Fig. 14.26 Automated machine

Figure 14.26 shows the logic gates that could be used to generate this Boolean expression. $A \cdot B$ describes an AND gate for the inputs A and B . Likewise $B \cdot C$ and $A \cdot C$ are two more AND gates. The $+$ signs indicate that the outputs from the three AND gates are then the inputs to an OR gate.

In some logic systems there are some input variable combinations for which outputs are not specified. They are termed 'don't care states'. When entering these on a Karnaugh map, the cells can be set to either 1 or 0 in such a way that the output equations can be simplified.

14.6 Applications of logic gates

The following are some examples of the uses of logic gates for a number of simple applications.

14.6.1 Parity generators

In Section 14.2.4 the use of parity bits as an error detection method was discussed. A single bit is added to each code block to force the number of 1s in the block, including the parity bit, to be an odd number if odd parity is being used or an even number if even parity is being used.

Figure 14.27 shows a logic gate circuit that could be used to determine and add the appropriate parity bit. The system employs XOR gates; with an XOR gate if all the inputs are 0 or all are 1 the output is 0, and if the inputs are not equal the output is a 1. Pairs of bits are checked and an output of 1 given if they are not equal. If odd parity is required the bias bit is 0, if even parity it is 1. The appropriate bias bit can then be added to the signal for transmission. The same circuit can be used to check the parity at the receiver, with the final output being a 1 when there is an error. Such circuits are available as integrated circuits.

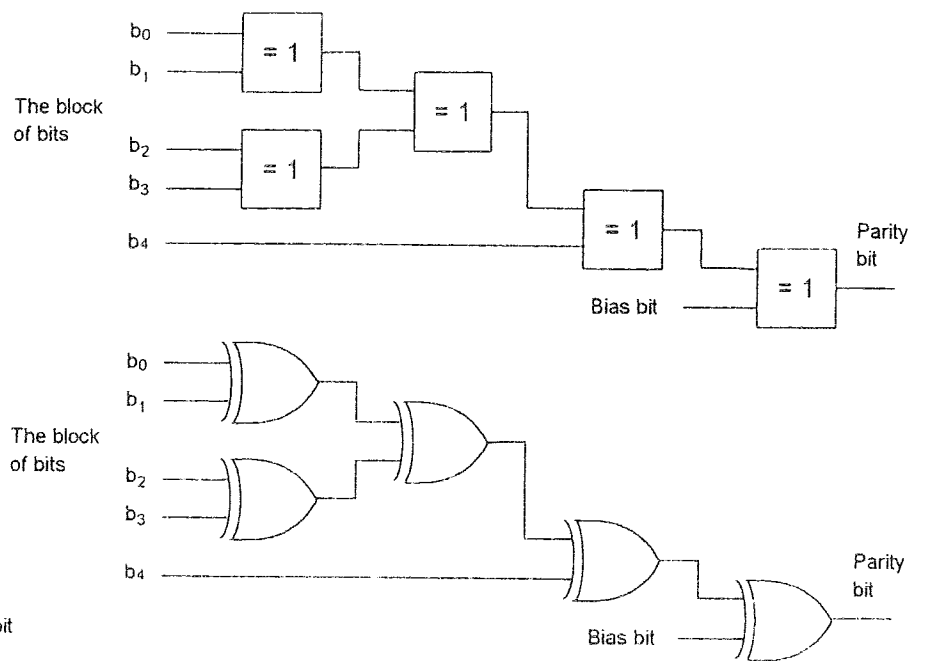


Fig. 14.27 Parity bit generator

14.6.2 Digital comparator

A digital comparator is used to compare two digital words to determine if they are exactly equal. The two words are compared bit by bit and a 1 output given if the words are equal. To compare the equality of two bits an XOR gate can be used; if the bits are both 0 or both 1 the output is 0, and if they are not equal the output is a 1. To obtain a 1 output when the bits are the same we need to add a NOT gate, this combination of XOR and NOT being termed an XNOR gate. To compare each of the pairs of bits in two words we need an XNOR gate for each pair. If the pairs are made up of the same bits then the output from each XNOR gate is a 1. We can then use an AND gate to give a 1 output when all the XNOR outputs are 1s. Figure 14.28 shows the system.

Digital comparators are available as integrated circuits and can generally not only determine if two words are equal but which one is greater than the other. For example, the 7485 4-bit magnitude comparator compares two 4-bit words A and B , giving a 1 output from pin 5 if A is greater than B , a 1 output from pin 6 if A equals B and a 1 output from pin 7 if A is less than B .

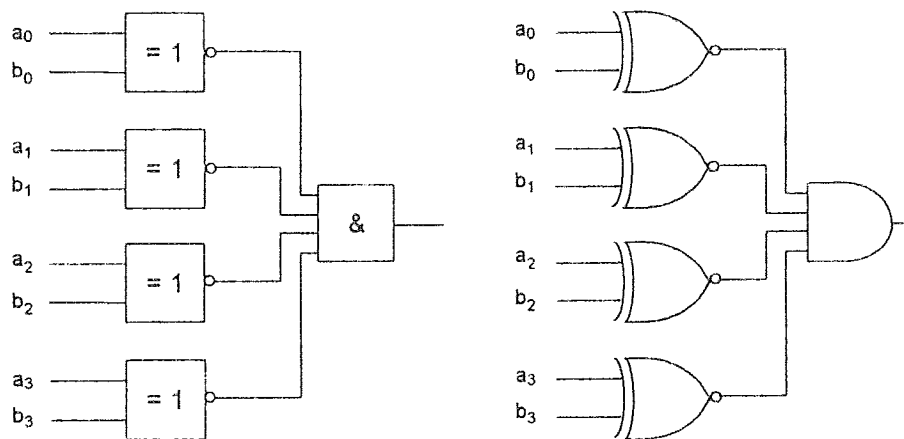


Fig. 14.28 Comparator

14.6.3 Code converter

In many applications there is a need to change data from one type of code to another. For example, the output from a microprocessor system might be BCD and need to be transformed into a suitable code to drive a seven-segment display. The term *data decoding* is used for the process of converting some code group, e.g. BCD, binary, hex, into an individual active output representing that group. A decoder has n binary input lines for the coded input of an n -bit word and gives m output lines such that only one line is activated for one possible combination of inputs, i.e. only one output line gives an output for a particular word input code. For example, a BCD-to-decimal decoder has a 4-bit input code and 10 output lines so that a particular BCD input will give rise to just one of the output lines being activated and so indicating a particular decimal number with each output line corresponding to a decimal number (Fig. 14.29).


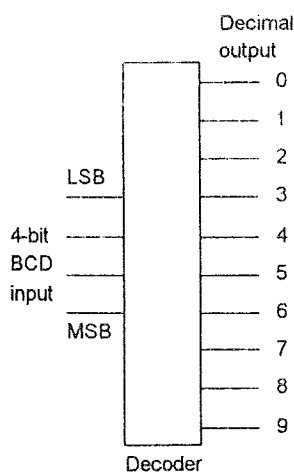


Fig. 14.29 Decoder

Thus, in general, a *decoder* is a logic circuit that looks at its inputs, determines which number is there, and activates the one output that corresponds to that number. Decoders are widely used in microprocessor circuits.

Decoders can have the active output high and the inactive ones low or the active output low and the inactive ones high. For active-high output a decoder can be assembled from AND gates while for active-low output NAND gates can be used. Figure 14.30 shows how a BCD-to-decimal decoder for active-low output can be assembled and the resulting truth table. Such a decoder is readily available as an integrated circuit, e.g. 74LS145.


A decoder that is widely used is BCD-to-seven, e.g. 74LS244, for taking a 4-bit BCD input and giving an output to drive the seven segments of a display.

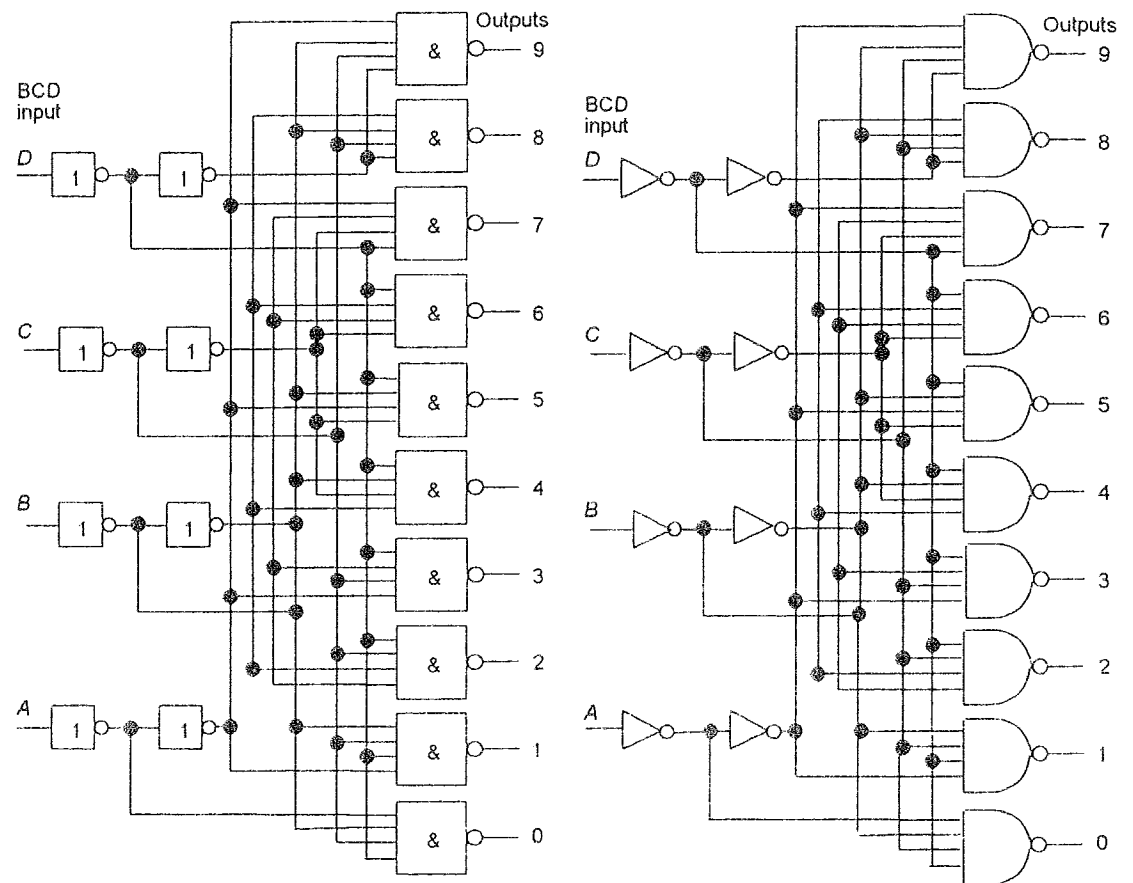

Inputs				Outputs									
A	B	C	D	0	1	2	3	4	5	6	7	8	9
0	0	0	0	0	1	1	1	1	1	1	1	1	1
0	0	0	1	1	0	1	1	1	1	1	1	1	1
0	0	1	0	1	1	0	1	1	1	1	1	1	1
0	0	1	1	1	1	1	1	1	1	1	1	1	1
0	1	0	0	1	1	1	1	0	1	1	1	1	1
0	1	0	1	1	1	1	1	1	0	1	1	1	1
0	1	1	0	1	1	1	1	1	1	0	1	1	1
0	1	1	1	1	1	1	1	1	1	1	0	1	1
1	0	0	0	1	1	1	1	1	1	1	1	0	1
1	0	0	1	1	1	1	1	1	1	1	1	1	0
1	0	1	0	1	1	1	1	1	1	1	1	1	1
1	0	1	1	1	1	1	1	1	1	1	1	1	1
1	1	0	0	1	1	1	1	1	1	1	1	1	1
1	1	0	1	1	1	1	1	1	1	1	1	1	1
1	1	1	0	1	1	1	1	1	1	1	1	1	1
1	1	1	1	1	1	1	1	1	1	1	1	1	1

Fig. 14.30 BCD-to-decimal decoder: 1 = HIGH, 0 = LOW

The term *3-line-to-8-line decoder* is used where a decoder has three input lines and eight output lines. It takes a 3-bit binary number and activates the one of the eight outputs corresponding to that number. Figure 14.31 shows how such a decoder can be realised from logic gates and its truth table.

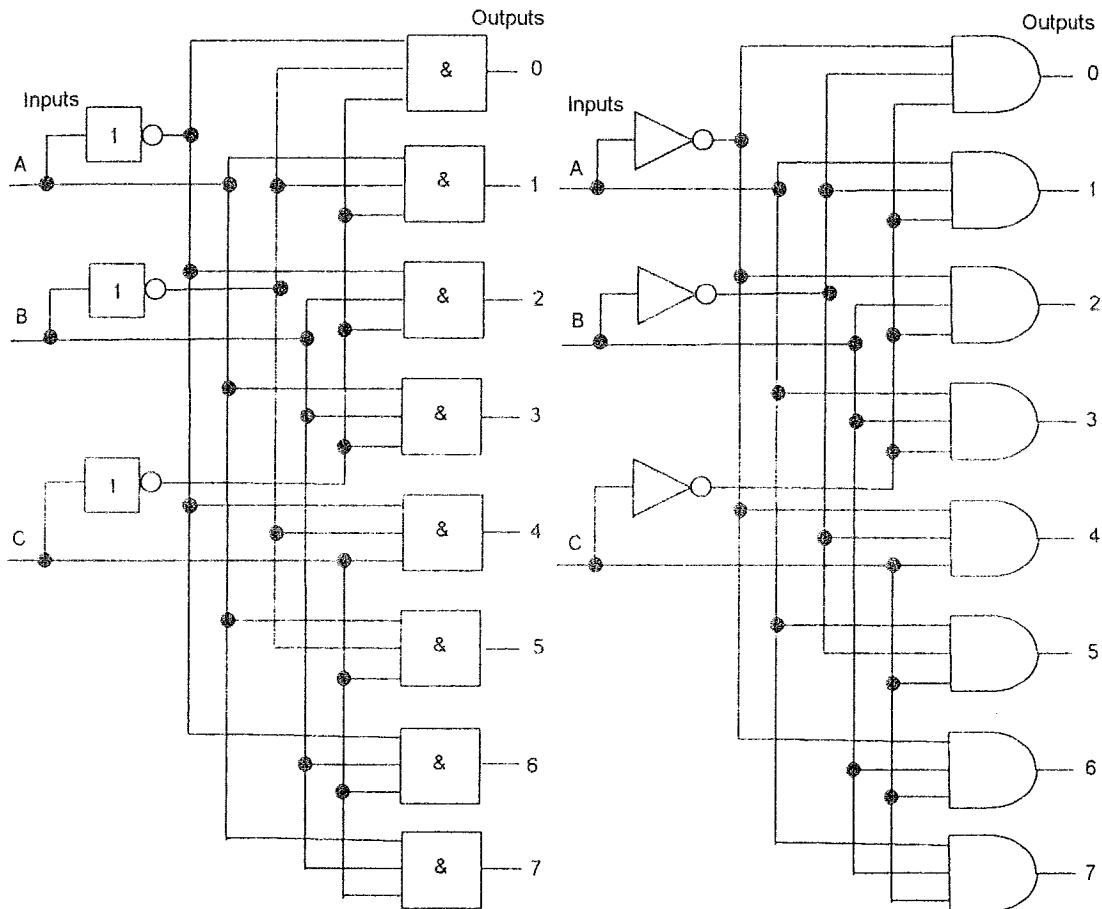

Inputs			Outputs							
C	B	A	0	1	2	3	4	5	6	7
0	0	0	1	0	0	0	0	0	0	0
0	0	1	0	1	0	0	0	0	0	0
0	1	0	0	0	1	0	0	0	0	0
0	1	1	0	0	0	1	0	0	0	0
1	0	0	0	0	0	0	1	0	0	0
1	0	1	0	0	0	0	0	1	0	0
1	1	0	0	0	0	0	0	0	1	0
1	1	1	0	0	0	0	0	0	0	1

Fig. 14.31 3-line-to-8-line decoder

Some decoders have one or more ENABLE inputs that are used to control the operation of the decoder. Thus with the ENABLE line HIGH the decoder will function in its normal way and the inputs will determine which output is HIGH; with the ENABLE line LOW all the outputs are held LOW regardless of the inputs. Figure 14.32 shows a commonly used 3-line-to-8-line decoder with this facility, the 74LS138. Note that the outputs are active-LOW rather than the active-HIGH of Figure 14.31, and that it has three ENABLE lines with the requirement for normal functioning that E1 and E3 are LOW and E3 is HIGH. All other variations result in the decoder being disabled and just a HIGH output.

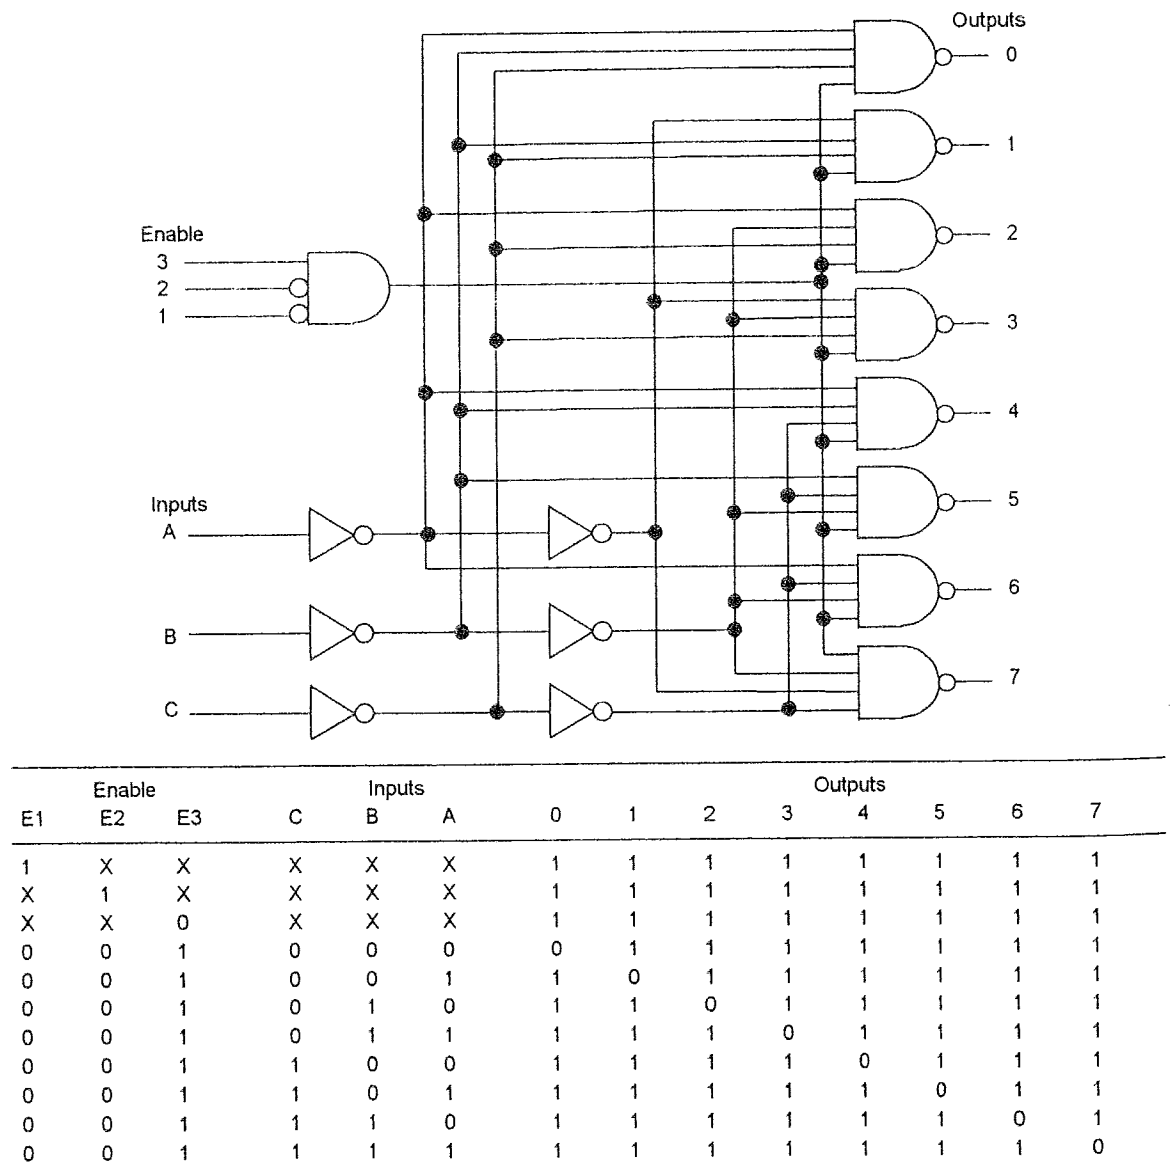


Fig. 14.32 74LS138: 1 = HIGH, 0 = LOW, X = does not matter

Figure 14.33 illustrates the type of response we can get from a 74LS138 decoder for different inputs.

A 74LS138 decoder might be used with a microprocessor with the ENABLE used to switch on the decoder and then depending on the the output from three output lines from the microprocessor so one of the 8 decoder outputs receives the LOW output with all the others remaining HIGH. Thus, we can consider each output device to have an address, i.e. a unique binary output number, so that when a microprocessor sends an address to the decoder it activates the device which has been allocated that address. The 74LS138 can then be referred to as an address decoder.

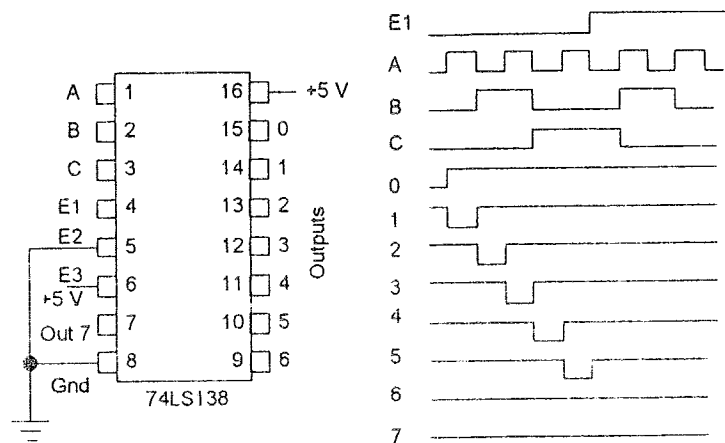


Fig. 14.33 74LS138

14.7 Sequential logic

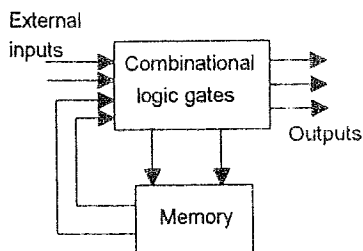


Fig. 14.34 Sequential logic system

The logic circuits considered in earlier sections of this chapter are all examples of combinational logic systems. With such systems the output is determined by the combination of the input variables at a particular instant of time. For example, if input *A* and input *B* occur at the same time then an AND gate gives an output. The output does not depend on what the inputs previously were. Where a system requires an output which depends on earlier values of the inputs, a *sequential logic* system is required. The main difference between a combinational logic system and a sequential logic system is that the sequential logic system must have some form of memory.

Figure 14.34 shows the basic form of a sequential logic system. The combinational part of the system accepts logic signals from external inputs and from outputs from the memory. The combinational system then operates on these inputs to produce its outputs. The outputs are thus a function of both its external inputs and the information stored in its memory.

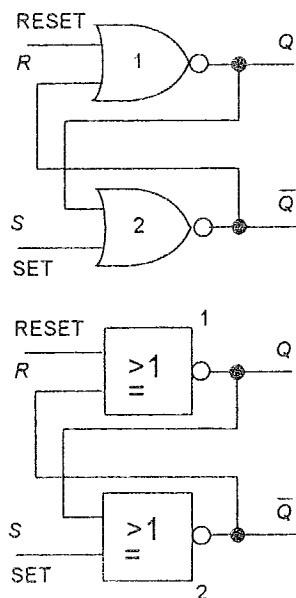


Fig. 14.35 SR flip-flop

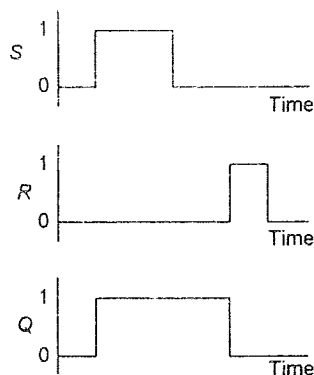


Fig. 14.36 Timing diagram




Fig. 14.37 SR flip-flop

14.7.1 The flip-flop

The *flip-flop* is a basic memory element which is made up of an assembly of logic gates. There are a number of forms of flip-flops. Figure 14.35 shows one form, the SR (set-reset) flip-flop, involving NOR gates. If initially we have both outputs 0 and $S = 0$ and $R = 0$, then when we set and have S change from 0 to 1, the output from NOR gate 2 will become 0. This will then result in both the inputs to NOR gate 1 becoming 0 and so its output becomes 1. This feedback acts as an input to NOR gate 2 which then has both its inputs at 1 and results in no further change.

Now if S changes from 1 to 0, the output from NOR gate 1 remains at 1 and the output from NOR gate 2 remains at 0. There is no change in the outputs when the input S changes from 1 to 0. It will remain in this state indefinitely if the only changes are to S . It 'remembers' the state it was set to. Figure 14.36 illustrates this with a timing diagram in which a rectangular pulse is used as the input S .

If we change R from 0 to 1 when S is 0, the output from NOR gate 1 changes to 0 and hence the output from NOR gate 2 changes to 1. The flip-flop has been reset. A change then of R to 0 will have no effect on these outputs.

Thus when S is set to 1 and R made 0, the output Q will change to 1 if it was previously 0, remaining at 1 if it was previously 1. This is the set condition and it will remain in this condition even when S changes to 0. When S is 0 and R is made 1 the output Q is reset to 0 if it was previously 1, remaining at 0 if it was previously 0. This is the rest condition. The output Q that occurs at a particular time will depend on the inputs S and R and also the last value of the output. The following state table illustrates this:

S	R	$Q_t \rightarrow Q_{t+1}$	$\bar{Q}_t \rightarrow \bar{Q}_{t+1}$
0	0	$0 \rightarrow 0$	$1 \rightarrow 1$
0	0	$1 \rightarrow 1$	$0 \rightarrow 0$
0	1	$0 \rightarrow 0$	$1 \rightarrow 1$
0	1	$1 \rightarrow 0$	$0 \rightarrow 0$
1	0	$0 \rightarrow 1$	$1 \rightarrow 0$
1	0	$1 \rightarrow 1$	$0 \rightarrow 0$
1	1	Not allowed	
1	1	Not allowed	

Note that if S and R are simultaneously made equal to 1, no stable state can occur and so this input condition is not allowed. Figure 14.37 shows the simplified block symbol used for the SR flip-flop.

As a simple illustration of the use of a flip-flop consider a simple alarm system in which an alarm is to sound when a beam

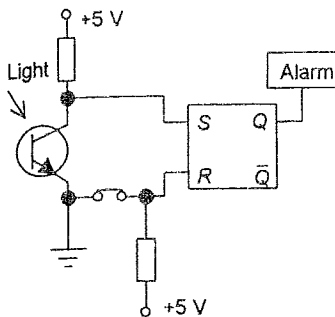


Fig. 14.38 Alarm circuit


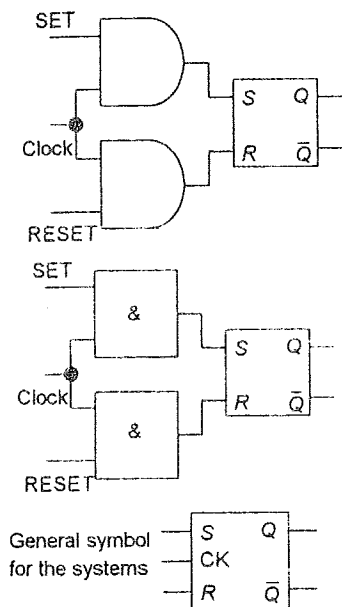


Fig. 14.39 Clocked SR flip-flop

Fig. 14.40 Timing diagram

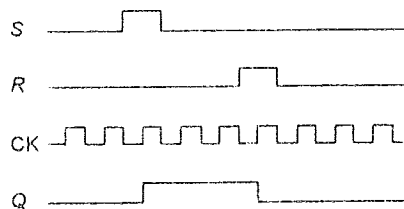

of light is interrupted and remain sounding even when the beam is no longer interrupted. Figure 14.38 shows a possible system. A photo transistor might be used as the sensor and so connected that when it is illuminated it gives a virtually 0 V input to S but when the illumination ceases it gives about 5 V input to S . When the light beam is interrupted S becomes 1 and the output from the flip-flop becomes 1 and the alarm sounds. The output will remain as 1 even when S changes to 0. The alarm can only be stopped if the reset switch is momentarily opened to produce a 5 V input to R .

14.7.2 Synchronous systems

It is often necessary for set and reset operations to occur at particular times. With an unclocked or *asynchronous system* the outputs of logic gates can change state any time any one or more of the inputs change. With a clocked or *synchronous system* the exact times at which any output can change state is determined by a signal termed the clock signal. This is generally a rectangular pulse train and when the same clock signal is used for all parts of the system, outputs are synchronised. Figure 14.39 shows the principle of a gated SR flip-flop. The set and clock signal are supplied through an AND gate to the S input of the flip-flop. Thus the set signal only arrives at the flip-flop when both it and the clock signal are 1. Likewise the reset signal is supplied with the clock signal to the R input via another AND gate. As a consequence, setting and resetting can only occur at the time determined by the clock. Figure 14.40 shows the timing diagram.

14.7.3 JK flip-flop

For many applications the indeterminate state that occurs with the SR flip-flop when $S = 1$ and $R = 1$ is not acceptable and another form of flip-flop is used, the *JK flip-flop* (Fig. 14.41). This has become a very widely used flip-flop device. The following is the truth table for this flip-flop; note the only changes from the state table for the SR flip-flop are the entries when both inputs are 1.




Fig. 14.41 JK flip-flop

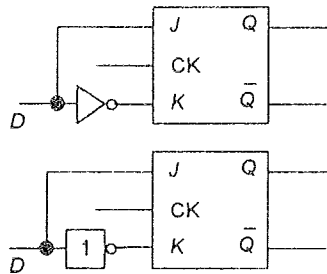


Fig. 14.42 D flip-flop




Fig. 14.43 Output from D flip-flop




Fig. 14.44 Symbol for D flip-flop

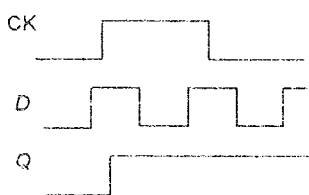


Fig. 14.45 Positive edge-triggered




Fig. 14.46 Symbol for edge-triggered D flip-flop

J	K	$Q_i \rightarrow Q_{i+1}$	$\bar{Q}_i \rightarrow \bar{Q}_{i+1}$
0	0	$0 \rightarrow 0$	$1 \rightarrow 1$
0	0	$1 \rightarrow 1$	$0 \rightarrow 0$
0	1	$0 \rightarrow 0$	$1 \rightarrow 1$
0	1	$1 \rightarrow 0$	$0 \rightarrow 0$
1	0	$0 \rightarrow 1$	$1 \rightarrow 0$
1	0	$1 \rightarrow 1$	$0 \rightarrow 0$
1	1	$0 \rightarrow 1$	$1 \rightarrow 0$
1	1	$1 \rightarrow 0$	$0 \rightarrow 1$

As an illustration of the use of such a flip-flop, consider the requirement for a high output when input A goes high and then some time later B goes high. An AND gate can be used to determine whether two inputs are both high but its output will be high regardless of which input goes high first. However, if the inputs A and B are used with a JK flip-flop, then A must be high first in order for the output to go high when B subsequently goes high.

14.7.4 D flip-flop

The Data or *D flip-flop* is basically a clocked SR flip-flop or a JK flip-flop with the D input being connected directly to the S or J inputs and via a NOT gate to the R or K inputs (Fig. 14.42); in the symbol for the D flip-flop this joined R and K input is labelled D . This arrangement means that a 0 or a 1 input will then switch the outputs to follow the input when the clock pulse is 1 (Fig. 14.43). A particular use of the D flip-flop is to ensure that the output will only take on the value of the D input at precisely defined times. Figure 14.44 shows the symbol used for a D flip-flop.

With the above form of D flip-flop, when the clock or enable input goes high, the output follows the data presented at input D . The flip-flop is said to be transparent. When there is a high-to-low transition at the enable input, output Q is held at the data level just prior to the transition. The data at transition is said to be *latched*. D flip-flops are available as integrated circuits. The 7475 is an example, it containing four transparent D latches.

The 7474 D flip-flop differs from the 7475 in being an edge-triggered device; there are two such flip-flops in the package. With an edge-triggered D flip-flop, transitions in Q only occur at the edge of the input clock pulse and with the 7474 it is the positive edge, i.e. low-to-high transition. Figure 14.45 illustrates this. The basic symbol for an edge-triggered D flip-flop differs from that of a D flip-flop by a small triangle being included on the CK input (Fig. 14.46). There are also two other inputs called preset and clear. A low on the preset sets the output Q to 1 while a low on clear clears the output, setting Q to 0.

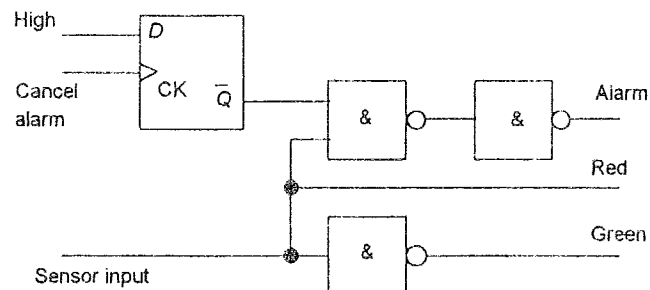


Fig. 14.47 Alarm system

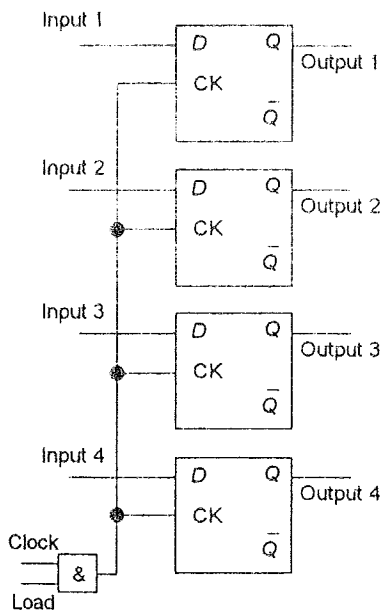


Fig. 14.48 Register

As an illustration of a simple application for such a flip-flop, Figure 14.47 shows a system that could be used to show a green light when the sensor input is low and a red light when it goes high and sound an alarm. The red light is to remain on as long as the sensor input is high but the alarm can be switched off. This might be a monitoring system for the temperature in some process, the sensor and signal conditioning giving a low signal when the temperature is below the safe level and a high signal when it is above. The flip-flop has a high input. When a low input is applied to the CK input and the sensor input is low, the green light is on. When the sensor input changes to high, the green light goes out, the red light on and the alarm sounds. The alarm can be cancelled by applying a high signal to the CK input, but the red light remains on as long as the sensor input is high. Such a system could be constructed using a 7474 and an integrated circuit or circuits giving three NAND gates.

14.7.5 Registers

A *register* is a set of memory elements and is used to hold information until it is needed. It can be implemented by a set of flip-flops. Each flip-flop stores a binary signal, i.e. a 0 or a 1. Figure 14.48 shows the form a 4-bit register can take when using D flip-flops. When the load signal is 0, no clock input occurs to the D flip-flops and so no change occurs to the states of the flip-flops. When the load signal is 1 then the inputs can change the states of the flip-flops. As long as the load signal is 0 the flip-flops will hold their old state values.

Problems

- 1 What is the largest decimal number that can be represented by the use of an 8-bit binary number?
- 2 Convert the following binary numbers to decimal numbers:
(a) 1011, (b) 10 0001 0001.
- 3 Convert the decimal numbers (a) 423, (b) 529 to hex.
- 4 Convert the BCD numbers (a) 0111 1000 0001, (b) 0001 0101 0111 to decimal.

- 5 What are the twos complement representations of the decimal numbers (a) -90, (b) -35?
- 6 What even-parity bits should be attached to (a) 100 1000, (b) 100 1111?
- 7 Subtract the following decimal numbers using twos complements (a) $21 - 13$, (b) $15 - 3$.
- 8 Explain what logic gates might be used to control the following situations:
 - (a) The issue of tickets at an automatic ticket machine at a railway station.
 - (b) A safety lock system for the operation of a machine tool.
- 9 State the Boolean functions that can be used to describe the following situations:
 - (a) There is an output when switch A is closed and either switch B or switch C is closed.
 - (b) There is an output when either switch A or switch B is closed and either switch C or switch D is closed.
 - (c) There is an output when either switch A is opened or switch B is closed.
 - (d) There is an output when switch A is opened and switch B is closed.
- 10 State the Boolean functions for each of the logic circuits shown in Figure 14.49.

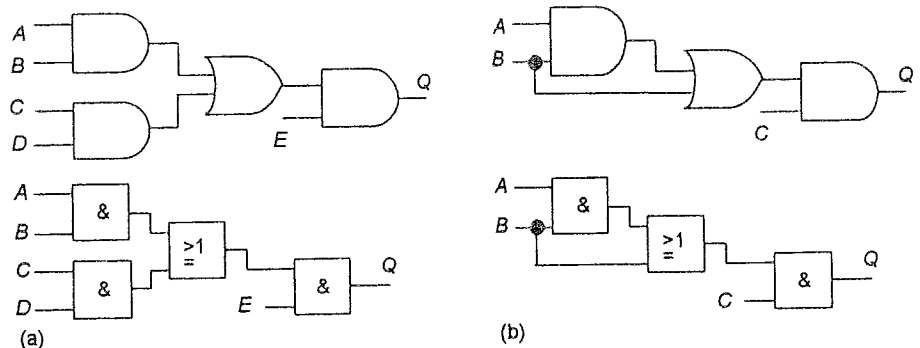


Fig. 14.49
Problem 10

- 11 Construct a truth table for the Boolean equation $Q = (A \cdot C + B \cdot C) \cdot (A + C)$.
- 12 Simplify the following Boolean equations:
 - (a) $Q = A \cdot C + A \cdot C \cdot D + C \cdot D$
 - (b) $Q = A \cdot \overline{B} \cdot D + A \cdot \overline{B} \cdot \overline{D}$
 - (c) $Q = A \cdot B \cdot C + C \cdot D + C \cdot D \cdot E$
- 13 Use De Morgan's laws to show that a NOR gate with inverted inputs is equivalent to an AND gate.
- 14 Draw the Karnaugh maps for the following truth tables and hence determine the simplified Boolean equation for the outputs:

Appendix A

The Laplace transform

A.1 The Laplace transform

This appendix gives more details of the Laplace transform than appears in Chapter 11. For a more detailed discussion of the Laplace transform, and examples of their use, the reader is referred to *Laplace and z-Transforms* by W. Bolton (Mathematics for Engineers Series, Longman 1994).

Consider a quantity which is a function of time. We can talk of this quantity being in the *time domain* and represent such a function as $f(t)$. In many problems we are only concerned with values of time greater than or equal to 0, i.e. $t \geq 0$. To obtain the Laplace transform of this function we multiply it by e^{-st} and then integrate with respect to time from zero to infinity. Here s is a constant with the unit of 1/time. The result is what we now call the *Laplace transform* and the equation is then said to be in the *s-domain*. Thus the Laplace transform of the function of time $f(t)$, which is written as $\mathcal{L}\{f(t)\}$, is given by

$$\mathcal{L}\{f(t)\} = \int_0^{\infty} e^{-st} f(t) dt$$

The transform is *one-sided* in that values are only considered between 0 and $+\infty$, and not over the full range of time from $-\infty$ to $+\infty$.

We can carry out algebraic manipulations on a quantity in the *s-domain*, i.e. adding, subtracting, dividing and multiplying in the normal way we do any algebraic quantities. We could not have done this on the original function, assuming it to be in the form of a differential equation, when in the time domain. By this means we can obtain a considerably simplified expression in the *s-domain*. If we want to see how the quantity varies with time in the time domain then we have to carry out the inverse transformation. This involves finding the time domain function that could have given the simplified *s-domain* expression.

When in the *s-domain* a function is usually written, since it is a function of s , as $F(s)$. It is usual to use a capital letter F for the

Laplace transform and a lower-case letter f for the time-varying function $f(t)$. Thus

$$\mathcal{L}\{f(t)\} = F(s)$$

For the inverse operation, when the function of time is obtained from the Laplace transform, we can write

$$f(t) = \mathcal{L}^{-1}\{F(s)\}$$

This equation thus reads as: $f(t)$ is the inverse transform of the Laplace transform $F(s)$.

A.1.1 The Laplace transform from first principles

To illustrate the transformation of a quantity from the time domain into the s -domain, consider a function that has the constant value of 1 for all values of time greater than 0, i.e. $f(t) = 1$ for $t \geq 0$. This describes a *unit-step* function and is shown in Figure ApA.1. The Laplace transform is then

$$\mathcal{L}\{f(t)\} = F(s) = \int_0^{\infty} 1 e^{-st} dt = -\frac{1}{s} [e^{-st}]_0^{\infty}$$

Since with $t = \infty$ the value of e is 0 and with $t = 0$ the value of e^0 is -1 , then

$$F(s) = \frac{1}{s}$$

As another example, the following shows the determination, from first principles, of the Laplace transform of the function e^{at} , where a is a constant. The Laplace transform of $f(t) = e^{at}$ is thus

$$\begin{aligned} F(s) &= \int_0^{\infty} e^{at} e^{-st} dt \\ &= \int_0^{\infty} e^{-(s-a)t} dt = -\frac{1}{s-a} [e^{-(s-a)t}]_0^{\infty} \end{aligned}$$

When $t = \infty$ the term in the brackets becomes 0 and when $t = 0$ it becomes -1 . Thus

$$F(s) = \frac{1}{s-a}$$

Common input functions to systems are the unit step and the impulse. The following indicates how their Laplace transforms are obtained.




Fig. ApA.1 Unit-step function

A.2 Unit steps and impulses

A.2.1 The unit-step function

Figure ApA.1 shows a graph of a unit-step function. Such a function, when the step occurs at $t = 0$, has the equation

$$\begin{aligned} f(t) &= 1 \text{ for all values of } t \text{ greater than } 0 \\ f(t) &= 0 \text{ for all values of } t \text{ less than } 0 \end{aligned}$$

The step function describes an abrupt change in some quantity from zero to a steady value, e.g. the change in the voltage applied to a circuit when it is suddenly switched on.

The unit-step function thus cannot be described by $f(t) = 1$ since this would imply a function that has the constant value of 1 at all values of t , both positive and negative. The unit-step function that switches from 0 to +1 at $t = 0$ is conventionally described by the symbol $u(t)$ or $H(t)$, the H being after the originator O. Heaviside. It is thus sometimes referred to as the *Heaviside function*.

The Laplace transform of this step function is, as derived in the previous section,

$$F(s) = \frac{1}{s}$$

The Laplace transform of a step function of height a is

$$F(s) = \frac{a}{s}$$




Fig. ApA.2 Rectangular pulse

A.2.2 Impulse function

Consider a rectangular pulse of size $1/k$ that occurs at time $t = 0$ and which has a pulse width of k , i.e. the area of the pulse is 1. Figure ApA.2 shows such a pulse. The pulse can be described as

$$\begin{aligned} f(t) &= \frac{1}{k} \text{ for } 0 \leq t < k \\ f(t) &= 0 \text{ for } t > k \end{aligned}$$

If we maintain this constant pulse area of 1 and then decrease the width of the pulse (i.e. reduce k), the height increases. Thus, in the limit as $k \rightarrow 0$ we end up with just a vertical line at $t = 0$ with the height of the graph going off to infinity. The result is a graph that is zero except at a single point where there is an infinite spike (Fig. ApA.3). Such a graph can be used to represent an impulse. The impulse is said to be a unit impulse because the area enclosed by it is 1. This function is represented by $\delta(t)$, the *unit impulse function* or the *Dirac-delta function*.

The Laplace transform for the unit area rectangular pulse in Figure ApA.2 is given by

$$F(s) = \int_0^{\infty} f(t)e^{-st} dt$$




Fig. ApA.3 Impulse

$$\begin{aligned}
&= \int_0^k \frac{1}{k} e^{-st} dt + \int_k^\infty 0 e^{-st} dt \\
&= \left[-\frac{1}{sk} e^{-st} \right]_0^k \\
&= -\frac{1}{sk} (e^{-sk} - 1)
\end{aligned}$$

To obtain the Laplace transform for the unit impulse we need to find the value of the above in the limit as $k \rightarrow 0$. We can do this by expanding the exponential term as a series. Thus

$$e^{-sk} = 1 - sk + \frac{(-sk)^2}{2!} + \frac{(-sk)^3}{3!} + \dots$$

and so we can write

$$F(s) = 1 - \frac{sk}{2!} + \frac{(sk)^2}{3!} + \dots$$

Thus in the limit as $k \rightarrow 0$ the Laplace transform tends to the value 1.

$$\mathcal{L}\{\delta(t)\} = 1$$

Since the area of the above impulse is 1 we can define the size of such an impulse as being 1. Thus the above equation gives the Laplace transform for a *unit impulse*. An impulse of size a is represented by $a\delta(t)$ and the Laplace transform is

$$\mathcal{L}\{a\delta(t)\} = a$$

A.3 Standard Laplace transforms

In determining the Laplace transforms of functions it is not usually necessary to evaluate integrals since tables are available that give the Laplace transforms of commonly occurring functions. These, when combined with a knowledge of the properties of such transforms (see the next section), enable most commonly encountered problems to be tackled. Table ApA.1 lists some of the more common time functions and their Laplace transforms.

A.3.1 Properties of Laplace transforms

In this section the basic properties of the Laplace transform are outlined. These properties enable the table of standard Laplace transforms to be used in a wide range of situations.

Table ApA.1 Laplace transforms

Time function $f(t)$	Laplace transform $F(s)$
1 $\delta(t)$, unit impulse	1
2 $\delta(t - T)$, delayed unit impulse	e^{-sT}
3 $u(t)$, a unit step	$\frac{1}{s}$
4 $u(t - T)$, a delayed unit step	$\frac{e^{-sT}}{s}$
5 t , a unit ramp	$\frac{1}{s^2}$
6 t^n , n th-order ramp	$\frac{n!}{s^{n+1}}$
7 e^{-at} , exponential decay	$\frac{1}{s + a}$
8 $1 - e^{-at}$, exponential growth	$\frac{a}{s(s + a)}$
9 te^{-at}	$\frac{1}{(s + a)^2}$
10 $t^n e^{-at}$	$\frac{n!}{(s + a)^{n+1}}$
11 $t - \frac{1 - e^{-at}}{a}$	$\frac{a}{s^2(s + a)}$
12 $e^{-at} - e^{-bt}$	$\frac{b - a}{(s + a)(s + b)}$
13 $(1 - at)e^{-at}$	$\frac{s}{(s + a)^2}$
14 $1 - \frac{b}{b - a}e^{-at} + \frac{a}{b - a}e^{-bt}$	$\frac{ab}{s(s + a)(s + b)}$
15 $\frac{e^{-at}}{(b - a)(c - a)} + \frac{e^{-bt}}{(c - a)(a - b)} + \frac{e^{-ct}}{(a - c)(b - c)}$	$\frac{1}{(s + a)(s + b)(s + c)}$
16 $\sin \omega t$, a sine wave	$\frac{\omega}{s^2 + \omega^2}$
17 $\cos \omega t$, a cosine wave	$\frac{s}{s^2 + \omega^2}$
18 $e^{-at} \sin \omega t$, a damped sine wave	$\frac{\omega}{(s + a)^2 + \omega^2}$
19 $e^{-at} \cos \omega t$, a damped cosine wave	$\frac{s + a}{(s + a)^2 + \omega^2}$
20 $1 - \cos \omega t$	$\frac{\omega^2}{s(s^2 + \omega^2)}$
21 $t \cos \omega t$	$\frac{s^2 - \omega^2}{(s^2 + \omega^2)^2}$

(Continued overleaf)

Time function $f(t)$	Laplace transform $F(s)$
22 $t \sin \omega t$	$\frac{2\omega s}{(s^2 + \omega^2)^2}$
23 $\sin(\omega t + \theta)$	$\frac{\omega \cos \theta + s \sin \theta}{s^2 + \omega^2}$
24 $\cos(\omega t + \theta)$	$\frac{s \cos \theta - \omega \sin \theta}{s^2 + \omega^2}$
25 $e^{-at} \sin(\omega t + \theta)$	$\frac{(s+a) \sin \theta + \omega \cos \theta}{(s+a)^2 + \omega^2}$
26 $e^{-at} \cos(\omega t + \theta)$	$\frac{(s+a) \cos \theta - \omega \sin \theta}{(s+a)^2 + \omega^2}$
27 $\frac{\omega}{\sqrt{1-\zeta^2}} e^{-\zeta\omega t} \sin \omega \sqrt{1-\zeta^2} t$	$\frac{\omega^2}{s^2 + 2\zeta\omega s + \omega^2}$
28 $1 - \frac{1}{\sqrt{1-\zeta^2}} e^{-\zeta\omega t} \sin(\omega \sqrt{1-\zeta^2} t + \phi), \cos \phi = \zeta$	$\frac{\omega^2}{s(s^2 + 2\zeta\omega s + \omega^2)}$

Note: $f(t) = 0$ for all negative values of t . The $u(t)$ terms have been omitted from most of the time functions and have to be assumed.

Linearity property

If two separate time functions, e.g. $f(t)$ and $g(t)$, have Laplace transforms then the transform of the sum of the time functions is the sum of the two separate Laplace transforms.

$$\mathcal{L}\{af(t) + bg(t)\} = a\mathcal{L}f(t) + b\mathcal{L}g(t)$$

a and b are constants.

Thus, for example, the Laplace transform of $1 + 2t + 4t^2$ is given by the sum of the transforms of the individual terms in the expression. Thus, using items 1, 5 and 6 in Table ApA.1,

$$F(s) = \frac{1}{s} + \frac{2}{s^2} + \frac{8}{s^3}$$

s -Domain shifting property

This property is used to determine the Laplace transform of functions that have an exponential factor and is sometimes referred to as the *first shifting property*. If $F(s) = \mathcal{L}\{f(t)\}$ then

$$\mathcal{L}\{e^{at}f(t)\} = F(s-a)$$

For example, the Laplace transform of $e^{at}t^n$ is, since the Laplace transform of t^n is given by item 6 in Table ApA.1 as $n!/s^{n+1}$, given by

$$\mathcal{L}\{e^{at}t^n\} = \frac{n!}{(s-a)^{n+1}}$$

Time domain shifting property

If a signal is delayed by a time T then its Laplace transform is multiplied by e^{-sT} . If $F(s)$ is the Laplace transform of $f(t)$ then

$$\mathcal{L}\{f(t-T)u(t-T)\} = e^{-sT}F(s)$$

This delaying of a signal by a time T is referred to as the *second shift theorem*.

The time domain shifting property can be applied to all Laplace transforms. Thus for an impulse $\delta(t)$ which is delayed by a time T to give the function $\delta(t-T)$, the Laplace transform of $\delta(t)$, namely 1, is multiplied by e^{-sT} to give $1e^{-sT}$ as the transform for the delayed function.

Periodic functions

For a function $f(t)$ which is a periodic function of period T , the Laplace transform of that function is

$$\mathcal{L}f(t) = \frac{1}{1 - e^{-sT}} F_1(s)$$

where $F_1(s)$ is the Laplace transform of the function for the first period.

Thus, for example, consider the Laplace transform of a sequence of periodic rectangular pulses of period T , as shown in Figure ApA 4. The Laplace transform of a single rectangular pulse is given by $(1/s)(1 - e^{-sT/2})$. Hence, using the above equation, then the Laplace transform is

$$\frac{1}{1 - e^{-sT}} \times \frac{1}{s}(1 - e^{-sT/2}) = \frac{1}{s(1 + e^{-sT/2})}$$

Initial- and final-value theorems

The initial-value theorem can be stated as: if a function of time $f(t)$ has a Laplace transform $F(s)$ then in the limit as the time tends to zero the value of the function is given by

$$\lim_{t \rightarrow 0} f(t) = \lim_{s \rightarrow \infty} sF(s)$$

The final-value theorem can be stated as: if a function of time $f(t)$ has a Laplace transform $F(s)$ then in the limit as the time tends to infinity the value of the function is given by

$$\lim_{t \rightarrow \infty} f(t) = \lim_{s \rightarrow 0} sF(s)$$

Derivatives

The Laplace transform of a derivative of a function $f(t)$ is given by

$$\mathcal{L}\left\{\frac{d}{dt}f(t)\right\} = sF(s) - f(0)$$

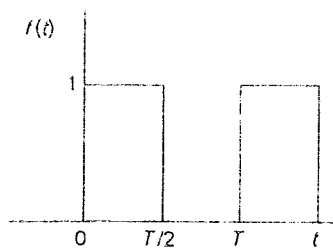


Fig. ApA.4 Rectangular pulses

where $f(0)$ is the value of the function when $t = 0$. For a second derivative

$$\mathcal{L}\left\{\frac{d^2}{dt^2}f(t)\right\} = s^2F(s) - sf(0) - \frac{d}{dt}f(0)$$

where $d f(0)/dt$ is the value of the first derivative at $t = 0$. Examples of the Laplace transforms of derivatives are given in Chapter 11.

Integrals

The Laplace transform of the integral of a function $f(t)$ which has a Laplace transform $F(s)$ is given by

$$\mathcal{L}\left\{\int_0^t f(t) dt\right\} = \frac{1}{s}F(s)$$

For example, the Laplace transform of the integral of the function e^{-t} between the limits 0 and t is given by

$$\mathcal{L}\left\{\int_0^t e^{-t} dt\right\} = \frac{1}{s} \mathcal{L}\{e^{-t}\} = \frac{1}{s(s+1)}$$

A.4 The inverse transform

The inverse Laplace transformation is the conversion of a Laplace transform $F(s)$ into a function of time $f(t)$. This operation can be written as

$$\mathcal{L}^{-1}\{F(s)\} = f(t)$$

The inverse operation can generally be carried out by using Table ApA.1. The linearity property of Laplace transforms means that if we have a transform as the sum of two separate terms then we can take the inverse of each separately and the sum of the two inverse transforms is the required inverse transform.

$$\mathcal{L}^{-1}\{aF(s) + bG(s)\} = a\mathcal{L}^{-1}F(s) + b\mathcal{L}^{-1}G(s)$$

Thus, to illustrate how rearrangement of a function can often put it into the standard form shown in the table, the inverse transform of $3/(2s + 1)$ can be obtained by rearranging it as

$$\frac{3(1/2)}{s + (1/2)}$$

The table (item 7) contains the transform $1/(s + a)$ with the inverse of e^{-at} . Thus the inverse transformation is just this multiplied by the constant $(3/2)$ with $a = (1/2)$, i.e. $(3/2)e^{-t/2}$.

As another example, consider the inverse Laplace transform of $(2s + 2)/(s^2 + 1)$. This expression can be rearranged as

$$2\left[\frac{s}{s^2+1} + \frac{1}{s^2+1}\right]$$

The first term in the brackets has the inverse transform of $\cos t$ (item 17 in Table ApA.1) and the second term $\sin t$ (item 16 in Table ApA.1). Thus the inverse transform of the expression is

$$2 \cos t + 2 \sin t$$

A.4.1 Partial fractions

Often $F(s)$ is a ratio of two polynomials and cannot be readily identified with a standard transform in Table ApA.1. It has to be converted into simple fraction terms before the standard transforms can be used. The process of converting an expression into simple fraction terms is called decomposing into *partial fractions*. This technique can be used provided the degree of the numerator is less than the degree of the denominator. The degree of a polynomial is the highest power of s in the expression. When the degree of the numerator is equal to or higher than that of the denominator, the denominator must be divided into the numerator until the result is the sum of terms with the remainder fractional term having a numerator of lower degree than the denominator.

We can consider there to be basically three types of partial fractions:

- 1 The denominator contains factors which are only of the form $(s+a)$, $(s+b)$, $(s+c)$, etc. The expression is of the form

$$\frac{f(s)}{(s+a)(s+b)(s+c)}$$

and has the partial fractions of

$$\frac{A}{(s+a)} + \frac{B}{(s+b)} + \frac{C}{(s+c)}$$

- 2 There are repeated $(s+a)$ factors in the denominator, i.e. the denominator contains powers of such a factor, and the expression is of the form

$$\frac{f(s)}{(s+a)^n}$$

This then has partial fractions of

$$\frac{A}{(s+a)^1} + \frac{B}{(s+a)^2} + \frac{C}{(s+a)^3} + \cdots + \frac{N}{(s+a)^n}$$

- 3 The denominator contains quadratic factors and the quadratic does not factorise without imaginary terms. For an expression of the form

$$\frac{f(s)}{(as^2 + bs + c)(s + d)}$$

the partial fractions are

$$\frac{As + B}{as^2 + bs + c} + \frac{C}{s + d}$$

The values of the constants A , B , C , etc. can be found by either making use of the fact that the equality between the expression and the partial fractions must be true for all values of s or that the coefficients of s^n in the expression must equal those of s^n in the partial fraction expansion. The use of the first method is illustrated by the following example where the partial fractions of

$$\frac{3s + 4}{(s + 1)(s + 2)} \text{ are } \frac{A}{s + 1} + \frac{B}{s + 2}$$

Then, for the expressions to be equal, we must have

$$\frac{3s + 4}{(s + 1)(s + 2)} = \frac{A(s + 2) + B(s + 1)}{(s + 1)(s + 2)}$$

and consequently

$$3s + 4 = A(s + 2) + B(s + 1)$$

This must be true for all values of s . The procedure is then to pick values of s that will enable some of the terms involving constants to become zero and so enable other constants to be determined. Thus if we let $s = -2$ then we have

$$3(-2) + 4 = A(-2 + 2) + B(-2 + 1)$$

and so $B = 2$. If we now let $s = -1$ then

$$3(-1) + 4 = A(-1 + 2) + B(-1 + 1)$$

and so $A = 1$. Thus


$$\frac{3s + 4}{(s + 1)(s + 2)} = \frac{1}{s + 1} + \frac{2}{s + 2}$$

Appendix B

Logic gates


The following are the truth tables and symbols used for logic gates. Different sets of standard circuit symbols have been used with the main form having originated in the United States; an international standard form (IEEE/ANSI) has, however, now been developed which removes the distinctive shape used for a symbol and uses a rectangle with the logic function written inside it. Both formats are given here.

AND gate




Input		
A	B	Output
0	0	0
0	1	0
1	0	0
1	1	1

OR gate

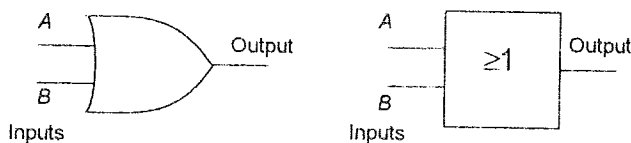

Input		
A	B	Output
0	0	0
0	1	1
1	0	1
1	1	1


NOT gate

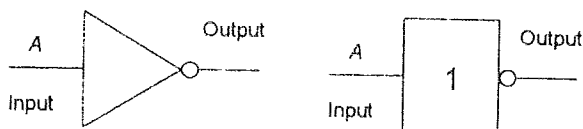

Input A	Output
0	1
1	0

NAND gate


This can be considered as an AND gate followed by a NOT gate.

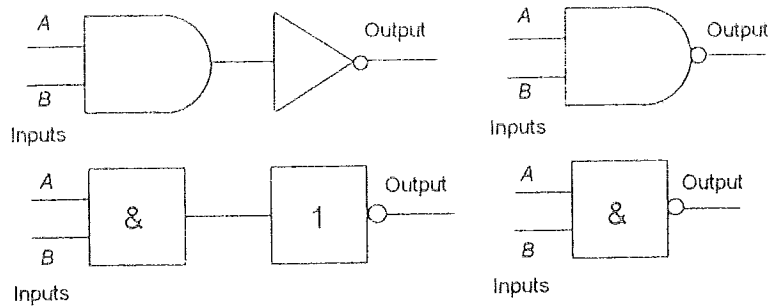

Inputs		
A	B	Output
0	0	1
0	1	1
1	0	1
1	1	0

NOR gate


This can be considered as an OR gate followed by a NOT gate.

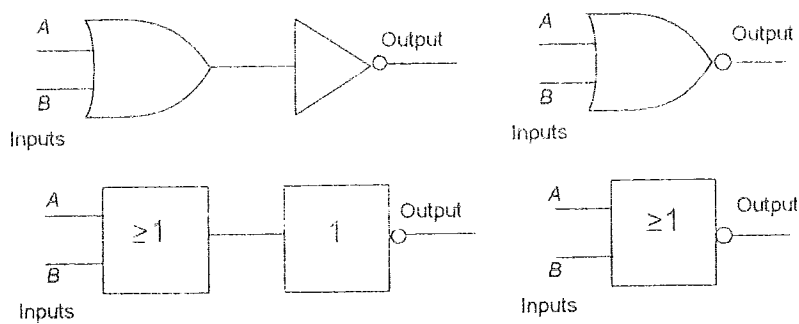

Inputs		
A	B	Output
0	0	1
0	1	0
1	0	0
1	1	0

EXCLUSIVE-OR (XOR) gate

This can be considered as an OR gate with a NOT gate applied to one of its inputs; alternatively it can be considered as an AND gate with a NOT gate applied to one of its inputs.

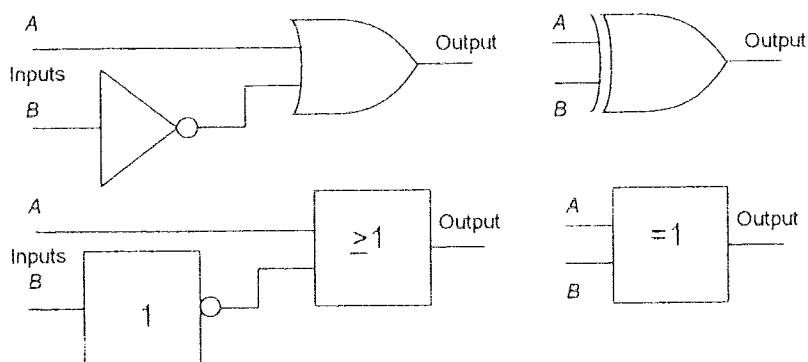

Inputs		
A	B	Output
0	0	0
0	1	1
1	0	1
1	1	0